


Keystone Heights

Elementary School

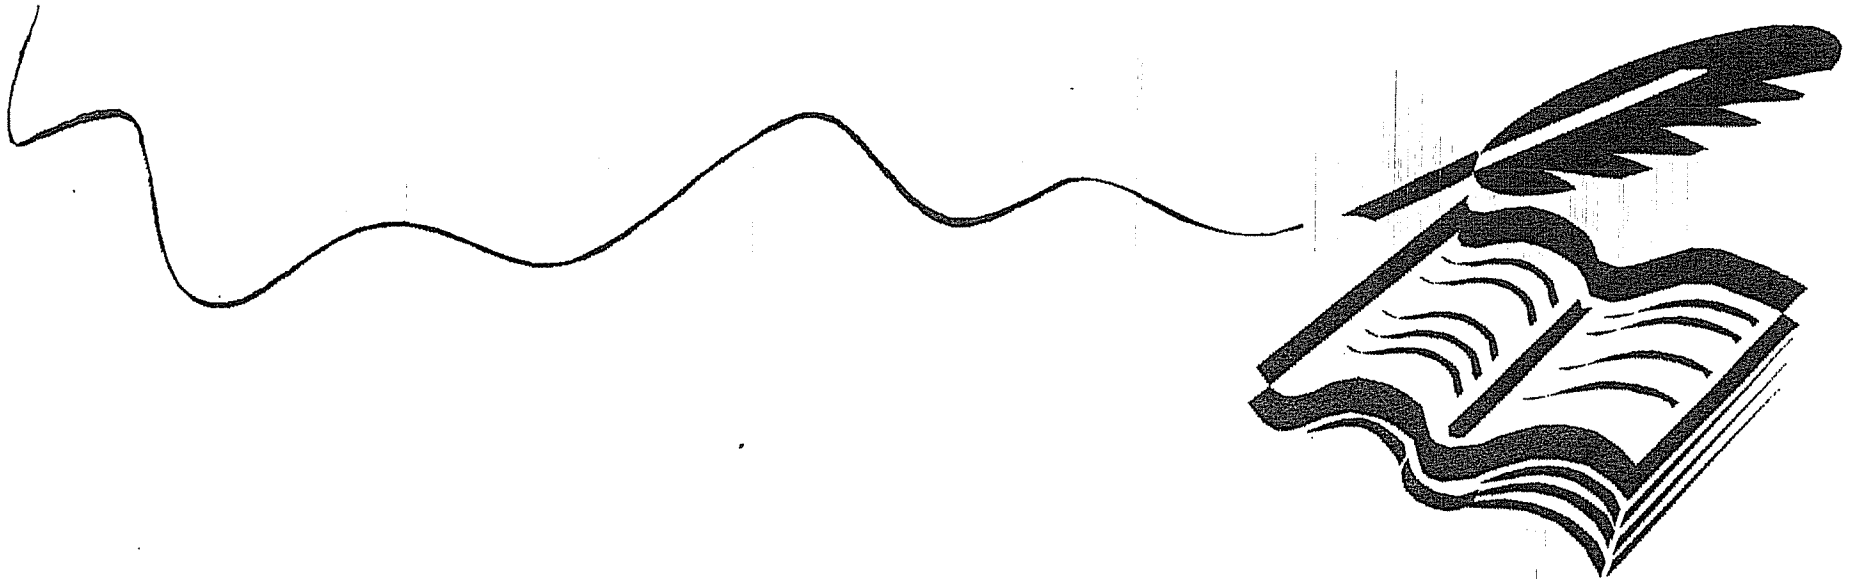

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008

[Signature]
INSPECTOR'S SIGNATURE

1-9-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	218	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	1	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
5	3	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
6	5	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
8	8	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
7	10	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
9	918	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
12	1214	LOCKER BLOCKING EXIT		X						FBC 423.20.1

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008


[Handwritten Signature]
INSPECTOR'S SIGNATURE

1-9-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	704	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	751	A&B EMERGENCY LIGHT OUT IN BATHROOMS - BOTH		X						FBC 423.17.1

Lake Arbony

Elementary School

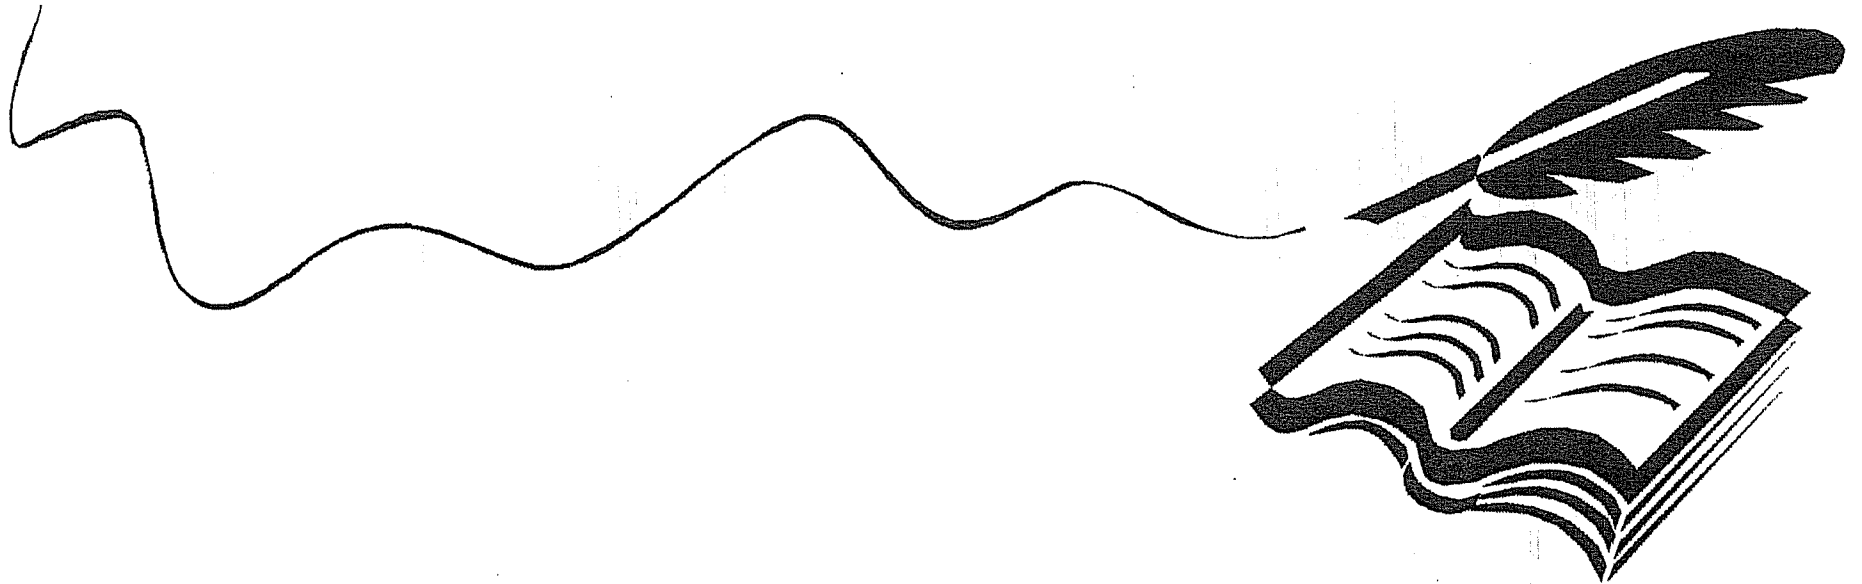

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Bob Sweatt
INSPECTOR'S SIGNATURE

Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	9	OK								
92	10	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								
92	15	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	16	OK								
92	18	OK								
92	20	OK								
92	39	OK								
92	40	OK								
92	41	OK								
92	42	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Ed Swettano
INSPECTOR'S SIGNATURE

Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	OK								
92	44	OK								
92	45	OK								
92	46	OK								
92	47	OK								
92	48	OK								
92	49	OK								
92	50	OK								
92	51	OK								
92	69	OK								
92	70	OK								
92	71	OK								
92	72	OK								
92	73	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Ted Sweetone
INSPECTOR'S SIGNATURE

Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	74	OK								
92	75	OK								
92	76	OK								
92	77	OK								
92	78	OK								
92	79	OK								
92	80	OK								
92	81	OK								
92	82	OK								
92	84	OK								
92	86	OK								
92	88	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Ed Sweetland
INSPECTOR'S SIGNATURE DATE Jan 8, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	89	OK								
92	90	OK								
92	91	OK								
92	93	OK								
92	94	OK								
92	95	OK								
92	96	OK								
92	97	OK								
92	98	OK								
92	99	OK								
92	100	OK								
92	101	OK								
92	102	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: JANUARY 8, 2008

Ted Swattans
INSPECTOR'S SIGNATURE Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	103	OK								
92	104	OK								

Lakeside

Elementary School

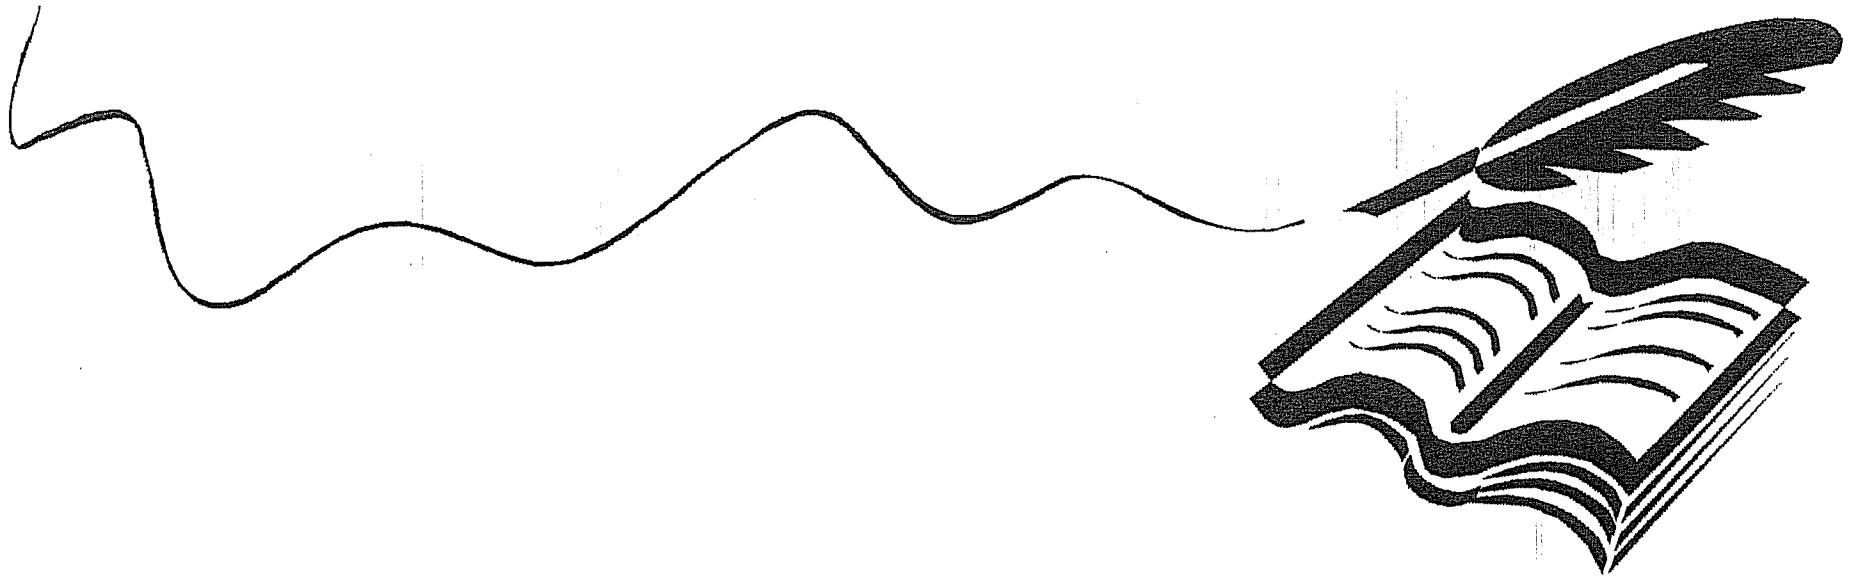

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Handwritten Signature]
INSPECTOR'S SIGNATURE

1-10-08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2		OK								
6		OK								
7		OK								
8		OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE

1-10-08
DATE

FIRE DRILL LOG: ✓ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								
92	15	OK								
92	17	OK								
92	18	OK								
92	19	OK								
92	20	OK								
92	21	OK								
92	23	OK								
92	24	OK								
92	25	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Handwritten Signature]
INSPECTOR'S SIGNATURE

1-10-08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	42	OK								
92	43	OK								
92	45	OK								
92	51	OK								
92	52	OK								
92	53	OK								
92	54	OK								
92	55	OK								
92	56	OK								
92	58	OK								
92	59	OK								
92	60	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

Paul H.
INSPECTOR'S SIGNATURE DATE 1-10-08


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	61	OK								
92	62	OK								
92	63	OK								

McRae

Elementary School

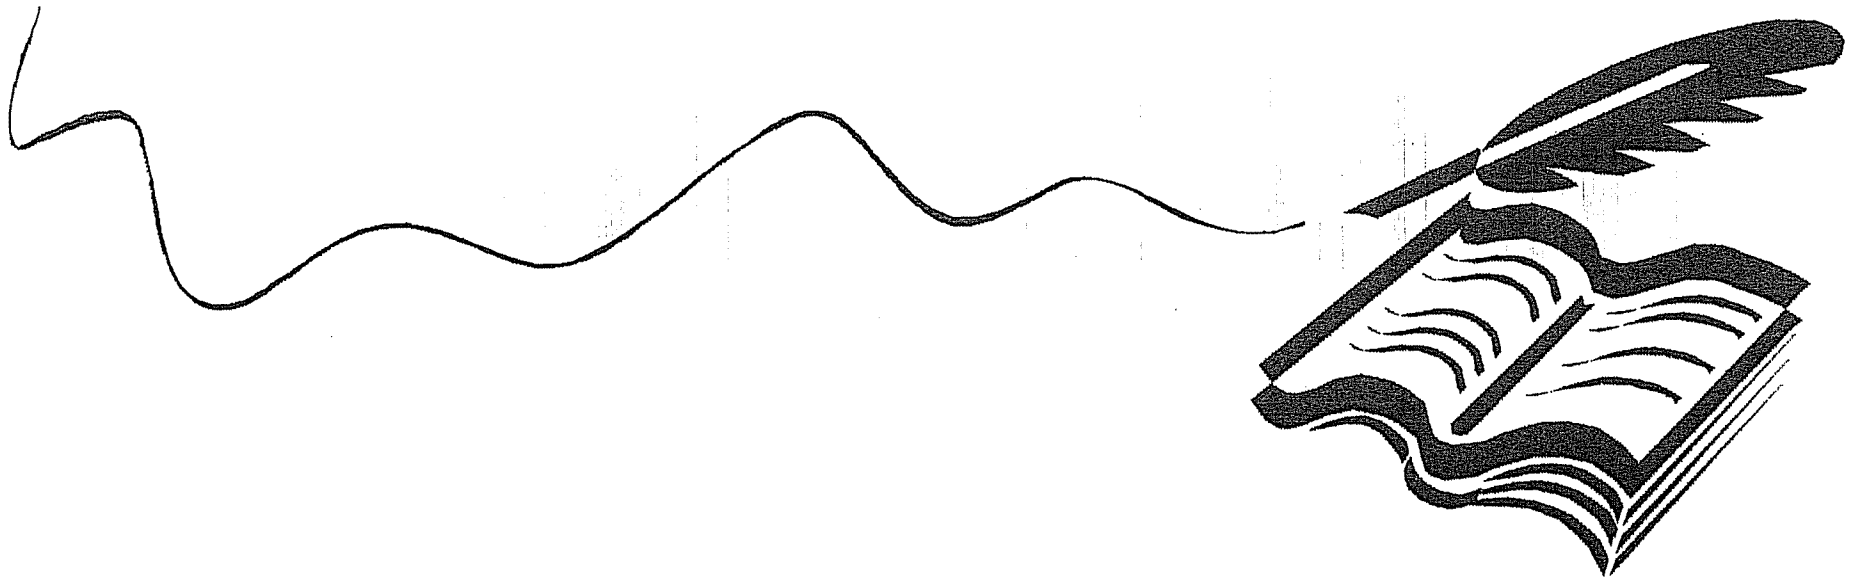

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 18, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE 1-18-08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2	221	EXIT LIGHT OUT								FBC 1006.3.1
3	311	EXIT LIGHT OUT								FBC 1006.3.1
3	314	EXIT LIGHT OUT								FBC 1006.3.1
3	323	COMPUTER WIRE DRAPED ACROSS DOOR								NFPA 70 110.12
3	320	COMPUTER WIRE DRAPED ACROSS DOOR								NFPA 70 110.12
5	530	EMERGENCY LIGHT OUT	X							FBC 423.17.1
6	OK									

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 18, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE 1-18-08
DATE

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	401	OK								
92	402	OK								
92	403	OK								
92	404	OK								
92	405	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	406	OK								
92	407	OK								
92	408	OK								
92	701	OK								
92	702	OK								
92	703	OK								
92	704	OK								
92	705	OK								
92	706	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 18, 2008


[Signature]
INSPECTOR'S SIGNATURE

1-18-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	707	OK								
92	708	OK								
92	801	OK								
92	803	OK								
92	804	OK								
92	821	OK								
92	823	OK								
92	824	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	825	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	826	OK								
92	827	OK								
92	828	OK								

Middletown

Elementary School

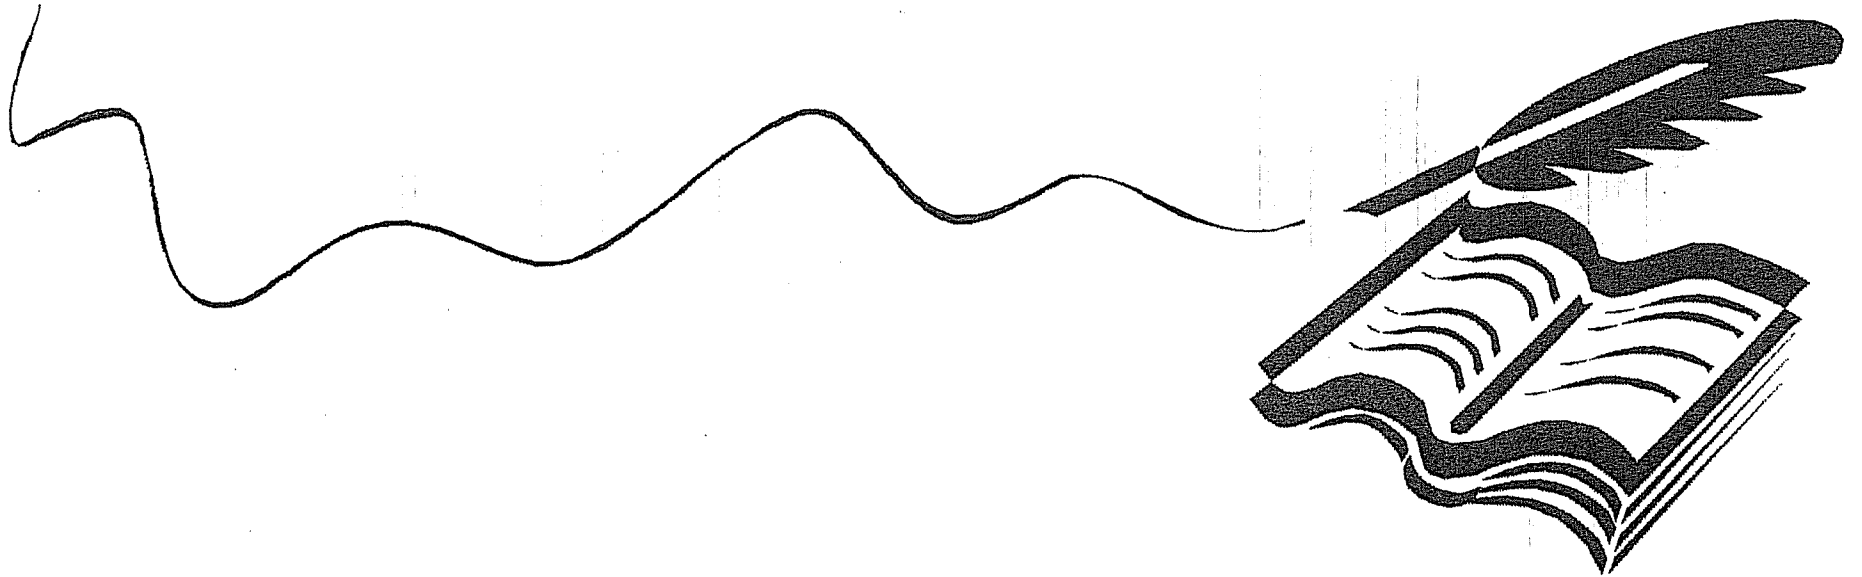

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

Larry H. [Signature]
INSPECTOR'S SIGNATURE

1.17.08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	2	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	1	EMERGENCY LIGHT OUT	X							FBC 423.17.1
2	1	EMERGENCY LIGHT OUT	X							FBC 423.17.1
3		OK								
4		OK								
7	58	EMERGENCY LIGHT OUT	X							FBC 423.17.1
7	38	NO EVACUATION SHEET		X						FBC 423.14.2.4
9		OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

Larry H. ...
INSPECTOR'S SIGNATURE DATE 1.17.08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	24	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	25	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	26	OK								
92	29	OK								
92	35	OK								
92	36	OK								
92	37	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	38	OK								
92	39	OK								
92	40	OK								
92	41	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	42	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

[Handwritten Signature]
INSPECTOR'S SIGNATURE

1.17.08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	57	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	64	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	65	OK								
92	66	OK								
92	67	OK								
92	68	OK								