


Grove Park

Elementary School



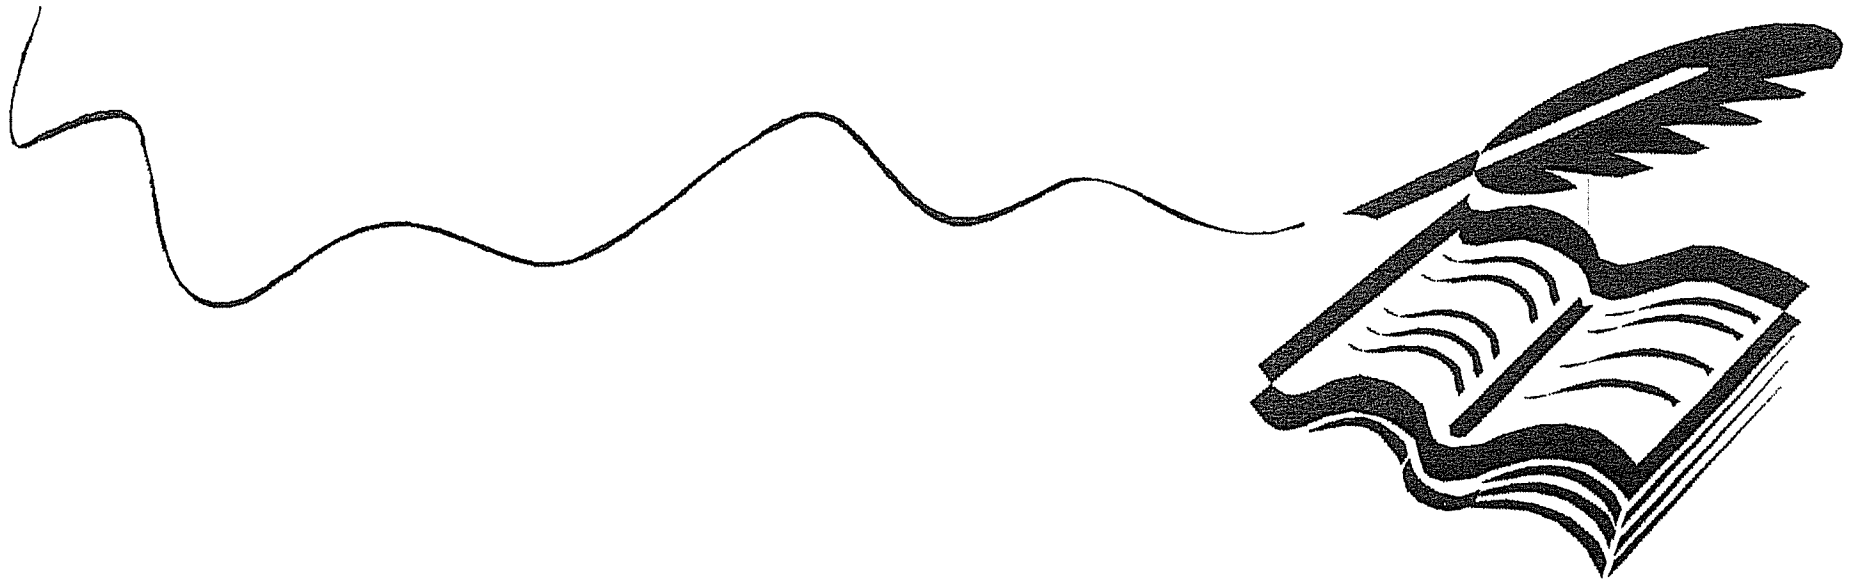

FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

Tod Smedley
INSPECTOR'S SIGNATURE

Feb 6, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	110	OCCUPANCY LOAD SIGN MISSING – MAX OCC 80		X						FBC 423.14.2.2
7	701	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
8	11A	ELECTRICAL WIRE ABANDONED – REMOVE	X							NFPA 70
9	1	EVACUATION SHEET MISSING		X						FBC 423.14.2.4



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

Tom Sweatt

 INSPECTOR'S SIGNATURE

Feb 6, 2008

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	5	OK								
92	6	OK								
92	7	OK								
92	8	OK								
92	9	OK								
92	10	OK								
92	27	OK								
92	28	OK								
92	29	OK								
92	30	OK								
92	31	OK								
92	37	OK								
92	38	LENSE COVER MISSING		X						NFPA 70
92	43	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

Tom Sweatt


 INSPECTOR'S SIGNATURE

Feb 6, 2008

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	OK								
92	71	OK								
92	500	OK								
92	501	OK								
92	503	OK								
92	504	OK								
92	505	OK								
92	520A/B	OK								
92	521A/B	OK								
92	522	OK								
92	523	OK								
92	524	OK								
92	525	OK								
92	526	OK								

Keystone Heights
Elementary School

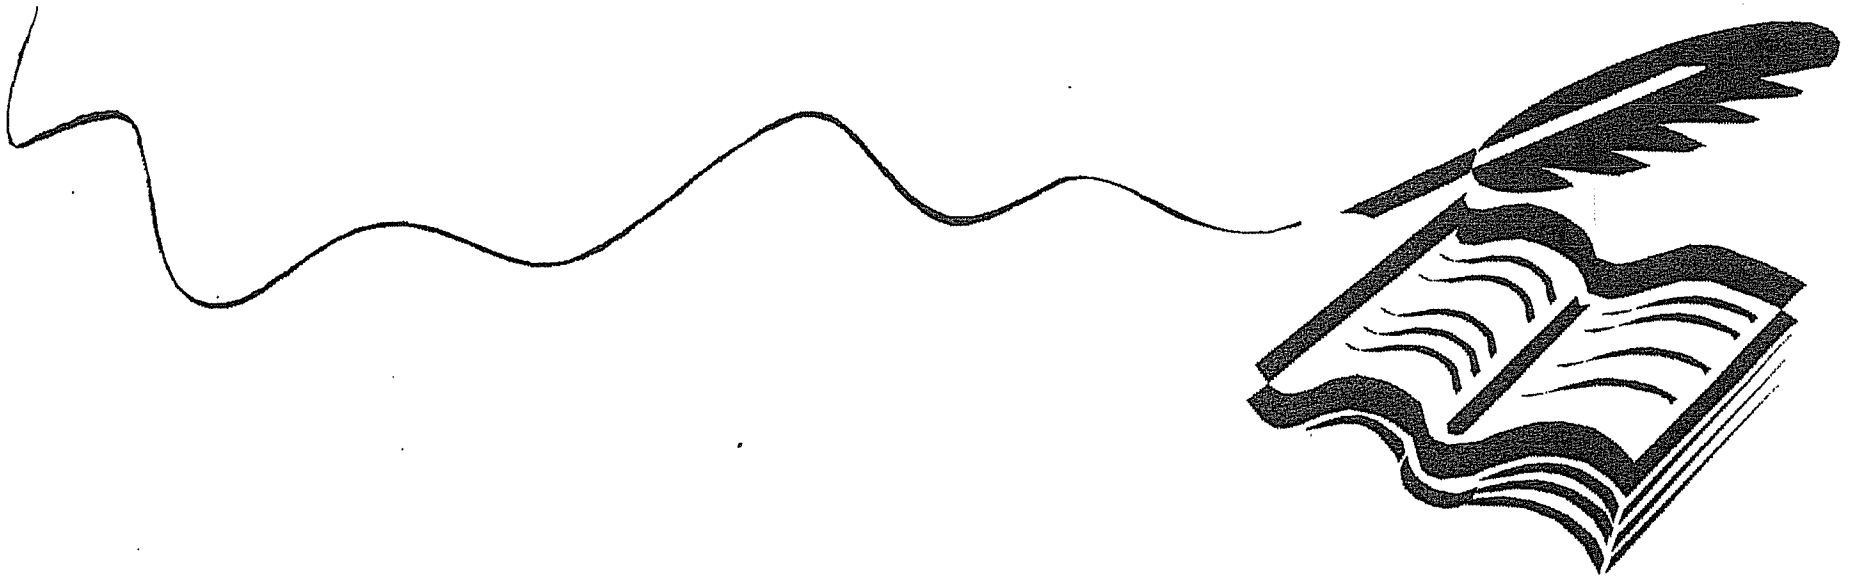



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008

[Handwritten Signature]
INSPECTOR'S SIGNATURE DATE 1-9-08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	218	EMERGENCY LIGHT OUT		X						FBC 42317.1
3	1	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
5	3	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
6	5	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
8	8	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
7	10	EMERGENCY EVACUATION SHEET NOT BY DOOR		X						FBC 423.14.2.4
9	918	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
12	1211	FIRE ALARM PANEL NOT UP TO DATE	X							
12	1214	LOCKER BLOCKING EXIT		X						FBC 423.20.1



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008

Samuel A. Brown
INSPECTOR'S SIGNATURE

1-9-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	OK								
92	702	OK								
92	703	OK								
92	704	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	705	OK								
92	706	OK								
92	707	OK								
92	708	OK								
92	709	OK								
92	710	OK								
92	713	DOOR DRAGS – BUILDING FOUNDATION SETTLING	X							
92	714	OK								
92	715	OK								
92	716 A&B	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008

Randy H. Rose
 INSPECTOR'S SIGNATURE 1-9-08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	717	OK								
92	718	OK								
92	719	OK								
92	720	OK								
92	721	OK								
92	722 A&B	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	724	OK								
92	770	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	771	OK								
92	772	OK								
92	773	OK								
92	750	OK								
92	751 A&B	EMERGENCY LIGHT OUT IN BATHROOMS - BOTH		X						FBC 423.17.1



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2008


Samuel A. Bur
INSPECTOR'S SIGNATURE

1-9-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	760	EXTENSSION CORD RAN OVERHEAD – ATTACHED TO CEILING – NEEDS OUTLET INSTALLED	X							NFPA 70 -110

Lake Arbony

Elementary School

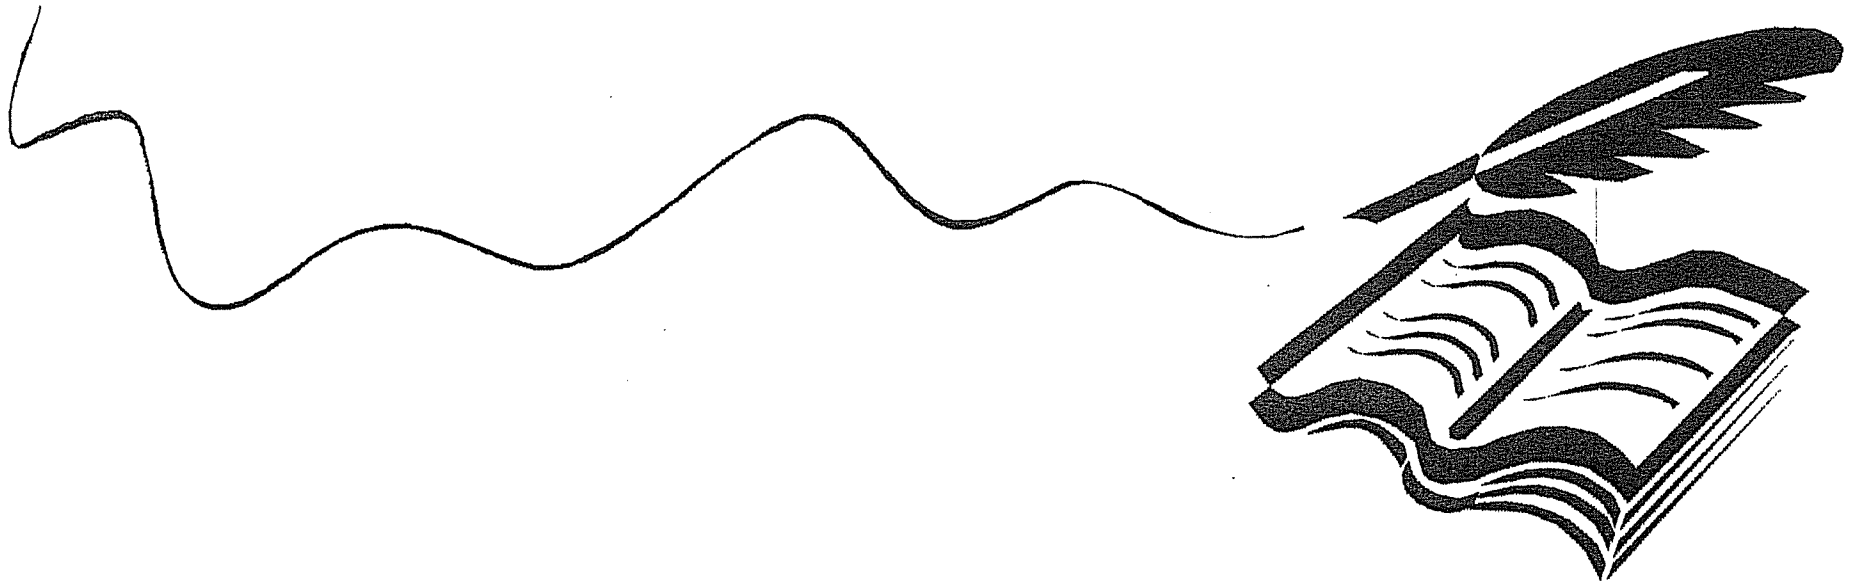



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Tom Sweatt
INSPECTOR'S SIGNATURE

Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2		OK								
5		OK								
6		OK								
7		OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Ted Sweetland
INSPECTOR'S SIGNATURE Jan 8, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	9	OK								
92	10	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	11	OK								
92	12	OK								
92	13	OK								
92	14	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	15	OK								
92	16	OK								
92	18	OK								
92	19	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	20	OK								
92	21	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	39	OK								
92	40	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Tom Sweetland
 INSPECTOR'S SIGNATURE Jan 8, 2008
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	41	OK								
92	42	OK								
92	43	OK								
92	44	COVERS MISSING ON LIGHTS	X							NFPA 708.401.3
92	45	OK								
92	46	OK								
92	47	OK								
92	48	OK								
92	59	OK								
92	50	OK								
92	51	OK								
92	69	OK								
92	70	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	71	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008

Ted Sweetman
 INSPECTOR'S SIGNATURE Jan 8, 2008
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	72	OK								
92	73	OK								
92	74	OK								
92	75	OK								
92	76	OK								
92	77	OK								
92	78	OK								
92	79	OK								
92	80	OK								
92	81	OK								
92	82	OK								
92	84	OK								
92	85	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	86	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 8, 2008


Ted Sweetan
 INSPECTOR'S SIGNATURE

Jan 8, 2008
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	93	OK								
92	94	OK								
92	95	OK								
92	96	OK								
92	97	OK								
92	98	OK								
92	99	OK								
92	100	OK								
92	101	TRIP HAZARD @ RAMP	X							
92	102	OK								
92	103	OK								
92	104	OK								

Lakeside

Elementary School

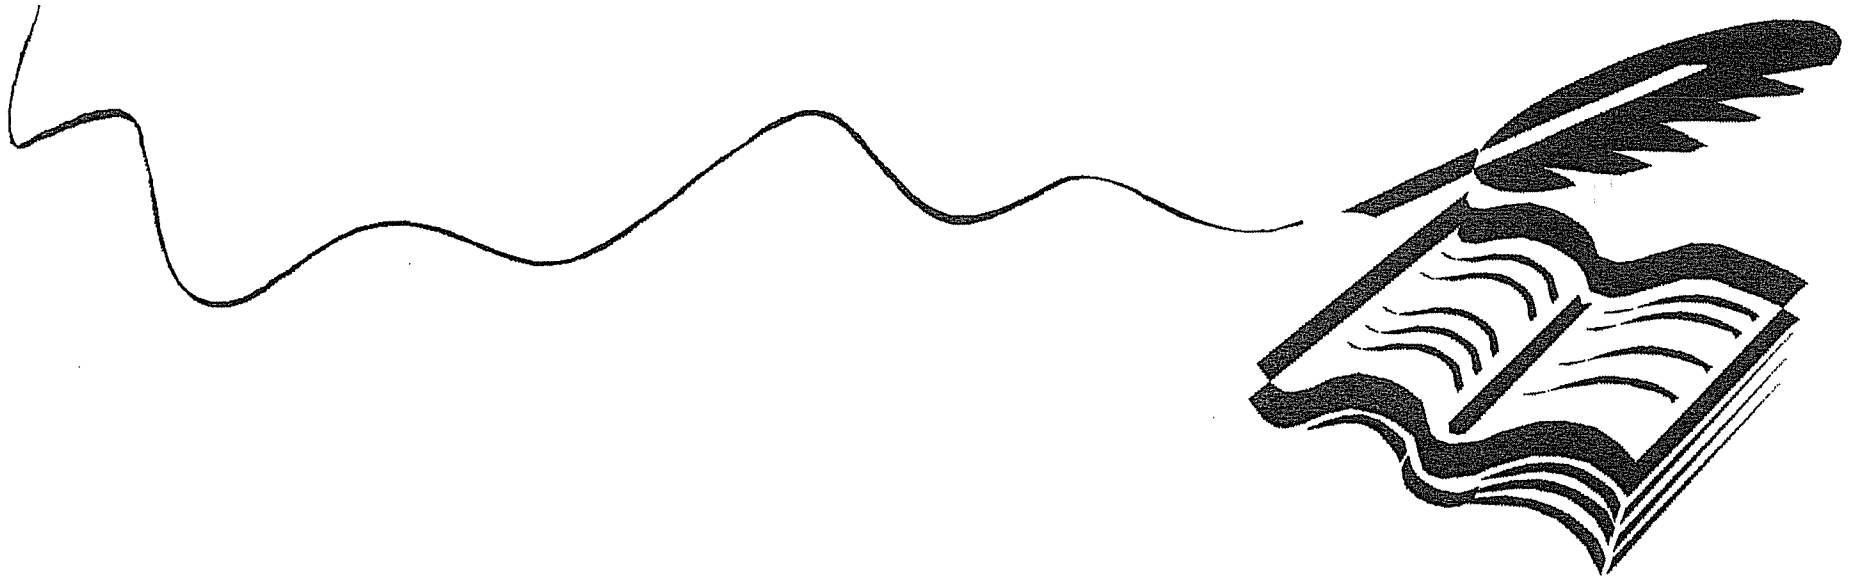



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

[Handwritten Signature]
 INSPECTOR'S SIGNATURE

1-10-08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								
92	15	OK								
92	16	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	17	OK								
92	18	OK								
92	19	OK								
92	20	OK								
92	21	OK								
92	22	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	23	OK								



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008

Larry H. [Signature]
INSPECTOR'S SIGNATURE 1-10-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	24	OK								
92	25	OK								
92	26	OK								
92	27	OK								
92	42	OK								
92	43	OK								
92	44	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	45	OK								
92	46	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	47	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	51	OK								
92	52	OK								
92	53	OK								
92	54	OK								



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
2752 MOODY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 10, 2008


[Signature]
INSPECTOR'S SIGNATURE

1-10-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	55	OK								
92	56	OK								
92	58	OK								
92	59	OK								
92	60	OK								
92	61	OK								
92	62	OK								
92	63	OK								

McRae

Elementary School

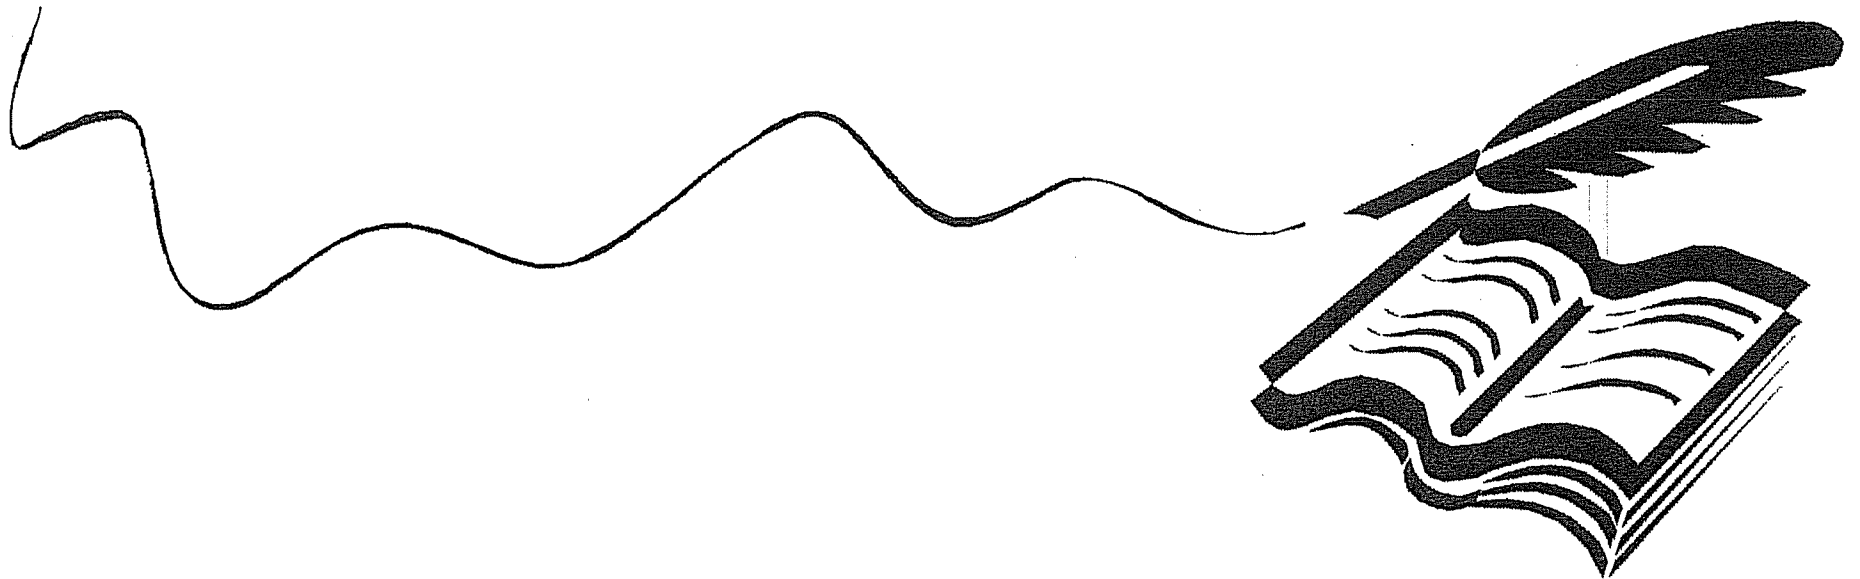



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 18, 2008

Russell F. Swann
INSPECTOR'S SIGNATURE

1-18-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2	221	EXIT LIGHT OUT	X							FBC 1016.3
3	311	EXIT LIGHT OUT	X							FBC 1016.3
3	314	EXIT LIGHT OUT	X							FBC 1016.3
3	323	COMPUTER WIRE DRAPED ACROSS DOOR				X				NFPA 70 110.12
3	320	COMPUTER WIRE DRAPED ACROSS DOOR				X				NFPA 70 110.12
5	530	EMERGENCY LIGHT OUT	X							FBC 423.17.1
6		OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 18, 2008


Larry P. Swann
INSPECTOR'S SIGNATURE

1-18-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	401	OK								
92	402	OK								
92	403	OK								
92	404	OK								
92	405	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	406	OK								
92	407	OK								
92	408	OK								
92	701	OK								
92	702	OK								
92	703	OK								
92	704	OK								
92	705	OK								
92	706	OK								

Middletown

Elementary School

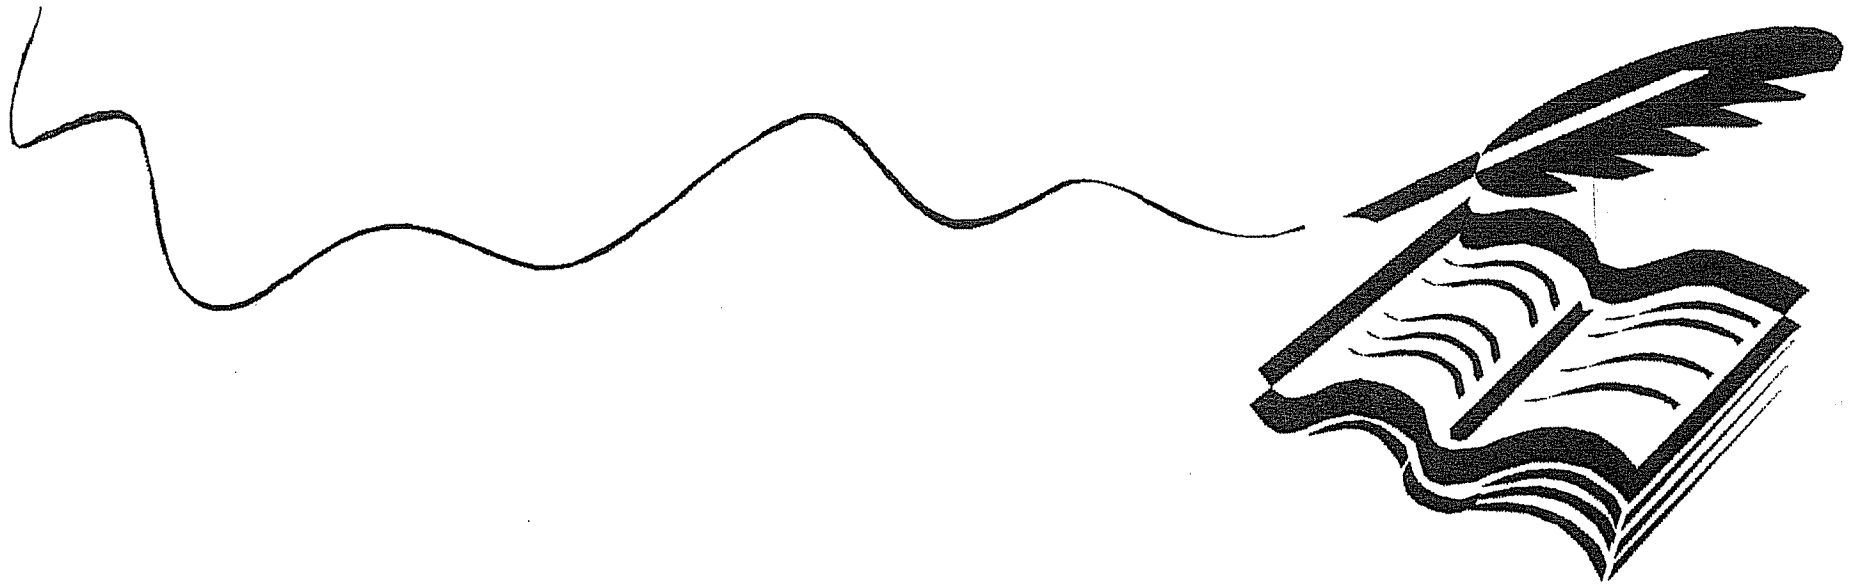



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

Larry St. John
 INSPECTOR'S SIGNATURE

1-17-08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	5	NO EVACUATION SHEET		X						FBC 423.14.2.4
1	10	EMERGENCY LIGHT OUT	X							FBC 423.17.1
2	1	EMERGENCY LIGHT OUT	X							FBC 423.17.1
3	1	OK								
4	1	OK								
7	58	EMERGENCY LIGHT OUT	X							FBC 423.17.1
7	38	NO EVACUATION SHEET		X						FBC 423.14.2.4
9		OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

[Handwritten Signature]
 INSPECTOR'S SIGNATURE

1.17.08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	23	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	24	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	25	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	26	OK								
92	29	OK								
92	35	OK								
92	36	OK								
92	37	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	38	OK								
92	39	OK								
92	40	OK								
92	41	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	42	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
3958 MAIN STREET
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 17, 2008

[Signature]
 INSPECTOR'S SIGNATURE

1-17-08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	57	OK								
92	64	OK								
92	65	OK								
92	66	OK								
92	67	OK								
92	68	OK								
92	69	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8