


Orange Park

High School



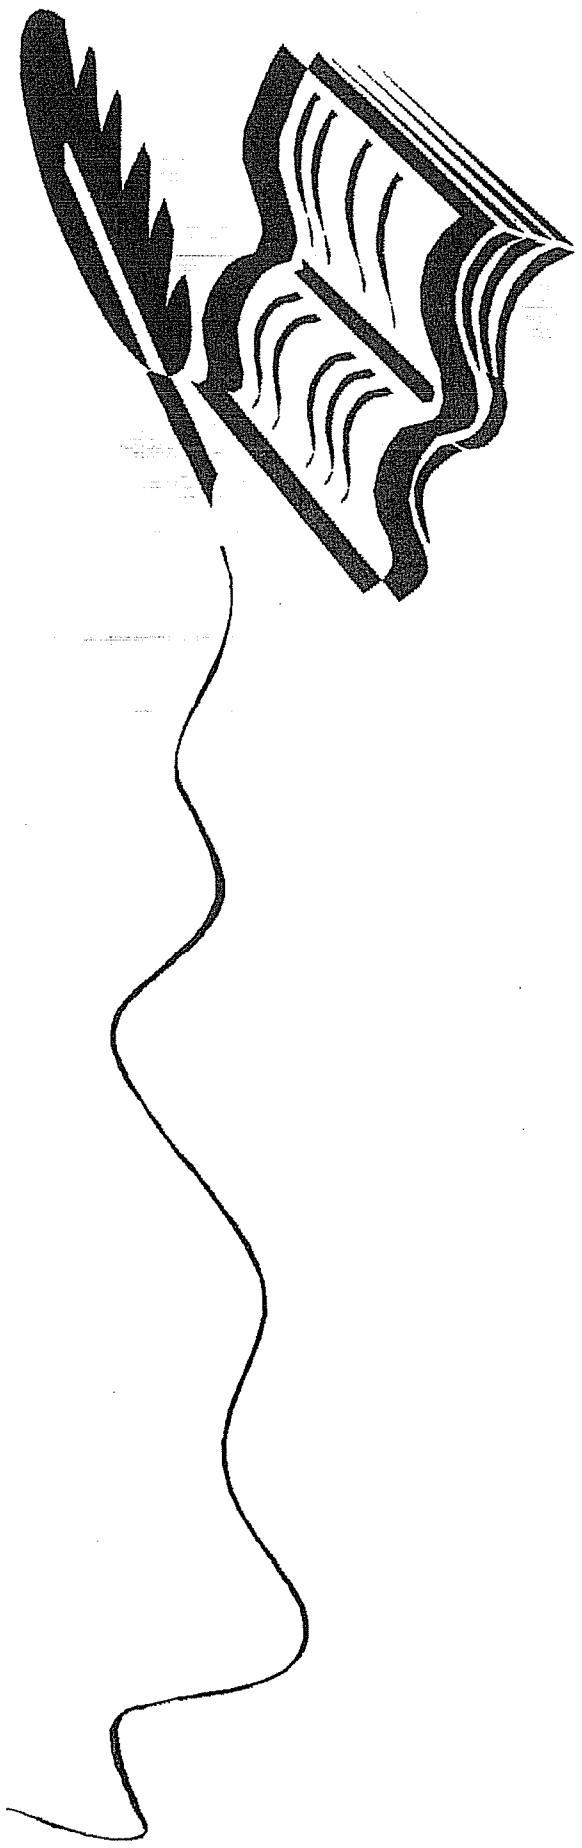

FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

[Signature]
 INSPECTOR'S SIGNATURE

10/23/07
 DATE

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	123 OUTLET COVER MISSING		X						NFPA 70 410.1.2
1	123 NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	156 NO URNIAL DIVIDERS		X						
1	156 NO EMERGENCY LIGHT		X						FBC 423.17.1
1	125 FIRE EXTINGUISHER NOT SIGNED		X						69A-58
1	164 STORAGE UNDER STAIRS		X						NFPA 1
1	165 COVER PLATE MISSING ON WALL ACROSS FROM BATHROOM CORRIDOR		X						NFPA 70
1	166 FIRE ALARM CONDUIT (BOX) OPEN	X							NFPA 70 110.26
1	102 OUTLET COVER BROKEN		X						NFPA 70 410.1.2
1	204 COMPUTER PROJECTOR HUNG FROM CEILING WITH "C" CLAMP				X				NFPA 101-14
1	207 CEILING TILE MISSING		X						FBC 804.2.3
1	252 EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	209 EXTENSION CORD RUNS INTO CEILING - REMOVE		X						NFPA 70
1	211 ROOF DRAIN LEAK	X							



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

[Signature]
INSPECTOR'S SIGNATURE

DATE
10/23/07

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	212 EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.3
1	214 COMPUTER PROJECTOR HUNG FROM CEILING TOO LOW 82" MIN - C-CLAMP TO STRUCTURE.				X				NFPA 101-14
1	216 ROOF LEAKS	X							
1	216 SWITCH COVER MISSING		X						NFPA 70 410.2
1	219 EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	220 EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	223B ELECTRICAL PANEL HAS NO COVER	X							NFPA 70-110
1	224C CEILING TILE HANGING DOWN		X						FBC 804.2.3
1	232A EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	233 ROOF LEAK	X							
2	3 BOX FOR INFO SERVICES ALL OPEN				X				NFPA 70
4	1 OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2
4	1 EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	21A ROOF LEAK BY EXHAUST FAN	X							



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10/23/07

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	21A EXIT BLOCKED - STAIRWELL TO NORTH WITH TUMBLING RODS		X						FBC 1001.3
10	100 OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
10	103 EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	111 EMERGENCY LIGHT OUT		X						FBC 423.17.1
12	112A&B ROOF LEAK	X							
12	116 ROOF LEAK	X							
12	118 STORAGE TO HIGH		X						NFPA 1.12.1
12	121 ROOF LEAK	X							
17	3C FIRE EXTINGUISHER NOT SIGNED		X						69A-58
17	3B DOOR STICKS TO FLOOR, HARD TO OPEN		X						FBC 1003
18	6 NO EMERGENCY LIGHT		X						FBC 423.17.1
19	6 CEILING TILES REMOVED		X						FBC 804.2.3
20	3 COMPUTER WIRES ACROSS FLOOR BY EXIT DOOR				X				FBC 1001
20	18A DESK AND COPIER IN EXIT CORRIDOR - REMOVE		X						FBC 1004



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10/23/07

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
27	1 WIRES HANGING FROM LIGHT	X							NFPA 70 110.12
27	2 EXIT LIGHT NOT WORKING		X						FBC 1016.3
27	3 HEAT/SMOKE DETECTOR HANGING FROM CEILING	X							NFPA 70
27	3 EXIT LIGHT OUT		X						FBC 1016.3
27	3 EXTENSION CORD UP THROUGH CEILING		X						NFPA 70
27	3 CEILING TILES MISSING		X						FBC 804.2.3
27	1 FLO-LIGHTS NO COVERS		X						NFPA 70
27	1 HOLES EXTERIOR DOOR AND UNDER DOORS		X						
51	12 EMERGENCY LIGHT OUT		X						FBC 423.17.1
51	12C SWITCH COVER MISSING		X						NFPA 70.410
51	8 EMERGENCY LIGHT OUT		X						FBC 423.17.1
51	17 EMERGENCY LIGHT OUT - BROKEN		X						FBC 423.17.1
51	19 EMERGENCY LIGHT OUT		X						FBC 423.17.1
51	2 EMERGENCY LIGHT OUT		X						FBC 423.17.1



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

DATE: 10/23/07

[Signature]
 INSPECTOR'S SIGNATURE

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
47	PROPANE TANK IN BUILDING - REMOVE		X						NFPA 1-21.3.3.5
12	PAPER STORED IN GENERATOR ROOM - REMOVE		X						NFPA 1
12	ROOF LEAK	X							
12	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
24	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
24	SWITCH COVER MISSING		X						NFPA 70 410
24	PAINT STORED IN BUILDING REMOVE		X						NFPA 1



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10/23/07

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	13 OK								
92	24 EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	25 OK								
92	26 OK								
92	27 OK								
92	28 OK								
92	29 OK								
92	30 NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	31 OK								
92	32 OK								
92	35 OK								
92	36 RAMP TO STEEP		X						FBC 11.4.8
92	37 OK								
92	38 OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10/23/07

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	39 DOOR STICKS		X						NFPA 70.14.5.2
92	40 OK								
92	41 RAMP TOO STEEP			X					FBC 11.4.8
92	42 RAMP TOO STEEP			X					FBC 11.4.8
92	43 OK								
92	44 OK								
92	45 EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	46 OK								
92	47 EMERGENCY EVACUATION SHEET MISSING		X						FBC 14.2.4
92	48 OK								
92	49 OK								
92	50 OK								
92	51 OK								
92	52 OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007

DATE 10/23/07

INSPECTOR'S SIGNATURE

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	53 HEAT DETECTOR BROKEN		X						NFPA 1.107
92	54 RAMP TO STEEP			X					FBC 11.4.8
92	55 NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	56 NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	56 RAMP EXCEEDS SLOPE			X					FBC 423.14.2.4
92	59 EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	60 OK								
92	61 OK								
92	62 OK								
92	63 OK								
92	64 OK								
92	65 OK								
92	66 TRIP HAZARD AT BASE OF RAMP			X					FBC 1006
92	67 OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 23, 2007


DATE: 10/23/07

INSPECTOR'S SIGNATURE

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	67 OK								
92	72 RAMP TOO STEEP			X					FBC 11.4.8
92	73 RAMP TOO STEEP			X					FBC 11.4.8
92	74 OK								

Ridgewood

High School

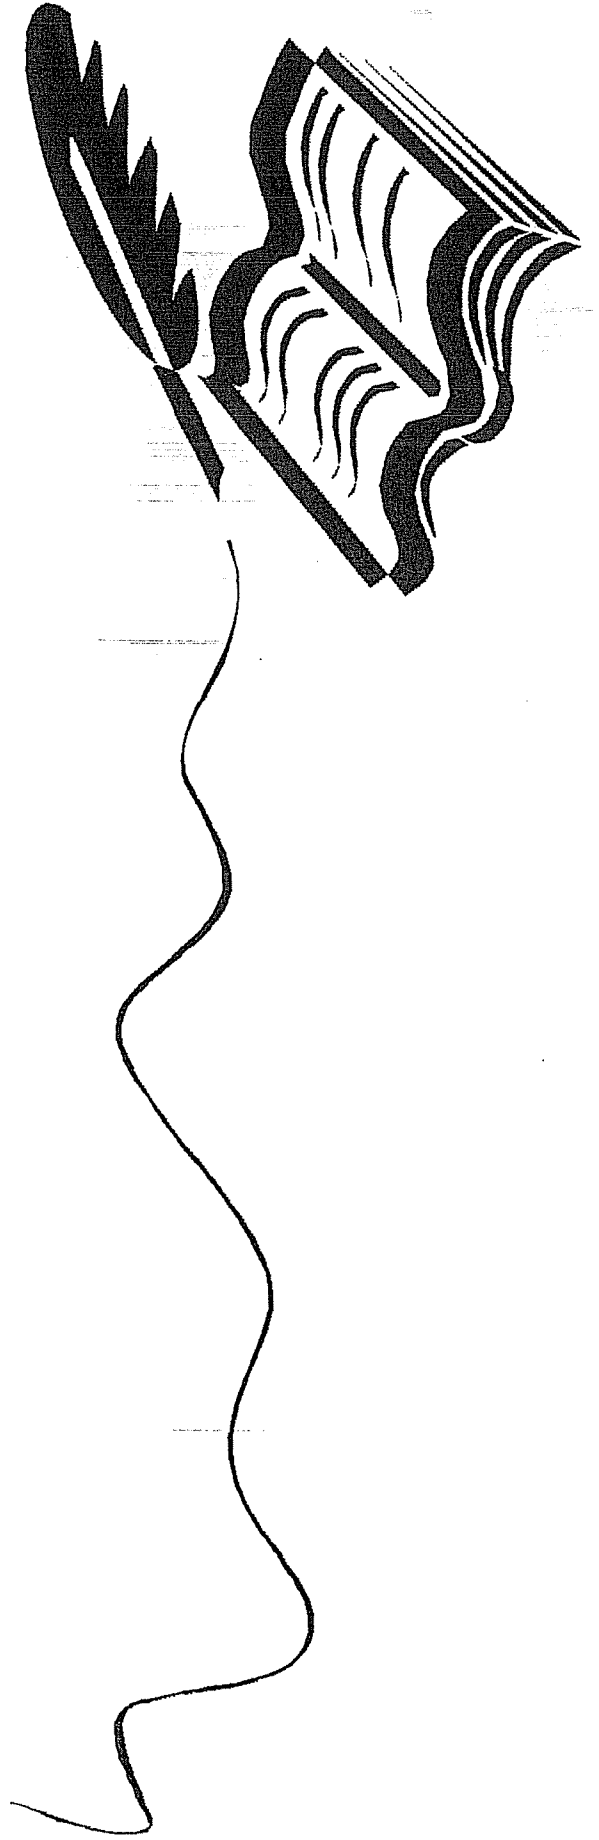



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

Darrell A. Burton
 INSPECTOR'S SIGNATURE DATE 10.25.07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		SEVERAL ROOF LEAKS ON NORTH & WEST SIDES	X							
1	137	HOLE THROUGH WALL TO EXTERIOR ROOM 137 MISSING		X						FBC 423.14.2.3
1	151	ROOM 157 BROKEN		X						FBC 423.14.2.3
2	214	STORAGE BLOCKING STAIR		X						FBC 1001.3
2	215	CONTROLLER FOR AC LOOSE								
3	302	NO EVACUATION SHEET		X						FBC 423.14.2.4
3	315	CEILING TILE MISSING		X						FBC 804.2.3
3	315	NO EVACUATION SHEET		X						FBC 423.14.2.4
3	317	EXTENSION CORD		X						NFPA 70 110.12
3	320	NO EVACUATION SHEET		X						FBC 423.14.2.4
3	329	NO EVACUATION SHEET		X						FBC 423.14.2.4
3	327	FIRE ALARM BOX OPEN		X						NFPA 70 110.26
3	327	SIMPLEX BOX WITHOUT COVER	X							NFPA 70 110.26
3	327	PANEL NOT LABELED, MISSING KNOCKOUT	X							



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

Dennis J. Johnson
 INSPECTOR'S SIGNATURE

10-25-07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
6	632	FIRE ALARM PANEL OPEN		X						NFPA 70 110.26
6	632	ROOF LEAKS AT SEVERAL LOCATIONS	X							
6	684	VENDING MACHINE BLOCKING ROOM		X						FBC 1001.4
6	690	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
6	629	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
8	829	FIRE ALARM BOXES OPEN COVERS REMOVED	X							NFPA 70 110.26
7	706	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	714	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
9	908	ROLL UP DOOR WON'T STAY OPEN - BROKEN SPRING	X							
9	914	ROOF LEAK FROM GUTTER	X							
9	924	DRINKING FOUNTAIN LEAKING - DAMAGED FLOOR TILE	X							
5	550	BROKEN DOOR HANDLE		X						FBC 1008



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
 466 MADISON AVENUE
 ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
5	545	EXIT LIGHT BROKEN		X						FBC 423.17.1
5	525	STAINED CEILING TILE BY ROOM 529 (Mez0		X						FBC 804.2.3
10	22	BATHROOM SIGNS MISSING		X						FBC 423.14.2.3
10	23	BATHROOM SIGNS MISSING		X						FBC 423.14.2.3
10	7	OPEN ELECTRICAL BOX		X						NFPA 70 110.12
10	7	AH DRAIN CLOGGED LEAKING ON FLOOR	X							FMC 300



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

Randy H. Burton
 INSPECTOR'S SIGNATURE

10-25-07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	2	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	3	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	4	OK								
92	5	OK								
92	6	OK								
92	7	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	8	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	9	OK								
92	10	OK								
92	11	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	11	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	12	OK								
92	13	NO EVACUATION SHEET		X						FBC 423.14.2.4



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

INSPECTOR'S SIGNATURE: *David F. Butler* DATE: 10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost.	No. of times Def. Cited	Scheduled for Correction	Rule
92	13	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	21	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	21	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	22	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	23	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	23	NO EVACUATION SHEET		X						FBC 423.14.2.4
92	24	CEILING LIGHT OUT		X						NFPA 70-401
92	24	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	25	OK								
92	26	OK								
92	27	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	27	NO EVACUATION SHEET		X						FBC 423.14.2.4
92	28	OK								
92	29	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

Darryl A. Brown
 INSPECTOR'S SIGNATURE DATE 10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost.	No. of times Def. Cited	Scheduled for Correction	Rule
92	30	OK								
92	31	OK								
92	32	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	33	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	34	NO EVACUATION SHEET		X						FBC 423.14.2.4
92	41	NO EVACUATION SHEET		X						FBC 423.14.2.4
92	41	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	42	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	42	FIRE ALARM BOX DANGLING FROM CEILING		X						NFPA 70 110.26
92	43	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	44	RAMP EXCEEDS 1-12 SLOPE	X							FBC 11.4.8
92	44	NO EVACUATION SHEET		X						FBC 423.14.2.4
92	45	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	46	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

[Signature]
 INSPECTOR'S SIGNATURE DATE 10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	48	OK								
92	50	EXCESSIVE COMBUSTIBLES ON WALLS & CEILINGS		X						NFPA 1 12.1
92	61	OK								
92	62	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	63	OK								
92	64	OK								
92	65	OK								
92	66	OK								
92	67	OK								
92	68	OK								
92	69	OK								
92	70	WOOD RAMP SPINDLES MISSING		X						FBC 1001.3
92	71	OK								
92	72	OK								



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	73	OK								
92	74	OK								
92	81	OK								
92	82	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	83	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	84	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	85	OK								
92	86	OK								
92	87	OK								
92	88	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	89	OK								
92	90	OK								
92	91	OK								
92	92	EMERGENCY LIGHT OUT		X						FBC 423.17.1



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 25, 2007

DATE

INSPECTOR'S SIGNATURE

[Handwritten Signature]
10-25-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	92	CARPET TORN, TRIP HAZARD		X						FBC 1001.3