
FIGUE 1

Elementary School



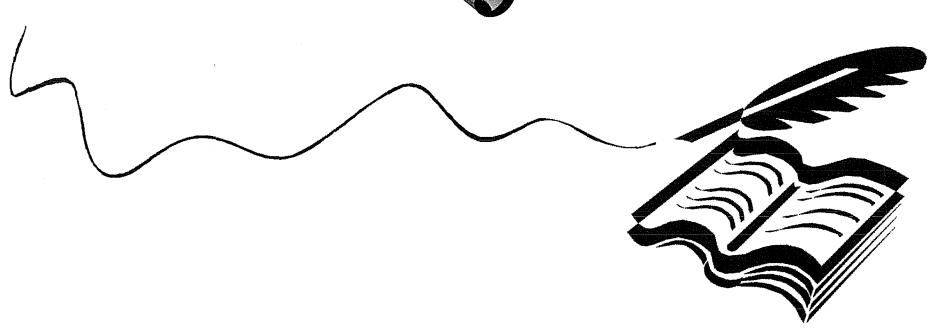

DISTRICT: CLAY FACIL	ITY #: 0046
FACILITY: ARGYLE ELEMENTAR	Y SCHOOL
2625 SPENCER PLANT	
ORANGE PARK, FLOR	IDA 32073
INSPECTION DATE: NOVEMBER	21, 2006
Told Xweathout	Nov 21, 2006
INSPÉCTOR'S SIGNATURE	DATE

Building	Room'	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	218	CEILING TILES STAINED BY AC - REPLACE		Х						FBC 804.2.3
3	.301	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
3	308A	CEILING TILE STAINED – REPLACE		Х						FBC 804.2.3
5	502	EXIT LIGHT OUT								FBC 1016.3.1
			Telements in his recent in the control of the contr							



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT; CLAY FACILIT	TY#: 0046
FACILITY: ARGYLE ELEMENTARY 2625 SPENCER PLANTA ORANGE PARK, FLORIC	ATION BOULEVARD
INSPECTION DATE: NOVEMBER 2	21, 2006
INSPECTOR'S SIGNATURE	<u> 7/10/21,2006</u> DATE

Bullding	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Gost	No. of times Def. Cited	Scheduled for Correction	Rule
92	812	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
92	701	ОК								
92	702	ОК								
92	703	OK								
92	704	ок								
92	705	OK								
92	706	ок								
92	707	OK								
92	708	ок								
92	709	OK								
92	710	ок								
92	711	ок								
92	712	ок								
92	714	οκ								



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACIL	.ITY #: 0046
FACILITY: ARGYLE ELEMENTAR 2625 SPENCER PLANT ORANGE PARK, FLOR	ATION BOULEVARD
INSPECTION DATE: NOVEMBER	
Medday) INSPECTOR'S SIGNATURE	10v 21, 2006 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	801	ок								
92	802	OK								
92	803	ОК							-	
92	804	ok .								
92	805	ок								
92	806	OK								
92	807	ок								
92	808	OK								
92	809	ОК								
92	810	OΚ								
92	902	ОК								
92	903	OK								
92	904	ок								
92	905	OK								



DISTRICT: CLAY FACIL	LITY#: <u>0046</u>
FACILITY: ARGYLE ELEMENTAR 2625 SPENCER PLANT ORANGE PARK, FLOR	TATION BOULEVARD
INSPECTION DATE: NOVEMBER	21, 2006
(sa Sureattano)	Mov 21, 2006
INSPECTOR'S SIGNATURE	DATE

Bullding	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	906	ок								
-92	907	OK								
92	908	ОК								
92	909	OK								
92	910	OK								
92	911	OK								
92	731	ROOF LEAK – CEILING TILE STAINED		Х						
92	812	SECONDARY DOOR STICKING		X						FBC 423.28.2.9.1
92	901	BATHROOM LIGHT COVER MISSING		Х						

Charles E. Bennett

Elementary School





COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

	EACH ITY: CHARLES E RENNETT ELEMENTARY SCHOOL
ľ	INDICATE OF THE PROPERTY OF TH

DISTRICT CLASS FACILITY # 0000

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL

1 SOUTH OAKRIDGE AVENUE

GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION, DATE: DECEMBER	5, 2006
11/1	T 724
MI SHI CALLAND	Vec 5, 2006
IMEDECTOR'S SIGNATURE	DATE

- Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S.!"	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	16	FIRE ALARM BOX OPEN	Х							NFPA 70 110.26
4	13	ELECTRICAL BOX OPEN	X							NFPA 70 110.26
5	23	HEAT DETECTOR LOOSE		Х						
10	810	ELECTRICAL BOX OPEN - CANOPY	X							NFPA 70 110.12
11	101	OCCUPANCY LOAD SIGNS MISSING		Х						FBC 423.14.2.2
11		WEEDS @ TRANSFORMER ENCLSURE - REMOVE		X						



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	CHARLES E. BENNETT ELEMENTARY SCHOOL
	1 SOUTH OAKRIDGE AVENUE
	GREEN COVE SPRINGS, FLORIDA 32043

DISTRICT: CLAY FACILITY #: 0002

INSPECTION DATE: DECEMBER 5, 2006

OF THE TOP OF THE TO

Building	Room	Deficiency Description and Corrective Action Required:	Maint: "M"	Oper. "O"	Fac. "C"	Info. Serv. "I,S."	Cost	No. of times Def: Cited	Scheduled for Correction	Rule
92	40	ОК								
92	41	OK								
92	42	ОК								
92	45	OK								
92	46	ок								
92	47	OK								
92	48	ок								
- 92	49	OK								
92	50	ок								
92	51	OK.								
92	52	ок								
92	53	ОК								
92	54	ок								
92	55	ОК								



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: CHARLES E. BENNET	FELEMENTARY SCHOOL
1 SOUTH OAKRIDGE A	AVENUE
GREEN COVE SPRING	
<u> </u>	
	T 0000
INSPECTION DATE: <u>DECEMBER</u>	5, 2006
	D 6000
My Mealland	Jecs, 206
INSPECTOR'S SIGNATURE	DATE
INSTECTOR S SIGNATORE	

FACILITY #: 0002

DISTRICT: CLAY

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	56	ок								
92	57	OK								
92	58	ок								
92	59	OK								
92	60	ок								
92	602	OK								
92	603A	ок								
92	603B	ОК								
92	604	ОК								
92	605	ОК								
92	606	ОК								
92	702	OK								
92	703	ОК								
F, 92	704	OK					William III			




DISTRICT: CLAY FACILITY#: 0002
FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL
1 SOUTH OAKRIDGE AVENUE GREEN COVE SPRINGS, FLORIDA 32043
GREEN COVE OF RINGS, I EORIDA GEOTO
INSPECTION DATE: DECEMBER 5, 2006
Ted Sweathans Dec 5, 2006
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	803	ОК								
92	804	ок								
92	43	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	502	EXCESSIVE STORAGE OF FLAMMABLE MATERIAL		X						
92	503	ELECTRICAL DISCONNECT REQUIRED	Х							NFPA 70 210
92	702	FENCE DAMAGED AT MDP	X							
92	703	FENCE DAMAGED AT MDP	Х							

Clay Hill

Elementary School

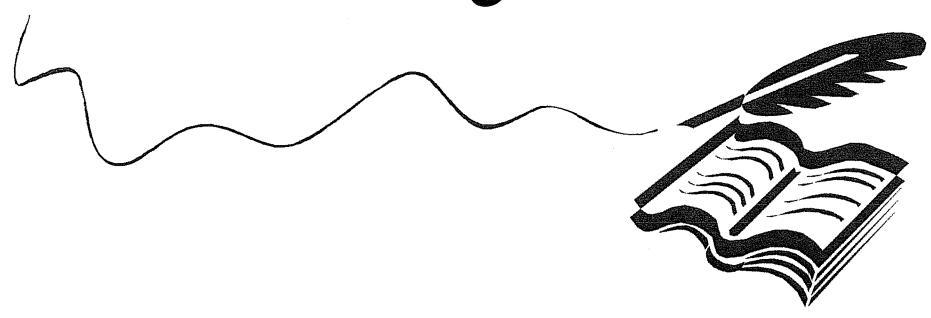



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: CLAY HILL ELEMENTARY	SCHOOL
6345 STATE ROAD 218	
JACKSONVILLE, FLORIDA	32234
INSPECTION-DATE: DECEMBER 7, 2	006
Lary It Inverse	12-7-06
N\$PECTOR'S SIGNATURE	DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper.	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	106	FIRE ALARM PANEL OUT OF DATE	Х							NFPA 72 10.6.2
2	209	EXIT LIGHT OUT		X						FBC 1016.3



	DISTRICT: CLAY FACILITY#: 0021
	FACILITY: CLAY HILL ELEMENTARY SCHOOL 6345 STATE ROAD 218
	JACKSONVILLE, FLORIDA 32234
	INSPECTION DATE: DECEMBER 7, 2006
/	MANUAL MORNEY DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	ок								
92	702A	EMERGENCY LIGHT OUT		Х						FBC 1016.3.1
92	702B	ок								
92	703	OK								
92	704	ок								
92	706	OK								
92	707	ок								
92	708	OK								
92	709	ОК							400	
92	710	OK								
92	711	ОК								
92	712	OK								
92	760	ОК								
92	762	OK								



	DISTRICT: CLAY FACILITY #: 0021
	FACILITY: CLAY HILL ELEMENTARY SCHOOL
	6345 STATE ROAD 218 JACKSONVILLE, FLORIDA 32234
	INSPECTION-DATE: DECEMBER 7, 2006
/	INSPECTOR'S SIGNATURE DATE

Bullding	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. L "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	764	ок								
92	766	OK								
92	682	ОК								

Doctors Intel

Elementary School





FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: DOCTORS INLET ELEMENTARY S	SCHOOL
2634 STATE ROAD 220	
MIDDLEBURG, FLORIDA 32068	

INSPECTOR'S SIGNATURE

Dec 12,2006 DATE

No. of Scheduled Fac. Info. Rule times for Maint. Oper. "C" Serv. Cost Deficiency Description and Corrective Action Required: Building Room "M" "O" Def. Correction "I.S." Cited FIRE ALARM COVER REMOVED Х 108 4 Χ 5 100 CEILING TILE MISSING FBC 804.2.3 FBC 804.2.3 **CEILING TILE MISSING** Χ 5 110 701 EMERGENCY EVACUATION SHEETS MISSING Χ FBC 423.14.2.4 FBC 423.14.2.4 7 **EMERGENCY EVACUATION SHEETS MISSING** Χ 703 Х FBC 423 14.2.4 707 EMERGENCY EVACUATION SHEETS MISSING FBC 423.14.2.4 8 801 EMERGENCY EVACUATION SHEETS MISSING Χ 8 802 EMERGENCY EVACUATION SHEETS MISSING Χ FBC 423.14.2.4 FBC 423.14.2.4 8 805 EMERGENCY EVACUATION SHEETS MISSING Χ Х 8 STORAGE IN ELECTRICAL ROOM - REMOVE 812 NFPA 70-110.26 Χ 8 815 OPEN AC/CONTROL BOX X 9 900 BOTH EXIT CORRIDOR LIGHTS OUT FBC 1205.3 9 912 STORAGE IN ELECTRICAL ROOM - REMOVE Χ



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACIL	LITY#: 0008
FACILITY: DOCTORS INLET ELEM	MENTARY SCHOOL
2634 STATE ROAD 220	0
MIDDLEBURG, FLORII	
INSPEÇTION DATE: DECEMBER	R 12, 2006
Tod Surcettons)	Dec 12, 2006

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	893	ОК								
92	894	OK								
92	895	OK						The transport one the training to the		
92	897	OK								
92	898	ОК					and the Action of the Control			
92	899	OK								
92	920	ОК								
92	922	OK								
92	923	ОК								
92	924A	ОК								
92	924B	ОК								
92	851	LIGHT FALLING FROM CEILING		X						
92	874	LENSE COVER MISSING		X						
92	896	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	921	EMERGENCY LIGHT OUT		X						FBC 423.17.1



COMPREHENSIVE SAFETY INSPECTION REPORT STATE BOARD OF EDUCATION **ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN **COMPLIANCE WITH** F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACI	LITY#: 0008
FACILITY: DOCTORS INLET ELEI 2634 STATE ROAD 22	0
MIDDLEBURG, FLORI INSPECTION DATE: _DECEMBER	
INSPECTOR'S SIGNATURE	Dec 12,2006 DATE

Bullding	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac.	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	836	ОК								
92	837	OK .								
92	838	OK								
92	839	OK								
92	840	ОК								emining become all and planting any contract and the grown
92	841A	OK								
92	841B	ОК								
92	843	OK	0.00							
92	844	ок								
i 92	845	OK			10 (10 (10 (10 (10 (10 (10 (10 (10 (10 (
92	846	ок						Control Sections and the Con-		
92	847	OK								
92	848	ОК					ar mysogyantosty.	SALE CONTRACTOR CONTRACTOR		
92	849	OK								



COMPREHENSIVE SAFETY INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: DOCTORS INLET ELEM	IENTARY SCHOOL
2634 STATE ROAD 220	
MIDDLEBURG, FLORID	A 32068
INSPECTION DATE: DECEMBER	12, 2006
Toll Sweathers	Dec 12, 2006
INCOPPOTODIS SIGNATURE	DATE

DISTRICT: CLAY FACILITY #: 0008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	850	ОК								
92	875A	ОК								
92	875B	ок								
92	876	OK								
92	869	ОК								
92	870 -	ОК								
92	871	ОК								
92	872	OK								
92	873	ОК								
92	888	OΚ								
92	889	ОК								
92	890	OK								
92	891	ОК								
92	892	OK								



COMPREHENSIVE SAFETY INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT: CLAY FACILITY #: 0008
•	FACILITY: DOCTORS INLET ELEMENTARY SCHOOL
	2634 STATE ROAD 220 MIDDLEBURG, FLORIDA 32068
	INSPECTION DATE: DECEMBER 12, 2006
	Day 17 7 mg

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def: Cited	Scheduled for Correction	Rule
92	893	ОК								
92	894	OK								
92	895	ОК								
92	897	OK								
92	898	ОК								Tinhan oyon markatinin pari patuju a anantar yang pinang parkang sa
92	899	OK								
92	920	ок			and, growing a new participating in open	daname-bookspools		ea naccanas atomeses	Caretra Oscocarece distric	
92	922	OK								
92	923	ОК			• in a sometime of the late of the	or tempo Association	messanalistans (1982)	via kolena doverni orosta dele	rangang sanan nangalang ang	
92	924A	OK								
92	924B	ок				traction and 1 Section	Dapera, mannas, andra	Capta of Calley Section (1)		
92	851	LIGHT FALLING FROM CEILING		Х						
92	874	LENSE COVER MISSING		X			gr.v			
92	896	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	921	EMERGENCY LIGHT OUT		X						

Eleming Island

Elementary School





COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT	: CLAY	F	ACILITY :	#: 0038	3	
	1 77 - Maria 23	Sir jigarakiya		100	1777 1971	

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL

4425 LAKE SHORE DRIVE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 14, 2006

INSPECTOR'S SIGNATURE

<u>)ec 14,2006</u>

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	120	STORAGE IN ELECTRICAL ROOM - REMOVE		Х						NFPA 70-110
\$\ 1 .1\$\.	120	FIRE ALARM PANEL OPEN - COVER MISSING	X				化成功 可能成分			NFPA 70-110
. 2	202	CEILING TILE MISSING		Х						FBC 804.2.3
2	208	EXTENSION CORD USED AS PERMANET WIRING-ADD OUTLET	X							NFPA 70 310.10
2	204	EXIT LIGHT OUT		Х						FBC 1016.3.1
2	201A	EXIT LIGHT TO HIGH @ STAGE END	X							FBC 1016.3.1
2	215	DOOR HANDLE BROKEN	х							FBC 423.13.6
2	232	LENSE COVE MISSING		X						NFPA 10
3	314	OCCUPANCY LOAD SIGN ?660 PEOPLE TOO MANY		х						FBC 423.14.2.2
3	303	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
3	304	NO EMERGENCY EVACUATION SHEET	-	Х						FBC 423.14.2.4
4	403	EXHAUST FAN NOT WORKING	X							FBC 423.15.4
4	428	LENSE COVER MISSING		Х						NFPA 10
WY.	120	STORAGE IN ELECTRICAL ROOM - REMOVE	TERRE	X						NFPA 70-110



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: FLEMING IS	SLAND ELEMENTARY SCHOOL
4425 LAKE	SHORE DRIVE
ORANGE P	ARK, FLORIDA 32003
INSPECTION DATE: [DECEMBER 14 2006

DISTRICT: CLAY FACILITY #: 0038

INSPECTOR'S SIGNATURE

Building Deficiency Description and Corrective Action Required: Maint. Scheduled Room Oper. Fac. Info. Cost No. of Rule "M" "C" Serv. "I.S." times for Def. Correction Cited 437 FIRE ALARM PANEL COVER MISSING Х 4 NFPA 70-110 Χ 5 538 STORAGE IN MECHANICAL ROOM - REMOVE 7 715 **CEILING TILE MISSING** Χ FBC 804.2.3 724 NO EMERGENCY EVACUATION SHEET Χ FBC 423.14.2.4



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY#: 0038
FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE ORANGE PARK, FLORIDA 32003
INSPECTION DATE: DECEMBER 14, 2006

INSPECTOR'S SIGNATURE

pec 19, con

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint: "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	601	ок		abloius		<u> </u>				
92	602	OK								
92	603	ок								
92	604	OK								
92	605	ок								
92	606	OK.								
92	607	ок								
92	608	OK								
92	797	ок								
92	798	OK								
92	800	ок								
92	801	OK								
92	802	ок								
The property of the property o										



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY#: 0038

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL

4425 LAKE SHORE DRIVE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 14, 2006

INSPECTOR'S SIGNATURE

DEC 14 LUC

Bullding Room Deficiency Description and Corrective Action Required: Scheduled Maint. Fac. Info. Cost No. of Rule Oper. "O" "C" "M" Serv. times for "I.S." Def. Correction Cited 92 803 OK 92 804 OK 92 OK 805 92 OK 806 92 OK 807 92 OK. 810 OK 92 811 92 812 OK 92 824 OK 92 OK 826 92 OK 830 92 OK 832 92 OK 841 LIGHT FIXTURE LOOSE @ CEILING X 92 845 NFPA 70



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

ŀ	DISTRICT	: CLA	Y	FACIL	LITY#:	0038	
ľ		Astoleten.	Aces decision for			JELFUL BURGER	

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL 4425 LAKE SHORE DRIVE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 14, 2006

INSPECTOR'S SIGNATURE


Dec 14, 2006

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint: "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def.	Scheduled for Correction	Rule
92	842	OK					Harrist Control	Cited		
92	843	-OK								
92	844	OK		(2.5000000000000000000000000000000000000			MANAGESTA SAS	1407-0275544945		Posta volument i savet seeden on det over-
92	846	OK								
92	847	ОК								
92	848	OK								
92	849	ОК								
92	850	OK					A production of the second			
92	851	ОК						1,000		
92.	852	OK .	English of the second							
92	799	AC FILTER DIRTY		Х						
92	808	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	809	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
92	860	EMERGENCY LIGHT NOT WORKING	X						FORCE	FBC 423 17:1

Grove Park

Elementary School

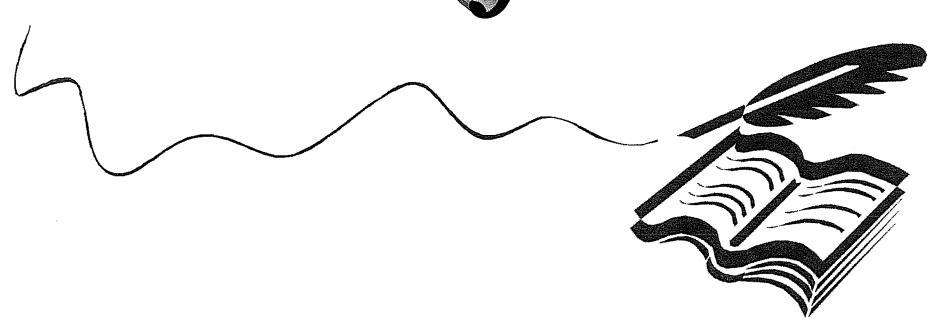



COMPREHENSIVE SAFETY INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

FACILITY	: GROVE PA			RY SCHOO	<u>) L</u>
	4425 LAK ORANGE			22072	
	ORANGE	PARK, F	LUKIDA	32013	

DATE

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	118	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
1	110	OCCUPANCY LOAD SIGN MISSING		Х						FBC 423.14.2.2
1	114	ROOM VERY WARM - LOTS OF COMPUTERS				Х				
2	131A	EXIT LIGHT OUT		X						FBC 1016.3.1
6	609	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
7	701	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.4
9	3	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.4



DISTRICT: CLAY FACIL	11Y#: 0005
FACILITY: GROVE PARK ELEMEN	ITARY SCHOOL
4425 LAKE SHORE DR ORANGE PARK, FLOR	
INSPECTION DATE: DECEMBER	19, 2006
Lie Sweathand	Dec 19,2000
INSPECTOR'S SIGNATURE	DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	5	ОК								
92	6	ОК								
92	7	ОК								
92	8	OK								
92	9	ОК								
92	10	ОК								
92	27	ок								
92	28	ОК								
92	29	ок								
92	30	ОК								
92	31	ОК								
92	37	OK								
92	38	ОК								
92	39	OK								



DISTRICT: CLAY FACIL	ITY #: 0005
FACILITY: <u>GROVE PARK ELEMEN</u> 4425 LAKE SHORE DRI ORANGE PARK, FLORI	VE
INSPECTION DATE: DECEMBER	
INSPECTOR'S SIGNATURE	<u>Dec 19 2006</u> DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	ок								
92	71	OK								
92	500	ок								
92	501	OK								
92	503	ок								
92	504	ОК								
92	505	ок								
92	520A	OK								
92	520B	ок								
92	521A	ОК								
92	521B	ОК								
92	522	ОК								
92	523	ок								
92	524	OK								



DISTRICT: CLAY FAC	CILITY#: 0005
FACILITY: GROVE PARK ELEM	
4425 LAKE SHORE D	RIVE
ORANGE PARK, FLO	RIDA 32073
INSPECTION DATE: DECEMBE	R 19, 2006
Tod Sweathans	Dec 19,2006
INSPECTOR'S SIGNATURE	DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	525	OK				1044				
92	526	ОК		* 1						
92	627	ОК				and the second s	i de El Turke Hyer			
92	528	OK								

Reystone Heights

Elementary School





FISCAL YEAR 2006-2007

DISTRICT: CLAY	FACILITY #:0010
335 S. PECAN	
	EIGHTS, FLORIDA 32656
INSPECTION DATE: JAN	Jan. 9, 2007
INSPECTOR'S SIGNATUR	E (DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
. 6	5	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
8	8	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	206	EXIT LIGHT OUT		Х						FBC 423.17.1
12	1210	COVER PLATE MISSING		X						NFPA 70
12	1214	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
					# 1.25 + 1 2					
A PARTICUMA A PROPERTY A PROPERTY OF THE	A SE					- 4,4				第450A 461数。
					1	J. 87 J. 1	12 14			
			1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1							



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

	ten tipes.	N. 19 . 18 . 18 . 18 . 18		
FACILITY:	KEYSTONE H	IEIGHTS ELE	EMENTARY	SCHOOL
	335 S. PECA			
	KEYSTONE H	IEIGHTS, FL	ORIDA 3265	56
INSPECTIO	DN DATE: JA	NUARY 9, 2	007	
Tal S	In tallous	\rightarrow	Jan	7,2007
INSPECTO	R'S SIGNATU	RE	DATE	

FACILITY #: 0010

DISTRICT: CLAY

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	ОК								
92	702	OK								
92	703	ок								
92	704	OK CLEAN CONTRACTOR OF THE CON								
92	705A	ок								
92	705B	OK								
92	706	ок								
92	707	OK								
92	708	ок								
92	709	OK								
92	710	ок								
92	713	OK								
92	714	ок								
92	715	OK BERGER BERGER								



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

5.11 ± 1		- 1 1 <u>- 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 -</u>		1, 1	***	<u> </u>	- 1.1.
FACILIT	Y: KEYS	TONE H	EIGHTS E	LEME	NTARY S	SCHOOL	
	335 8	. PECAI	STREET	1			
	KEYS	STONE H	IEIGHTS,	FLORI	DA 3265	6	
INSPEC.	TION DA	TE: JA	NUARY 9.	2007			
1/1	9,40		\rightarrow		ban	9 200	 フ
INCOER	TOP'S S	CHATH	<u> </u>		MATE	1,000	

FACILITY #: 0010

DISTRICT: CLAY

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	716A	ок								
92	716B	OK								
92	717	ок								
92	718	OK .								
92	719	ок								
92	720	OK							$\mathbb{E}_{\mathcal{A}_{k}}[H][\mathcal{F}_{k}]$	
92	750	ок								
92	771	OK								
92	772	ОК								_
92	773	OΚ								
92	770	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.4
92	721	RAMP NEEDS NON-SKID	Jane 18	Х	1.12					FBC 1006
92	722	RAMP NEEDS NON-SKID		Х						FBC 1006
92	724	RAMP NEEDS NON SKID		Х				1911 - 1. 11 - 1		FBC 1006



DISTRICT: CLAY FACILITY	#:0010
FACILITY: KEYSTONE HEIGHTS ELEM 335 S. PECAN STREET KEYSTONE HEIGHTS, FLO	
INSPECTION DATE: JANUARY 9, 200	07
INSPECTOR'S SIGNATURE	Jan. 9, 2007 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	750	FIRE EXTINGUISHER NOT SIGNED BY STOVE		Х						69A-58
92	760	NO HEAT DETECTOR IN CLOSET	X		1 Tenghiy					NFPA 107
								1444		
						May 1				
	Zoure Tyre N					1		7. II		
						11 12 12 12 12 12 12 12 12 12 12 12 12 1		- (2) (2) - (2) (4) - (3) (4)		