


		FISCAL YEAR 2006-2007				DISTRIC	T:CL	AY .	FACIL	TY #: <u>0046</u>
	FLO	FIRE SAFETY INSPECTION REPO FOR EDUCATIONAL FACILITIES ORIDA STATUTES 1013.12 & RULE	6	8		FACILITY	2625 \$	SPENCER	<u>NTARY SC</u> PLANTATIO FLORIDA	ON BOULEVARD
	_ PERM/	ANENT INSPECTION ANNUAL RELOCATA	N 🗆	INSPECTI		: <u>NOVEN</u>	<u>/IBER 21, 2</u>	006		
	FIRE DF	RILL LOG: NUMBER OF DRILLS PERFO		INSPECT	ÓR'S SIG	Haw) NATURE		<u>//w21,2006</u> date		
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No: of times Def. Cited	Scheduled for Correction	Rule
3	301	NO EMERGENCY EVACUATION SHEET	T.C.EE a ket	X	CREAK FLORA					FBC 423.14.2.4
5	502	EXIT LIGHT OUT								FBC 1016.3.1
AES 2006 (TEIDES	AFETY INSPECTION REPORT.doc								

FISCAL YEAR <u>2006-2007</u> FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58							DISTRICT: CLAY FACILITY #: 0046 FACILITY: ARGYLE ELEMENTARY SCHOOL 2625 SPENCER PLANTATION BOULEVARD ORANGE PARK, FLORIDA 32073 ORANGE PARK, FLORIDA 32073 INSPECTION DATE: NOVEMBER 21, 2006 Maxeman Mar 24, 2004 INSPECTOR'S SIGNATURE DATE					
Building	Room	Deficiency Description and Corrective Action Required:	Maint: "M"	Oper. "O"	Fac. "C"	Info: Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule		
92	812	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1		

AES 2006-07 FIRE SAFETY INSPECTION REPORT.doc

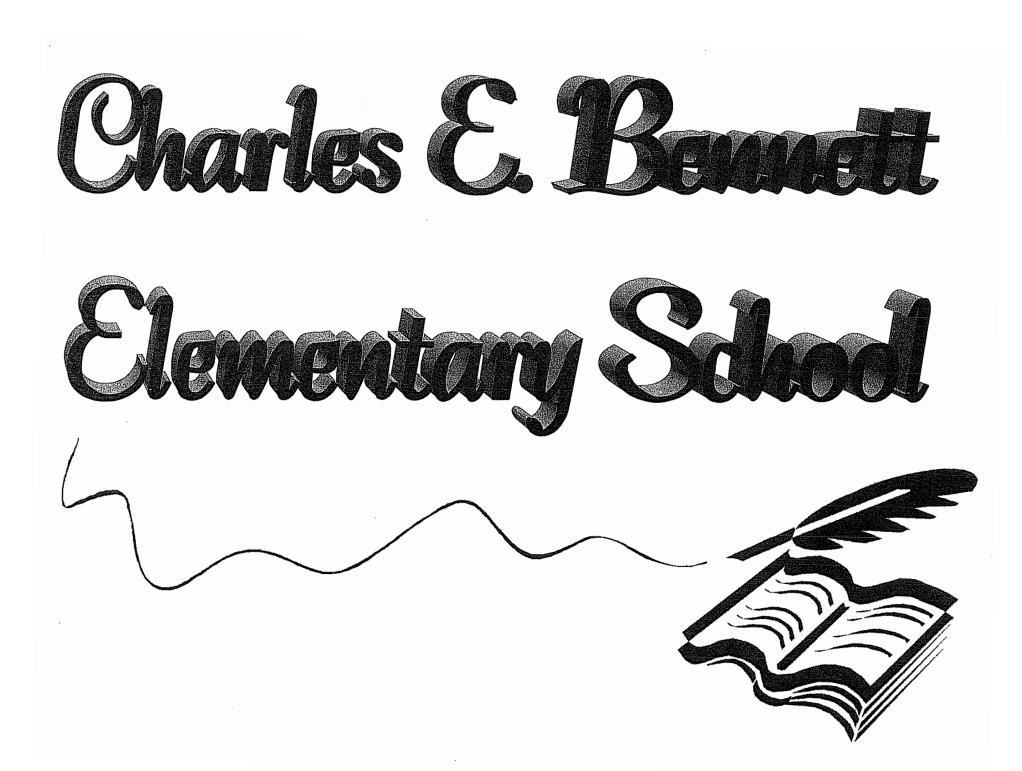

	. PERM	FISCAL YEAR <u>2006-2007</u> FIRE SAFETY INSPECTION REPOR FOR EDUCATIONAL FACILITIES ORIDA STATUTES 1013.12 & RULE ANENT INSPECTION ANNUAL RELOCATAN RILL LOG:√ NUMBER OF DRILLS PERFO	DISTRICT: CLAY FACILITY #: 002 FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL 1 SOUTH OAKRIDGE AVENUE GREEN COVE SPRINGS, FLORIDA 32043 INSPECTION DATE: DECEMBER 5, 2006 Jung Dec.5, 2006 INSPECTOR'S SIGNATURE DATE							
Building	Room	Deficiency Description and Corrective Action Required:	Maint. .'M"	Oper. "O"	Fac. "C"	Info, Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	16	FIRE ALARM BOX OPEN	Х							NFPA 70 110.26
4	13	ELECTRICAL BOX OPEN	x							NFPA 70 110.26
5	23	HEAT DETECTOR LOOSE		Х						
10	810	ELECTRICAL BOX OPEN - CANOPY	X							NFPA 70 110 12
11	101	OCCUPANCY LOAD SIGNS MISSING		X						FBC 423.14.2.2
11		WEEDS @ TRANSFORMER ENCLOURE - REMOVE		×						


CEB 2006-07 FIRE SAFETY INSPECTION REPORT.doc

	FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION							<u>es e. ben</u> Th oakrii I cove sp	INETT ELE	ORIDA 32043
Building	Room	Deficiency Description and Corrective Action Required:	Maint. ''M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	EMERGENCY LIGHT OUT		X	11. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1.			a fair an ann	The second s	FBC 423.17.1
92	502	EXCESSIVE STORAGE OF FLAMMABLE		X				And Annual and An		
92	503	ELECTRICAL DISCONNECT REQUIRED	X				1997 - Frieddon J. (1997) - Mar (1996) - Ala (19		a dene son til senara passa den	NFPA 70 210
92	702	FENCE DAMAGED AT MDP	X							
92	703	FENCE DAMAGED AT MDP	X							
					in Frankrik († 1995) 1999 - Standard Harrison, frankrik 1999 - Standard Harrison, frankrik 1999 - Standard Harrison, frankrik 1999 - Standard Harrison, frankrik 1990 - Standard Harrison, frankrik 1990 - Standard Harrison, frankrik 1990 - Standard Harrison, frankrik 1990 - Standard Harrison, frankrik					

CEB 2006-07 FIRE SAFETY INSPECTION REPORT.doc





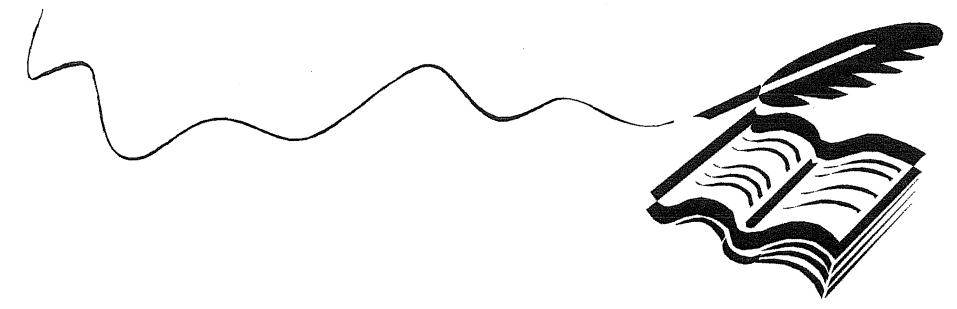

	FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION Image: Imag							DISTRICT: <u>CLAY</u> FACILITY #: <u>0021</u> FACILITY: <u>CLAY HILL ELEMENTARY SCHOOL</u> <u>6345 STATE ROAD 218</u> <u>JACKSONVILLE, FLORIDA 32234</u> INSPECTION-DATE: <u>DECEMBER 7, 2006</u> <u>Auth.</u> <u>Mommana</u> INSPECTOR'S SIGNATURE <u>JACE</u>					
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv, "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule			
1	106	FIRE ALARM PANEL OUT OF DATE	X							NFPA 72 10.6.2			
2	209	EXIT LIGHT OUT		X						FBC 1016.3			


CHE 2006-07 FIRE SAFETY INSPECTION REPORT.doc

	FIRE DRILL LOG: <u>v</u> NUMBER OF DRILLS PERFORMED: <u>4</u>							IILL ELEMI FATE ROA ONVILLE,	ENTARY S D 218 FLORIDA (BER 7, 200	32234
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info: Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	ОК			a distanti sa manan a			intherene to bind the the structure of	i di jesti incolficita incorrente dan	r store i en de la desta de
92	702A	EMERGENCY LIGHT OUT		X						FBC 1016.3.1
92	702B	ОК								
92	703	ΟK								
92	704	ОК	-							
92	7.06	ΟΚ								
92	707	ОК	THE R MARGERS AND AND	anterstore sciences and	and the first state of the state of the	neret and an Addression of the desired		1944 Martin Construction and a second		
92	708	OK								
92	709	ОК	an children and an an an						ալունին ամելի արեններ	n, in mutuum spats in terressennyseine (Warten by Panarson Souch
92	710	OK								
92	711	ОК			The state of the state of the state	1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 - 1997 -				
92	712	OK								
92	760	ОК		adiana kuti ia dalahitikana	NULIN MINISTRATION AND A				nipedy/modes.sources.com	
92	762	OK								

CHE 2006-07 FIRE SAFETY INSPECTION REPORT.doc

	_ PERM	FISCAL YEAR <u>2006-2007</u> FIRE SAFETY INSPECTION REPO FOR EDUCATIONAL FACILITIES ORIDA STATUTES 1013.12 & RULE ANENT INSPECTION ANNUAL RELOCATA RILL LOG: NUMBER OF DRILLS PERF	DISTRICT: <u>CLAY</u> FACILITY #: <u>0021</u> FACILITY: <u>CLAY HILL ELEMENTARY SCHOOL</u> <u>6345 STATE ROAD 218</u> <u>JACKSONVILLE, FLORIDA 32234</u> INSPECTION DATE: <u>DECEMBER 7, 2006</u> <u>MAXA MUMANAN</u> <u>11 - 7 - 0 6</u> INSPECTOR'S SIGNATURE <u>DATE</u>							
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	764	OK					CARACTERIAN (CONSERVANC)			
92	766	ОК								
92	682	OK		Alteratulation estimation		1		toolo to geographic and a	-	ta chanachraidheannachanachraidheannach tach tachadaidheac

CHE 2006-07 FIRE SAFETY INSPECTION REPORT.doc

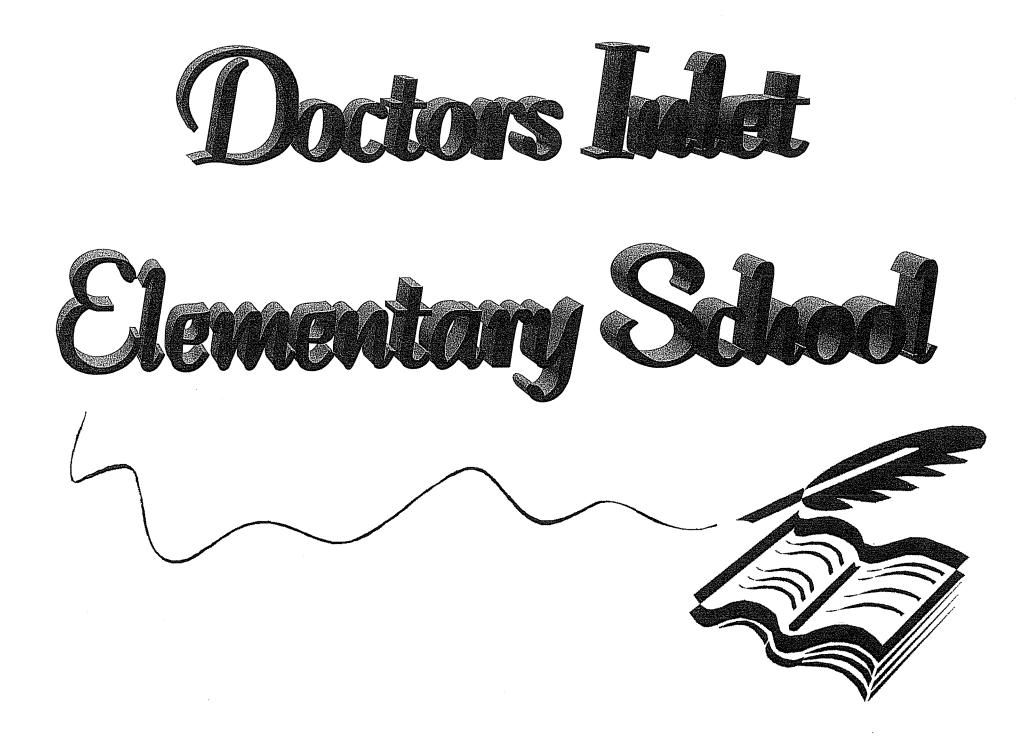


FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED:					-	DISTRICT: <u>CLAY</u> FACILITY #: <u>0008</u> FACILITY: <u>DOCTORS INLET ELEMENTARY SCHOOL</u> <u>2634 STATE ROAD 220</u> <u>MIDDLEBURG, FLORIDA 32068</u> INSPECTION DATE: <u>DECEMBER 12, 2006</u> <u>MAMMAMAN</u> INSPECTOR'S SIGNATURE <u>Dec. 2, 2006</u> DATE						
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule		
4	108	FIRE ALARM COVER REMOVED	X									
7	701	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4		
7	703	EMERGENCY EVACUATION SHEETS MISSING		Х						FBC 423.14.2.4		
7	707	EMERGENCY EVACUATION SHEETS MISSING		Х						FBC 423.14.2.4		
8	801	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4		
8	802	EMERGENCY EVACUATION SHEETS MISSING		Х						FBC 423.14.2.4		
8	805	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4		
8	812	STORAGE IN ELECTRICAL ROOM – REMOVE		X		un de la companya de						
9	900	BOTH EXIT CORRIDOR LIGHTS OUT		Х						FBC 1205.3		
9	912	STORAGE IN ELECTRICAL ROOM – REMOVE		X								

DIS 2006-07 FIRE SAFETY INSPECTION REPORT.doc


.

	FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 NNUAL PERMANENT INSPECTION ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: Image:							DISTRICT: <u>CLAY</u> FACILITY #: <u>0008</u> FACILITY: <u>DOCTORS INLET ELEMENTARY SCHOOL</u> <u>2634 STATE ROAD 220</u> <u>MIDDLEBURG, FLORIDA 32068</u> INSPECTION DATE: <u>DECEMBER 12, 2006</u> <u>MEDDEMENTARY</u> <u>Dec 12, 2006</u> <u>Dec 12, 2006</u> <u>Date</u>						
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule				
92	896	NO EMERGENCY EVACUATION SHEET		X			n din serie de la serie de la di			FBC 423.14.2.4				
92	921	EMERGENCY LIGHT OUT		x						FBC 423.17.1				

DIS 2006-07 FIRE SAFETY INSPECTION REPORT.doc

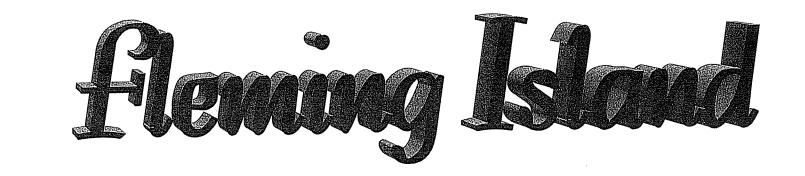



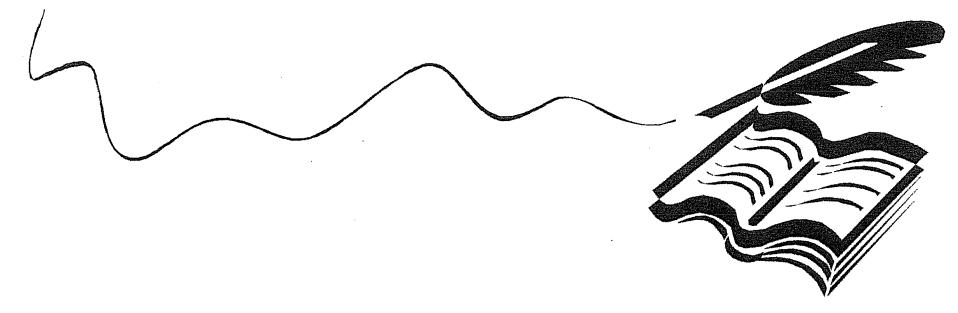

FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED:4							: <u>FLEMIN</u> <u>4425 LA</u> <u>ORANO</u>	IG ISLAND AKE SHOR BE PARK, I E: DECE		
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	120	STORAGE IN ELECTRICAL ROOM – REMOVE		X	a tan Anisha (tan 1997). Ali		n in fan de regen fan de fan it de f	a na 17 kupa na pangang na pangang sa pang		NFPA 70-110
1	120	FIRE ALARM PANEL OPEN – COVER MISSING	x							NFPA 70-110
2	208	EXTENSION CORD USED AS PERMANET WIRING-ADD OUTLET	x							NFPA 70 310.10
2	204	EXIT LIGHT OUT		X						FBC 1016.3.1
2	215	DOOR HANDLE BROKEN	X							FBC 423.13.6
3	303	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
3	304	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	724	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

FIE 2006-07 FIRE SAFETY INSPECTION REPORT.doc


FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL PERMANENT INSPECTION ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: Image: Image							DISTRICT: <u>CLAY</u> FACILITY #: <u>0038</u> FACILITY: <u>FLEMING ISLAND ELEMENTARY SCHOOL</u> <u>4425 LAKE SHORE DRIVE</u> <u>ORANGE PARK, FLORIDA 32003</u> INSPECTION DATE: <u>DECEMBER 14, 2006</u> <u>Dec.14, Zooc</u> INSPECTOR'S SIGNATURE <u>Dec.14, Zooc</u> DATE					
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule		
92	808	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1		
92	809	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1		

FIE 2006-07 FIRE SAFETY INSPECTION REPORT.doc




	FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: _√ NUMBER OF DRILLS PERFORMED: _8							DISTRICT: <u>CLAY</u> FACILITY #: <u>0005</u> FACILITY: <u>GROVE PARK ELEMENTARY SCHOOL</u> <u>1643 MILLER STREET</u> <u>ORANGE PARK, FLORIDA 32073</u> INSPECTION DATE: <u>DECEMBER 19, 2006</u> <u>Ject 19, 2006</u> <u>Dec 19, 2006</u> <u>Dec 19, 2006</u> <u>Dec 19, 2006</u> <u>Dec 19, 2006</u>					
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule			
1	118	EMERGENCY LIGHT OUT		X					i legi setti ber da da da da da da	FBC 423.17.1			
1	110	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2			
1	114	ROOM VERY WARM – LOTS OF COMPUTERS				X							
2	131A	EXIT LIGHT OUT		X						FBC 1016.3.1			
6	609	EMERGENCY LIGHT OUT		Х						FBC 423.17.1			
7	701	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4			
9	3	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.4			

GPE 2006-07 FIRE SAFETY INSPECTION REPORT.doc

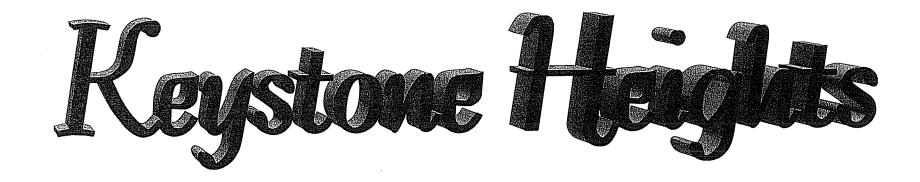



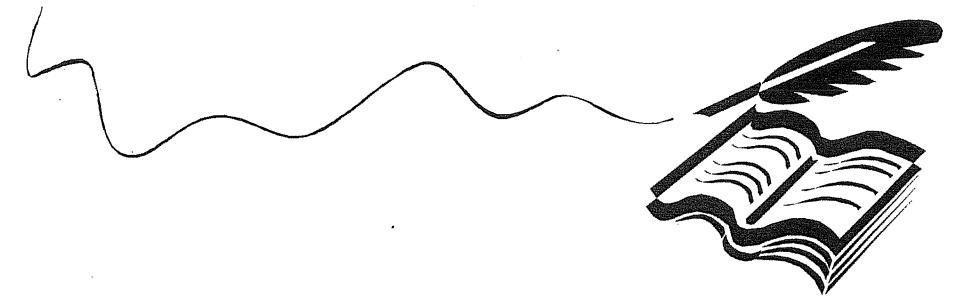

FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED:5						DISTRICT: <u>CLAY</u> FACILITY #: <u>0010</u> FACILITY: <u>KEYSTONE HEIGHTS ELEMENTARY SCHOOL</u> <u>335 S. PECAN STREET</u> <u>KEYSTONE HEIGHTS, FLORIDA 32656</u> INSPECTION DATE: JANUARY 9, 2007 <u>Jan. 9, 2007</u> INSPECTOR'S SIGNATURE					
Bullding	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule	
6	5	EMERGENCY LIGHT OUT		X			a niya wifitu, kutya	 Colored Control of Perificiency of Perificiency of Perificiency of Perificiency of Perificiency of Perificience o		FBC 423.17.1	
8	8	EMERGENCY LIGHT OUT		X						FBC 423.17.1	
10	206	EXIT LIGHT OUT		X			1			FBC 423.17.1	
12	1210	COVER PLATE MISSING		X						NFPA 70	
12	1214	EMERGENCY LIGHT OUT		X						FBC 423.17.1	

KHE 2006-07 FIRE SAFETY INSPECTION REPORT.doc

FISCAL YEAR 2006-2007 FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED:5						DISTRICT: <u>CLAY</u> FACILITY #: <u>0010</u> FACILITY: <u>KEYSTONE HEIGHTS ELEMENTARY SCHOOL</u> <u>335 S. PECAN STREET</u> <u>KEYSTONE HEIGHTS, FLORIDA 32656</u> INSPECTION DATE: <u>JANUARY 9, 2007</u> <u>January</u> January <u>1007</u> <u>January</u> January <u>1007</u> <u>January</u> January					
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule	
92	770	EMERGENCY EVACUATION SHEET MISSING		X		anta da especializada en		len de lies en ser jeur		FBC 423.14.2.4	
92	750	FIRE EXTINGUISHER NOT SIGNED BY STOVE		X						69A-58	
92	760	NO HEAT DETECTOR IN CLOSET	X							NFPA 107	

KHE 2006-07 FIRE SAFETY INSPECTION REPORT.doc