


R. M. Paterson

Elementary School



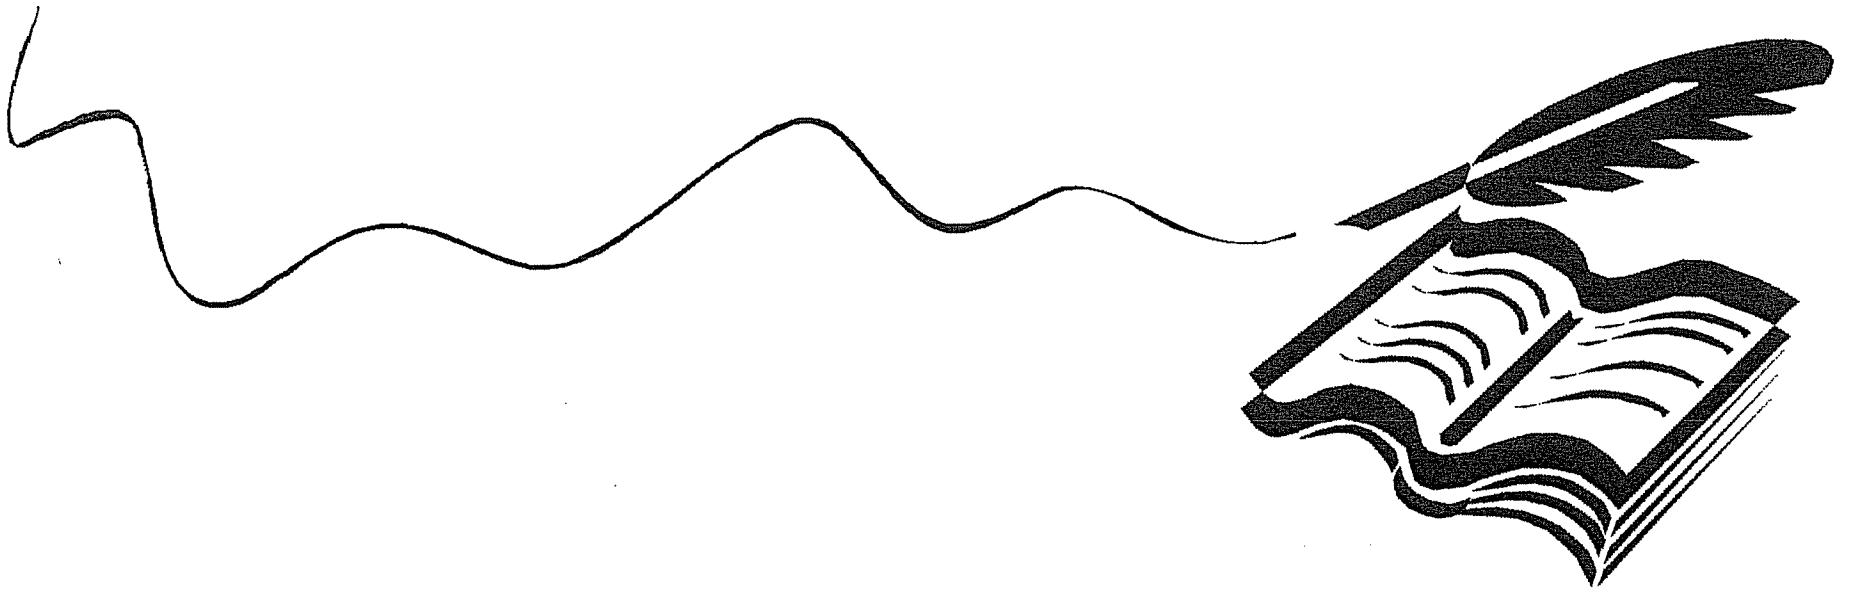

FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 23, 2007

Todd Sweetland
 INSPECTOR'S SIGNATURE

Jan 23, 2007
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	142	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
5	526	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
6	629	ELECTRICAL BOX COVER MISSING		X						NFPA-70



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 23, 2007

Tom Sweatt
 INSPECTOR'S SIGNATURE

Jan 23, 2007
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	OK								
92	2	OK								
92	3	OK								
92	4	OK								
92	5	OK								
92	6	OK								
92	7	OK								
92	8	OK								
92	11	OK								
92	13	OK								
92	14	OK								
92	15	OK								
92	16	OK								
92	17	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 23, 2007

Ted Sweetland

 INSPECTOR'S SIGNATURE

Jan 23, 2007

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	18	OK								
92	21	OK								
92	22	OK								
92	23	OK								
92	24	OK								
92	25	OK								
92	26	OK								
92	27	OK								
92	28	OK								
92	29	OK								
92	30	OK								
92	41	OK								
92	42	OK								
92	43	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 23, 2007


Zed Sweattard
 INSPECTOR'S SIGNATURE

Jan 23, 2007
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	OK								
92	45	OK								
92	46	OK								
92	47	OK								
92	48	OK								
92	49	OK								
92	50	OK								
92	51	OK								
92	52	OK								
92	53	OK								
92	54	OK								

Ride Out

Elementary School

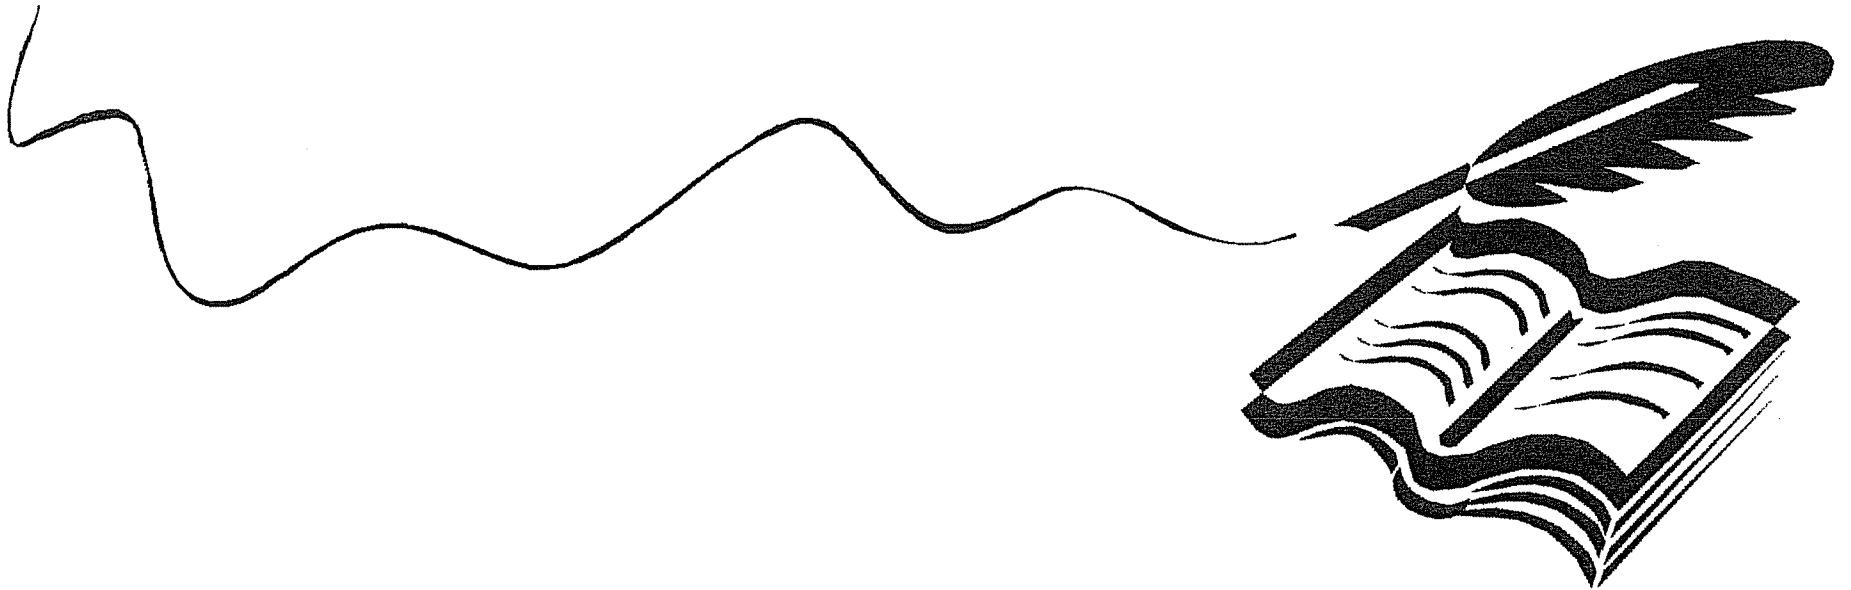



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007

Laurel Swanson
INSPECTOR'S SIGNATURE

1-25-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	308	FRONT OFFICE EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	239	CEILING TILE; INSULATION MISSING WHEN WATERLINE REPAIRED	X							
1	424	COMPUTER CABLE DRAPED OVER EXTERIOR EXIT				X				



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007

Janet Swanson
INSPECTOR'S SIGNATURE 1-25-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	14	OUTLET COVER MISSING NEAR EMERGENCY LIGHT		X						NFPA 70
92	20	OK								
92	21	OK								
92	22	OK								
92	23	OK								
92	24	OK								
92	25	OK								
92	26	OK								
92	27	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007


[Handwritten Signature]
 INSPECTOR'S SIGNATURE

1-25-07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	28	OK								
92	29	OK								
92	30	DOOR CLOSER MISSING	X							
92	31	OK								
92	32	OK								
92	33	OK								
92	34	AC FILTERS DIRTY		X						
92	40	OK								
92	41	OK								
92	42	OK								
92	43	OK								
92	44	OK								
92	45	OK								

Ridgeview

Elementary School

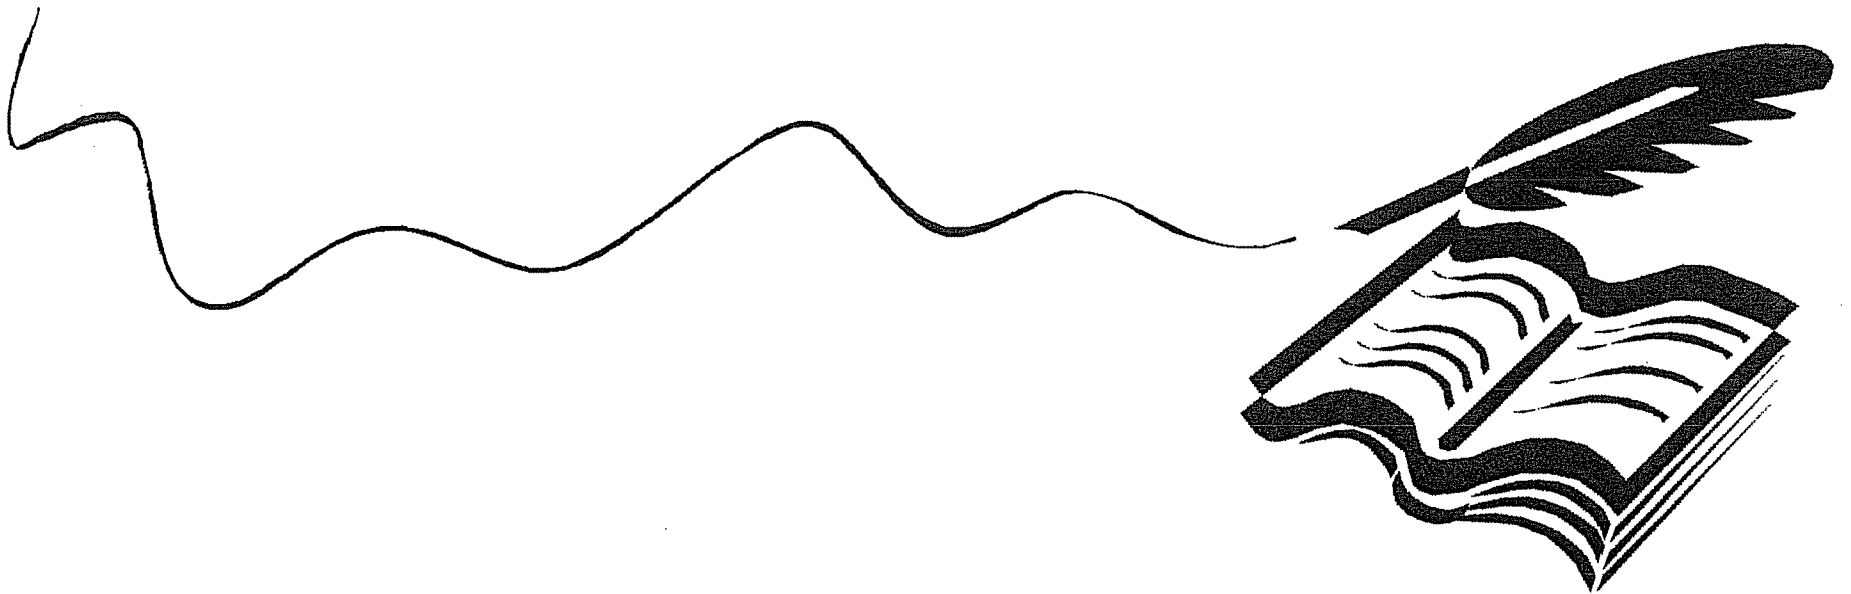



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 30, 2007

James A. Swanson
 INSPECTOR'S SIGNATURE

1-30-07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
2	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
3	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
1	108	OPEN ELECTRICAL BOX ON WALL -CLOCK REMOVED		X						NFPA-70
1	131	OPEN INTERCOM BOX		X						
2	210	HOOD SYSTEM NOT CERTIFIED - BEING WORKED ON		X						
2	215	TOILET OUT OF ORDER		X						
7	703	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4
7	706	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4
7	708	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 30, 2007

[Handwritten Signature]
INSPECTOR'S SIGNATURE

1-30-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	711	OK								
92	712	OK								
92	713	OK								
92	714	OK								
92	715	OK								
92	716	OK								
92	717	OK								
92	718	OK								
92	728	OK								
92	729	OK								
92	730	OK								
92	731	OK								
92	732	OK								
92	733	OK								



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 30, 2007

Darryl H. Jones
INSPECTOR'S SIGNATURE DATE 1-30-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	734	OK								
92	735	OK								
92	736	OK								
92	737	OK								
92	741	OK								
92	743	OK								
92	744	OK								
92	745	OK								
92	746	OK								
92	748	OK								
92	749	OK								
92	750	OK								
92	751	OK								
92	752	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065


INSPECTION DATE: JANUARY 30, 2007

[Signature]
 INSPECTOR'S SIGNATURE DATE 1-30-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	753	OK								
92	754	OK								
92	755	OK								
92	756	OK								
92	757	OK								
92	759	OK								
92	760	OK								
92	772	OK								
92	783	OK								
92	784	OK								
92	785	OK								
92	787	OK								
92	742	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	758	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

S. Bryan Jennings

Elementary School

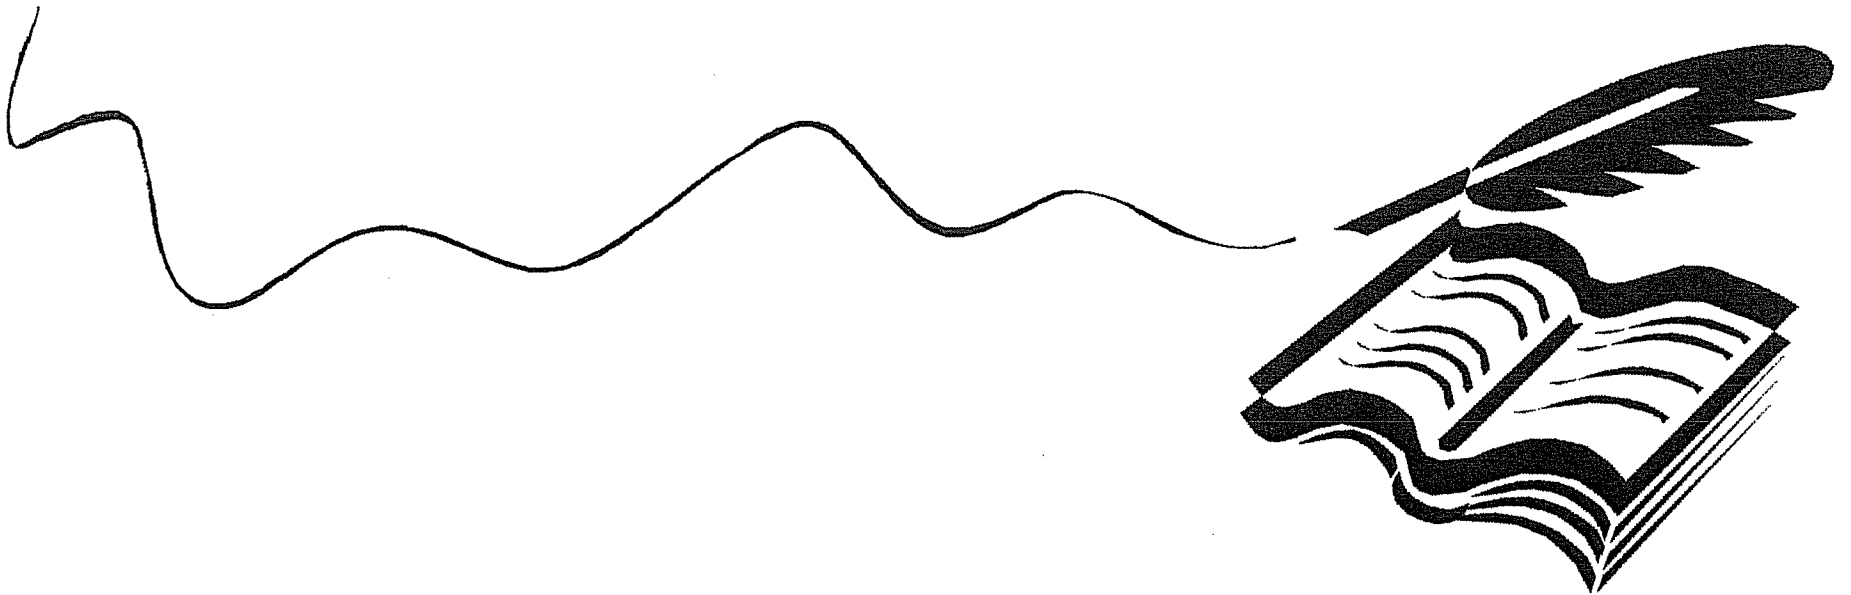



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 1, 2007

[Signature]
 INSPECTOR'S SIGNATURE

2-1-07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	31A	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	40A	MC CABLE DISCONNECTED WITH BARE WIRES	X							NFPA 70



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 1, 2007

[Signature]
INSPECTOR'S SIGNATURE

2-1-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	28A	OK								
92	28B	OK								
92	29	OK								
92	30	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	OK								
92	37	OK								
92	38	OK								
92	39	OK								
92	42	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: FEBRUARY 1, 2007

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 2-1-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	OK								
92	44	OK								
92	45	OK								
92	50	OK								
92	75	OK								
92	76	OK								
92	77	OK								
92	78	OK								
92	79	OK								
92	80A	OK								
92	80B	OK								
92	81	OK								
92	36	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Swimming Pen Creek

Elementary School

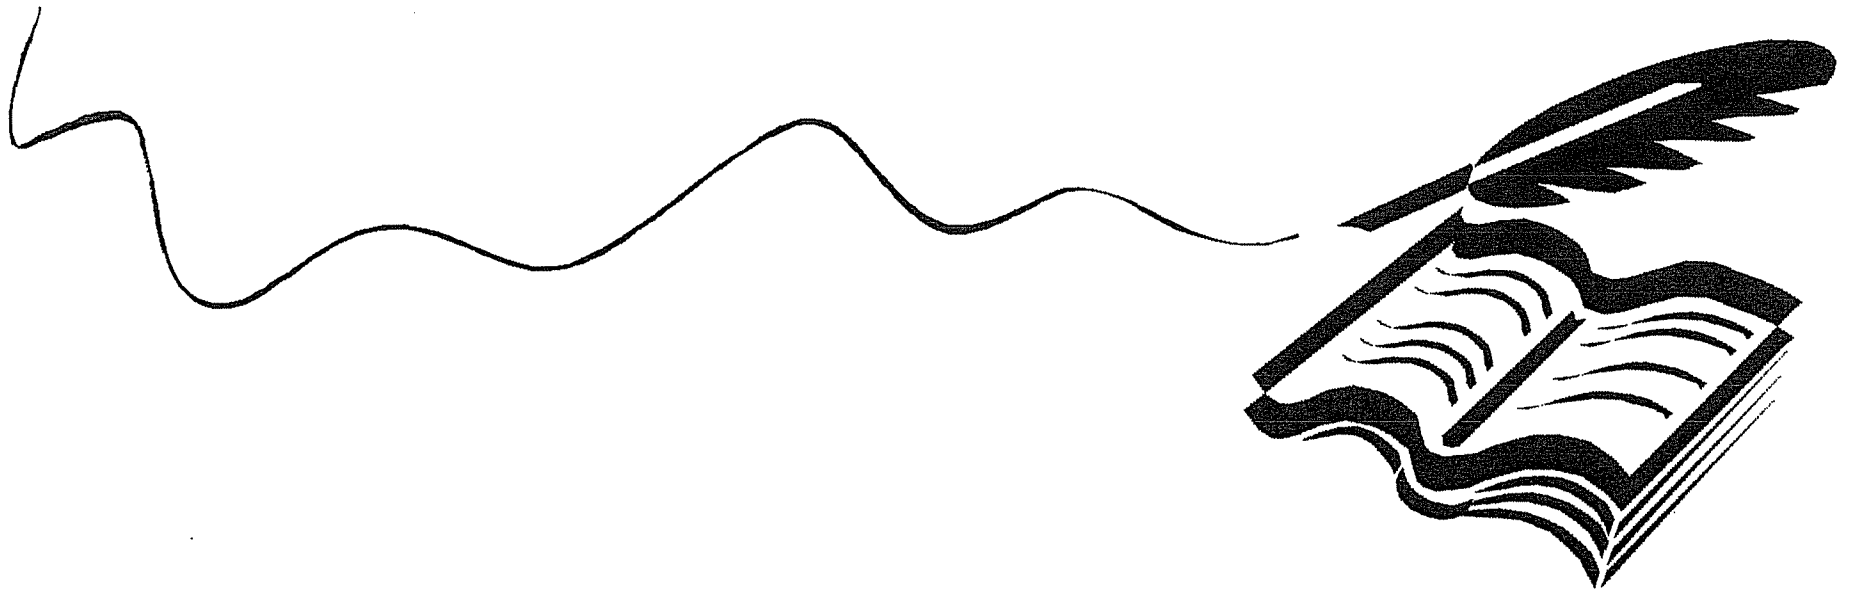



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2007
[Signature] 2/9/07
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	230	PAINT STORED IN MECHANICAL ROOM – REMOVE		X						NFPA -1
5	500	TABLE IN HALL – MUST MAINTAIN 72" MINIMUM		X						NFPA 101.14
6	627	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2007

[Handwritten Signature]
 INSPECTOR'S SIGNATURE

2/9/07
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	OK								
92	702	OK								
92	704	OK								
92	705	OK								
92	706	OK								
92	707	OK								
92	708	OK								
92	801	OK								
92	803	OK								
92	804	OK								
92	805	OK								
92	806	OK								
92	807	OK								
92	808	OK								



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2007

[Handwritten Signature]
INSPECTOR'S SIGNATURE

2/9/07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	809	OK								
92	810	OK								
92	703	EMERGENCY LIGHT OUT		X						FBC 423.17.1