THE PARTIES OF THE PA

Clementain School



FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES	FACILITY: THUNDERBOLT ELEMENTARY SCHOOL 2020 THUNDERBOLT ROAD ORANGE PARK, FLORIDA 32003
FLORIDA STATUTES 1013.12 & RULE 69A-58 ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION	INSPECTION DATE: FEBRUARY 8, 2007
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED:6	ÍNSPECTOR'S SIGNATURE DATE

DISTRICT: CLAY FACILITY #: 0042

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	11	EMERGENCY EVACUATION SHEET		х	N -street start for the				3 (Francisco) (A. 12. (1906) (In 1906)	FBC 423.14.2.4
1	247	OCCUPANCY LOAD SIGN MISSING - 86 PEOPLE		X						FBC 423.14.2.4
1	231	OCCUPANCY LOAD SIGN MISSING - 360 PEOPLE		х						FBC 423.14.2.4
20 14 15 y										

FISCAL YEAR 2006-2007

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

___ ANNUAL RELOCATABLE INSPECTION

	FIRE DF	RILL LOG: _√ NUMBER OF DRILLS PERF	ORMED:	: <u>6</u>	آل .	WSPECT	<i>g∭⊬<u></u> ∕</i> OR'S SIG	NATURE		DATE/
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	702	REMOVE EXTENSION CORD TO COMPUTER	1 10 7 10 10 10 10	х	10 10 10 10 10 10 10 10 10 10 10 10 10 1			Colonia Ser perili di ser fil de alla		NFPA 70
92	726	KNOCK-OUT MISSING ELECTRICAL BOX BY RAMP	X							NFPA 70
l e										


DISTRICT: CLAY

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL

2020 THUNDERBOLT ROAD ORANGE PARK, FLORIDA 32003

FACILITY #: 0042

Element State

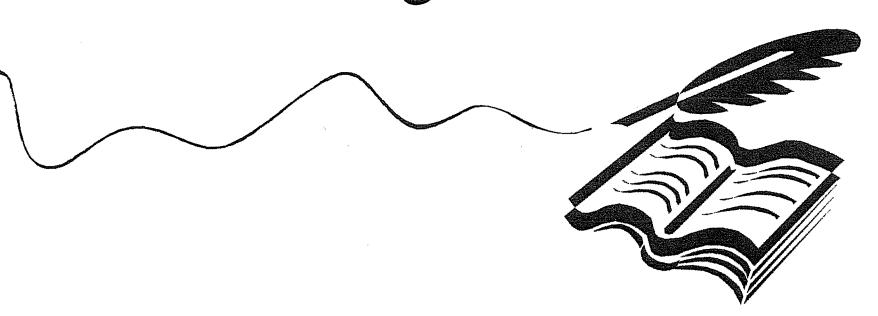

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES	FACILITY: TYNES ELEMENTARY SCHOOL 1550 TYNES BOUEVARD MIDDLEBURG, FLORIDA 32068
FLORIDA STATUTES 1013.12 & RULE 69A-58	INSPECTION-BATE: FEBRUARY 13, 2007
ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION	Xarrell hou 5/13/07
FIRE DRILL LOG:√ NUMBER OF DRILLS PERFORMED:8	INSPECTOR'S SIGNATURE DATE
ι	Y

DISTRICT: CLAY

FACILITY #: 0040


Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	144	OCCUPANCY LOAD SIGN MISSING - 80 PEOPLE		х						FBC 423.14.2.2
4	144	FIRE EXTINGUISHER NOT SIGNED IN HALL		Х						69A-58 FAC
4	414	414 EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.2.4
							3			Verse

	. PERM	FIRE SAFETY INSPECTION REPORE FOR EDUCATIONAL FACILITIES ORIDA STATUTES 1013.12 & RULE ANENT INSPECTION ANNUAL RELOCATABLE RILL LOG: NUMBER OF DRILLS PERFORM	69A-5 BLE INS	PECTIO	N		1550 TY MIDDLI	FEBRU	FARY SCHO EVARD LORIDA 32 ARY 13, 20	068
Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	8	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
92	43	EMERGENCY LIGHT NOT WORKING		×						FBC 423.17.1

DISTRICT: CLAY FACILITY #: 0040

M E GENY

Elementary Strott

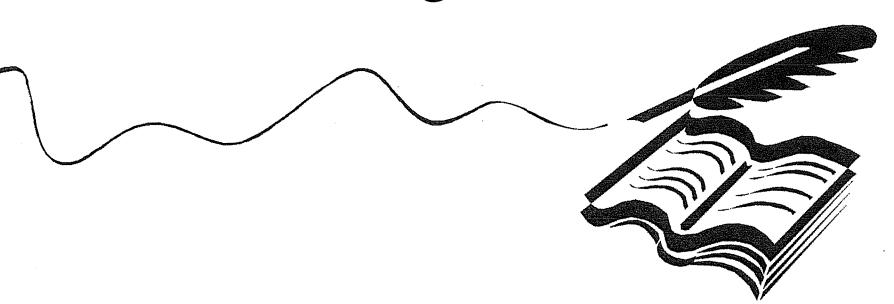

FISCAL YEAR 2006-2007

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION	INSPÉCTION DATE! <u>FEBRUARY 16, 2007</u> ANALY MULES
FIRE DRILL LOG:√ NUMBER OF DRILLS PERFORMED:7	INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	77	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
3	55	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
3	64	LIGHT COVER MISSING		Х						NFPA 70
3	-66	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	68	EMERGENCY LIGHT OUT		Х						FBC 423.17.1

DISTRICT: CLAY FACILITY #: 0006

ORANGE PARK, FLORIDA 32073

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

420 EDSON DRIVE

fire safe i y inspection report	420 EDSON DRIVE
FOR EDUCATIONAL FACILITIES	ORANGE PARK, FLORIDA 32073
FLORIDA STATUTES 1013.12 & RULE 69A-58	
ANNUAL PERMANENT INSPECTION ☐ ANNUAL RELOCATABLE INSPECTION ☐ FIRE DRILL LOG:7	INSPECTION DATE: FEBRUARY 16, 2007 INSPECTION DATE: FEBRUARY 16, 2007 INSPECTION SIGNATURE DATE
Building Room Deficiency Description and Corrective Action Required: Maint: Oper Fac.	Info. Cost No. of Scheduled Rule

DISTRICT: CLAY FACILITY #: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	31	EMERGENCY LIGHT OUT		Х			Section 1. The section of the sectio			FBC 423.17.1
92	41	EMERGENCY LIGHT OUT	11 50 10 10 10 10 10 10 10 10 10 10 10 10 10	X						FBC 423.17.1
92	60	EMERGENCY LIGHT OU		Х						FBC 423.17.1

Elementary Sands



FISCAL YEAR 2006-2007

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

JN\$	ΥΡΕ∕CTIQΛ DAT⊯: <u>FEBRUARY 23, 200</u>	<u> 17</u>
ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION	Saul A busin -	
FIRE DOUGLES A NUMBER OF DOULS DEPENDED: 4	PECTOR'S SIGNATURE	ť

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	300	LENSE COVER MISSING BY ROOM 301		Х						
5	528	EXIT LIGHT OUT		X						FBC 1006.3.1

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL

MIDDLEBURG, FLORIDA 32068

4965 C.R. 218