



# ANCIENTLY ARIFFLES/ COUNTY OFFICES

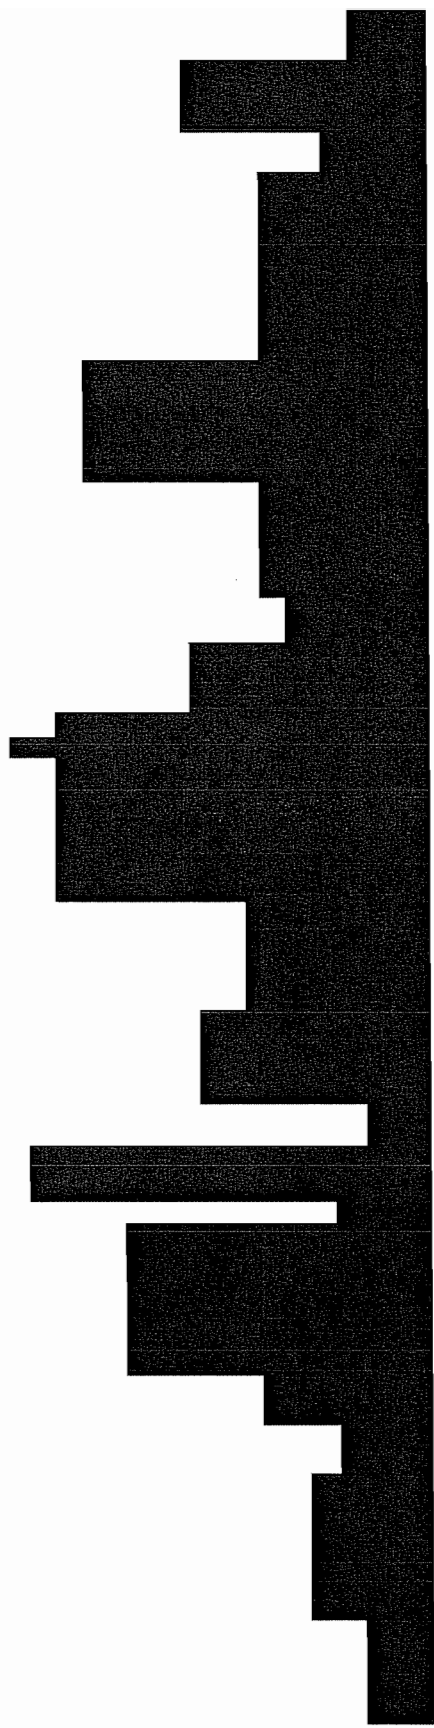

**ADMINISTRATIVE OFFICE**

**ORANGE PARK ANNEX**

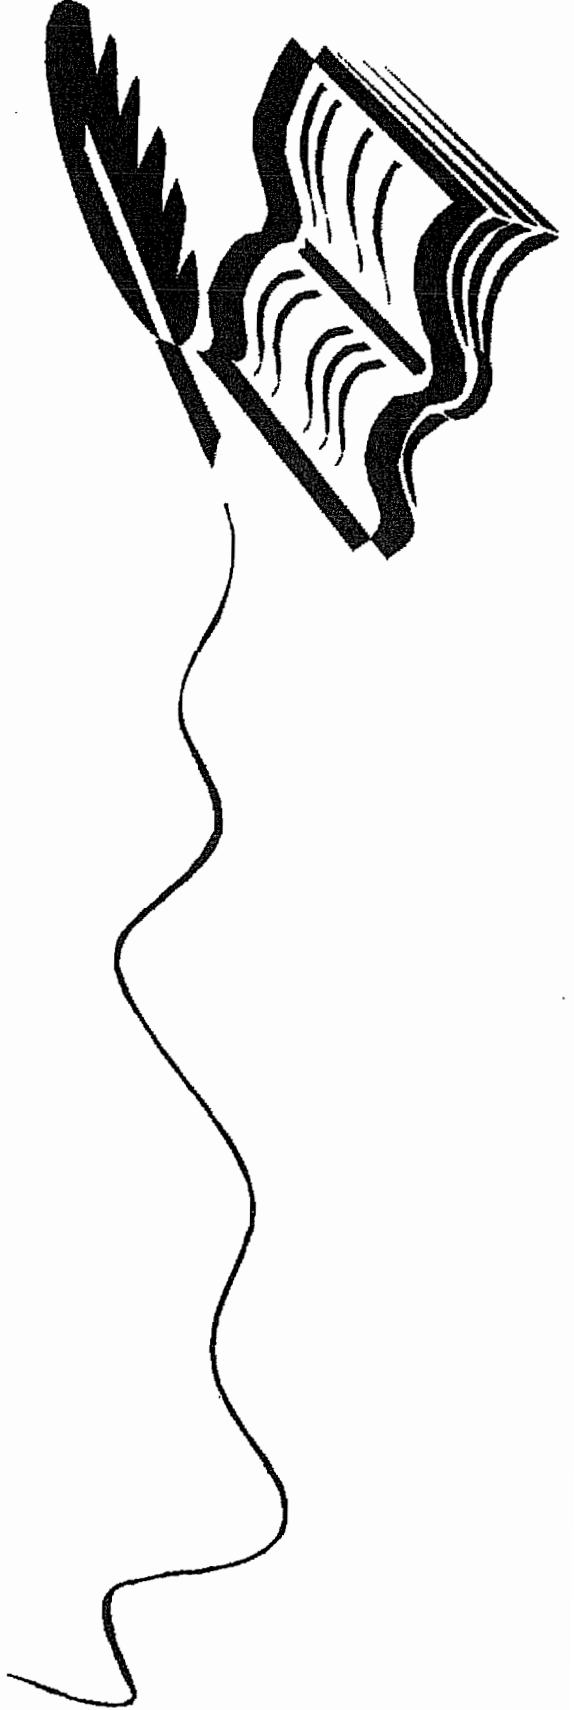

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY    FACILITY #: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX  
2300 KINGSLEY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005


*Ed Sweetser*  
INSPECTOR'S SIGNATURE

*Sept 23, 2005*  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16	1A	EXIT LIGHT MISSING	X							FBC 1016.3.1
16	1A	NO EMERGENCY LIGHTING IN WHOLE BUILDING	X							FBC 423.17.1
16	5	EXTENSION CORD TO STRIP		X						NFPA-70 527.2
17	2	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EXTENSION CORDS PLUGGED TOGETHER		X						NFPA-70 527.2
17	8	EXTENSION CORDS PLUGGED TOGETHER		X						NFPA-70 527.2
17	8	SECOND EXIT BLOCKED WITH FILING CABINET		X						NFPA-70 4.4.3.1

**CLAY SUPERINTENDENTS**

**OFFICE**

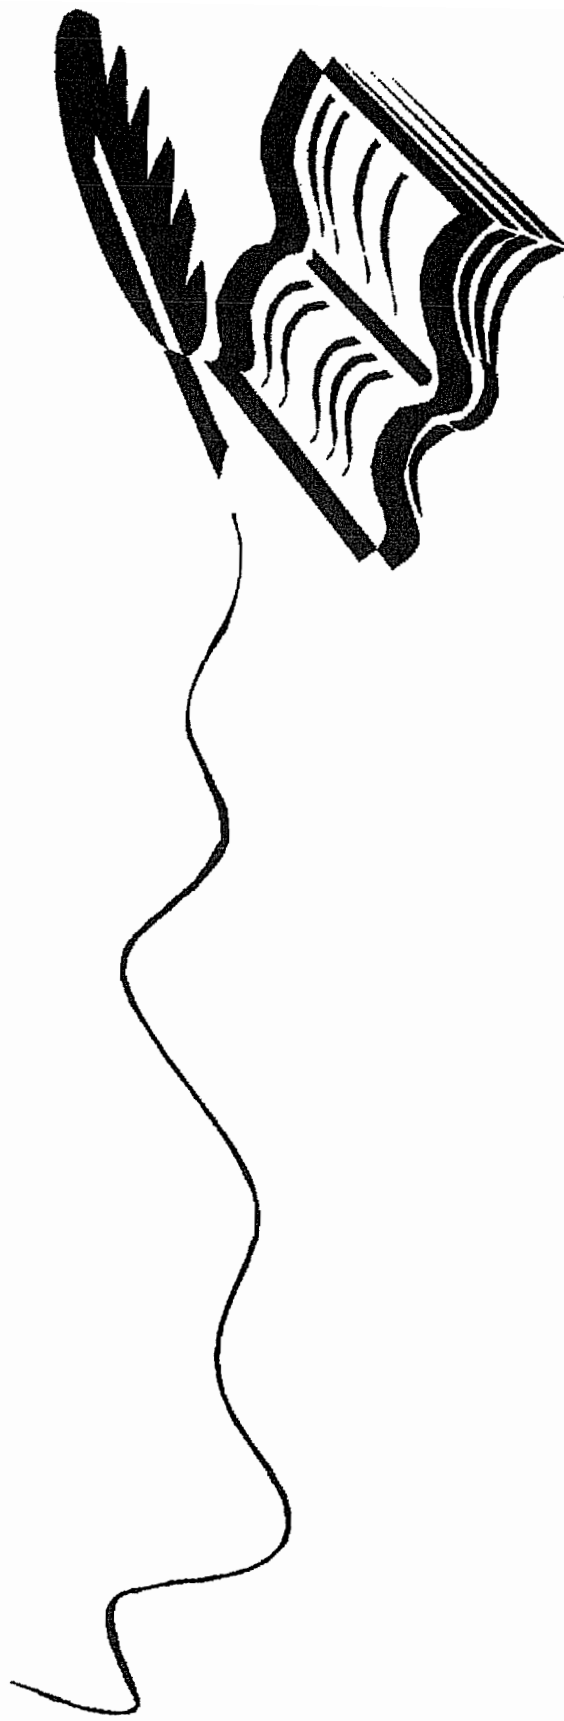

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

**TYPE OF INSPECTION**

DISTRICT: CLAY    FACILITY #: 0036

FACILITY: SUPERINTENDENT'S OFFICE  
900 WALNUT AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006

*[Signature]*  
INSPECTOR'S SIGNATURE

*Feb 24, 2006*  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
2	10	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
2	20	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
2	14	DOOR CLOSURE BROKEN - PART OF SMOKE COMPARTMENT	X							

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION     ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

DISTRICT: CLAY    FACILITY #: 0036

FACILITY: SUPERINTENDENT'S OFFICE  
 900 WALNUT AVENUE  
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006

*John Spreatery*  
 INSPECTOR'S SIGNATURE

*Feb 24, 2006*  
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	3	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
92	7	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	49	EXIT PARTIALLY BLOCKED BY COKE MACHINE/TRASH CAN		X						FBC 1003.6

**FISCAL YEAR 2005-2006**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION    
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 1

DISTRICT: CLAY FACILITY #: 0036

FACILITY: FHS TEACHERS INSERVICE CENTER  
2233 VILLAGE SQUARE PARKWAY  
ORANGE PARK, FLORIDA 32003


INSPECTION DATE: SEPTEMBER 23, 2005

  
 INSPECTOR'S SIGNATURE     Sept 23, 2005 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
10	1019	OK								

( FHS TEACHERS INSERVICE CENTER 2005 FIRE SAFETY INSPECTION.wpd)

# FOOD SERVICES/STORAGE

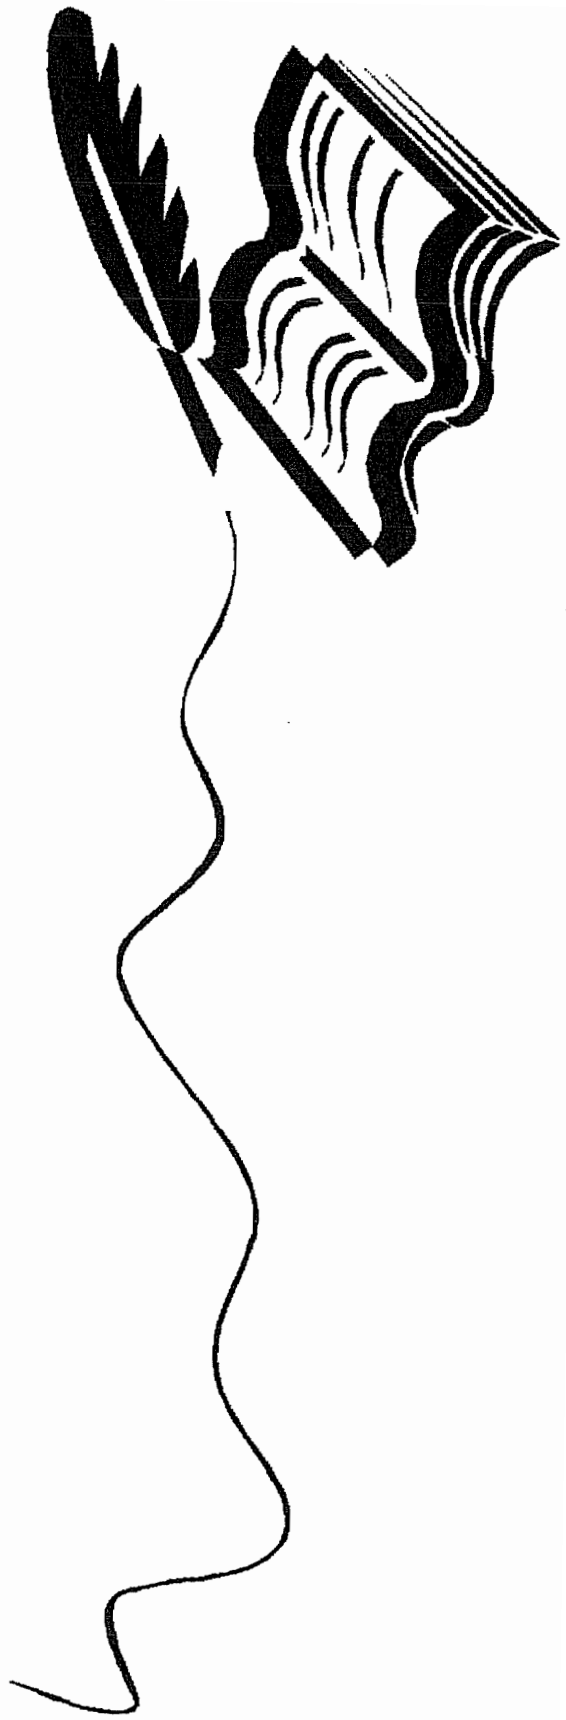



FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION     ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

DISTRICT: CLAY FACILITY # 0035


FACILITY: FOOD SERVICE STORAGE  
720 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 15, 2006

Zed Juncatana Feb 15, 2006  
 INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	OK								

# HARRIS C. LONG BUILDING

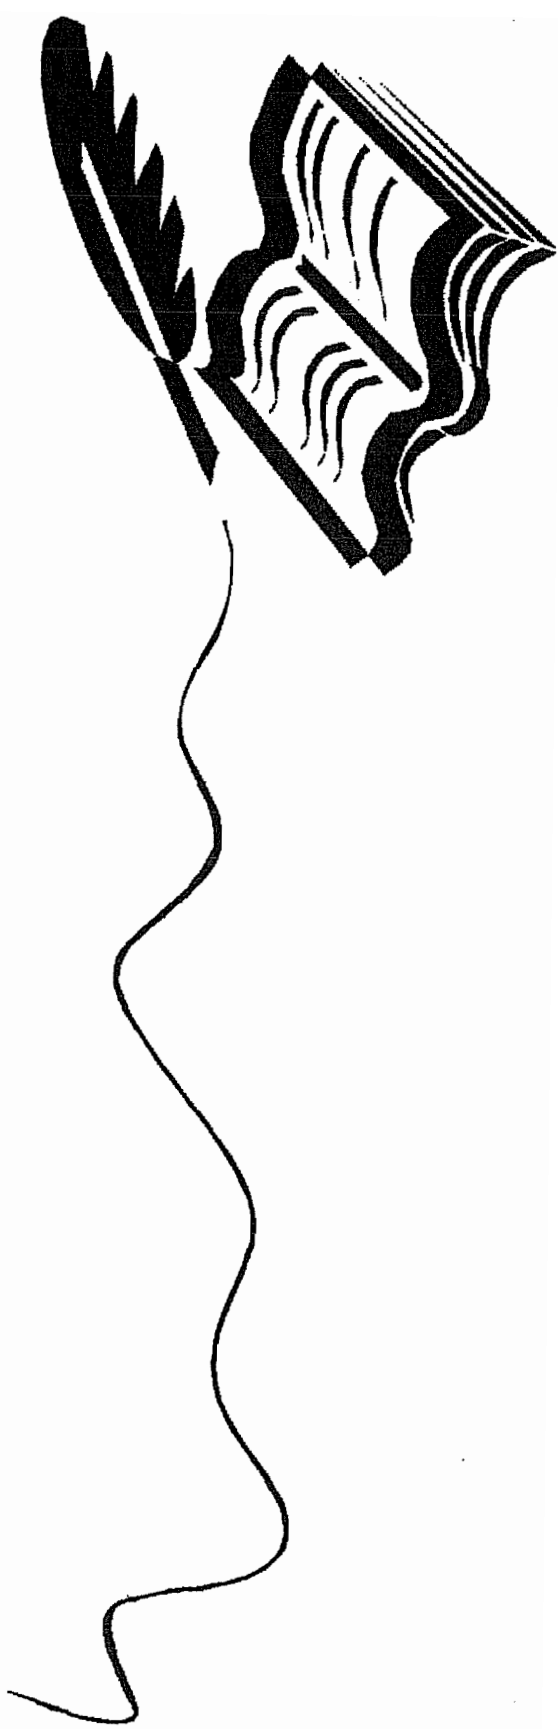

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION       ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

DISTRICT: CLAY      FACILITY #: 0027

FACILITY: HARRIS C. LONG ADMINISTRATION  
23 SOUTH GREEN STREET  
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 24, 2006

*Jed. Spreaton*  
 INSPECTOR'S SIGNATURE      DATE Feb 24, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
2		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
3		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
5		NO EMERGENCY LIGHTS	X							FBC 423.17.1

**KEYSTONE FRIGHERS**

**TRANSPORTATION**

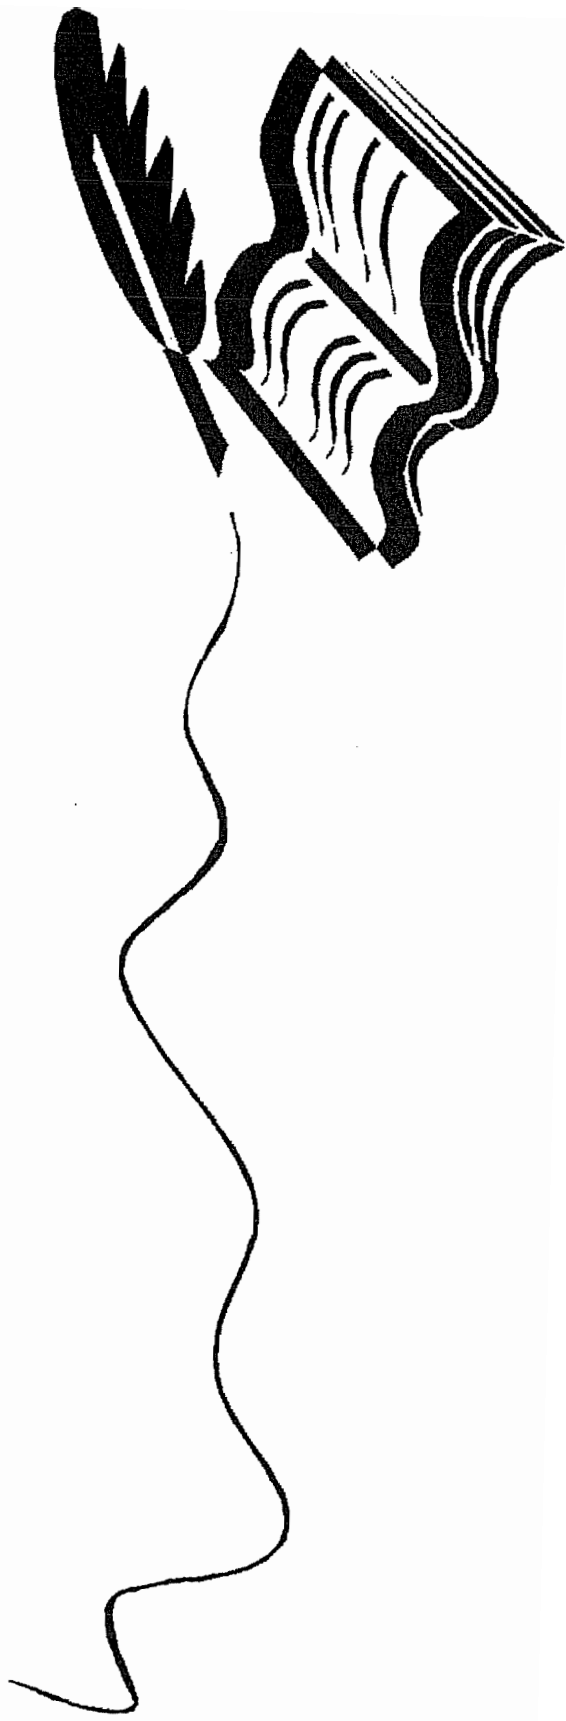

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION    
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: N/A    
 NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY     FACILITY #: 0037

FACILITY: KEYSTONE HEIGHTS TRANSPORTATION  
6800 COUNTY ROAD 315  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: FEBRUARY 15, 2006


*Carl Sweetland*  
INSPECTOR'S SIGNATURE

Feb 15, 2006  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								

**MIDDLETHERG**

**TRANSPORTATION**

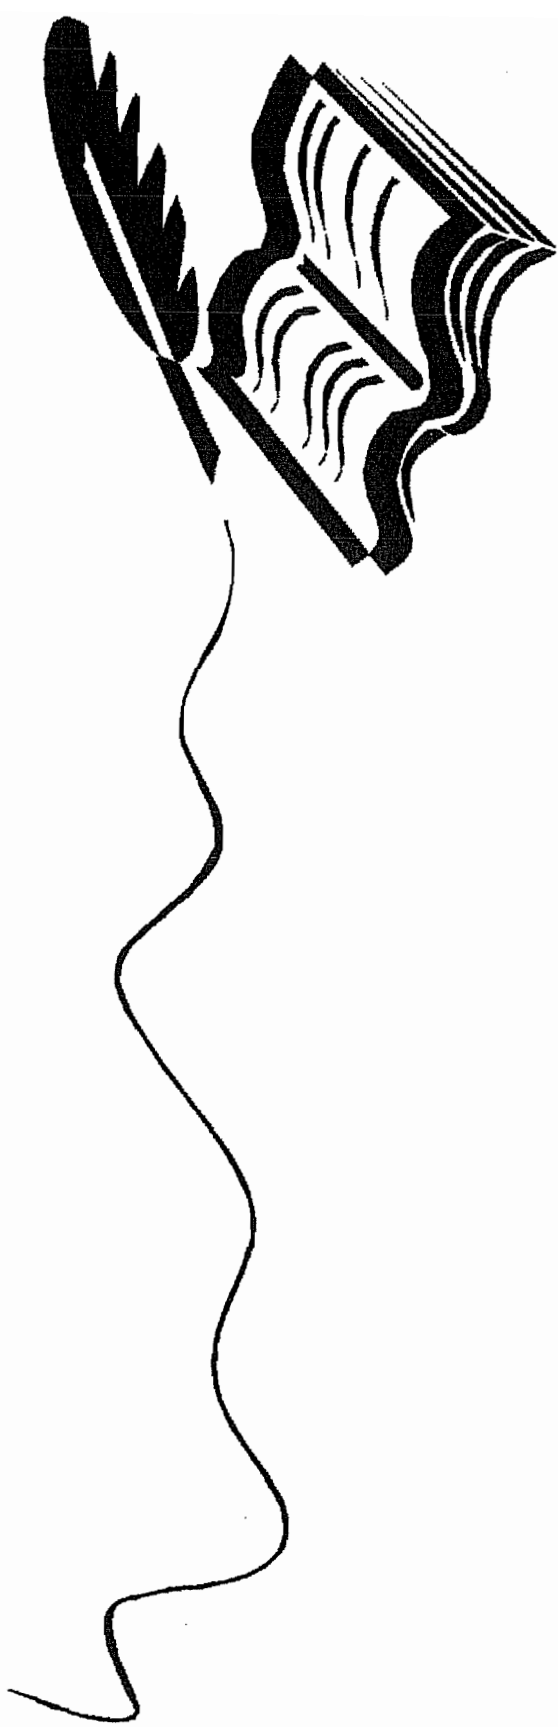

**FISCAL YEAR 2005-2006**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION  ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY # 0033

FACILITY: MIDDLEBURG TRANSPORTATION  
3674 COUNTY ROAD 2  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 22, 2006

INSPECTOR'S SIGNATURE: *Earl Swartzland* DATE: Feb 22, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	1	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36
3	5	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	8	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	8	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36
3	801	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION

ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0033

FACILITY: MIDDLEBURG TRANSPORTATION  
3674 COUNTY ROAD 2  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 22, 2006


*Ted Swartz*  
INSPECTOR'S SIGNATURE Feb 22, 2006  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	9	OK								



**SCHOOL BUS**

**GARAGE**

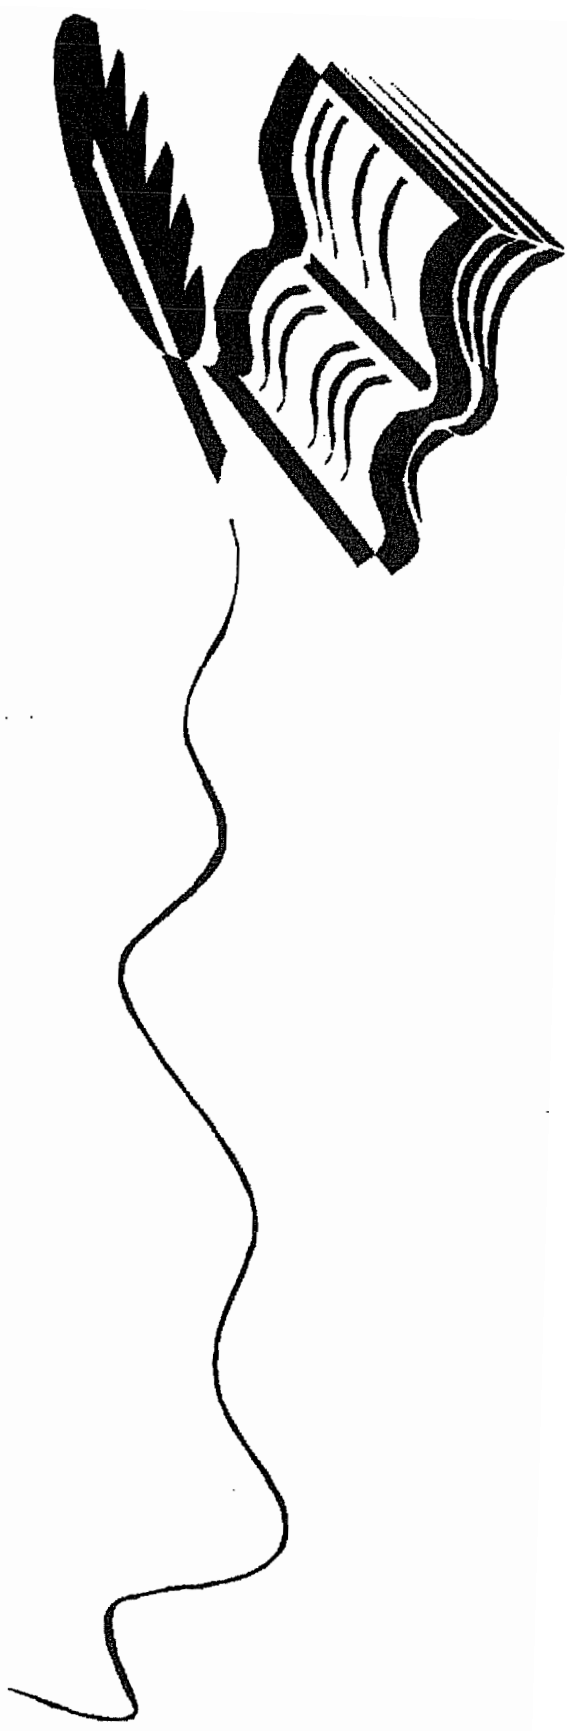

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
 FOR EDUCATIONAL FACILITIES  
 FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0030

FACILITY: SCHOOL BUS GARAGE-TRANSPORTATION  
 800 CENTER STREET  
 GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 24, 2006

INSPECTOR'S SIGNATURE: *Ted J. Ivattam* DATE: Feb 24, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	8	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
1	11	FIRE EXTINGUISHER NOT SIGNED (5) GARAGE		X						69A-36
2		FIRE EXTINGUISHER NOT SIGNED		X						69A-36

**SUPPORT SERVICES**

**AG LOT**

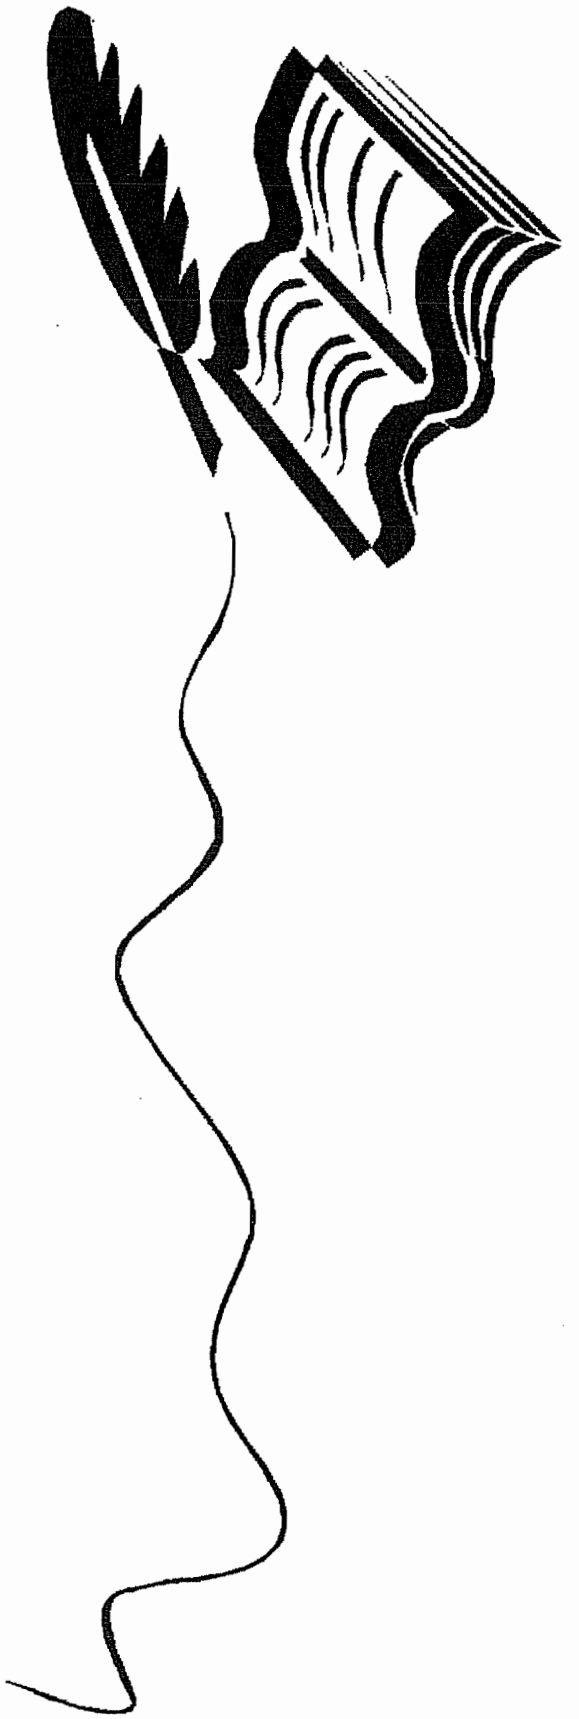

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION    
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG: \_\_\_\_\_ NUMBER OF DRILLS PERFORMED: \_\_\_\_\_

DISTRICT: CLAY     FACILITY #: 0028

FACILITY: SUPPORT SERVICES AG LOT  
ROBERTS STREET  
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 15, 2006

INSPECTOR'S SIGNATURE: *Ted Swathlow*     DATE: Feb 15, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								
95	2	STORAGE BUILDING NOT OCCUPIED								
95	3	STORAGE BUILDING NOT OCCUPIED								
95	4	STORAGE BUILDING NOT OCCUPIED								
95	5	STORAGE BUILDING NOT OCCUPIED								
95	6	STORAGE BUILDING NOT OCCUPIED								

**SUPPORT SERVICES**

**CENTRE**

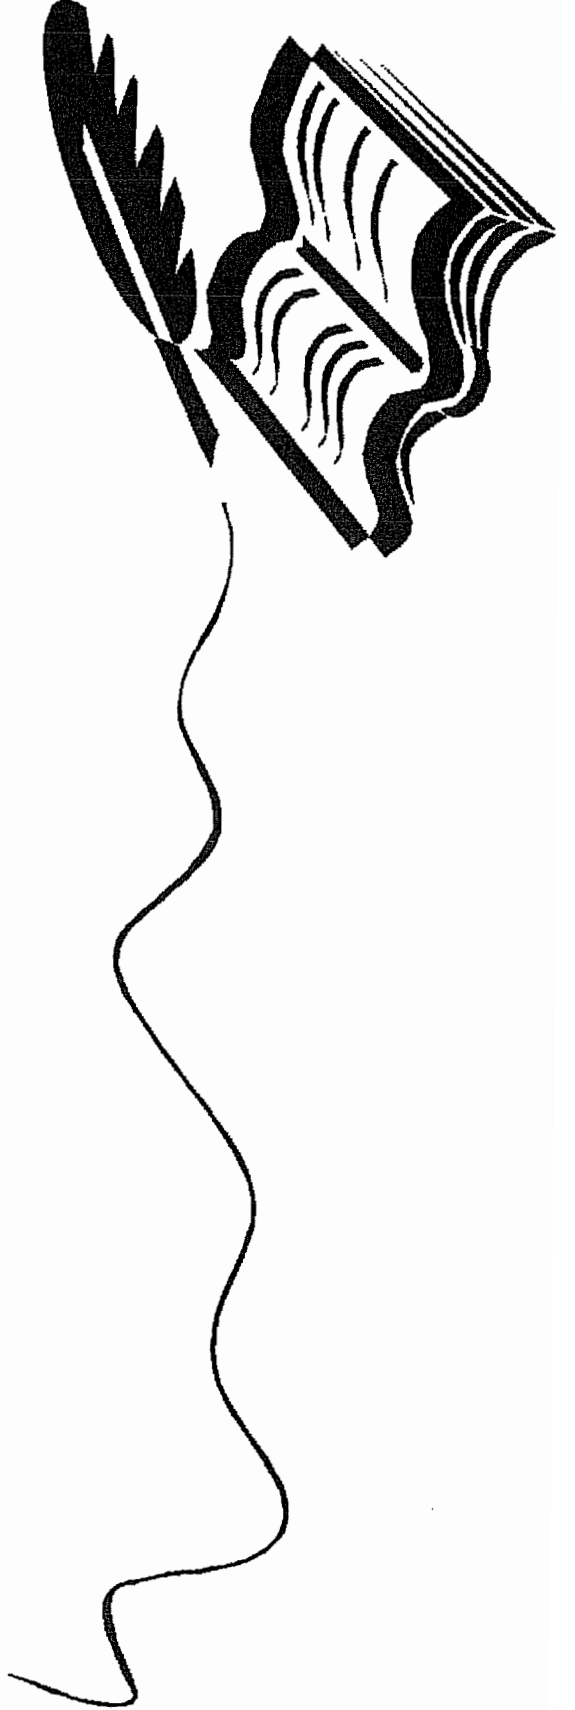

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:    N/A    NUMBER OF DRILLS PERFORMED:    N/A

DISTRICT: CLAY    FACILITY # 0029

FACILITY: SUPPORT SERVICES CENTER  
925 WEST CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006

  
 INSPECTOR'S SIGNATURE    DATE Feb 24, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
SS1		EMERGENCY EVACUATION SHEETS MISSING - 2 <sup>ND</sup> FLOOR		X						
5	14	FIRE EXTINGUISHER NOT SIGNED OFF		X						69A-58
9	911	EMERGENCY LIGHT NOT WORKING - STREET SIDE		X						FBC 423.17.1
11	2 <sup>ND</sup> FL	NO EMERGENCY LIGHTS	X							FBC 423.17.1
11	2 <sup>ND</sup> FL	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
11	102A	NO SAFETY GLASS @ STAIR/DOOR AREA								FBC 2406.3
11	107A	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
11	107A	NO EMERGENCY LIGHTS	X							FBC 423.17.1