


MIDDLEBURG

ELEMENTARY SCHOOL

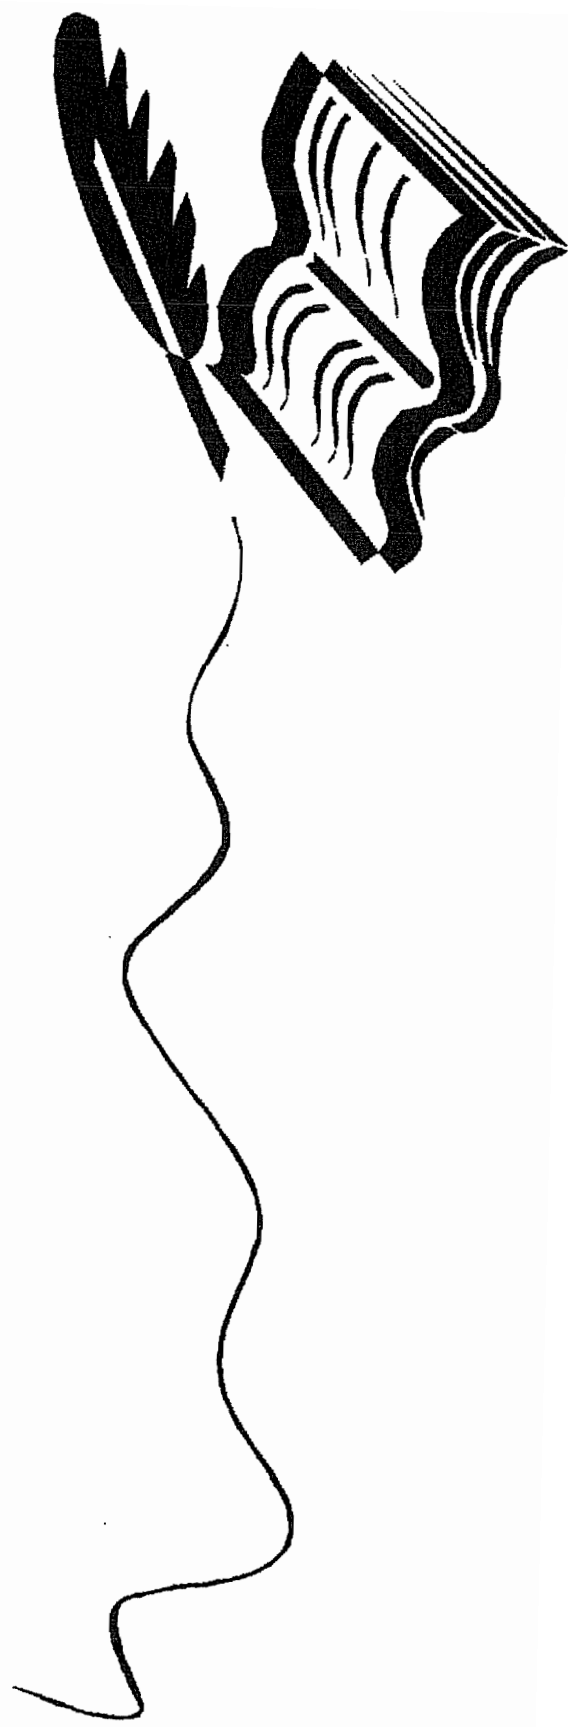

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY # 0009
 FACILITY: MIDDLEBURG ELEMENTARY SCHOOL
 3958 MAIN STREET
 MIDDLEBURG, FLORIDA 32068
 INSPECTION DATE: November 3, 2005
 INSPECTOR'S SIGNATURE: *Ed Swearingin* DATE: Nov 3, 2005


TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	1	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	4	MISSING EMERGENCY LIGHT	X							FBC 423.17.1
		FIRE ALARM BOX COVER MISSING	X							NFPA-70 314.1
	7	EXIT LIGHT OUT		X						FBC 1016.3.1
	13	FIRE ALARM BOX COVER MISSING	X							NFPA-70 314.1
	15	ELEC/ALARM BOX COVERS MISSING	X							NFPA-70 314.1
2	2	EXIT LIGHT OUT		X						FBC 1016.3.1
	4	EXIT LIGHT OUT		X						FBC 1016.3.1
	7	FIRE ALARM COVER MISSING	X							NFPA-70 314.1
3	*****	NO EMERGENCY LIGHTS WHOLE BUILDING	X							FBC 423.17.1
	4	ELEC,PHONE,TV,FIRE ALARM BOXES NO COVERS	X							NFPA-70 314.1
4	18	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	19	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	20	EMERGENCY LIGHT OUT		X						FBC 423.17.1

MONTCLAIR

ELEMENTARY SCHOOL

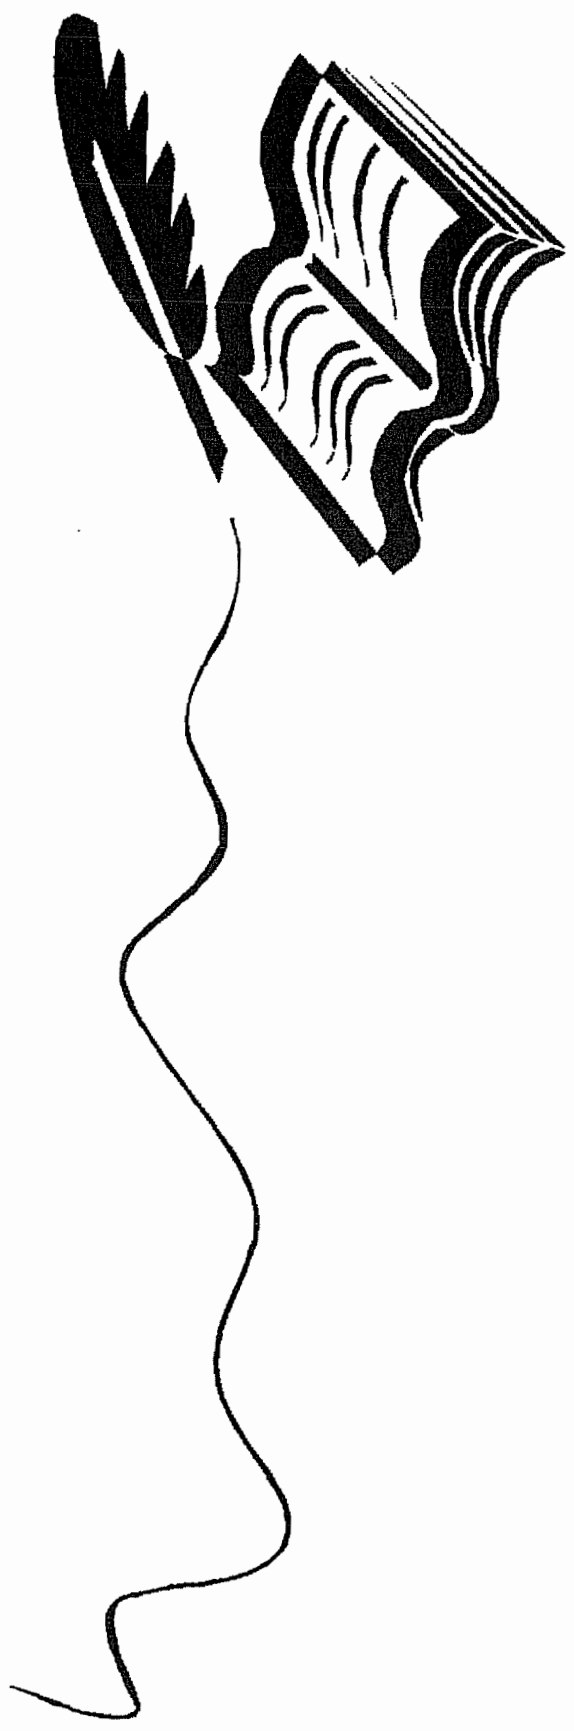

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL
2398 MOODY ROAD
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: NOVEMBER 8, 2005

INSPECTOR'S SIGNATURE: *Ed Sweetland* DATE: Nov 8, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	435a	EXIT LIGHT OUT		X						FBC 1016.1
	436a	EXIT LIGHT OUT		X						FBC 1016.1
	407	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	***	EXTERIOR BUILDING NUMBERS MISSING	X							
5	***	EXTERIOR BUILDING NUMBERS MISSING	X							
	516	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

ORANGE PARK

ELEMENTARY SCHOOL

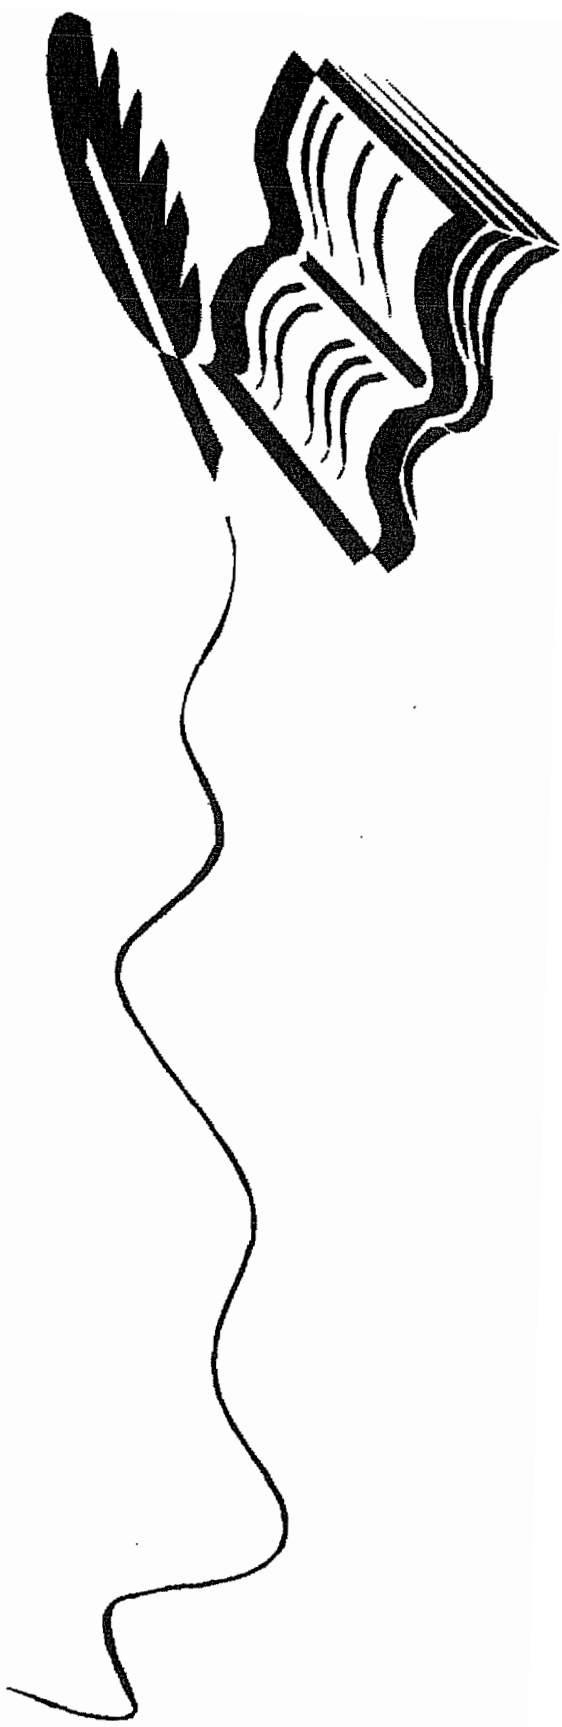

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 4

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0004


FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 10, 2005

INSPECTOR'S SIGNATURE: *Carl Sweetman*
DATE: Nov 10, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS"	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	12	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
1	13	ELECTRIC BOX COVER MISSING	X							NFPA-70 314.1
1	11	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
1	5	MOVE OCCUPANCY LOAD SIGN INSIDE		X						FBC 423.16.2
1	810	TURN EXIT SIGN		X						FBC 1016.3.1
4	83	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.16.2
4	84	SOUND SYSTEM PANEL COVER MISSING	X							NFPA-70 314.1
5	70	EMERGENCY LIGHTS MISSING	X							FBC 423.17.1
5	71	EMERGENCY LIGHTS MISSING	X							FBC 423.17.1
3	8	EMERGENCY LIGHTS MISSING	X							FBC 423.17.1
3	9b	EMERGENCY LIGHTS MISSING	X							FBC 423.17.1
3	9b	2" STEP DOWN AT DOOR	X							FBC 11-4.13.8
7	74	EMERGENCY LIGHT OUT		X						FBC 423.17.1

R.M. PATTERSON ELEMENTARY SCHOOL

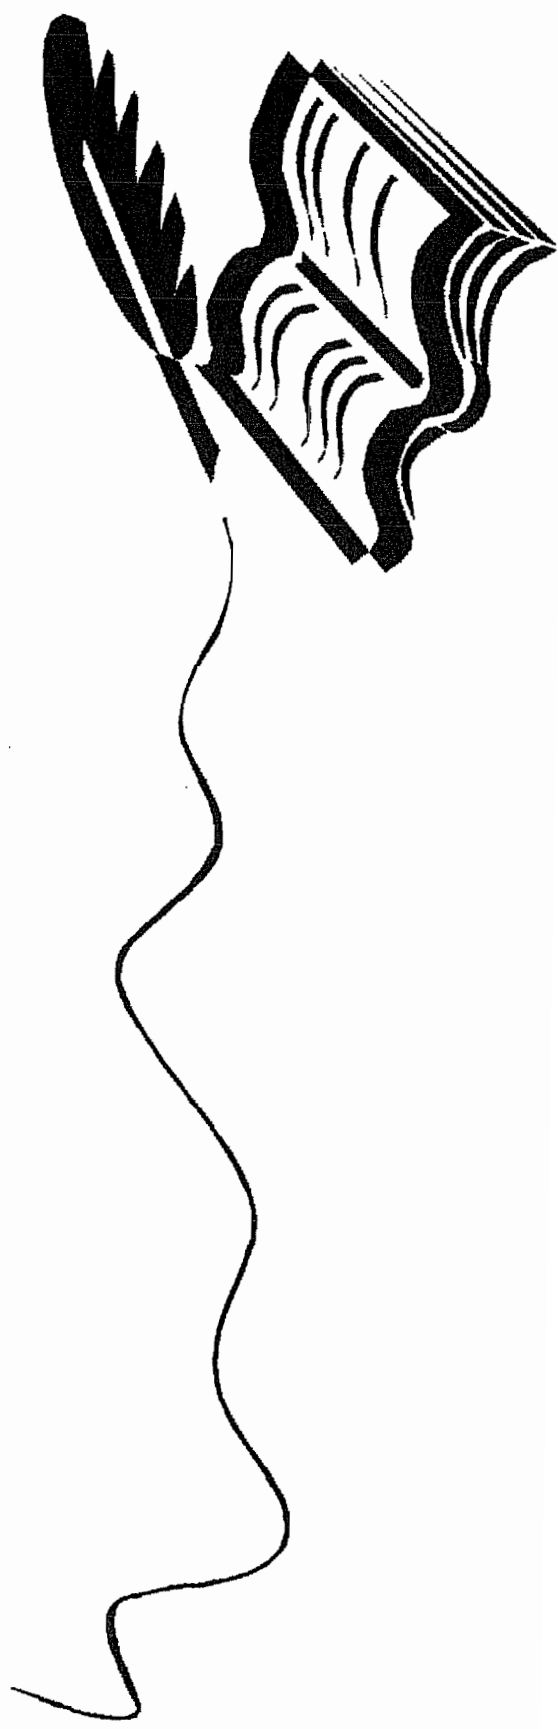

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003


INSPECTION DATE: NOVEMBER 15, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: Nov 15, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	142	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.16.2
	122	CLASSROOM NOT BY DESIGN CHANGE DOOR SWING			X					
3	312	CLASSROOM NOT BY DESIGN CHANGE DOOR SWING			X					
5	508	EXIT LIGHT OUT		X						FBC 1016.3.1

RIDDFOOT

ELEMENTARY SCHOOL

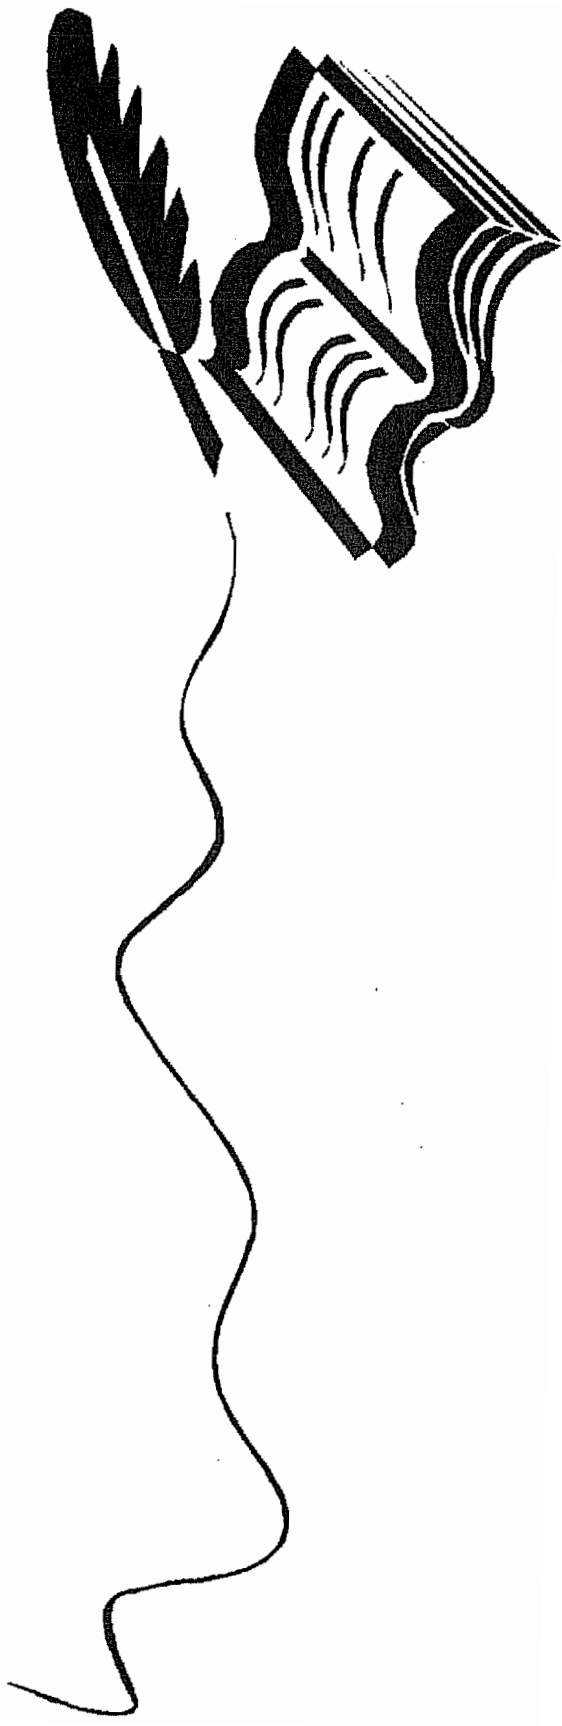

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: November 17, 2005


Col Sweetman
INSPECTOR'S SIGNATURE

Nov. 17, 2005
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	20	HOOD NOT DUCTED TO EXTERIOR	X							FBC 423.24
		FIRE EXTINGUISHER NOT WITHIN 15ft OF COOKTOP		X						69A-36
	21	HOOD NOT DUCTED TO EXTERIOR	X							FBC 423.24
		FIRE EXTINGUISHER NOT WITHIN 15ft OF COOKTOP		X						69A-36
	23	HOOD NOT DUCTED TO EXTERIOR	X							FBC 423.24

RIDDGEVIEW

ELEMENTARY SCHOOL

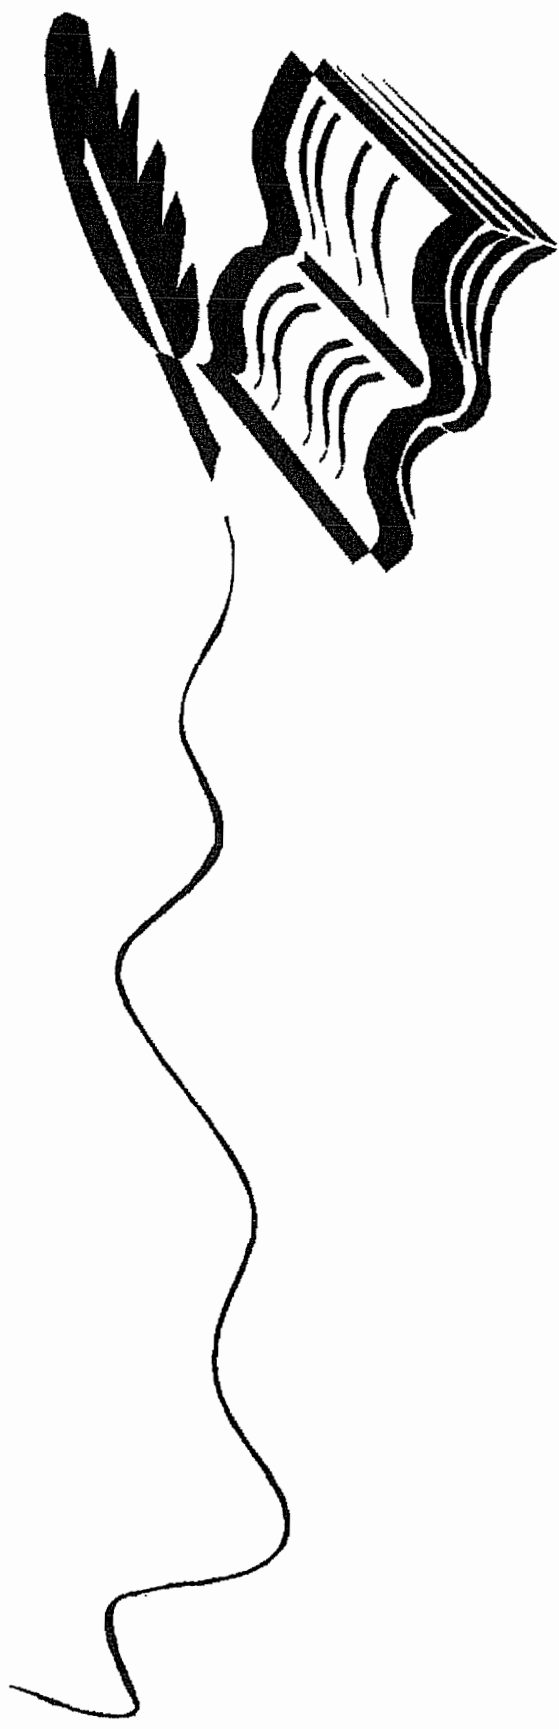

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: NOVEMBER 22, 2005

INSPECTOR'S SIGNATURE: *Ed Swettan* DATE: Nov 22, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	****	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
	****	FIRE EXTINGUISHERS NOT SIGNED		X						69A-36
	129	EXIT LIGHT OUT		X						FBC 1016.1
	108	FIRE EXTINGUISHER NOT BY COOKTOP max 15ft		X						69A-36
6	****	FIRE EXTINGUISHERS NOT SIGNED		X						69A-36
	601	FIRE EXTINGUISHER NOT BY COOKTOP max 15ft		X						69A-36
	602	FIRE EXTINGUISHER NOT BY COOKTOP max 15ft		X						69A-36
	603	FIRE EXTINGUISHER NOT BY COOKTOP max 15ft		X						69A-36
	604	FIRE EXTINGUISHER NOT BY COOKTOP max 15ft		X						69A-36
7	708	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: NOVEMBER 22, 2005

INSPECTOR'S SIGNATURE: *Carl Swartz* DATE: Nov 22, 2005

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

TYPE OF INSPECTION

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS"	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	*****	FIRE EXTINGUISHERS NOT SIGNED		X						69A-36
	713	DETECTORS IN RESTROOMS NOT HOOKED UP	X							
	714	DETECTORS IN RESTROOMS NOT HOOKED UP	X							
	734	DOOR SWINGS IN THE WRONG DIRECTION	X							FBC 423.16.1
	736	TV NOT SECURED TO BOOKCASE		X						
	741	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	742	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	743	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	744	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	746	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	748	REPLACE NON SKID ON RAMP		X						FBC 1013.9
	772	EMERGENCY LIGHT OUT		X						FBC 423.17.1
		FIRE EXTINGUISHER NOT INSTALLED		X						