


# S. BRYAN JENNINGS ELEMENTARY SCHOOL



FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58

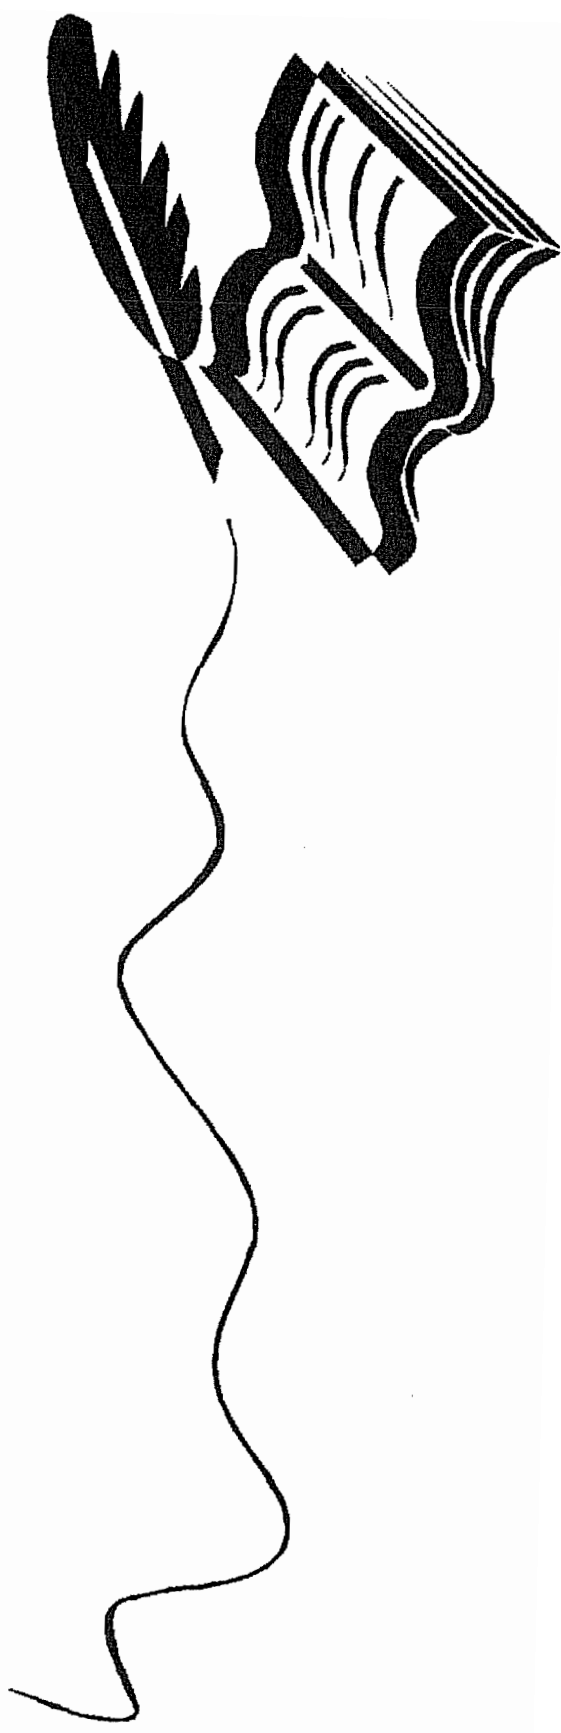

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:   X   NUMBER OF DRILLS PERFORMED:   5  

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL  
215 CORONA DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: DECEMBER 1, 2005

  
 INSPECTOR'S SIGNATURE    Dec 1, 2005  
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	29a	COMMUNICATION COVER MISSING	X							NFPA-70 314.1
1	30a	ELECTRIC PANEL COVER MISSING	X							NFPA-70 314.1
1	30a	10"+/- HOLES IN WALL TO BOILER ROOM	X							
1	33	ELECTRIC PANEL COVER REMOVED	X							NFPA-70 314.1
1	33	LIGHT OUT AND COVER MISSING		X						
1	34d	LIGHT COVER MISSING INCAND. BULB	X							
1	34e	LIGHT COVER MISSING INCAND. BULB	X							NFPA-70
1	32b	INCAND. BULB NEEDS FLOOD BULBS		X						NFPA-70
3	42	RETURN AIR GRILLE @ CEILING FILLED W/TRASH		X						
2	44	RETURN AIR GRILLE @ CEILING FILLED W/TRASH		X						
2	43	ELECTRIC BOX MISSING KNOCK OUT HIGH ON WALL	X							NFPA-70 314.1
2	48a	BATHROOM LIGHT OUT		X						

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:   X   NUMBER OF DRILLS PERFORMED:   5

TYPE OF INSPECTION

DISTRICT: CLAY    FACILITY #: 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL  
215 CORONA DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: DECEMBER 1, 2005

  
 INSPECTOR'S SIGNATURE    DATE: Dec 1, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
5	5c	BATHROOM LIGHT OUT		X						
5	8c	BATHROOM LIGHT OUT		X						
5	8d	BATHROOM LIGHT OUT		X						
6	9d	BATHROOM LIGHT OUT		X						
6	12c	BATHROOM LIGHT OUT		X						
7	17c	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	22d	EXHAUST FAN NOT WORKING	X							FBC 423.15.4
9	21e	COMMUNICATION BOX COVER MISSING TV	X							
9	23d	EXHAUST FAN NOT WORKING	X							FBC 423.15.4
9	24a	EXTENSION CORD THROUGH DOORWAY		X						
4,5,6,	*****	BLDG CLASSROOMS NO EMERGENCY LIGHTS								FBC 423.17.1
7,8,9	*****	BLDG CLASSROOMS NO EMERGENCY LIGHTS								FBC 423.17.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION  ANNUAL RELOCATABLE BUILDING INSPECTION  
FIRE DRILL LOG:  X NUMBER OF DRILLS PERFORMED: 5

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY # 0012

FACILITY: S. BRYAN JENNINGS ELEMENTARY SCHOOL  
215 CORONA DRIVE  
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: DECEMBER 1, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: Dec 1, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	ELECTRIC PANEL BLOCKED BY FILE CABINET		X						NFPA 70, 26.1
92	34	EMERGENCY LIGHT OUT		X						FBC 1006.2
92	79	EMERGENCY LIGHT OUT		X						FBC 1006.2

**SWIMMING PEN CREEK**

**ELEMENTARY SCHOOL**

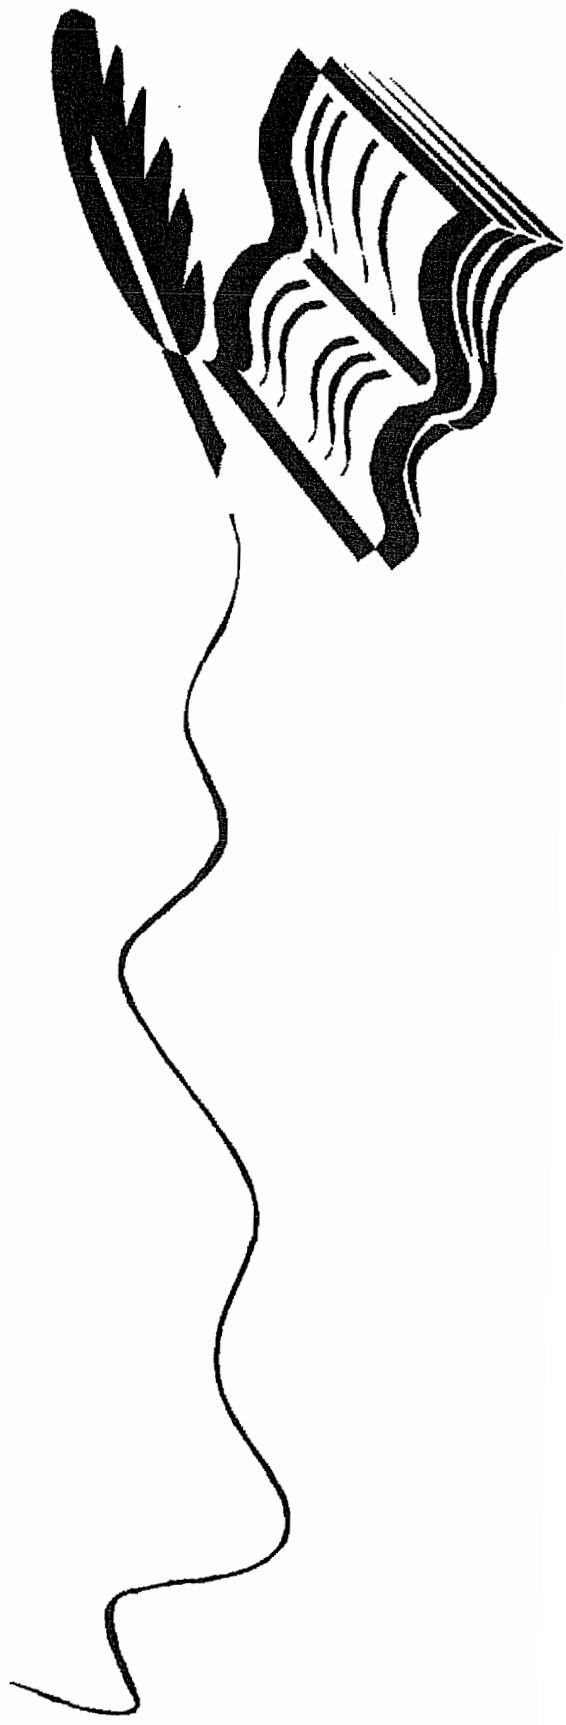

FISCAL YEAR 2005-2006



**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT BUILDING INSPECTION  ANNUAL RELOCATABLE BUILDING INSPECTION  
FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0012

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL  
1630 WOODPECKER LANE  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 19, 2006

*Larry F. Anderson*  
INSPECTOR'S SIGNATURE DATE 1-19-06

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	102	FIRE ALARM PANEL TAG NOT CURRENT	X							69A-58.008
2	228	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
4	433	CLASSROOM NOT BY DESIGN - SECONDARY EXIT REQUIRED			X					FBC 423.13.1
2	203	CLASSROOM NOT BY DESIGN - SECONDARY EXIT REQUIRED			X					FBC 423.13.1
5	533	CLASSROOM NOT BY DESIGN - SECONDARY EXIT REQUIRED			X					FBC 423.13.1
6	627	CLASSROOM NOT BY DESIGN - SECONDARY EXIT REQUIRED			X					FBC 423.13.1
6	630	ROOM NUMBER SIGN NOT CORRECT. SAYS 627 BUT IS ACTUALLY 630		X						FBC 423.14.2.3

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0012

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL  
1630 WOODPECKER LANE  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 19, 2006

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 1-19-06


TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION  ANNUAL RELOCATABLE BUILDING INSPECTION  
FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	801	FIRE EXTINGUISHER NOT CURRENT		X						NFPA 10
92	804	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	806	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	807	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	809	TV NOT ON BRACKET		X						

**THEUNDERRBOLLT**

**ELEMENTARY SCHOOL**

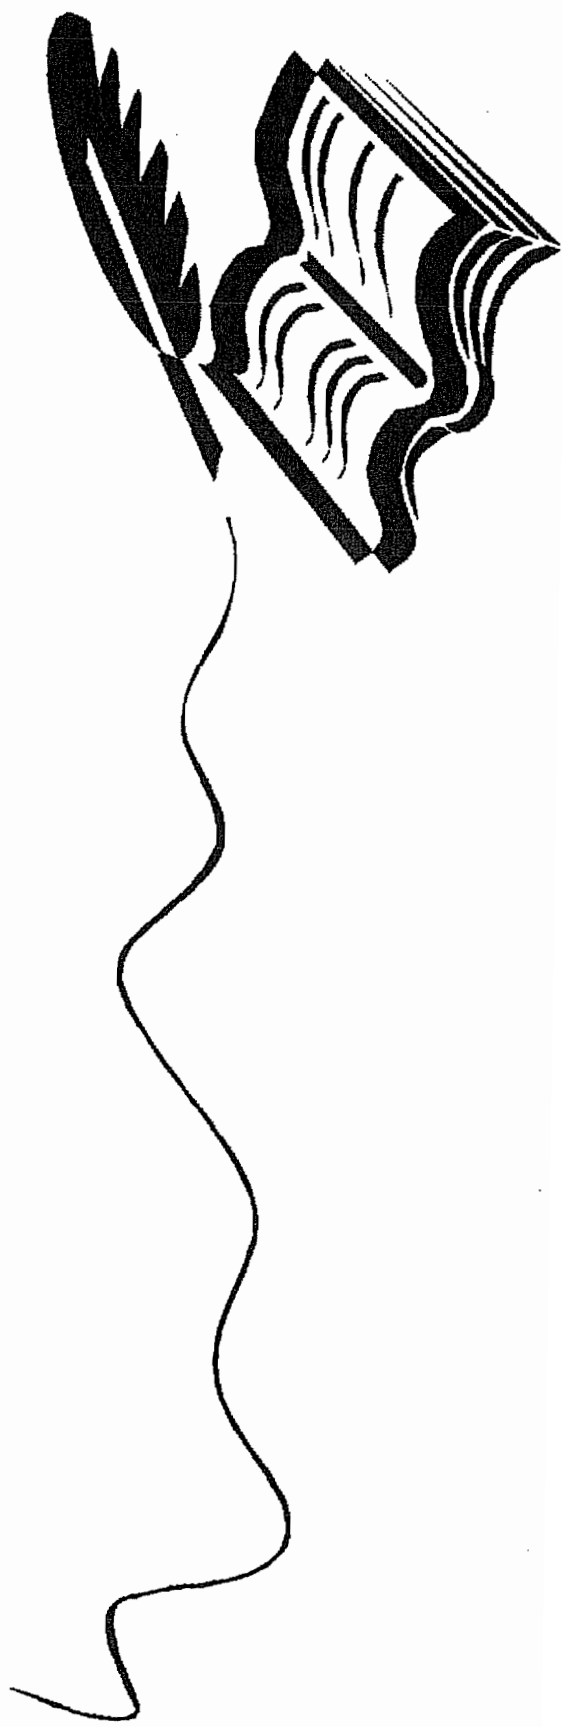



FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY    FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL  
2020 THUNDERBOLT ROAD  
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 8, 2005

INSPECTOR'S SIGNATURE: *[Signature]*  
DATE: Dec. 8, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	262	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	247	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	231	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	236	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	239	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	240	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	244	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	245	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
 FOR EDUCATIONAL FACILITIES  
 FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION     ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY    FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL  
 2020 THUNDERBOLT ROAD  
 ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 8, 2005

INSPECTOR'S SIGNATURE: *Ed Swartz*    DATE: Dec. 9, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	708	AC UNIT NEEDS PADDING BY RAMP	X							FBC 1003.2
92	721	ELECTRICAL PANEL COVERED WITH POSTERS		X						NFPA 70.26.1