
Oakleaf School



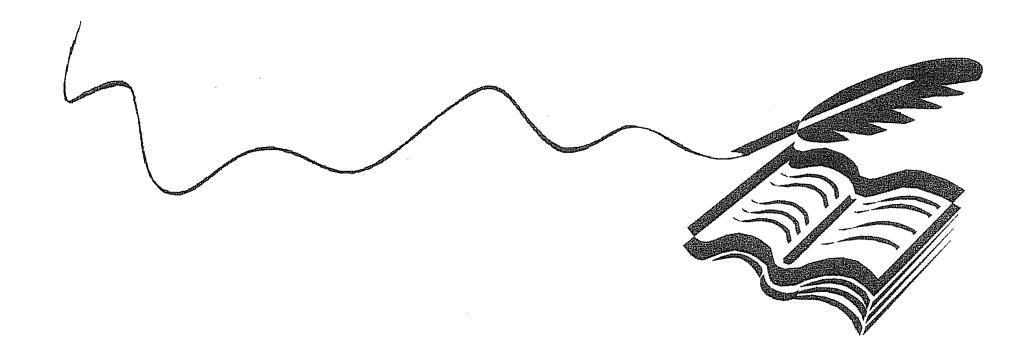

COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	FACILITY	#: 0611	
:				

FACILITY: OAKLEAF SCHOOL

4085 PLANTATION OAKS BOULEVARD ORANGE PARK, FLORIDA 32065

INSPECTION DATE: DECEMBER 3, 2008

Aurest Signature Date

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	213	MAGNETIC DOOR HOLDER BROKEN	Х							FBC 705.1.3.2.3
1	226	SEAL AROUND SPRINKLER PIPE IN FLAMMABLE STORAGE ROOM	X							
1	111A	STORAGE TO HIGH IN CLOSET		Х						NFPA 13.8.5.5.3
1	909	DOOR SWINGS IN WRONG DIRECTION, CURRENTLY BEING USED AS A CLASSROOM	X							
1	419	STOARGE TO HIGH IN CLOSET		Х						NFPA 13.8.5.5.3
5 5	505	OCCUPANCY LOAD SIGN MISSING		Х						FBC 423.14.2.2
2	501	ROOF LEAK	Х							
				1						



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DIGING	OLAT TAOLITY
	_
FACILITY:	OAKLEAF SCHOOL
	4085 PLANTATION OAKS BOULEVARD


ORANGE PARK, FLORIDA 32065

DISTRICT: CLAV FACILITY# 0611

INSPECTION DATE: DECEMBER 3, 2008

SPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rüle
92	601	ОК								
. 92	602	OK								
92	603	ок								
. 92	604	OK								
92	605	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	606	OK								
92	607	ок								
92	608	OK	(1) (1) (1) (1) (1) (1) (1) (1) (1) (1)							
92	609	ок								
92	610	OK								
92	611	ок								
⊵ 92	612	ок								
92	613	ок								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

 DISTRICT:_	CLAY FACILITY#: 0611
EA OU ITV	
FACILITY:	OAKLEAF SCHOOL
	4085 PLANTATION OAKS BOULEVARD
	ORANGE PARK ELORIDA 32065

INSPECTION DATE: DECEMBER 3, 2008

New from 13
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	614	ок								
92	616	OK								
92	617	ок								
92	618	OK								
92	619	RAMP EXCEEDS 1/12 SLOPE						2		FBC 11-4.8
92	620	OK				7.				
92	701	ОК								
.92	702	OK								
92	703	ок								-
92	704	OK								
92	705	ок								
92	706	OK								
92	707	ок								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	úr.			na.		10	15		100			1-6-7		199								11	×., .		14.5		. 7			 - 1		300	1		1 2 4	256	1103	23.7		S		्
4		ı,	0	7	_	10	٠,	٠.	**	•	11	. ^	. \/				4-7.					_	A.	^	11	ı.	•	v	44		200	201	$\cap c$	24	11	1						Э,
1	L	"	3	ш	≺	ľ		- 1	20		غاد		١T	20.0		1	633	. 100				- /	ч.	Ū	11	-1		1	#		: B.	-112	Ut)			والمعرفة	~~~	, in the			
	-		-									_				_				<u></u>	11	7		- 7	.,	77.	58		-75.	 ••••				-		_				_		 57
	1,50	87					: ())			186					30.10			Ŀ.	39.	20		20	-11				16:				100			Sec.			137	21.7	4 :-	200	- 19	
	der.		10.4		11.5		11.5	70		CLAY FACILITY#: 0611																																

FACILITY: OAKLEAF SCHOOL

4085 PLANTATION OAKS BOULEVARD ORANGE PARK, FLORIDA 32065


INSPECTION DATE: DECEMBER 3, 2008

INSPECTOR'S SIGNATURE

15 5-08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	708	ОК			3000 31 (1.33) 50 50 115.	3,7 27 27 27				
92	709	OK								
92	710	ок								
92	711	OK								
92	712	ок								
92	713	OK								
92	714	ок								
92	715	ОК			671					
92	716	ок								
92	801	RAMP EXCEEDS 1/12 SLOPE	X					2		FBC 11-4.8
92	802	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	803	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	804	ОК								

OAKLEAF SCHOOL 2008-09 SREF REPORT



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DIS	TRIC	Τ:	CLA	Υ		F	AC	LIT	/ #:	061	1		
2				SUNTA SUN NANCELE		8.55 M								

FACILITY: OAKLEAF SCHOOL

4085 PLANTATION OAKS BOULEVARD ORANGE PARK, FLORIDA 32065


INSPECTION DATE: DECEMBER 3, 2008

INSPECTOR'S SIGNATURE

15-501

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	805	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	806	RAMP EXCEEDS 1/12 SLOPE	X					2		FBC 11-4.8
92	807	ок								
∵ '92	809	OK								
92	810	ок								
92	811	RAMP EXCEEDS 1/12 SLOPE	X					2		FBC 11-4.8
92	812	ок								
92	813	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	814	ок								
92	815	OK.								
92	816	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	816	EMERGENCY LIGHT OUT	×							FBC 423.17.1
92	817	ОК								

OAKLEAF SCHOOL 2008-09 SREF REPORT



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

î	DIST	RICT	r· c	LAY		F	ACIL	ITY #	Ŀ	061	1		
ં				ya ya ga ti (y eya il	1. p. 1. 187 (1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1.	100			7.00	24-14-6491-1	10000000000	124 (14.12)	•
N							0 - 10 - 10 - 10 - 10 - 10 - 10 - 10 -		2011				

FACILITY: OAKLEAF SCHOOL

4085 PLANTATION OAKS BOULEVARD ORANGE PARK, FLORIDA 32065


INSPECTION DATE: DECEMBER 3, 2008

INSPECTOR'S SIGNATURE

1 - 3.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	818	EMERGENCY LIGHT OUT	Х				***************************************			FBC 423.17.1
. 92	821	NO EVACUATION SHEET		x						FBC 423:14:24
92	821	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11-4.8
92	822	OK								
92	823	ок								
92	824	EVACUATION SHEET MISSING		X						FBC 423 14.2.4

OAKLEAF SCHOOL 2008-09 SREF REPORT



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY#:_	0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 14, 2009

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv: "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ок			:					
2		oK								
3		ОК								
4	87	OUTLET COVERS MISSING @ STAGE		Х						NFPA 70
5		ОК								
7		OK								

						_				
	2.5.2			7.00						





COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	ORANGE PARK ELEMENTARY SCHOOL
	1401 PLAINFIELD AVENUE
	ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 14, 2009

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	21	ок								
92	-22A	OK								
92	22B	ОК								
92	34	OK								
92	35	ок								
92	- 36	OK								
92	37	ок								
92	38	OK							94	
92	39A	ок								
92	39B	OK								
92	41	ок								
92	42	OK		10 mg						

ORANGE PARK ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101


FACILITY:	ORANGE PARK ELEMENTARY SCHOOL 1401 PLAINFIELD AVENUE ORANGE PARK, FLORIDA 32073
INSPECTIO	N DATE: <u>JANUARY 14, 2009</u>

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	ок								
92	44	OK								
92	45	ОК								
92	.50	EMERGENCY LIGHT NOT WORKING		×						FBC 423.17.1
92	51	ок				ŧ				
92	52	ОК								
92	53	ок								
= 92	54	OK	15 To 16 To							

ORANGE PARK ELEMENTARY SCHOOL 2008-09 SREF INSPECTION

CERENTIII SUUSI





COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

ć.			50	10			4		3		÷			J,	ø	9×	Æ,	13	8	13		Ų.			ì.			i,				Ü	'n.			1	ď		ŧ,			ď	3				2	٠.	e.	-	îX,			2	×	Ġ			Ź		Ž.			43		Ġ					2.			sé.			
3	L	ì	C	:	T	F	5	l	٢	٠,	ī	٠		í	۲	•	Ŀ	1	Δ	١	1	×		í,		i.	'n	à		4	Ġ	X	1	ě	3	1		F	.,	L	V.	C	•	ı	ı	à	ľ	1	1	Y	1	£	Ł		Ŷ			Ĝ		Ť	٦	ſ	۱	2	Z	1	-		ű,	í.			4	÷			
3	•				•		•		-		•	٠.	_	- 1	<u>~</u>	_	느	_	_`	_	_		_	-		4	-	3		43		_	~	-	-	¥	4		5		•		1			-	•	•	23	Я.		"							7"	٠.'	_	_	_	-	-	1	312	0.7	- 10		7	 *	3	1.4	 ٠.		
1		***	160		. e.			16		33	2		10					25	2.	245		4							4				١.			۶,		90	72				٠,			2					٧.	1	9	0	1,	30	25	100		1			33	15	100	. 4							d			 	

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL

5400 PINE AVENUE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 22, 2009

INSPECTOR'S SIGNATURE

OATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	113	STORAGE IN ELECTRICAL CLOSET – REMOVE		Х				11. That were \$1 to \$4.		NFPA 70
1	122	CLASSROOM NOT BY DESIGN - CHANGE DOOR SWING OR STOP USING AS CLASSROOM		Х						FBC 423
1	134	STORAGE IN MECHANICAL ROOM – REMOVE		Х						FMC
1	133	STORAGE IN ELECTRICAL ROOM - REMOVE		X						NFPA 70
2	208	STORANGE IN MECHANICAL ROOM – REMOVE		Х						FMC
3		OK								
4		ок								
5	526	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.2
6	622	EMERGENCY EVACUATION SHEET MISSING		х						FBC 423.14.2.2
6	630	EMERGENCY LIGHT NOT WORKING		X						FBC 423:17.1
										000

CERENTIN SIGN





COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

 Ì	D	K	S	T	F	31	(;	T		C	,		Α	1	1							F	1	۱	(•	11	L	ľ	T	٦	1	#				C	()2	24	4						
 W.												Ş	į,												7					1						7						1				Ť,	Ì	9

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL

5400 PINE AVENUE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE:	JANUARY 22, 2009

SPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	113	STORAGE IN ELECTRICAL CLOSET – REMOVE		Х						NFPA 70
1	122	CLASSROOM NOT BY DESIGN – CHANGE DOOR SWING OR STOP USING AS CLASSROOM		X						FBC 423
1	134	STORAGE IN MECHANICAL ROOM – REMOVE		Х						FMC
1	133	STORAGE IN ELECTRICAL ROOM - REMOVE		X						NFPA 70
2	208	STORANGE IN MECHANICAL ROOM – REMOVE		Х						FMC
3		OK								
4		ОК								
5	526	EMERGENCY EVACUATION SHEET MISSING		Χ						FBC 423.14.2.2
6	622	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.2
6	630	EMERGENCY LIGHT NOT WORKING		X						FBC 423:17.1
								, es 101 % 14		

PATTERSON ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

n	CTRICT	. OI A			ν/ ш. /	1004	
,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	STRICT	LJA	Y	FACILIT	Y 22 1	0024	
_	U 1 1 1 1 U 1				1 77	/VLT	
	The Mark Tall Control of the	ALCOHOLOGICAL TOP AND ADMINISTRATION OF THE PARTY OF THE	The state of Artist (1987).			the media to the late of the state of the	

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL 5400 PINE AVENUE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 22, 2009

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	ок								
92	2	OK								
92	3	ок								
92	4A&B	OK								
92	5	ок		:						
92	6	OK								
92	11	ОК								
92	13	OK								
92	14	ОК								
92	15	OK								
92	16	ОК								
92	18	OK								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

-	DISTRICT: (CLAY	FACILITY:	#: 0024	
-	PART OF PERMIT				ALTERNATION STATE OF THE STATE

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL

5400 PINE AVENUE

ORANGE PARK, FLORIDA 32003

INSPECTION DATE: <u>JANUARY 22, 200</u>	I DATE: JANUARY 22, 2009
---	-----------------------------

PECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	23	ок								
92	24	OK								
92	25	ОК								
92	26	OK								
92	27	SPINDLES MISSING ON RAMP GUARDRAIL	,	Х						FBC 1006
92	28	OK								
92	29	ОК								
92	30	OK								
92	41	ок								
92	42	OK			75.0					
92	43	ОК								
92	44	ОК						t aves (laces		



"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

						1		193					 100			7			300	5.4	1,143		1	100	5.										
		C	т	R	10	• •		-	\sim		١,	1				4.5	E	٠,		• 11		T١	1 .	H-		40	n	าว	M				150		
9	U	v):1:	\mathbf{r}	ľ	, 1	14 X	10.	U		1		 		W.	17.		•	\cdot	11				η,	X		U	JZ	.4	1		200	211	7 1	
Ä			1100			11	100	400	13.15	42.3	5.20	1000		4	pite.				100			200	100	the:	 177.	100	1.70	113	100	1	 9.35	San -	Section.	2113	:

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL

5400 PINE AVENUE

ORANGE PARK, FLORIDA 32003

INS	PÉ	C	ΓIC	M	Ð,	A'	TI	Ξ:	JANUARY 22, 2009

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. Fac	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	45	ОК								
92 -	46	OK								
92	47	OK								
92	48	OK								
92	49	OK								
92	50	EMERGENCY LIGHTS NOT WORKING		X						FBC 423.17.1
92	51	ок								
92	52	OK								
92	53	ок								
92	54	OK		100						
										E

CERENTILI SOCI





COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	RIDGEVIEW ELEMENTARY SCHOOL
· ACILII I I	421 JEFFERSON AVENUE
	ORANGE PARK, FLORIDA 32065

SPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	1 Maria 2 September 1 Maria 2	ОК								
2	223	EXIT LIGHT NOT WORKING		Х						FBC 1016.3
2	201	EXIT LIGHT NOT WORKIGN		Х						FBC 1016.3
- 3		OK					1 10 294 3 1 2 3 4 5		1	
4	401	CONTROL WIRES NOT IN ELECTRICAL BOX	Х							
6	616	STORAGE IN MECHANICAL ROOM		Х			2000 2000 2000 2000 2000			NFPA 70
6	621	STORAGE IN ELECTRICAL ROOM		Х						FBC 423.14.3
6	607	TV TOO LOW - NEEDS PADDING		X						FBC 423,.14,3
7	703	TV TOO LOW - NEEDS PADDING		Х						FBC 423,.14,3
7	704	TV TOO LOW - NEEDS PADDING		X						FBC 423,.14,3
7	705	TV TOO LOW – NEEDS PADDING		Х	1					FBC 423,.14,3
7	706	TV TOO LOW - NEEDS PADDING	8:07	X						FBC 423,.14,3
7	707	TV TOO LOW - NEEDS PADDING		Х						FBC 423,.14,3



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT: CLAY FACILITY #: 0020
	FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE ORANGE PARK, FLORIDA 32065
77	INSPECTION DATE: FEBRUARY 16, 2009

DATE

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
7	702	32 " MIN WIDTH CLEARANCE @ BACK DOOR		Х						FBC 423.20.1
7	708	32 " MIN. WIDTH CLEARANCE @ BACK DOOR		Х						FBC 423.20.1
7	711	BLANK COVERS MISSING @ CEILING BOXES		Х						NFPA 70
7	712	BLANK COVERS MISSING @ CEILING BOXES		. X						NFPA 70
		·								
							-5		4	
						217.7				
3.25										



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT: CLAY FACILITY #: 0020
	FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE ORANGE PARK, FLORIDA 32065
7	INSPECTION DATE: FEBRUARY 16, 2009

DATE

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	711 A&B	ок								
92	712	ОК								
92	713	ок								
92	714	OK								
92	715	ок								
92	716	COVER MISSING ON LIGHT		X			Section (Section)			NFPA 70
92	717	ок								
92	718	OK								
92	728	ок								
92	729	OK:	200 ANG 200 ANG 200 ANG							
92	730	ок								
92	731	OK								
92	732	ОК								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:	CLAY FAC	:ILITY #: 00	20
	FACILITY:	RIDGEVIEW ELEME 421 JEFFERSON AV		DL
		ORANGE PARK, FLO		
9	INSPECTIO	N DATE: <u>FEBRUAR</u>	Y 16, 2009	
-	Laure	The	3	.1609
/	MSPECTO	R'S SIGNATURE	DATE	•

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	733	ОК								
վ- 92	734	OK								
92	735	ОК								
92	736	OK								
92	737	ОК								
92	738	OK								
92	741	ОК								
92	742	OK								
92	743	ОК								
.92-	744	OK								
92	745	ОК								
:⊴ 92	746	OK								
92	747	ок								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	
FACILITY:	RIDGEVIEW ELEMENTARY SCHOOL
	421 JEFFERSON AVENUE
	ORANGE PARK, FLORIDA 32065

INSPECTOR'S SIGNATURE

No. of Info. **Scheduled** Fac. Deficiency Description and Corrective Action times Rule Maint. Oper. Serv. Building Room Cost for "O" "C" Required: Def. "I.S." Correction Cited 748 OK 92 OK 92 749 92 750 OK 92 751 OK 92 752 OK 92 753 OK. 92 754 OK 92 OK. 755 92 756 OK 92 757 OK 92 758 OK 92 759 OK 92 760 OK OK 92 772

EMENTALIA SI



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	S.B. JENNINGS ELEMENTARY SCHOOL
	215 CORONA DRIVE
	ORANGE PARK, FLORIDA 32073

DISTRICT: CLAV FACILITY#


INSPECTION DATE: JANUARY 23, 2009

INSPECTOR'S SIGNATURE

DATE

0012


Building	Room.	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK	42 1024 (347 - 6.25 - 15.75)			1 11 11 12 12 12 12 12 12 12 12 12 12 12				
2		OK								
3	42A	LIGHT GLOBE MISSING		Х						NFPA 70 401.3
4		OK								
5		ок								
6	13A	HOLES IN ROOF	X							
7		ок								
8	17E	FIRE ALARM BOX OPEN		X						NFPA 70 110.26
9		ок						;		



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:_	CLAY	FA	CILITY#	. 0012	
	FACILITY:	215 COF	NNINGS EL RONA DRIV E PARK, FL	E)L
,	INSPECTIO	N DATE:	JANUAR	Y 23, 200	9	
_	K	111		/	102 A	7

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	ОК								
92	27	OK								
92	28	ок								
92	29	OK								
92	30	ок								
92	32	OK								
92	33	ок								
92	34	OK								
92	35	ок								
92	36	oK								
92	37	ок								
92	38	ок								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101


DISTRICT.	CLAT FACILITY
FACILITY:	S.B. JENNINGS ELEMENTARY SCHOOL
TAGILITY	215 CORONA DRIVE
	ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 23, 2009

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	39	ОК								
92	42	OK								
92	43	ок								
92	44	OK								
92	45	ОК								
92	75	OK								
92	76	ок								
92	77	OK								
92	78	ок								
92	79	OK								
92	80	ок								
92	81	OK								




COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	_ FACILITY#	0053
FACILITY:	SWIMMING PE 1630 WOODPE ORANGE PAR	ECKER LANE	EMENTARY SCHOOL 2068
INSPECTION	ON DATE: JAN	<u>IUARY 27, 200</u>	9 /-27-0 ^G

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ОК								
2,	200	BROKEN OUTLET COVER ON EAST SIDE		x				in the		NFPA 70
2	200	TWO ROOF LEAKS ON NORTH CORNER	Х							
3	312	DESK IN CORRIDOR - REMOVE		X						
4	410	NO EMERGENCY EVACUATION SHEET		Х				3		FBC 423.14.2.4
5		OK			12 - 12 - 12 - 12 - 12 - 12 - 12 - 12 -					
6	627	TEACHERS PLANNING ROOM USED AS CLASSROOM - NO SECONDARY EXIT		x						FBC 423.13.1
	- 4									

FISCAL YEAR <u>2008-2009</u>



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

			33.4	200		100	1.5	10,71			16.1		-151	11.	2.3	15 11	 100	1-5		700						0.75		34114					45	111	æ
	DI	G.	TE	214	~	۳.	77	0	1 /	٩N	•						۸	CI	1	IT	V	#				n	٦٢	3			4.5	#R0		1	
	וט	J	15	۱ij,	·			U		٦,	1913		4.00		-100		<u>س</u> ۱	U I	L	11	1.7	11		y Film		V	<i>J</i>	J		363	10.74	100			÷
٩						10	. 27				1.70	1.12			3.1.1						27	· inte	100	e- 49		1.0		41.19	1.50	110	Sal is	314.9	3.43	7	Ė
				277			1	100	0.00		S	1	1000				 	140		1.5	1	100	i e i		100	400	0.5		1	77 to 42		77		3.0	

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL

1630 WOODPECKER LANE


ORANGE PARK, FLORIDA 32068

INSPECTION DATE: JANUARY 27, 2009

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	ec. Fac. F	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	LIGHT LENSE COVER MISSING		Х						NFPA 70
92	702	EMERGENCY LIGHT NOT WORKING		×						FBC 423.17.1
92	703	EMERERGENCY								FBC 423.17.1
92	7.04	TV IN HAZARDOUS LOCATION – MOVE FROM ENTRY		Χ						
92	705	ОК			:					
92	706	OK								
92	707	ок								
92	708	OK					化多类化 化基类化			
92	801	ок								
92	803	OK			EV 55					
92	804	ок								
92	- 805	OK				¥				

SWIMMING PEN CREEK ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

Ľ)	S	3	T	F	₹	l	C	Γ			3	C)	L	j	Δ	ľ	Y							î	11.6414	0.10		ı	F	٥	Ü	(3	Î	ı	î	-	Γ	١	Y	1	¥			200	100		4	C)(Ö	E	5	3)									440000
						į.			0		7		7		i	3				3	਼	7				-			行法																	0			2			3					Š			2.1 (b)		10			Ī	

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
ORANGE PARK, FLORIDA 32068

INSPECTION DATE: JANUARY 27, 2009

NSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	806	ок								
92	807	OK								
92	808	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
92	809	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	810	ок								
•										
										THE STATE OF THE S

CERENTAL SUCI





COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT: CLAY FACILITY#: 0042
	FACILITY: THUNDERBOLT ELEMENTARY SCHOOL 2020 THUNDERBOLT ROAD ORANGE PARK, FLORIDA 32003
ij	INSPECTION DATE: FEBRUARY 3, 2009

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	126	BREAKER KNOCKOUT MISSING	Х							NFPA 70
1	247	ADD EXIT LIGHTS @ ROOM 270, ROOM 414, CORRIDORS	×							FBC 1006:3
							100			

THUNDERBOLT ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:_	CLAY	FACII	LITY#:	0042
	FACILITY:	THUNDERB	OLT ELEM	VIENTARY	' SCHOOL
	TAGILITY:	2020 THUNI	DERBOLT	ROAD	
		ORANGE PA	ARK, FLOI	RIDA 3200	03
ı	INSPECTIO	N.DATE: FI	EBRUARY	3, 2009	
	Hay	II.			5-3-09
	INSPECTO	R'S SIGNATL	JRE	D	ATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	OK								
92	702	OK								
92	703	ОК								
. 92	704	OK								
92	705	ОК								
92	706	ОК								
92	707	ок								
92	708	OK								
92	709	ок								
92	710	OK					1 m 1 m			
92	711	ок								
92	713	OK			99					

THUNDERBOLT ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT: CLAY FACILITY# 0042
	FACILITY: THUNDERBOLT ELEMENTARY SCHOOL 2020 THUNDERBOLT ROAD ORANGE PARK, FLORIDA 32003
7	INSPECTION DATE: FEBRUARY 3, 2009
	INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. Fac.	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	721	ОК								
- 92	722	OK								
92	723	ок								
92	724	OK	70.0			m12				
92	725	ок								
92	726	OK								
92	727	ок								
- 92	728	OK								
92	729	ок								
92	730	OK			31 m 2					
92	731	ок								
92	732	OK:								

THUNDERBOLT ELEMENTARY SCHOOL 2008-09 SREF INSPECTION




COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101


	DISTRICT: CLAY FACILITY#: 0042
	FACILITY: THUNDERBOLT ELEMENTARY SCHOOL 2020 THUNDERBOLT ROAD
	ORANGE PARK, FLORIDA 32003
7	INSPECTION DATE: FEBRUARY 3, 2009
	Tay 1 9.3-09
l	ÍNSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	733	ОК								
92	734	DOOR STICKS @ STAIR HITS HANDRAIL – SHORTEN HANDRAIL		Х						
92	734	STANDING WATER UNDER BUILDING		Х						
92	735	OK								
92	736	ОК								
92	737	OK								
92	738	ок								
92	739	OK								
92	740	ок								
92	741	OK								
92	742	ок								
92	743	OK								
92	744	ок								

THUNDERBOLT ELEMENTARY SCHOOL 2008-09 SREF INSPECTION

CERTINI SINO

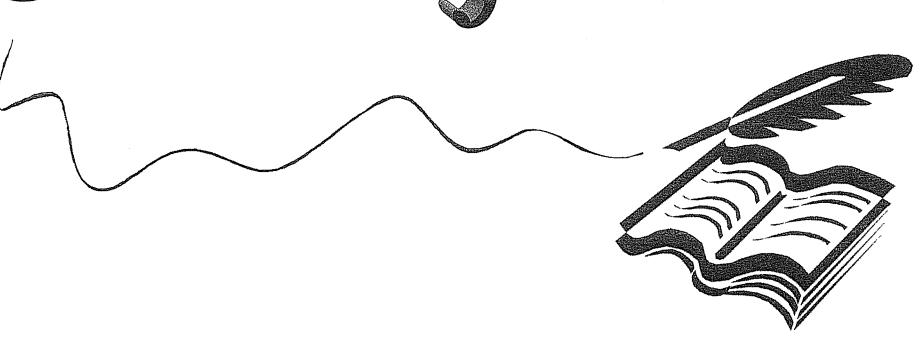



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT	CLAY	FACILITY #	# : 0040)

FACILITY: TYNES ELEMENTARY SCHOOL

1550 TYNES BOULEVARD MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 3, 2009

INSPECTOR'S SIGNATURE

2-3-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	112	ROOF LEAK	Х							
1 1	127	ELECTRICAL WIRE NOT TERMINATED TO PANEL	X							
1	157	EMERGENCY LIGHT OUT	Х							FBC 423.17.1
2		OK								
3	302	NO EMERGENCY EVACUATION SHEET		Х						FBC 423.14.2.4
4		OK								
5		ок								
6		OK								
20		ок								
- 21		OK .								
22		ок								
31		ok								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY #:	0040

FACILITY: TYNES ELEMENTARY SCHOOL

1550 TYNES BOULEVARD

MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 3, 2009

Many # Ju

2.3.09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	ок								
92	2	OK								
92	3	ок								
92	- 4	OK								
92	5	ок								
92	-6	ОК								
92	7	ок								
- 92	. 8	OK								
92	10	ок								
92	21	OK								
92	22	ок								
- 92	23	OK.								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

1	D	IS	T	R	IC	TC		C	L	4)				I	=/	١(CI	L	T	Y	#	Ť,		00)4()			200
	31 (2 31) (2 3)												Z										T.						5

FACILITY: TYNES ELEMENTARY SCHOOL

1550 TYNES BOULEVARD


MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 3, 2009

ANY FULL SIGNATURE

5-3-01

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac, "C"	Info. Serv. "I.S."	Cost	No. of times Def: Cited	Scheduled for Correction	Rule
92	24	ОК								
92	25	OK								
92	26	ок								
92	27	OK								
92	28	ок								
92	29	OK								
92	30	ок								
92	41	OK								
92	43	ок								
92	- 61	OK								
92	62	ок								
92	63	OK								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	TYNES ELEMENTARY SCHOOL	
	1550 TYNES BOULEVARD	
	MIDDLEBURG ELORIDA 32068	

DISTRICT: CLAY **FACILITY #**: 0040

INSPECTION DATE: FEBRUARY 3, 2009

NSPECTOR'S SIGNATURE

2-3-01

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	64	ОК								
92	65	OK								
92	66	RAMP EXCEEDS 1/12 SLOPE	Х					2		FBC 11.4.8
92	67	OK								
92	68	ок								
							13.62.50			



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DI	STR	ICT	: C	LAY		F	AC	ILIT	Y#:	000)6		

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

420 EDSON DRIVE


ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 17, 2009

INSPECTOR'S SIGNATURE

2-17-09

No. of Info. Scheduled **Deficiency Description and Corrective Action** Maint. Fac. times Oper. Rule Building Room Serv. Cost for Required: "M" "O" Def. "I.S." Correction Cited **EMERGENCY LIGHT OUT** 1 Χ FBC 423.17.1 X DRINK FOUNTAIN COVER MISSING 54 1 **EMERGENCY LIGHT OUT** Χ FBC 423.17.1 2 FIRE EXTINGUISHER NOT SIGNED Χ 53 69A-58.008 3 55 **EMERGENCY LIGHT OUT** Х FBC 423.17.1 Χ 4 14A NO COVER ON LIGHT NFPA 70 401.3 4 FIRE EXTINGUISHER NOT SIGNED Χ 69A-58.008 Χ ROOF LEAK 4 58A 4 21 **EMERGENCY EVACUATION SHEET MISSING** Х FBC 423.14.2.4 10 Χ NO COVER ON LIGHT 64 NFPA 70 401.3 10 **EMERGENCY LIGHT OUT** Х FBC 423.17.1



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

277					31.00	100		14	3450			15.70		16.5						111	414	1.0	1.0			2000
	NIC	TC		т.	100	CL	ΛV				11.			`11	IT	v.	4.		(000	10			a tiends		
: L	IJΘ		ıı	4	400	UL	ΑI	1.20			27. / 12.2	ΓI	41) I L			₩.		٠.(ソンし	, O(11.2			100	
100	7.50	4000		100	Jan Street	- h- r'm - r -		4575 4 45	A 14 1 E.	22 June 10		137		200	44.435				-	1000				75	-	
	400	15.25		100	1963	200	. A			1000		4				100		1000	110		0.55		300	11 11		

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

420 EDSON DRIVE


ORANGE PARK, FLORIDA 32073

INSP	EC/TI	ON I	ďΑ	ATE:	FEBRUARY 17, 2009	

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26 A & B	ОК								
92	27	OK								
92	29	RAMP EXCEEDS 1-12 SLOPE	Х					2		FBC 11.4.8
92	30	RAMP EXCEEDS 1-12 SLOPE	X					2		FBC 11.4.8
92	31	RAMP EXCEEDS 1-12 SLOPE	Х					2	;	FBC 11.4.8
92	-32	OK							das	
92	33	ок								
92	34 A&B	OK		172			2-12			
92	36	ОК								
92	37	OK.								



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT	T: CLAY FACIL	LITY#: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL


420 EDSON DRIVE

ORANGE PARK, FLORIDA 32073

INSPECTION	DATE:	FEBRUARY 17, 2009	

VSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	38	ОК								
92	39	OK								
92	40	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	41	OK								
92	42	RAMP EXCEEDS 1-12 SLOPE	х					2		FBC 11.4.8
-92	43	OK					SP 1			
92	47	ОК								
92	48	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	49	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	50	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	51	ок								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	W.E. CHERRY ELEMENTARY SCHOOL
	420 EDSON DRIVE
	ORANGE PARK, FLORIDA 32073

DISTRICT: CLAY FACILITY# 0006

INSPECTION DATE: FEBRUARY 17, 2009

INSPECTOR'S SIGNATURE

21/09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	54	ок								
. 92	55	RAMP EXCEEDS 1-12 SLOPE	X					2		FBC 11.4.8
92	56	ОК								
92	57	ОК								
92	58	ок								
92	59	OK								
92	60	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	62	OK								
92	63	ок								
92	64	OK:								
92	65	ок								
92	66	OK	al substitution Section (1987)		1300					



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	FACILITY	′ #: 0006	
T. (1)				

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL 420 EDSON DRIVE

ORANGE PARK, FLORIDA 32073


INSPECTION DATE: FEBRUARY 17, 2009

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	67	ОК								
92	68	OK								The state of the s
92	69	ОК								
							TANGE			
47.2 47.2 4.2 4.2 4.3 4.3 4.3 4.3 4.3 4.3 4.3 4.3 4.3 4.3										
					3					
				i mani d				127		

ERRAIN SIA





COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	J. L. WILKINSON ELEM	MENTARY SCHOOL
	4966 C. R. 218	A 00000
	MIDDLEBURG, FLORID	DA 32068
_		
INSPECTIO	N DATE: FEBRUARY	18. 2009
Macy 1		2.18.69
/INSPECTO	R'S SIGNATURE	DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	118	EXHAUST FAN NOT WORKING	Х							FBC 423.15.4
2		OK								
3		ОК								
4		OK								
5		OK								
20		ОК								
23	}	ОК								
24		οK								
										:

J.L.WILKINSON ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION **ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:_	CLAY	FACILITY#:_	0026
	FACILITY:	J. L. WILKINSON 4966 C. R. 218	N ELEMENTA	RY SCHOOL
		MIDDLEBURG, F	LORIDA 320	68
9	INSPECTION	NDATE: <u>FEBR</u> I	JARY 18, 200	99
	Xaul I	li		8-18-09
(INSPECTO	R'S SIGNATURE		DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rüle
92	1	OK				Control of the Contro	And of Physical Parish Profits			Hadding to the transfer that a street to be a single transfer to be a set to be
92:	2	OK								
92	3	ОК								
92	4	OK								
92	5	ОК								
92	6	OK								
92	7	ОК								
92	- 8	OK								
92	9	ок								
92	10	OK								
92	11	ОК								
92	12	OK .	Service Control							



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

INSPECTION DATE: FEBRUARY 18, 2009

4966 C. R. 218

DISTRICT: CLAY **FACILITY #**: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL

MIDDLEBURG, FLORIDA 32068

ÍNSPEÇTÓR'S SIGNATURE

J.18.08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	13	ОК								
92	14	OK								
92	15	ОК								
92	16	OK				11.12				
92	17	OK								
92	18	OK								
92	19	ОК								
92	20	OK	territoria e 12 f. de la 12 f. de la							
92	21	OK								
92	22	OK					4 15 13 25 4 15 13 25			
92	31	ОК								
92	33	OK								

J.L. WILKINSON ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

INSPECTION DATE: FEBRUARY 18, 2009

J. 18

INSPECTOR'S SIGNATURE

DATE

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL

MIDDLEBURG, FLORIDA 32068

DISTRICT: CLAY **FACILITY #**: 0026

4966 C. R. 218

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv: "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	34	ок								
- 92	35A	EMERGENCY LIGHTS NOT WORKING		X	70071 100671					FBC 423.17.1
92	35B	EMERGENCY LIGHTS NOT WORKING	:	Х						FBC 423.17.1
. 92	36	EMERGENCY LIGHTS NOT WORKING		X						FBC 423.17.1
92	37	EMERGENCY LIGHTS NOT WORKING		Х						FBC 423.17.1
92	38	OK								
92	39	ОК								
92	40	OK							- Care	
92	41	ОК								
92	42	OK								
92	43	ок								
92	44	OK								

J.L. WILKINSON ELEMENTARY SCHOOL 2008-09 SREF INSPECTION



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

grand to the second	eriet okkingen fil okking of translate om grent og teknologisk, det frekking frek utbridget et fyrigt frek bred Okking
FACILITY:	J. L. WILKINSON ELEMENTARY SCHOOL
	4966 C. R. 218
	MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 18, 2009

DISTRICT: CLAY FACILITY #: 0026

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	45	ок								
92	46	OK								
92	47	ок								
92	48	OK								
92	49	ок								
92	50	OK								
92	51	ок								
. 92	52	OK								
92	53	ОК								
92	62	OK								
92	64	OK								
92	66	OK	15.2							
92	68	ок								

J.L.WILKINSON ELEMENTARY SCHOOL 2008-09 SREF INSPECTION