


R. M. Paterson

Elementary School

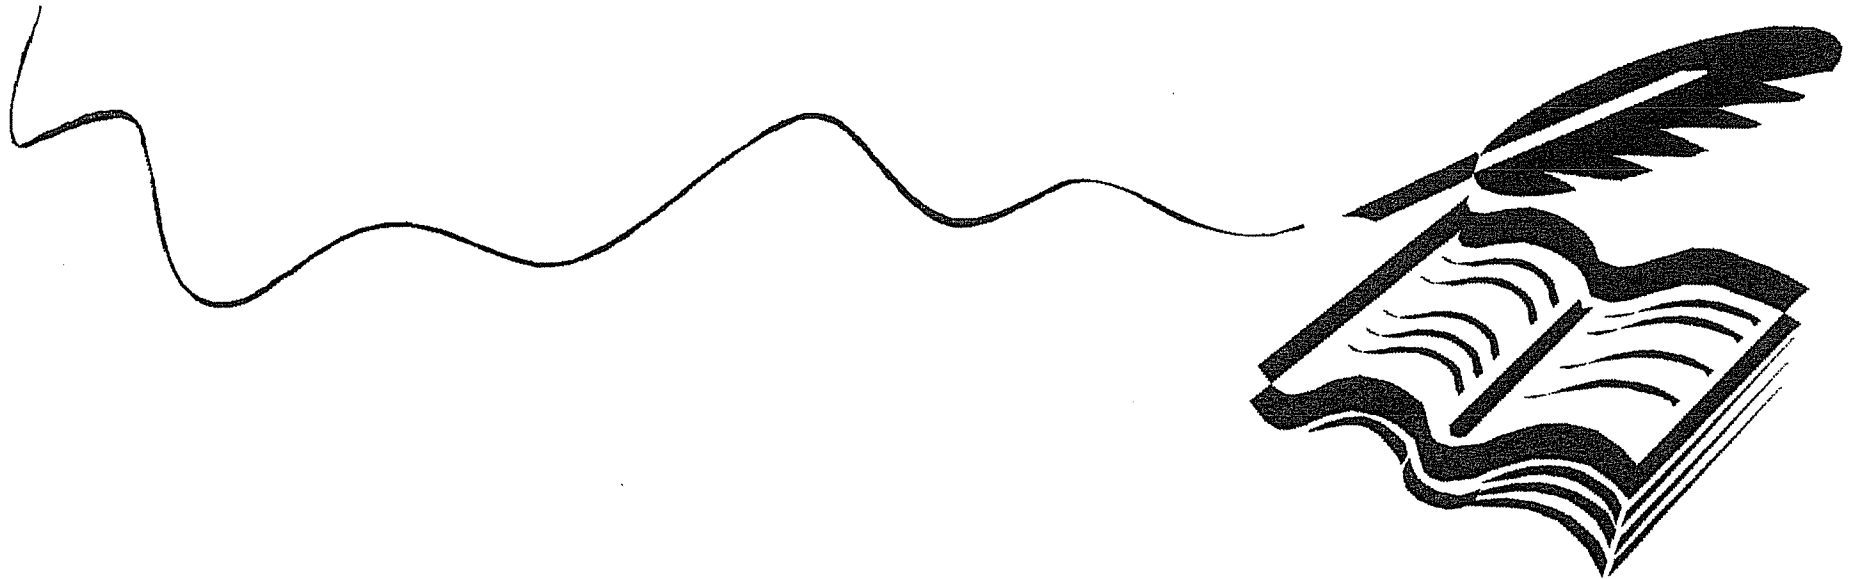

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL  
5400 PINE AVENUE  
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 23, 2007


*Ted Sweetland*  
INSPECTOR'S SIGNATURE

Jan 23, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	142	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
5	526	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
6	629	ELECTRICAL BOX COVER MISSING		X						NFPA 70

Ride Out

Elementary School

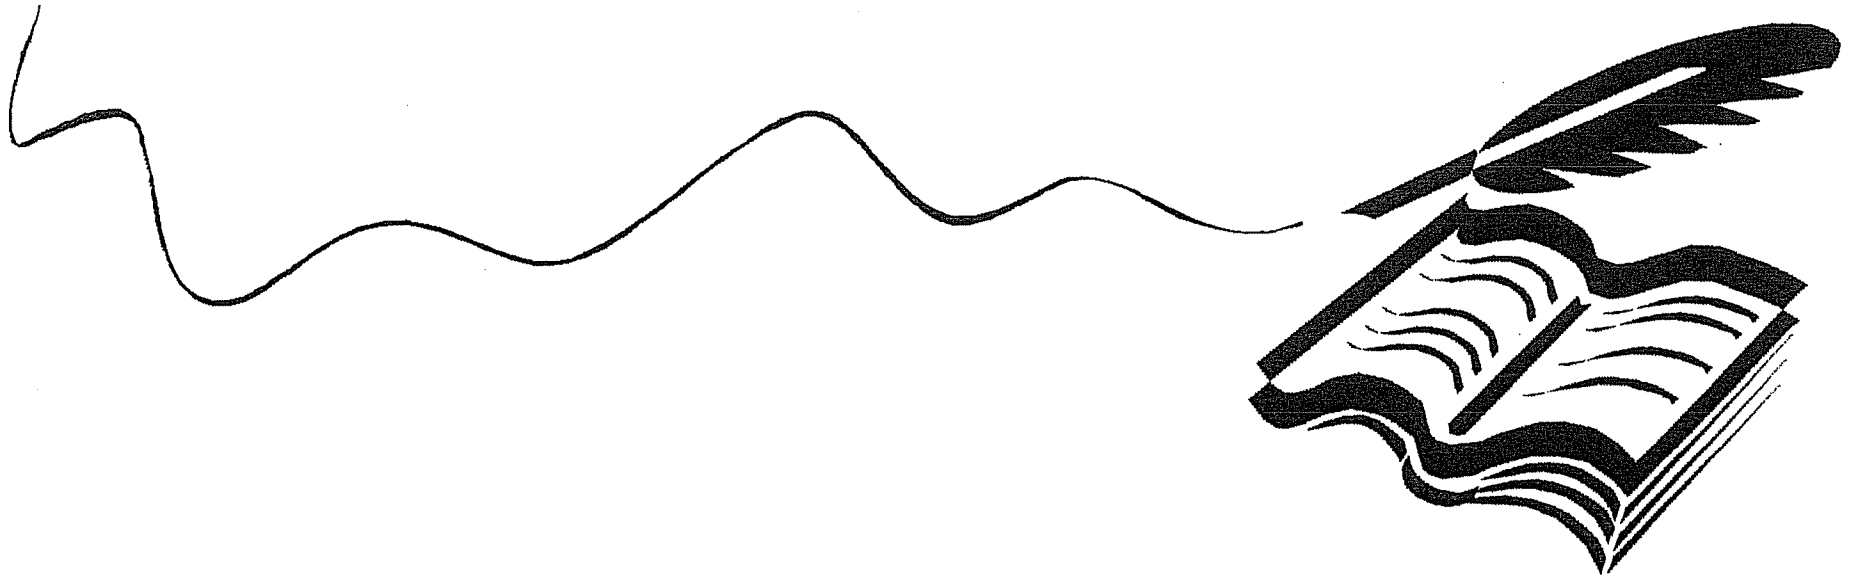

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL  
3065 APALACHICOLA BOULEVARD  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*David H. Swanson*  
INSPECTOR'S SIGNATURE

1-25-07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	308	FRONT OFFICE EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	424	COMPUTER CABLE DRAPED OVER EXTERIOR EXIT				X				

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL  
3065 APALACHICOLA BOULEVARD  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*Larry A. Swenson*  
INSPECTOR'S SIGNATURE

1-25-07  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	14	OUTLET COVER MISSING NEAR EMERGENCY LIGHT		X						NFPA 70
92	20	OK								
92	21	OK								
92	22	OK								
92	23	OK								
92	24	OK								
92	25	OK								
92	26	OK								
92	27	OK								

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL  
3065 APALACHICOLA BOULEVARD  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 25, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*Garrett H. Swanson*  
INSPECTOR'S SIGNATURE


1-25-07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	28	OK								
92	29	OK								
92	30	DOOR CLOSER MISSING	X							
92	31	OK								
92	32	OK								
92	33	OK								
92	34	AC FILTERS DIRTY		X						
92	40	OK								
92	41	OK								
92	42	OK								
92	43	OK								
92	44	OK								
92	45	OK								

Ridgeview

Elementary School

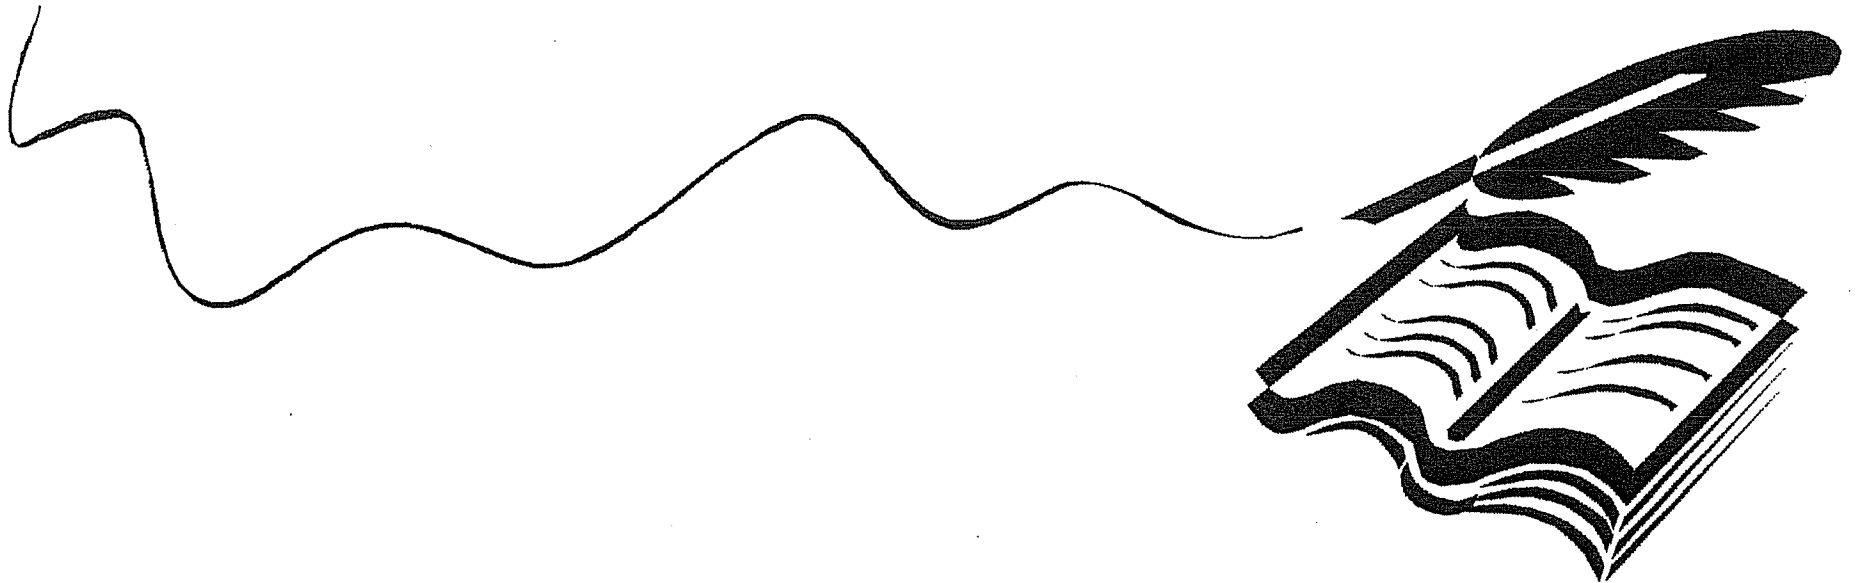



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL  
421 JEFFERSON AVENUE  
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 30, 2007

*[Signature]*  
INSPECTOR'S SIGNATURE 1.30.07  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	210	HOOD SYSTEM NOT CERTIFIED - BEING WORKED ON		X						
1	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
2	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
3	ALL	FIRE EXTINGUISHERS NOT SIGNED OFF		X						69A-58
7	703	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4
7	706	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4
7	708	COMPUTER CABLE ACROSS FLOOR @ EXIT		X						FBC 1003.4



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL  
421 JEFFERSON AVENUE  
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 30, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE


1-30-07  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	742	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	758	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

S. Bryan Jennings

Elementary School

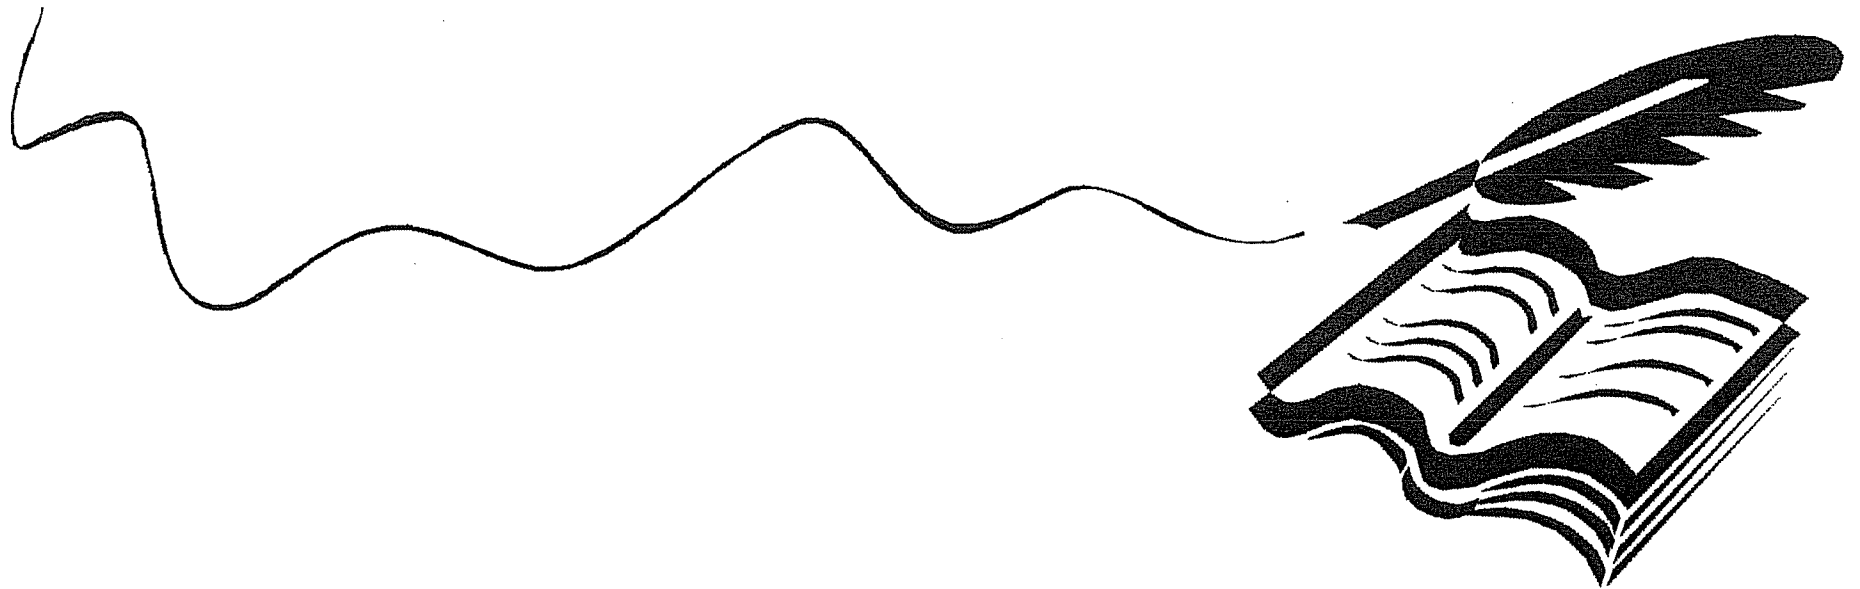



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. B. JENNINGS ELEMENTARY SCHOOL  
215 CORONA DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 1, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE

2/1-07  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	28A	OK								
92	28B	OK								
92	29	OK								
92	30	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	OK								
92	37	OK								
92	38	OK								
92	39	OK								
92	42	OK								

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. B. JENNINGS ELEMENTARY SCHOOL  
215 CORONA DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 1, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION


*[Signature]*  
INSPECTOR'S SIGNATURE DATE 2-1-07

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	OK								
92	44	OK								
92	45	OK								
92	50	OK								
92	75	OK								
92	76	OK								
92	77	OK								
92	78	OK								
92	79	OK								
92	80A	OK								
92	80B	OK								
92	81	OK								
92	36	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	43	OK								

Swimming Pen Creek

Elementary School

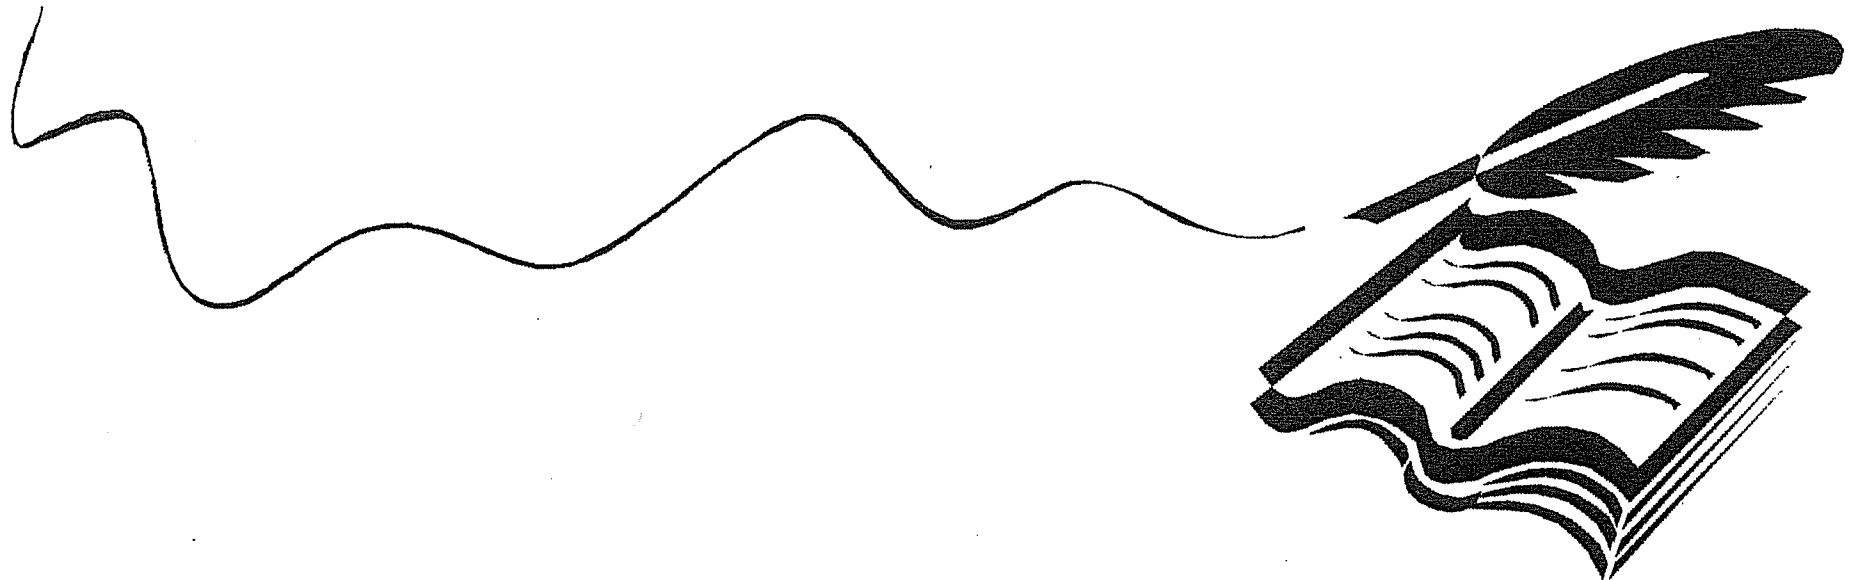



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL  
1630 WOODPECKER LANE  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE

2/9/07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	230	PAINT STORED IN MECHANICAL ROOM – REMOVE		X						NFPA – 1
5	500	TABLE IN HALL, MUST MAINTAIN 72" MIN.		X						NFPA 101-14
6	627	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

