


Lake Asbury

Elementary School

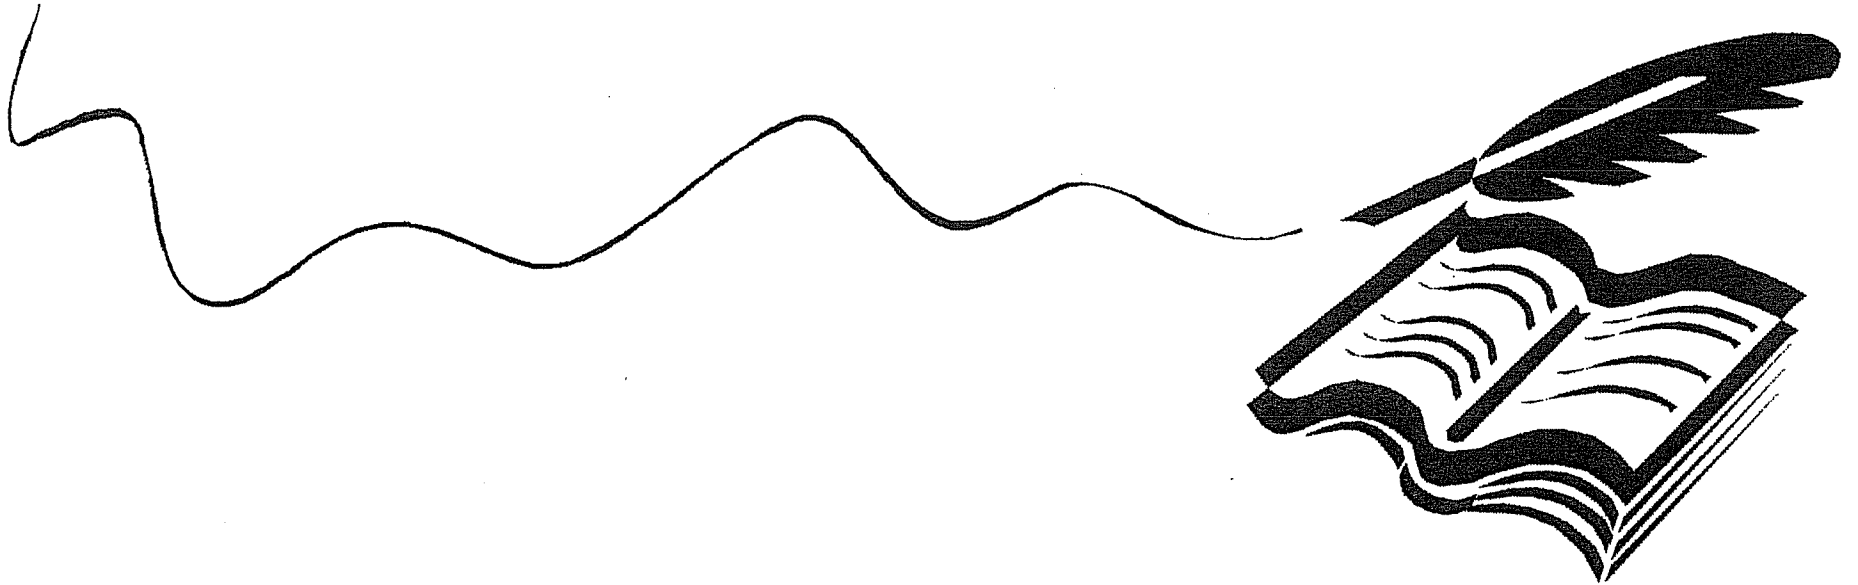

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL  
2901 SANDRIDGE ROAD  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 2, 2007

*Ed Sweetland*  
INSPECTOR'S SIGNATURE Jan 2, 2007  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	101	EXIT LIGHT NOT WORKING		X						FBC 423.17.1
1	128	FIRE ALARM BOX COVER MISSING	X							NFPA 70
1	136	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
2	217	FIRE ALARM BOX COVER MISSING	X							NFPA 70
5	508	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
5	514	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL  
2901 SANDRIDGE ROAD  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: JANUARY 2, 2007

*Ted Swettenham*  
INSPECTOR'S SIGNATURE Jan 2, 2007  
DATE


ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	13	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	40	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Lakeside

Elementary School

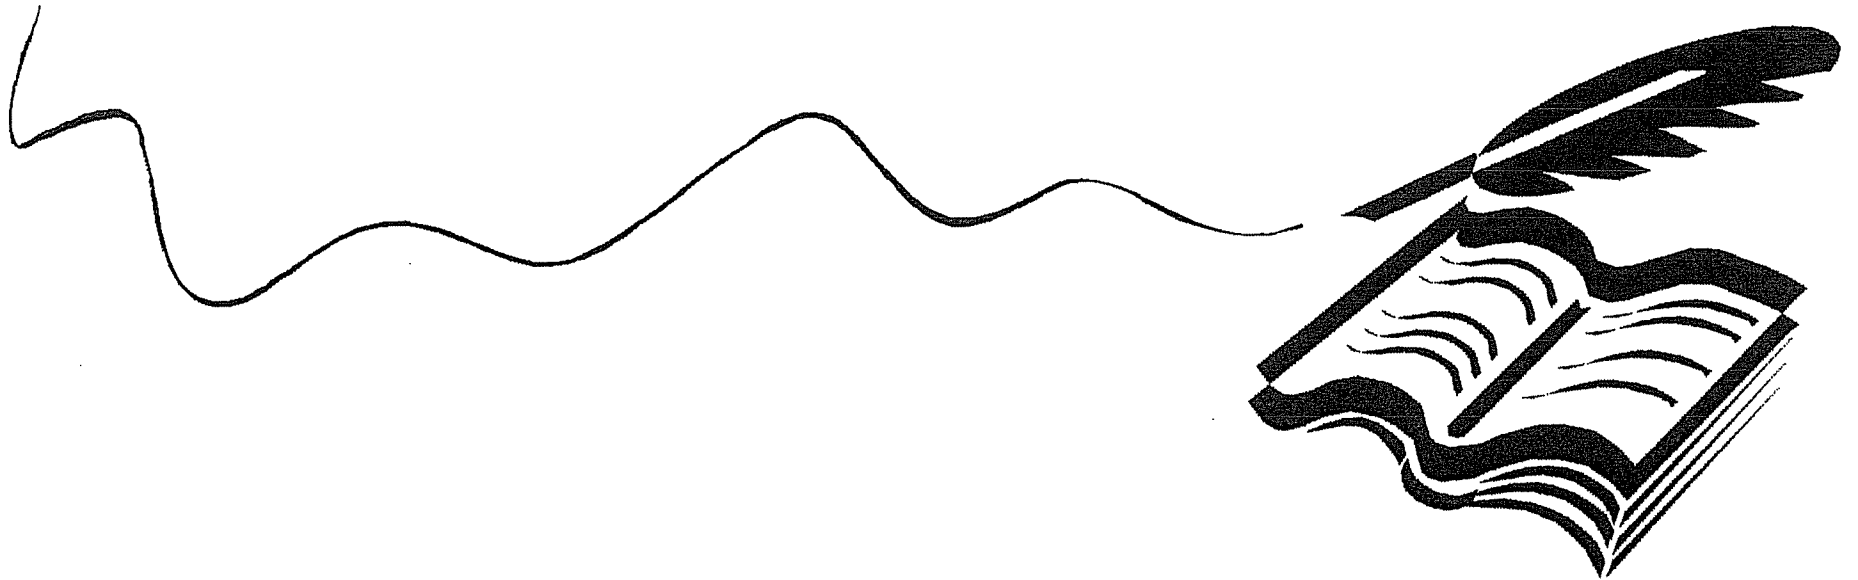

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL  
2752 MOODY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 4, 2007  
*[Signature]*  
INSPECTOR'S SIGNATURE 1-4-07  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	109	EXIT LIGHT OUT		X						FBC 1006.3
1	11A	REMOVE EXIT LIGHT		X						
2	127	EMERGENCY LIGHT OUT		X						FBC 423.17.1
6	611	FIRE ALARM COVER MISSING		X						NFPA 70 110-26
7	700	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
7	705	EXIT DOOR STICKS		X						NFPA 14.5.2
7	701	EXCESSIVE STORAGE BY EXIT		X						NFPA 70 110.26

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL  
2752 MOODY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 4, 2007

*Larry D. Brown*  
INSPECTOR'S SIGNATURE 1-4-07  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								
92	15	OK								
92	16	OK								
92	17	OK								
92	18	OK								
92	20	OK								
92	22	OK								
92	23	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	24	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	25	OK								

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL  
2752 MOODY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 4, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE


1-4-07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	42A	OK								
92	42B	OK								
92	43	OK								
92	44	OK								
92	45	OK								
92	46	OK								
92	47	OK								
92	51	OK								

McRae

Elementary School

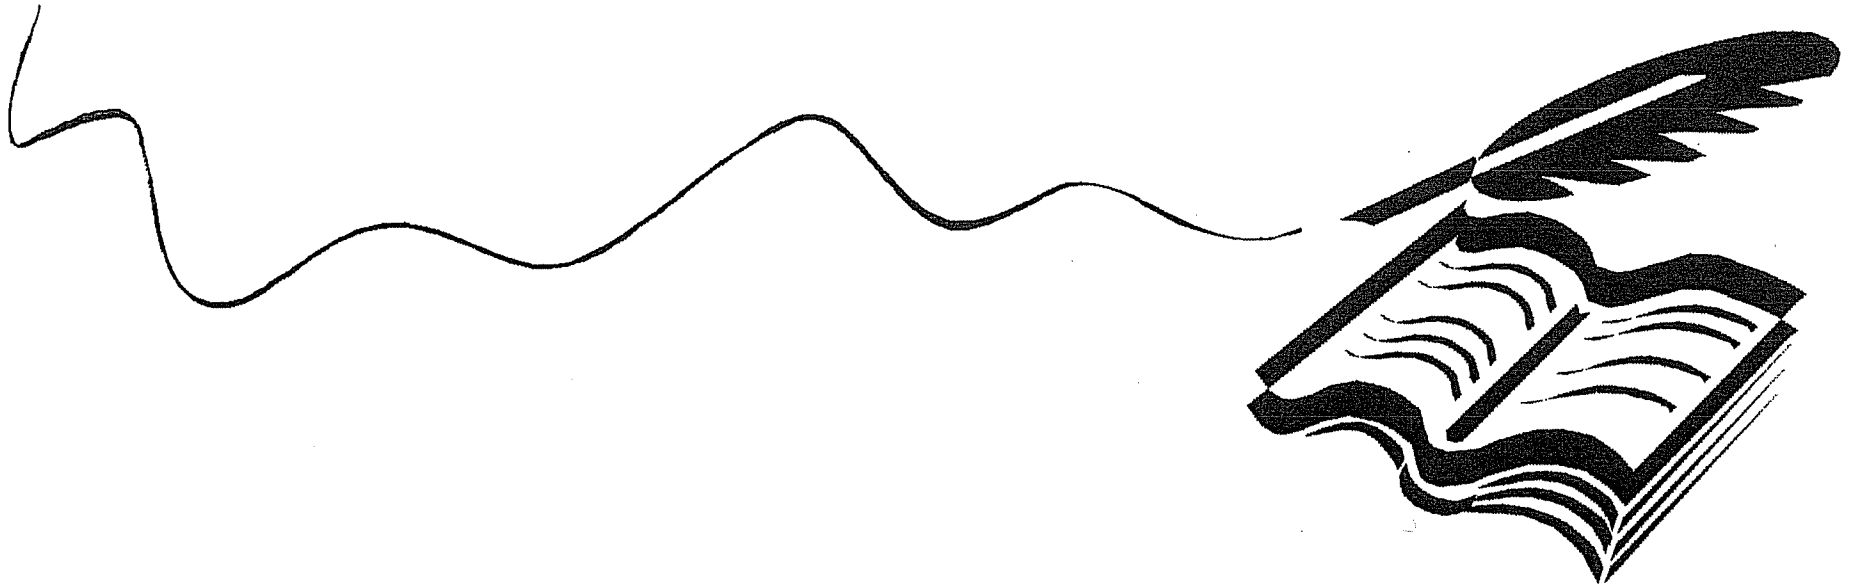



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL  
6770 COUNTY ROAD 315 C  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*Barry J. Burson*  
INSPECTOR'S SIGNATURE      1-9-07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	125	EXIT LIGHT OUT		X						FBC 423.17.1
2	229	FIRE EXTINGUISHER NOT SIGNED		X						59A-58
6	614	EXIT LIGHT OUT		X						FBC 423.17.1

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL  
6770 COUNTY ROAD 315 C  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*Garrett J. Rogers*  
INSPECTOR'S SIGNATURE

1-9-07  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	401	OK								
92	402	OK								
92	403	OK								
92	404	OK								
92	405	OK								
92	406	OK								
92	407	OK								
92	408	OK								
92	701	OK								
92	702	OK								
92	703	OK								
92	704	OK								
92	705	OK								
92	706	OK								

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL  
6770 COUNTY ROAD 315 C  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: JANUARY 9, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Signature]*  
INSPECTOR'S SIGNATURE


1-9-07  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	707	OK								
92	708	OK								
92	801	OK								
92	802	OK								
92	803	OK								
92	804	OK								
92	821	OK								
92	823	OK								
92	824	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	825	OK								
92	826	OK								
92	827	OK								
92	828A	OK								
92	828B	OK								

Middleburg

Elementary School

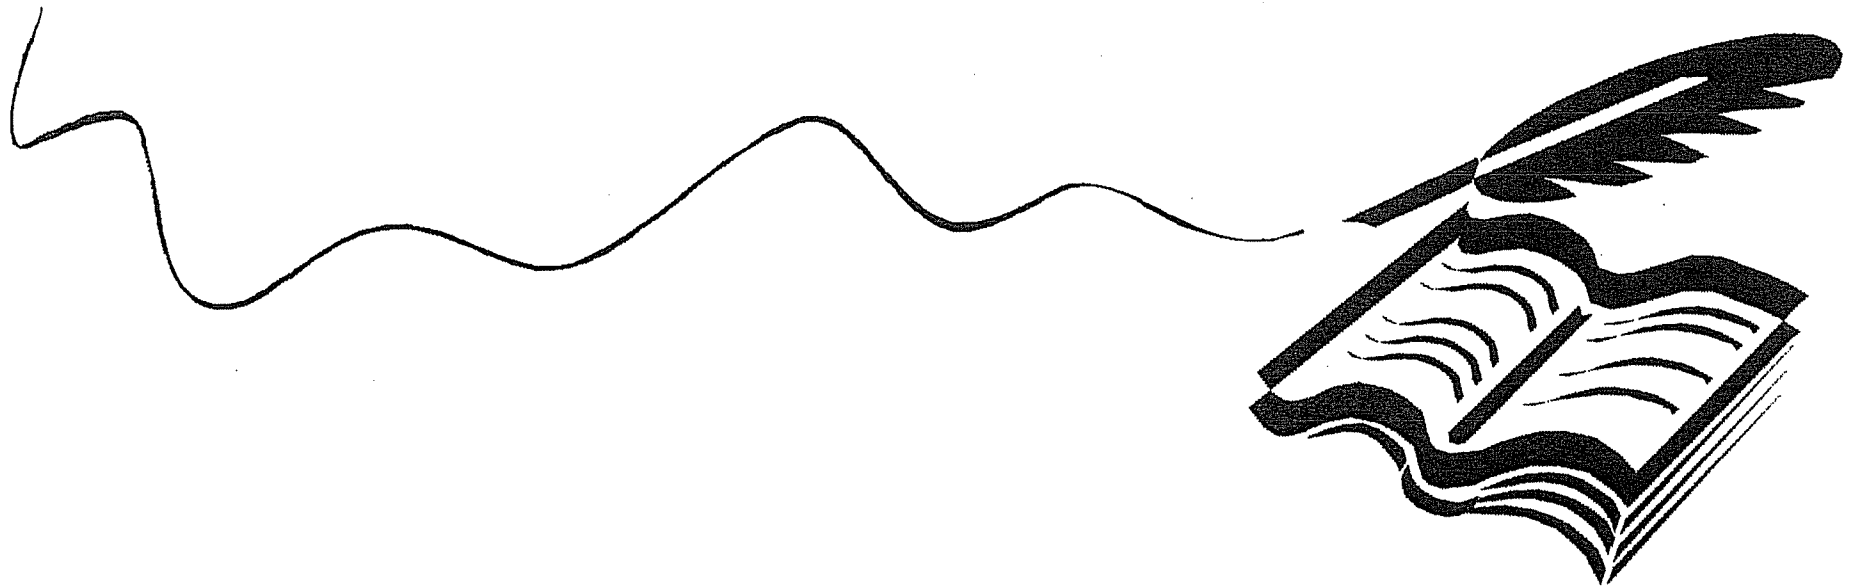

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL  
3958 MAIN STREET  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 11, 2007

*Ted S. [Signature]*  
INSPECTOR'S SIGNATURE Jan 11, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	2	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
2	1	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
2	3	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
2	3	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
3	3	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
7	37	EXIT LIGHT OUT		X						FBC 1006.3
7	39	EXIT LIGHT OUT		X						FBC 1006.3
9	101	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
9	101	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
9	115	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
9	118	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	119	EMERGENCY LIGHT OUT		X						FBC 423.17.1

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0009

FACILITY: MIDDLEBURG ELEMENTARY SCHOOL  
3958 MAIN STREET  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 11, 2007


*Ted Swartzland*  
INSPECTOR'S SIGNATURE

Jan 11, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	35	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	39	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

Mountain

Elementary School

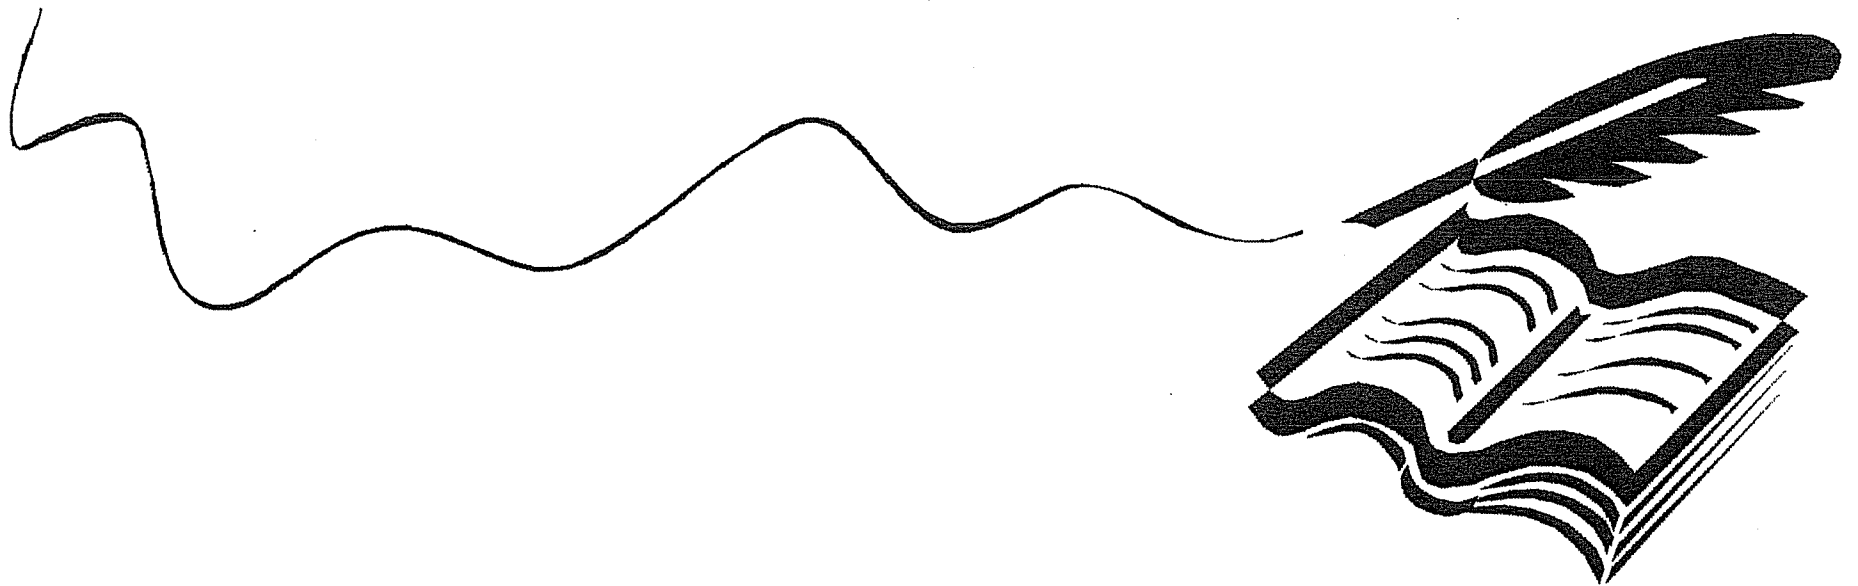

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL  
2398 MOODY ROAD  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 16, 2006

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE  
DATE 1-16-07

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	126	OCCUPANCY LOAD SIGN MISSING	X							FBC 1004.3
5	501	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4



**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL  
2398 MOODY ROAD  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 16, 2006

INSPECTOR'S SIGNATURE *James H. Woods* DATE 1-16-07

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	21	OK								
92	22	OK								
92	23	OK								
92	25	OK								
92	26	OK								
92	27	OK								
92	28	OK								
92	31	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	OK								
92	36	OK								
92	37	OK								

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL  
2398 MOODY ROAD  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 16, 2006

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE


1-16-07  
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	38	OK								
92	39	OK								
92	40	OK								
92	41	OK								
92	44	OK								
92	45	OK								
92	46	OK								

Orange Park

Elementary School

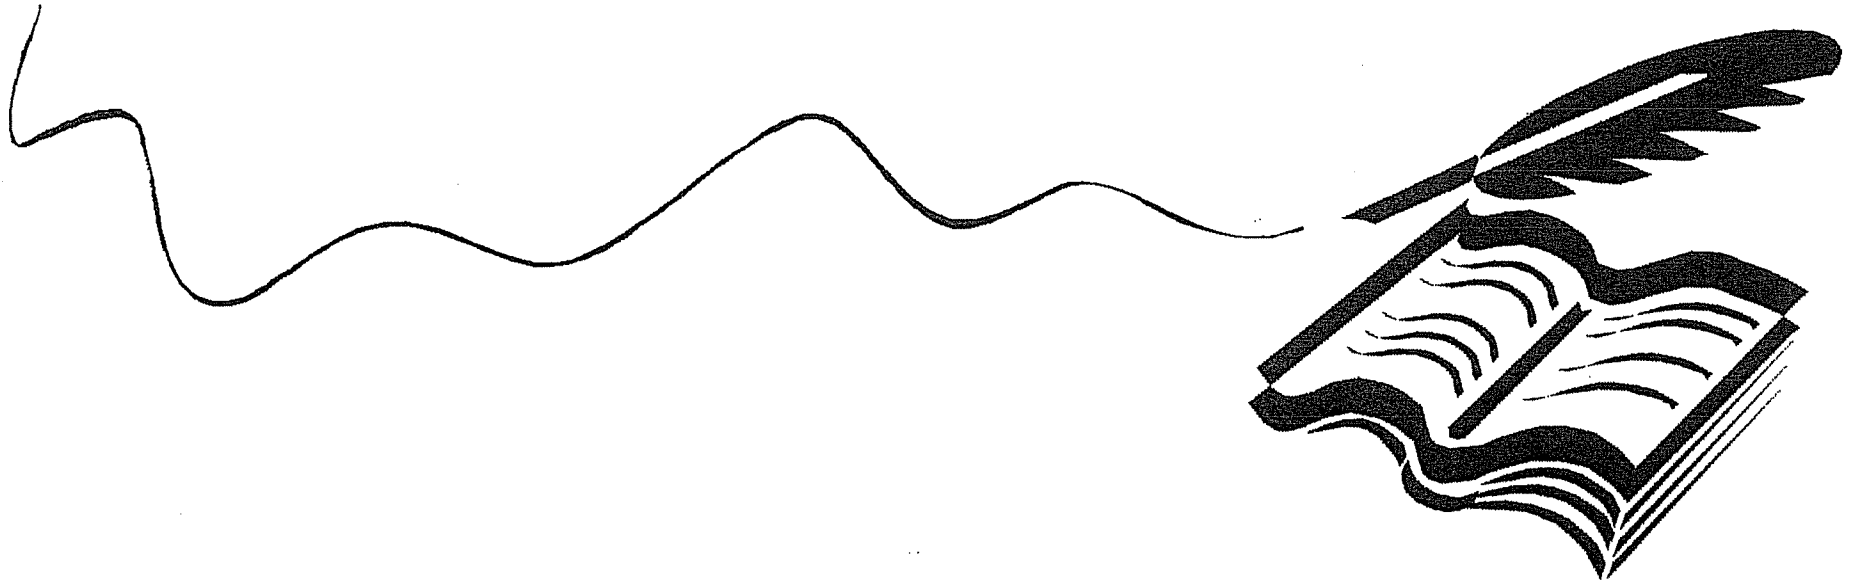

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL  
1401 PLAINFIELD AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 18, 2007

  
INSPECTOR'S SIGNATURE

Jan 18, 2007  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	82	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	83	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.16.2

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL  
1401 PLAINFIELD AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 18, 2007

*[Signature]*  
INSPECTOR'S SIGNATURE DATE Jan 18, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	22	EMERGENCY LIGHT OUT		X						FBC 423.17.1