


Clay

High School

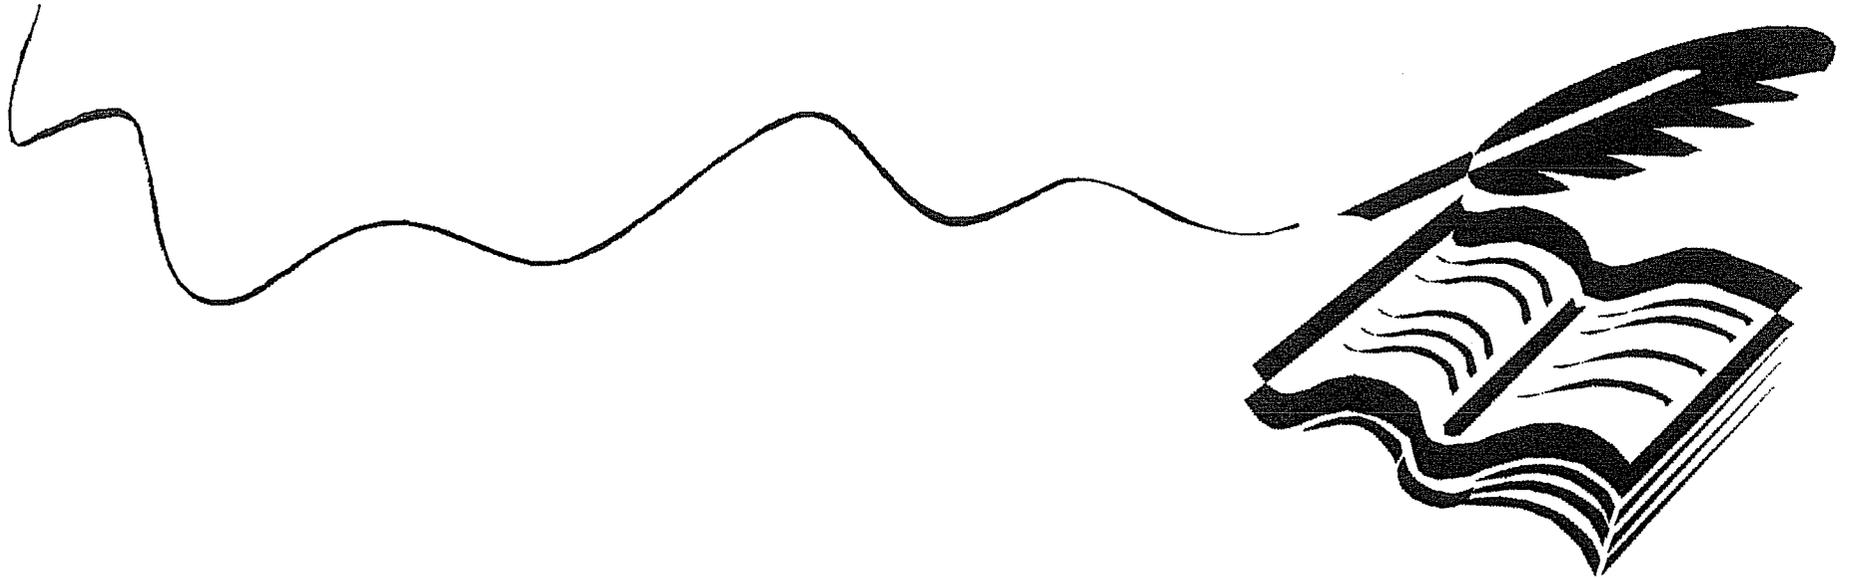

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0013

FACILITY: CLAY HIGH SCHOOL
2025 HIGHWAY 16 WEST
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 10, 2006

Ted Sweetland
INSPECTOR'S SIGNATURE Oct 10, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	102	MAXIMUM OCCUPANCY SIGN MISSING		X						FBC 1004.3
1	102	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
1	111	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
1	113	EMERGENCY LIGHT COVER BROKEN		X						FBC 423.14.2.4
1	118	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	127	EMERGENCY LIGHT NOT WORKING – BROKEN WIRES EXPOSED	X							FBC 423.14.2.4
1	135	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	127B	JUNCTION BOX LOOSE	X							NFPA 70 410.12
1	138	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	138A	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
2	211	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	301	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
3	302	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0013

FACILITY: CLAY HIGH SCHOOL
2025 HIGHWAY 16 WEST
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 10, 2006

Tom Swartzland
INSPECTOR'S SIGNATURE Oct 10, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	302	MOVE EMERGENCY LIGHT TO LIGHT UP ROOM	X							FBC 423.17.1
3	312A	ADD EMERGENCY LIGHT	X							FBC 423.17.1
3	318	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	300B	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	379	CEILING TILES MISSING		X						FBC 804.2.3
3	381	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	361	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
3	344	HALF OF THE EMERGENCY LIGHTS NOT WORKING (BULB)		X						FBC 423.17.1
3	341	AV WIRES UP WALL ACROSS CEILING				X				NFPA 70 – 870.52
3	389	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
5	510A	EXIT LIGHT COVER MISSING		X						FBC 423.17.1
5	517A	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0013

FACILITY: CLAY HIGH SCHOOL
2025 HIGHWAY 16 WEST
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 10, 2006

Ted S. Carter
INSPECTOR'S SIGNATURE Oct 10, 2006
DATE


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
11	1109	WIRES THROUGH EXIT – ACROSS FLOOR WORK ORDER # 0201266				X				NFPA 70 – 110.12
35		NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
30		COOKING EQUIPMENT IN FRONT OF THE ELECTRICAL PANEL		X						NFPA 70 110.26
30		NO FENCE AROUND PUMP STATION IN FRONT OF BUILDING			X					

Fleming Island

High School

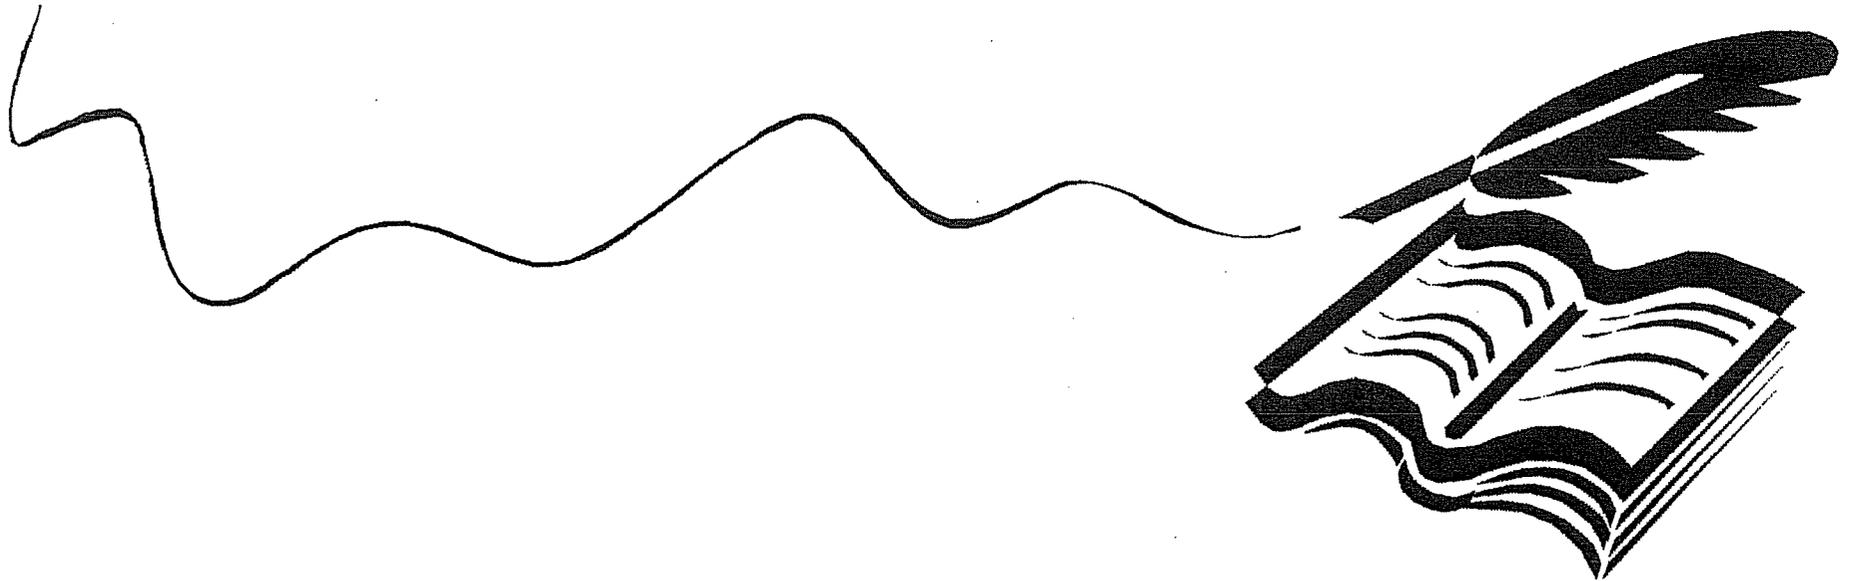

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0044

FACILITY: FLEMING ISLAND HIGH SCHOOL
2233 VILLAGE PARKWAY
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 12, 2006

Carl Sweatt
INSPECTOR'S SIGNATURE

Oct 12, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	28	STORAGE TO CLOSE TO CEILING – MIN. 18"		X						NFPA 1 12.1
1	122	FIRE ALARM NOT CERTIFIED	X							69A 58.008
1	142	OPEN ELECTRICAL BOX		X						NFPA 70 110.26
1	149	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	151	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	171	STORAGE TO CLOSE TO CEILING – MIN. 18"		X						NFPA 1 12.1
1	270	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	272	ELECTRICAL PANEL MISSING	X							NFPA 70 410-12
1	314	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
10	1022	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	332	FIRE ALARM BOX OPEN		X						NFPA 70 110-12
1	332	ELECTRICAL BOX OPEN ATAH13		X						NFPA 70 110.12
1	334	FIRE ALARM BOX OPEN – BARE WIRES	X							NFPA 70 110.12

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0044

FACILITY: FLEMING ISLAND HIGH SCHOOL
2233 VILLAGE PARKWAY
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 12, 2006

Tom Sweatt
INSPECTOR'S SIGNATURE Oct 12, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	205	LIGHTS HANGING FROM WIRES	X							NFPA 70 110.12
2	207	LIGHTS HANGING FROM WIRES	X							NFPA 70 110.12
2	268	REMOVE PAINT FROM GEN. ROOM		X						NFPA 1
2	1019B	TRASH; WOOD IN HALLWAY		X						FBC 1004
2	203	TWO OPEN ELECTRICAL BOXES - LOWER RIGHT HAND SIDE		X						NFPA 70 110.12

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0044

FACILITY: FLEMING ISLAND HIGH SCHOOL
2233 VILLAGE PARKWAY
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 12, 2006

Tom Sweatt
INSPECTOR'S SIGNATURE DATE Oct 12, 2006


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	CLOSET DOOR HITS FLOOR		X						
92	12	MISSING PANEL KNOCK-OUT	X							NFPA 70 110.12
92	12	EMERGENCY LIGHT NOT WORKING	X	X						FBC 423.17.1
92	20	EMERGENCY LIGHT NOT WORKING	X							FBC 423.17.1
92	40	MISSING HALF OF EMERGENCY LIGHTS	X							FBC 423.17.1
92	47	NO EMERGENCY EVACUATION SHEET		X						FBC 423.13.2.4
92	48	NO EMERGENCY EVACUATION SHEET		X						FBC 423.13.2.4
92	82	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	45	EXTINGUISHER NOT SIGNED OFF		X						69A-58

Keystone Heights

Junior/Senior High School

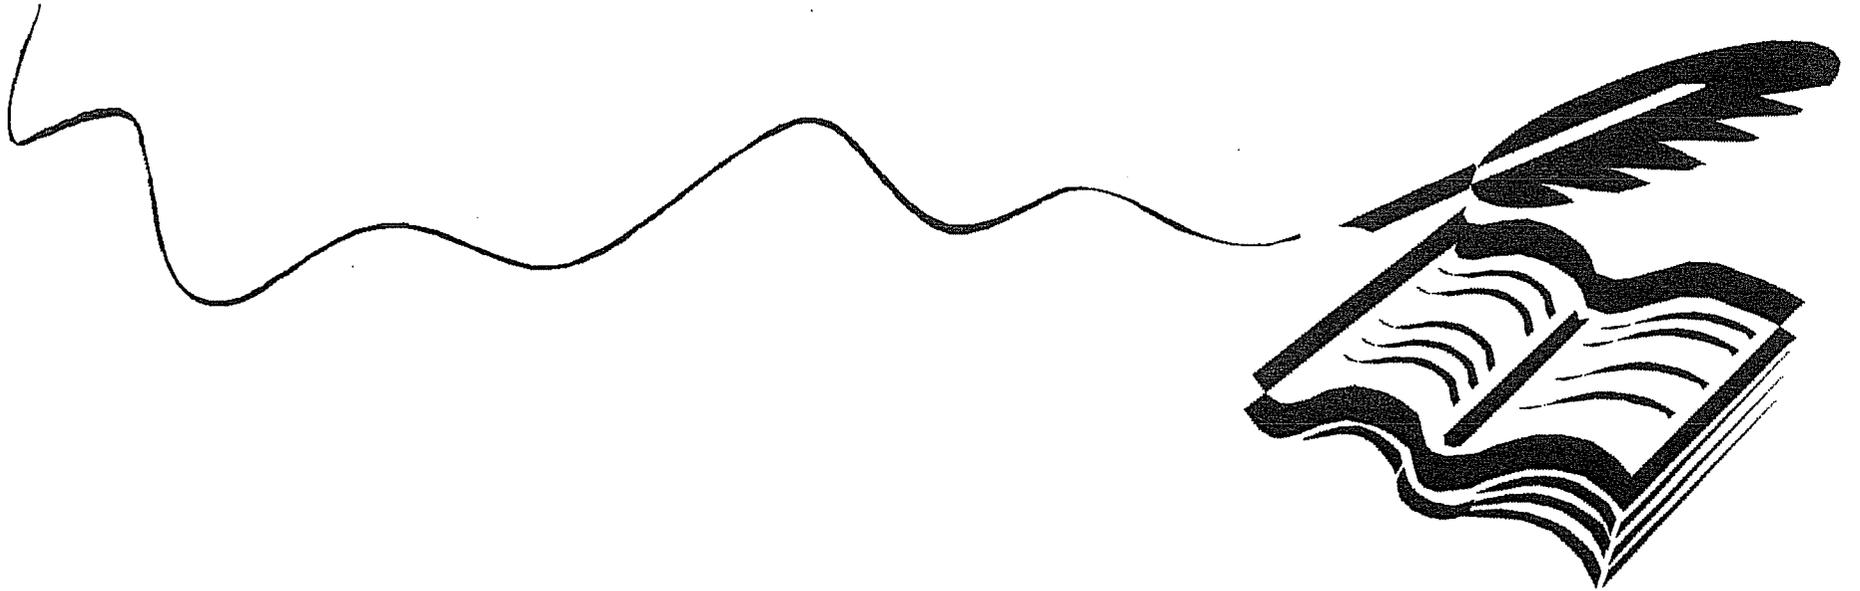

FISCAL YEAR 2006-2007

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S.W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: OCTOBER 17, 2006

Col Sweetant
INSPECTOR'S SIGNATURE DATE Oct 17, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	160	FIRE ALARM TROUBLE LIGHT @ DUCT DETECTOR		X						NFPA 70 410.12
1	173	REMOVE STORAGE IN ELECTRICAL ROOM		X						NFPA 70 110.26
1	187	NEED NEW EXIT LIGHT NORTH END OF CORRIDOR	X							FBC 1016.3.1
1	188	TV TOO LOW NEED TO MOVE DESK OR CABINET		X						FBC 423.20.1
4	403	ELECTRICAL SURGE PROTECTOR PLUGGED INTO SURGE PROTECTOR		X						NFPA 70 400.8
4	401	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
5	548	STORAGE IN ELECTRICAL CLOSET		X						NFPA 70 110.12
5	505	REMOVE WOOD BACKDROP FROM STAGE BLOCKS EXIT		X						FBC 423.20.1
5	550	REMOVE STORAGE & REPLACE CEILING TILES		X						FBC 423.20.1
6	609 E	STORAGE IN ELECTRICAL CLOSET		X						NFPA 70 110.12

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S.W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: OCTOBER 17, 2006

Ted Sweatt
INSPECTOR'S SIGNATURE Oct 17, 2006
DATE


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
9	912	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
9	921	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
9	928	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
9		2 ND FLOOR MEZZANINE ELECTRICAL BOX COVER MISSING	X							NFPA 70 410.12
9	933	STORAGE IN ELECTRICAL CLOSET		X						NFPA 70 110.12
20	17	EXIT BLOCKED BY WEIGHT BENCH		X						FBC 423.20.1

Middleburg

High School

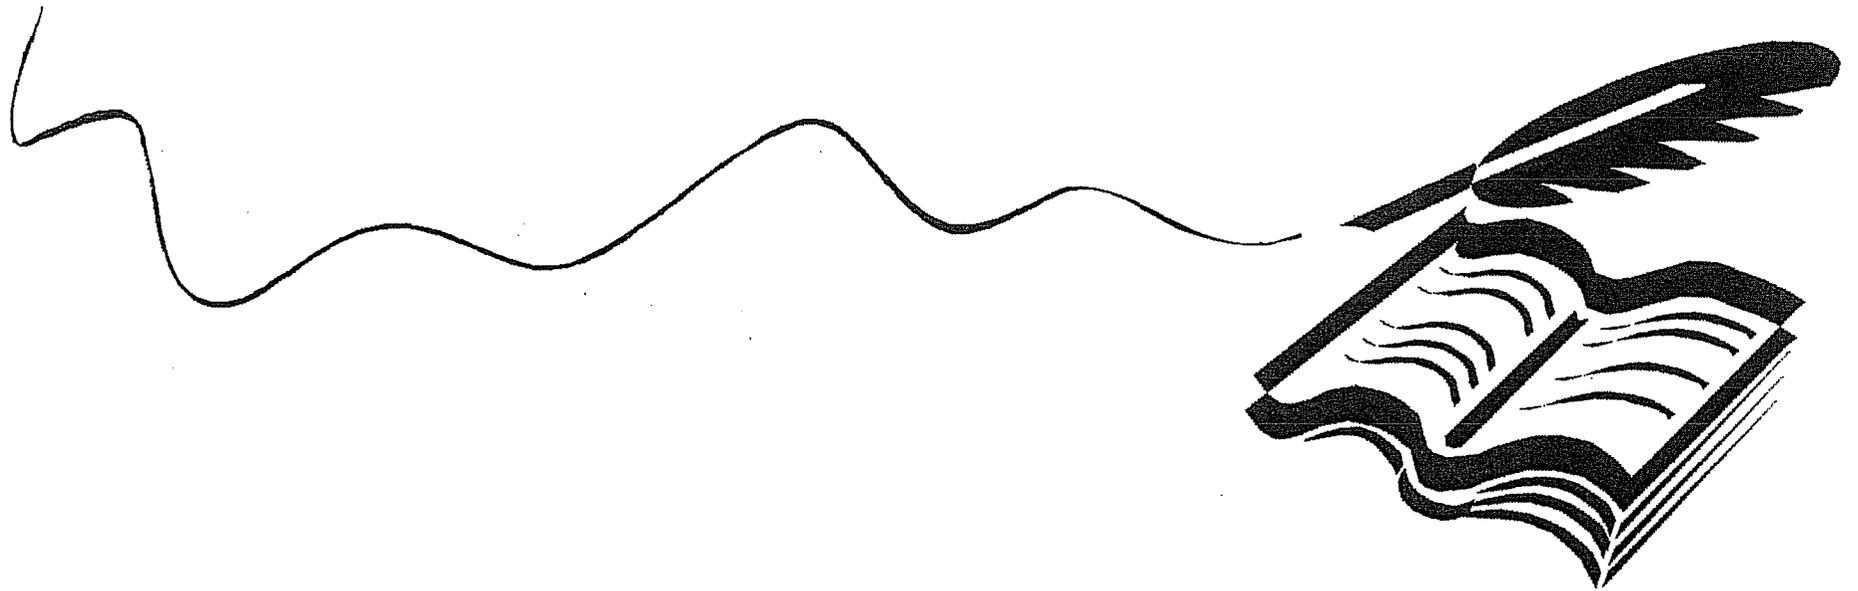

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 C.R. 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: OCTOBER 25, 2006

Tom Sweetland
INSPECTOR'S SIGNATURE Oct 25, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	76	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
1	89	NO EMERGENCY EVACUATION WSHEET		X						FBC 423.14.2.4
1	249	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
1	203	STORAGE TOO HIGH WITHIN 18" OF SPRINKLER		X						NFPA 1 12.1
1	285	EXIT LIGHT COVER MISSING		X						
1	285	OCCUPANCY LOAD SIGN MISSING (1,770)		X						FBC 1004.3
1	335	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	327	EXIT BLOCKED		X						FBC 423.20.1
1	361	ROOF LEAK CEILING REPLACED		X						
1	284A	EXIT LIGHT OUT		X						FBC 1016.3.1
35		EMERGENCY LIGHT OUT		X						FBC 423.17.1
35		2 LP TANKS STORED IN BUILDING - REMOVE		X						NFPA 1.21-3.3.5
9		LP TANKS STORED IN BUILDING - REMOVE		X						NFPA 1-21-3.3.5
10		LP TANKS STORED IN BUILDING - REMOVE		X						NFPA 1-21-3.3.5

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 C.R. 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: OCTOBER 25, 2006

Ted Sweetland
INSPECTOR'S SIGNATURE Oct 25, 2006
DATE


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	7	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	9	NO EMERGENCY EVACUATION SHEET		X						FBC 423.17.1

Orange Park

High School

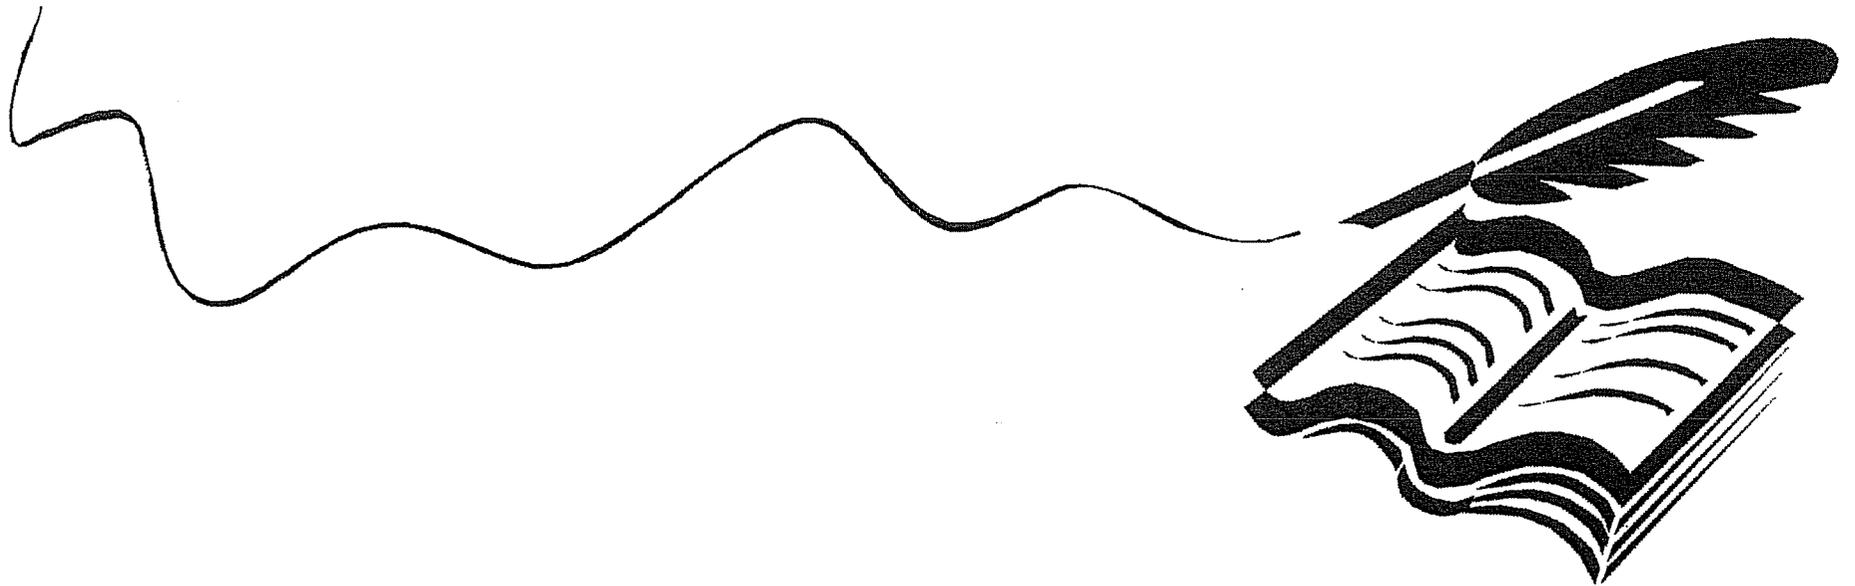

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

[Signature]
INSPECTOR'S SIGNATURE 10/24/06
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED OFF THROUGHOUT THE BUILDING SINCE THEY WERE INSTALLED IN JUNE 2006		X						
1	159A	EXIT LIGHT OUT	X							FBC 1016.3.1
1	151A	EXIT LIGHT OUT	X							FBC 1016.3.1
1	167A	EXIT LIGHT OUT	X							FBC 1016.3.1
1	100	EXIT LIGHT OUT	X							FBC 1016.3.1
1	181J	EXIT LIGHT OUT	X							FBC 1016.3.1
1	220	EXIT LIGHT OUT	X							FBC 1016.3.1
1	164	PROPANE FLOOR MACHINE STORED IN HALL DURING SCHOOL HOURS		X						
1	110	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	118	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	123	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1										

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	122	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	226	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	224	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	215	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	201	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	205	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	118	CEILING AT ENTRY TO ROOM 118 FALLING	X							FBC 804.23
1	220	EMERGENCY LIGHT OUT	X							FBC 423.17.1
1	101	COVER MISSING ON J-BOX (OUTLET)	X							NFPA 70.314.1
2		NONE OF THE FIRE EXTINGUISHERS IN THE BULDING HAVE BEEN SIGNED OFF SINCE THEY WERE INSTALLED IN JUNE 2006								
2	14	LIGHT FIXTURE DANGLING FROM CEILING	X							

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED OFF SINCE THEY WERE INSTALLED IN JUNE 2006		X						
4	19B	LENSES MISSING ON CEILING LIGHT FIXTURES	X							
4	19A	LENSES MISSING ON CEILING LIGHT FIXTURES	X							
4	17	LENSES MISSING ON CEILING LIGHT FIXTURE	X							
4	5	EMERGENCY LIGHT OUT	X							FBC 423.17.1
4	1	EMERGENCY LIGHT OUT	X							FBC 423.17.1
4	17C	EMERGENCY LIGHT OUT	X							FBC 423.17.1
4	1	EMERGENCY LIGHT OUT	X							FBC 423.17.1
4	17A	LIGHT SWITCH NOT WORKING	X							FBC 423.17.1
4	17B	LIGHT SWITCH NOT WORKING	X							FBC 423.17.1
4	1	EXIT LIGHT MISSING S.E. EXIT	X							FBC 1016.3.1
4	1	EXIT LIGHT MISSING S.E. EXIT	X							FBC 1016.3.1

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	5H	EXIT LIGHT	X							FBC 1016.3.1
4	5	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
4	21A	EMERGENCY LIGHT OUT	X							FBC 423.17.1
10		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED OFF SINCE THEY WERE INSTALLED JUNE 2006	X							
10	102	EMERGENCY LIGHT OUT	X							FBC 423.17.1
10	104	EMERGENCY LIGHT OUT	X							FBC 423.17.1
10	112	EMERGENCY LIGHT OUT	X							FBC 423.17.1
10	124	LP TANK STORED IN ROOM 124		X						
10	116	EXTENSION CORD TO LAVA LAMP		X						
10	116	BACK DROP CURTAIN NOT FIRE RETARDANT		X						
10	110	AC DIFFUSER RESTING ON FIRE SPRINKLER UNIT		X						

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE 10/24/06
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
12		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED OFF SINCE INSTALLATION JUNE 2006		X						
12	105	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	116	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	161A	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	135	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	161B	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	140	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
12	135	COVER PLATE MISSING ON SWITCH		X						FBC 423.14.2.4
12	161A	LENSE MISSING ON CEILING LIGHT FIXTURE	X							
12	164	SIDE EXIT LIGHTS OUT	X							FBC 1016.3.1
24		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
	23	PAINT STORED IN ROOM 23		X						

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
24	14	CAN LIGHT HOUSING MISSING	X							FBC 423.17.1
18C		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
18C	1	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
18C	3	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
18C	6	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19D		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
19D	9	EXIT LIGHT OUT	X							FBC 1016.3.1
19D	8	EXIT LIGHT OUT	X							FBC 1016.3.1
19D	7	EXIT LIGHT OUT	X							FBC 1016.3.1
19D	2	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19D	2B	FIRE EXTINGUISHER MISSING BY KILN ROOM		X						
19D	3	PAINT STORED IN ROOM		X						

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
19D	4	PAINT STORED IN ROOM		X						
20		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
20	18A	EXIT LIGHT OUT	X							
20	18A	EXIT BLOCKED		X						
20	10	EVACUATION SHEET MISSING		X						
20	10	NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
20	1	EXTENSION CORD TO POWER STRIP TO SPLITTER		X						
20	14	FIRE ALARM CERTIFIEC 10/2005 (EXPIRED)	X							
20	14	TROUBLE LIGHT ON FIRE ALARM	X							
21		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
22	7	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	6	EVACUATION SHEET MISSING		X						FBC.423.14.2.4

FISCAL YEAR 2006-2007

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
27		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
27	2	NO EVACUATION SHEET		X						FBC 423.14.2.4
27	3	EXIT LIGHT OUT	X							FBC 1016.3.1
20	14	TROUBLE LIGHT ON FIRE ALARM	X							
21		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
21	2	NO EMERGENCY LIGHT								FBC 423.17.1
22		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
22	9	EXIT LIGHT OUT	X							FBC 1016.3.1
22	4	EXIT LIGHT OUT	X							FBC 1016.3.1
22	7	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	6	EVACUATION SHEET MISSING		X						FBC.423.14.2.4
27		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
27	2	NO EVACUATION SHEET		X						FBC 423.14.2.4
27	3	EXIT LIGHT OUT	X							FBC 1016.3.1
27	3	NO EMERGENCY LIGHT	X							FBC 423.17.1
27	4	COVERS MISSING ON LIGHT FIXTURE	X							
27	6	COVERS MISSING ON LIGHT FIXTURE	X							
48		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
48	1	PROPANE TANKS INSIDE		X						
47	1	NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
47	1	PROPANE TANKS STORED INSIDE		X						
43	1	NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
43	1	PROPANE TANKS STORED INSIDE		X						
51	2	EMERGENCY LIGHT OUT	X							FBC 423.17.1

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
51	14	EMERGENCY LIGHT OUT	X							FBC 423.17.1
51	7	SWITCH COVER MISSING		X						FBC 423.14.2.4
51	12	SWITCH COVER BROKEN		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE 10/24/06
DATE

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
GENERAL		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
92	24	EMERGENCY LIGHT NOT WORKING	X							FBC 423.17.1
92	24	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	25	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	26	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	27	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	27	COVER MISSING ON CLOSET LIGHT	X							FBC 423.14.2.4
92	28	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	29	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	31	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	31	EMERGENCY LIGHT NOT WORKING	X							
92	32	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	41	EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

[Signature]
INSPECTOR'S SIGNATURE DATE 10/24/06


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	41	OUTLET COVER MISSING BY PANEL		X						FBC 423.14.2.4
92	42	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	43	ELECTRICAL PANEL BLOCKED		X						
92	44	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	44	EMERGENCY LIGHT NOT WORKING	X							FBC 423.17.1
92	45	INTERCOM NOT WORKING	X							
92	46	FIRE EXTINGUISHER MISSING		X						
92	48	OK								
92	49	OK								
92	52	OK								
92	53	HEAT DETECTOR MISSSING	X							
92	54	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	54	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	55	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	56	EVACUATION SHEET MISSING		X						FBC 423.14.2.4

Ridgerview

High School

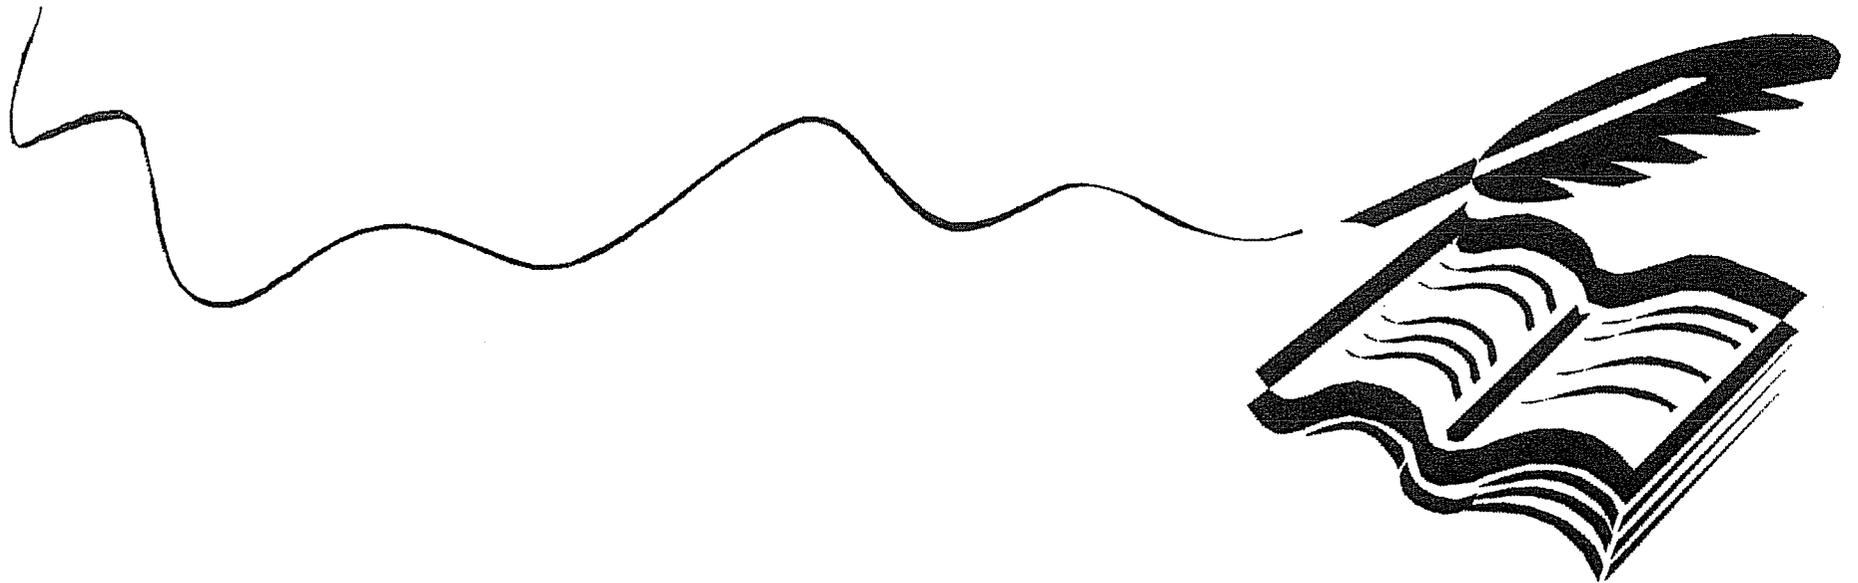

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 26, 2006

[Signature]
INSPECTOR'S SIGNATURE

Oct 26, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	108A	TWO OPEN ELECTRICAL BOXES OVER EXTINGUISHER		X						NFPA 70 110.26
1	110	ELECTRICAL JUNCTION BOX COVER MISSING		X						NFPA 70 110.26
1		EMERGENCY SHEETS MISSING		X						FBC 423.14.2.4
1	137	ELECTRICAL BOX COVER MISSING		X						NFPA 70 110.26
1	143	CLASSROOM NOT BY DESIGN - CHANGE DOOR SWING			X					FBC 423.13.1
1	149	NO OCCUPANCY LOAD SIGN		X						FBC 1004.3
2	223	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
2	227	EXIT LIGHT OUT		X						FBC 1006.3
2	236	EXIT LIGHT OUT		X						FBC 1006.3
2	238	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	302	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
3	315	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
3	320	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 26, 2006

Ted Sweatt
INSPECTOR'S SIGNATURE DATE Oct 26, 2006

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	333	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
3	340	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
6	688	EXIT LIGHT OUT		X						FBC 1006.3
6	689	EXIT LIGHT OUT		X						FBC 1006.3
6	690	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
6	689	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	701	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	705	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	720	MISSING FIRE EXTINGUISHERS		X						69A-58
9	911	NO OCCUPANCY LOAD SIGN		X						FBC 1004.3
9	911	EMERGENCY LIGHT BROKEN		X						FBC 423.17.1
9	911	EXTERIOR DOOR HANDLE BROKEN		X						FBC 423.17.1
9	910	EMERGENCY LIGHT HANGING		X						
9	914	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
9	914	EXIT DOOR HANDLE BROKEN		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 26, 2006

Tom Sweatt
INSPECTOR'S SIGNATURE Oct 26, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
9	915	NO EVACUATION SHEET		X						FBC 423.14.2.4
9	915	EXIT DOOR HANDLE BROKEN		X						FBC 423.14.2.4
9	916	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	924	FIRE EXTINGUISHER MISSING		X						69A-58
9	919	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	941	TWO EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	941	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
9	924	WATER COOLER RUSTY SHARP EDGES	X							

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 26, 2006

Todd Swettenham
INSPECTOR'S SIGNATURE

Oct 26, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	3	NO FIRE EXTINGUISHER BY STOVE		X						69A-58
92	4	EXTINGUISHER NOT SIGNED		X						69A-58
92	5	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	6	EXTINGUISHER MISSING		X						69A-58
92	8	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	13	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	23	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	29	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	32	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	62	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	66	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	81	EMERGENCY LIGHT OUT		X						FBC 423.17.1
02	82	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	24	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

FISCAL YEAR 2006-2007

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: OCTOBER 26, 2006

Ted Sweetney
INSPECTOR'S SIGNATURE

Oct 26, 2006
DATE

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	27	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	45	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4