


Bannerman

Learning Center



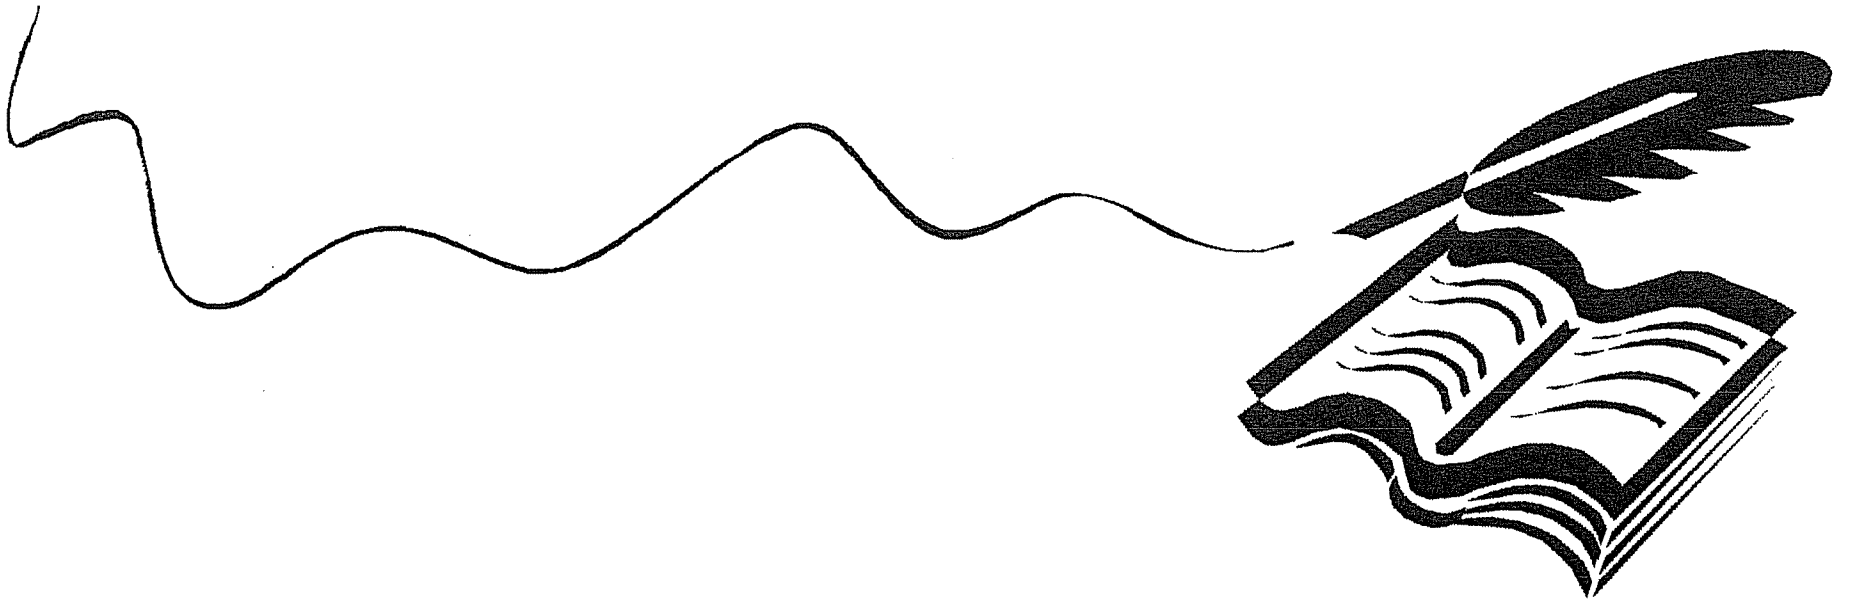

FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0003

FACILITY: BANNERMAN LEARNING CENTER
608 MILL STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 31, 2006

[Signature]
 INSPECTOR'S SIGNATURE

Oct 31, 2006
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	205	EXHAUST FAN NOT WORKING	X							FMC
2	208	FIRE ALARM PANEL COVER MISSING				X				
2	229	POWER STRIP TO POWER STRIP – REMOVE		X						NFPA 70 400.8



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0003

FACILITY: BANNERMAN LEARNING CENTER
608 MILL STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 31, 2006

Ted Sweetland

 INSPECTOR'S SIGNATURE

Oct 31, 2006

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	OK								
92	2	OK								
92	3	OK								
92	4	OK								
92	5	OK								
92	6	OK								
92	7	OK								
92	8	OK								
92	9	OK								
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0003

FACILITY: BANNERMAN LEARNING CENTER
608 MILL STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 31, 2006

Ted Sweetland

 INSPECTOR'S SIGNATURE

Oct 31, 2006

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	30	OK								
92	31	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	OK								
92	36	OK								
92	37	OK								
92	38	OK								
92	39	OK								
92	40	OK								
92	42	OK								
92	43	OK								
92	50	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0003

FACILITY: BANNERMAN LEARNING CENTER
608 MILL STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 31, 2006


Tod Sweetow
INSPECTOR'S SIGNATURE

Oct 31, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	52	OK								

Green Cove Springs

Junior High School

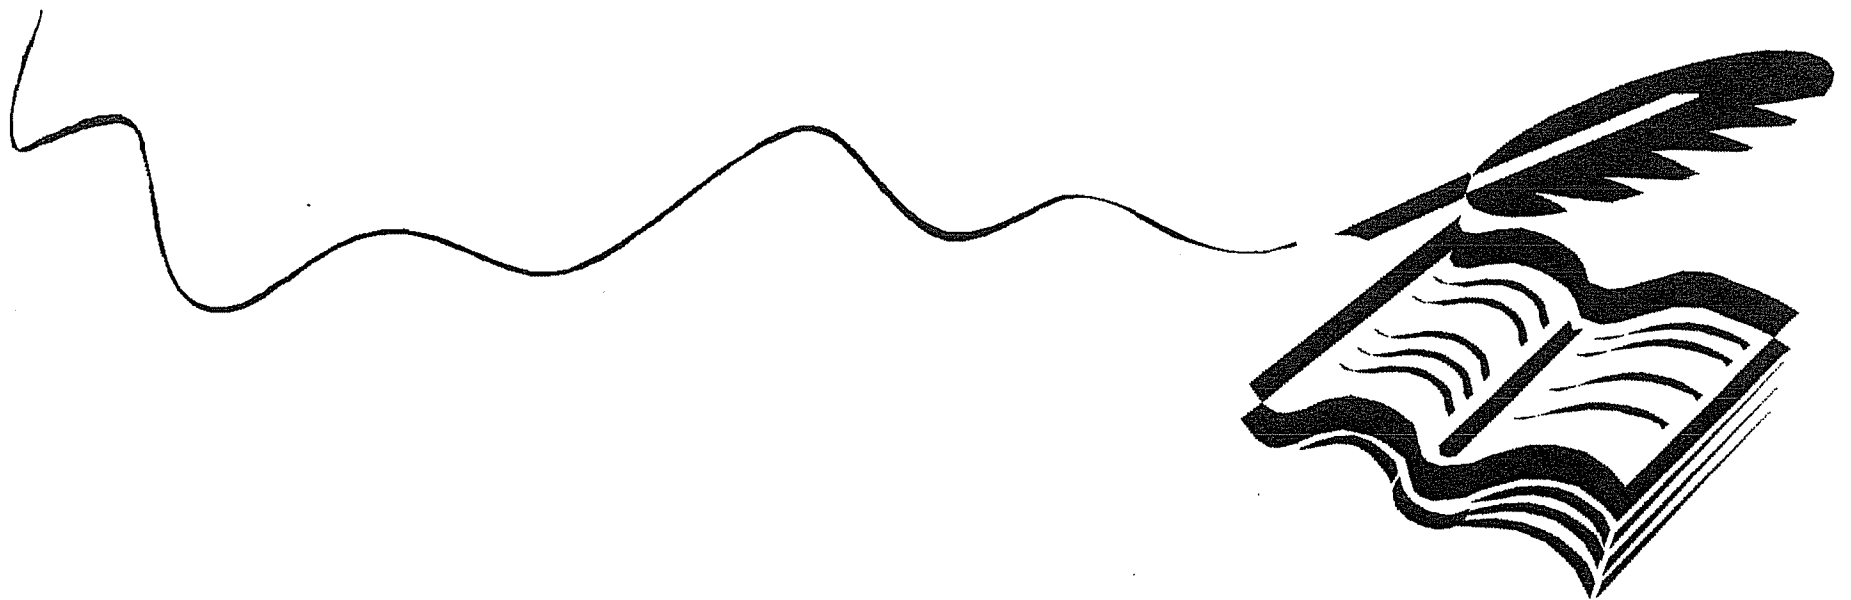



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: _____

FACILITY: GREEN COVE SPRINGS JUNIOR HIGH SCHOOL
1220 BONAVENTURE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 1, 2006

Tom Swartz
INSPECTOR'S SIGNATURE

Nov 1, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	7	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	100	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	802	EXIT LIGHT NEEDS TO BE ADDED	X							FBC 1016.3.1
1	147A	OUTSIDE GFCI COVER MISSING		X						NFPA 70 110.26
1	107	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	800	EXIT LIGHT NEEDS TO BE ADDED	X							FBC 1016.3.1
1	12	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	15B	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	15A	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	14A	NO EMERGENCY LIGHT		X						FBC 423.17.1
2	16	NO EMERGENCY LIGHT		X						FBC 423.17.1
2	17	NO EMERGENCY LIGHT		X						FBC 423.17.1
2	19	NO EMERGENCY LIGHT		X						FBC 423.17.1
2	20	NO EMERGENCY LIGHT		X						FBC 423.17.1



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: _____

FACILITY: GREEN COVE SPRINGS JUNIOR HIGH SCHOOL
1220 BONAVENTURE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 1, 2006

Ted Sweetland
INSPECTOR'S SIGNATURE

Nov 1, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	103	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	106	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	107	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	30	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	32	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	35	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	31	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
4	422	EMERGENCY LIGHT OUT		X						FBC 423.17.1
5	535	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
5	545	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
6	103	EXIT LIGHT OUT		X						FBC 1016.3.1
6	109	EXIT LIGHT OUT		X						FBC 1016.3.1
7	701	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	702	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: _____

FACILITY: GREEN COVE SPRINGS JUNIOR HIGH SCHOOL
1220 BONAVENTURE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 1, 2006

Tad Sweatt
INSPECTOR'S SIGNATURE

Nov 1, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
7	706	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	707	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	708	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	709	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
8	800	GFCI COVER MISSING		X						FBC 423.14.2.4
8	803	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
9	910	AC DEFUSER MISSING	X							



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: _____


FACILITY: GREEN COVE SPRINGS JUNIOR HIGH SCHOOL
1220 BONAVENTURE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 1, 2006
Tod Sweattow
 INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	70	OK								
92	104	OK								
92	105	OK								
92	106	OK								
92	107	OK								
92	112	OK								

Lake Asbury

Junior High School

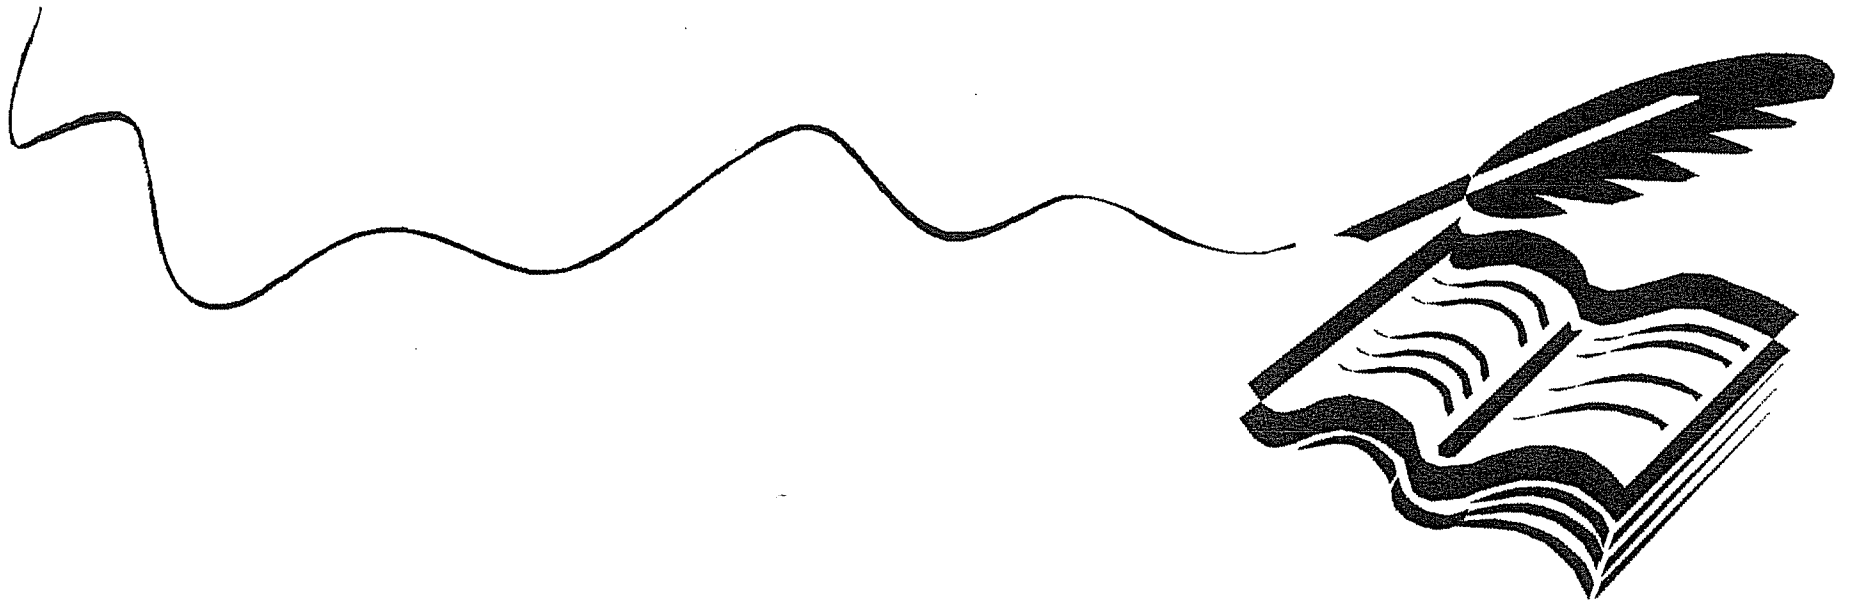



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0025

FACILITY: LAKE ASBURY JUNIOR HIGH SCHOOL
2851 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 7, 2006

[Handwritten Signature]
INSPECTOR'S SIGNATURE DATE 11-7-06

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	111	CEILING TILE MISSING		X						FBC 804.2.3
1	119	HOOD NOT CERTIFIED	X							
1	105	STAINED CEILING TILE	X							FBC 804.2.3
1	111	STAINED CEILING TILE	X							FBC 804.2.3
2	220	IS BOX OPEN				X				
3	344	MATERIAL STORED TOO HIGH		X						NFPA 1 12-1
5	520	MATERIAL STORED TOO HIGH		X						NFPA 1 12-1
5	525	IS BOX OPEN				X				
6	610	STAINED CEILING TILE		X						FBC 804.2.3
7	610	EXTERIOR – SOUTHEAST CORNER CANOPY LOOSE AND DAMAGING BUILDING	X							
7	702	REPLACE FIRE EXTINGUISHER	X							
7	715	REPLACE FIRE EXTINGUISHER	X							
7	709	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	715	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423 14.2.4



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
 COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0025

FACILITY: LAKE ASBURY JUNIOR HIGH SCHOOL
2851 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: NOVEMBER 7, 2006


[Handwritten Signature]
 INSPECTOR'S SIGNATURE

11-9-06
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	423	OUTLET COVER MISSING BY ELECTRICAL PANEL	X							NFPA 70 314.1
92	424	EXTERIOR CORNER TRIM MISSING ON SOUTHEAST AND SOUTHWEST CORNER; SIDING LOOSE ON SOUTH WALL	X							

Lakeside

Junior High School

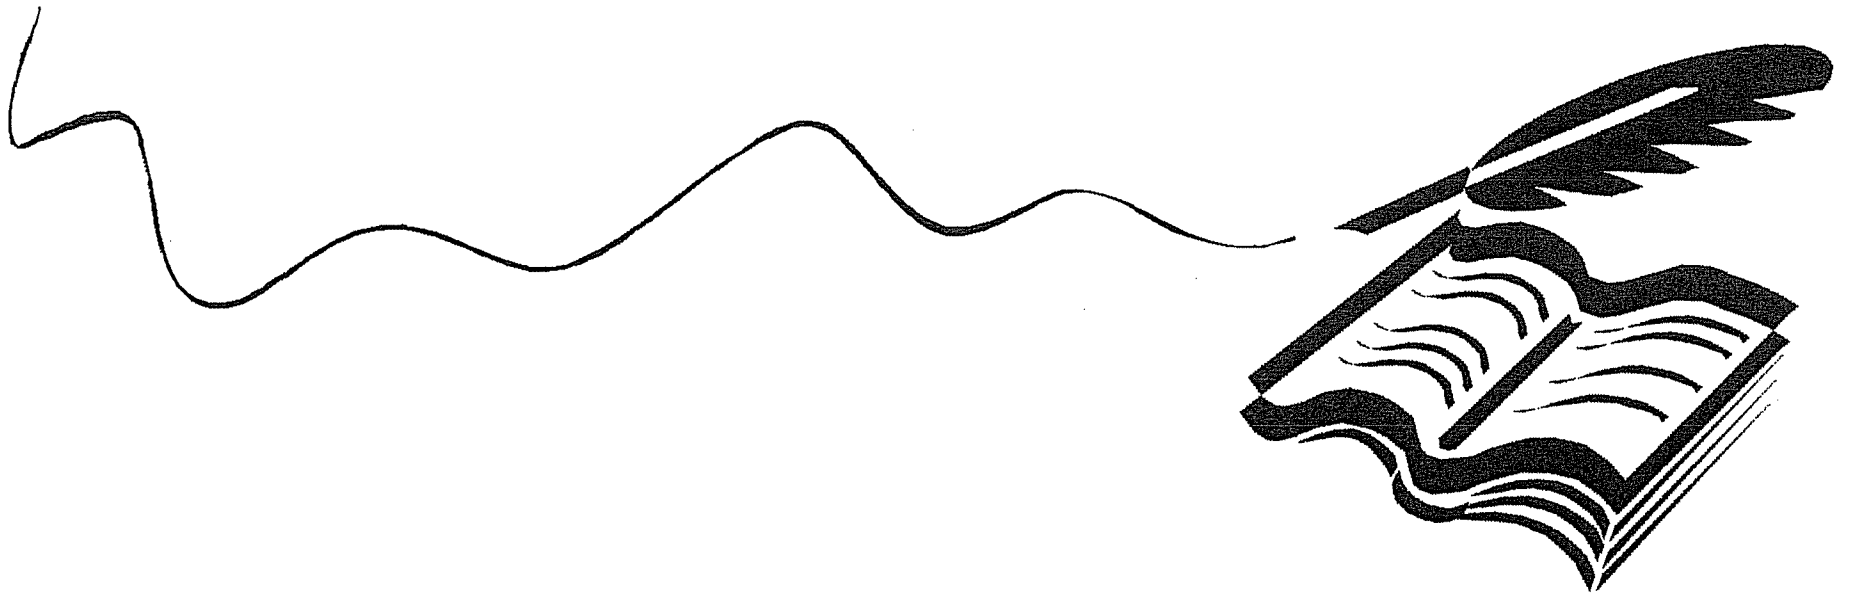



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0014

FACILITY: LAKESIDE JUNIOR HIGH SCHOOL
2750 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

Bob Sweetman
INSPECTOR'S SIGNATURE

Nov 9, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	9	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	10	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
1	11	CEILING TILES MISSING		X						FBC 804.2.3
1	12	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	12	EXTINGUISHER NOT SIGNED		X						69A-58
1	18	CEILING TILE MISSING		X						FBC 804.2.3
1	20	NO EMERGENCY LIGHT	X							FBC 423.17.1
1	21	BOTH EXTINGUISHERS NOT SIGNED		X						69A-58
1	23	URINAL DIVIDER BROKEN		X						
1	24	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	40	NO EXIT SIGN		X						FBC 1016.3.1
2	31	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	38	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	46	DOOR CLOSURE BROKEN		X						



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0014

FACILITY: LAKESIDE JUNIOR HIGH SCHOOL
2750 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

Ted Sweeten
INSPECTOR'S SIGNATURE

Nov 9, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	43	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	44	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	45	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	53	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	54	NO EMERGENCY LIGHT	X							FBC 423.17.1
2	55	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	56	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	57	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	58	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	69	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	70	NO EMERGENCY LIGHT	X							FBC 423.17.1
3	71	NO EMERGENCY LIGHT	X							FBC 423.17.1
5	118	EMERGENCY LIGHT OUT		X						FBC 423.17.1
5	133	EMERGENCY LIGHT OUT		X						FBC 423.17.1



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0014

FACILITY: LAKESIDE JUNIOR HIGH SCHOOL
2750 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

Led Sweetland
INSPECTOR'S SIGNATURE

Nov 9, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
5	215	NO OCCUPANCY LOAD SIGN		X						FBC 1004.3
5	216	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9		FIRE EXTINGUISHER NOT SIGNED - WHOLE BLDG.		X						69A-58



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0014

FACILITY: LAKESIDE JUNIOR HIGH SCHOOL
2750 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

Ted Sweatt
INSPECTOR'S SIGNATURE

Nov 9, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	OK								
92	705	OK								
92	706	OK								
92	708	OK								
92	710	OK								
92	721	OK								
92	722	OK								
92	723	OK								
92	725	OK								
92	733	OK								
92	735	OK								
92	737	OK								
92	745A	OK								
92	745B	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0014

FACILITY: LAKESIDE JUNIOR HIGH SCHOOL
2750 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

Ted Sweetland

 INSPECTOR'S SIGNATURE


Nov 9, 2006

 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	791	OK								
92	792	OK								
92	793	OK								
92	794	OK								
92	702	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
92	703	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
92	704	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Orange Park

Junior High School

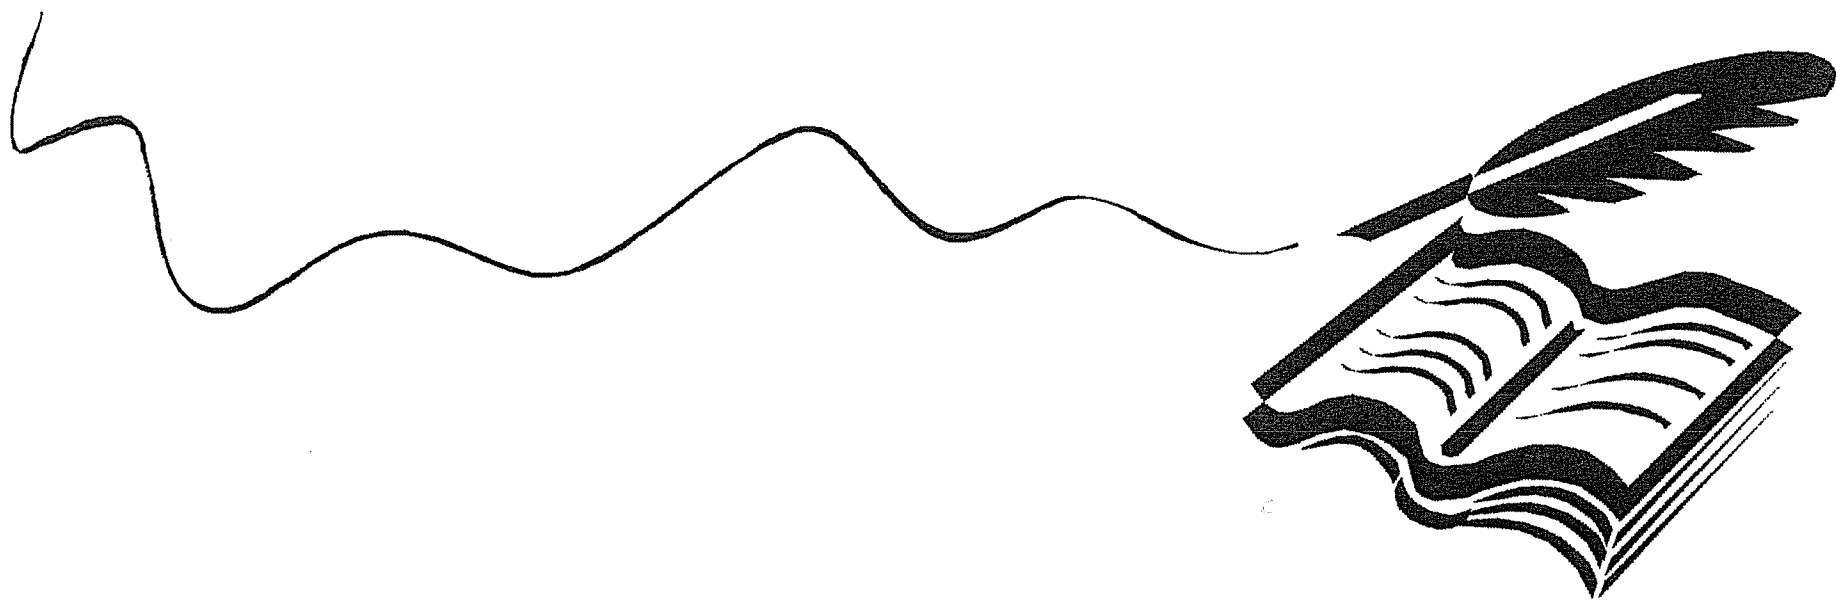



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0016

FACILITY: ORANGE PARK JUNIOR HIGH SCHOOL
1550 GANO AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

[Signature]
INSPECTOR'S SIGNATURE

11-9-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	110	CEILING TILE MISSING		X						FBC 804.2.3
1	110	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	110	OPEN ELECTRICAL BOX ABOVE CEILING		X						NFPA 70 110.26
1	121	EXIT LIGHT OUT		X						FBC 1205.3
1	121	EXTENSION CORD TO LIGHTS AT CEILING		X						NFPA 70 400.8
1	121	PAINT STORED		X						FBC 423.20.4.2
1	123	ELECTRICAL BOX OPEN BY ANSUL SYSTEM								NFPA 70 110.26



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0016

FACILITY: ORANGE PARK JUNIOR HIGH SCHOOL
1550 GANO AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 9, 2006

[Handwritten Signature]
INSPECTOR'S SIGNATURE

11-9-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	501	RAMP NEEDS REPAIR		X						FBC 1013.9
92	503	OK								
92	504	OK								
92	505	SIDERAILS AND RAMP DAMAGED	X							FBC 11-8.4
92	506	OK								
92	507	OK								
92	508	OK								
92	509	RAMP & STAIRS DETERIORATING		X						FBC 1013.9
92	510	OK								
92	511	OK								
92	512	OK								
92	513	OK								
92	514	OK								
92	515	OK								



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0016

FACILITY: ORANGE PARK JUNIOR HIGH SCHOOL
1550 GANO AVENUE
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: NOVEMBER 9, 2006

[Signature]
INSPECTOR'S SIGNATURE 11-9-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	516	OK								
92	703	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	704	SPINDLES MISSING ON RAMP	X							FBC 1013.7
92	705	OK								
92	706	OK								
92	707	OK								
92	708	OK								
92	710	OK								
92	712	OK								

Wilkinson

Junior High School

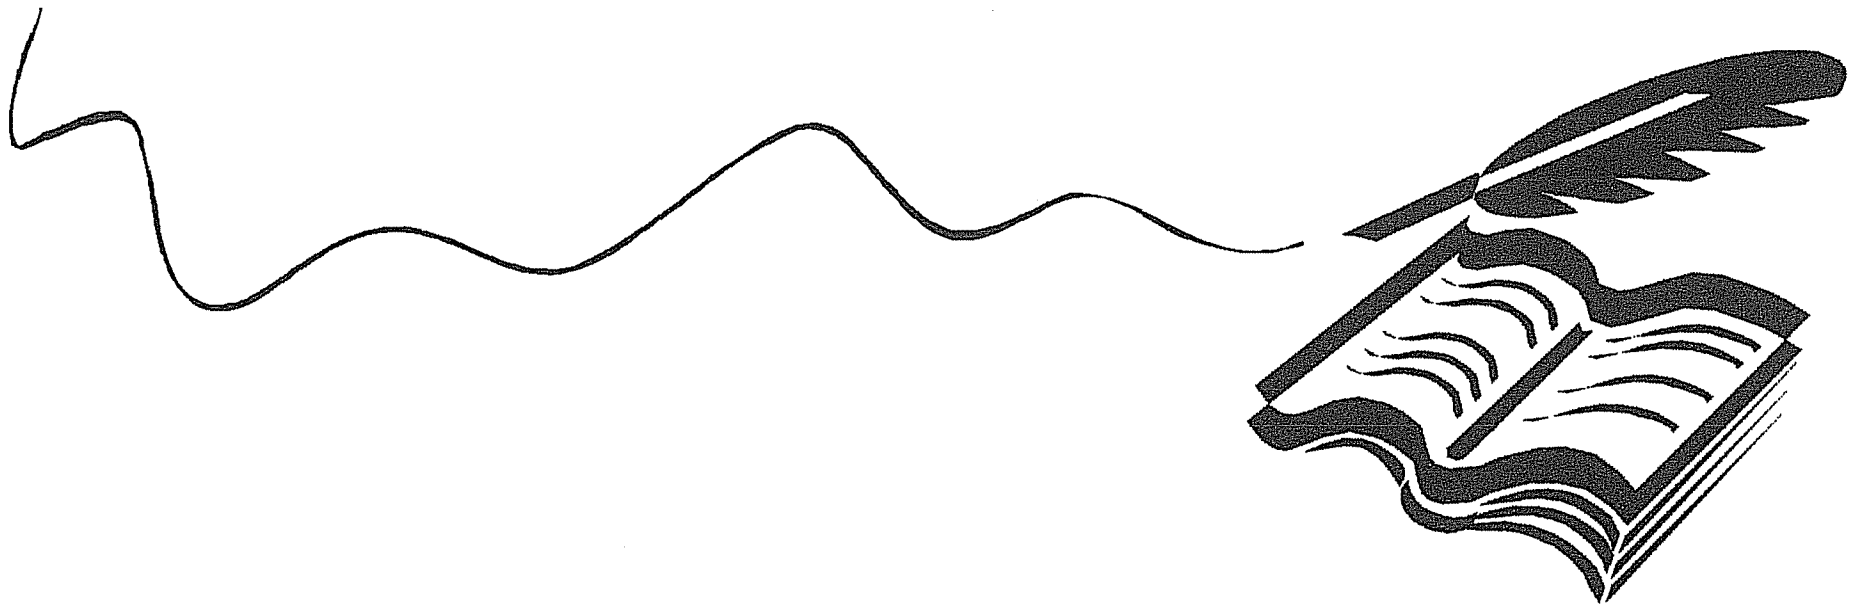



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0017

FACILITY: WILKINSON JUNIOR HIGH SCHOOL
5025 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: NOVEMBER 16, 2006

Garrett A. Swann
INSPECTOR'S SIGNATURE

11-16-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	130	LIGHT FIXTURE BROKEN	X							FBC 423.17.1
1	129	EXIT LIGHT OUT	X							FBC 423.17.1
2	214	PAINT STORED IN CLOSET		X						NFPA 1
	220	LIGHT FIXTURE BROKEN	X							FBC 423.17.1
	219	CEILING FALLING @ STAIRS	X							
	209	FIRE EXTINGUISHER NOT SIGNED		X						69A-58.008
3	301	OCCUPANT LOAD SIGN MISSING	X							FBC 1004.3
3	326	AC CONTROL PANEL OPEN	X							NFPA 70 110.12
4	407	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
5	507	EXIT LIGHT OUT	X							FBC 423.17.1
5	509	LIGHT COVERS MISSING	X							NFPA 70 401.3
5	504	EXIT LIGHTS OUT	X							FBC 423.17.1
5	503	EMERGENCY LIGHT OUT	X							FBC 423.17.1
5	503	FIRE ALARM BOX OPEN	X							



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0017

FACILITY: WILKINSON JUNIOR HIGH SCHOOL
5025 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: NOVEMBER 16, 2006

[Signature]
INSPECTOR'S SIGNATURE

11-16-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
6	600	EXIT LIGHT OUT	X							FBC 423.17.1
6	600	REPLACE FIRE EXTINGUISHER		X						NFPA 1 13.6.6.7
6	603	EMERGENCY LIGHT OUT	X							FBC 423.17.1
6	606	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
6	612	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
7	703	FIRE ALARM WIRE NOT CONNECTED	X							FBC 423.7.7
7	703	SMOKE DETECTOR BROKEN	X							FBC 423.7.7
7	734	LIGHT OUT	X							FBC 423.17.1
7	728	EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
7	777	LIGHT OUT	X							FBC 423.17.1
7	789	AC CONTROL COVER MISSING	X							NFPA 312.5
7	789	EXTINGUISHER NOT SIGNED		X						69A-58.008
7	790	EXTINGUISHER NOT SIGNED		X						69A-58.008
7	790	LIGHT OUT	X							FBC 423.17.1



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0017

FACILITY: WILKINSON JUNIOR HIGH SCHOOL
5025 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: NOVEMBER 16, 2006

Paul A. Brown
 INSPECTOR'S SIGNATURE

11-16-06
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	2	OK								
92	3	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	4	OK								
92	5	OK								
92	6	OK								
92	7	OK								
92	8	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	9	OK								
92	10	OK								
92	11	OK								
9	12	OK								
92	17	OK								
92	18	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	30	OK								



FISCAL YEAR 2006-2007

**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0017

FACILITY: WILKINSON JUNIOR HIGH SCHOOL
5025 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: NOVEMBER 16, 2006

[Handwritten Signature]
INSPECTOR'S SIGNATURE

11-16-06
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	27	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	26	OK								
92	25	EMERGENCY LIGHT INOPERABLE	X							FBC 423.17.1
92	23	ERMEGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	24	OK								
92	22	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	22	EMERGENCY LIGHT INSPECTION	X							FBC 423.17.1
92	21	OK								
92	41	SPINDLES MISSING ON RAMP	X							FBC 1013.7
92	40	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	42	OK								
92	43	OK								
92	46	OK								
92	48	OK								



FISCAL YEAR 2006-2007

COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN
COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0017

FACILITY: WILKINSON JUNIOR HIGH SCHOOL
5025 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: NOVEMBER 16, 2006

[Handwritten Signature]
 INSPECTOR'S SIGNATURE

11-16-06
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	96	OK								