



ANCILLARIES

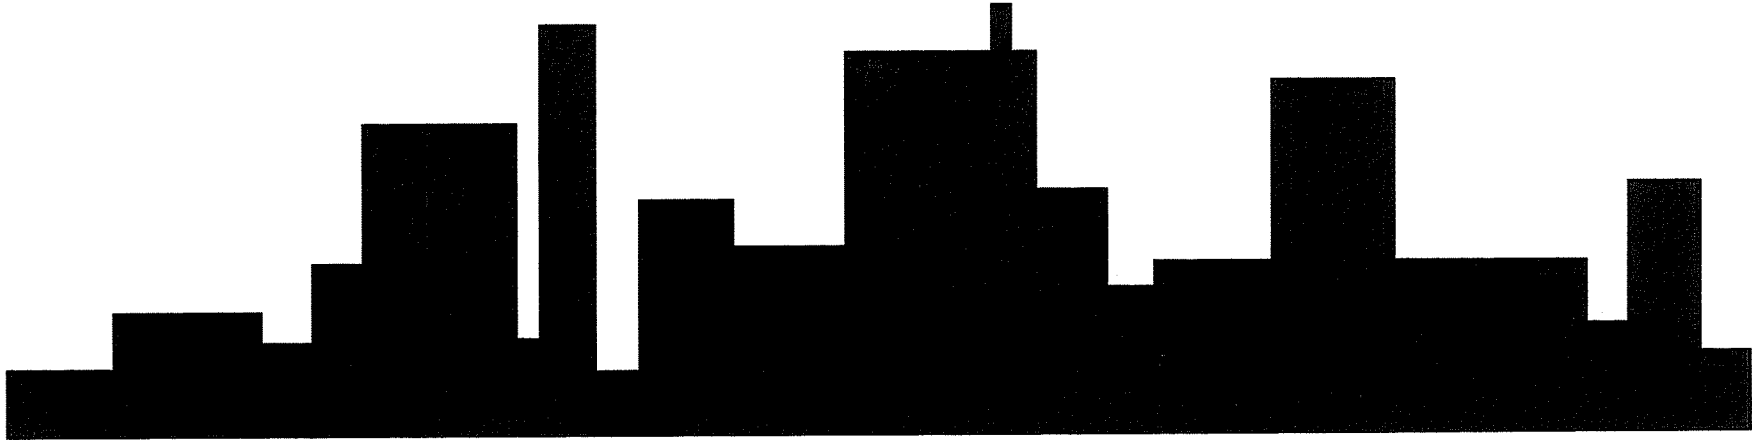

Administrative Office

Orange Park Annex

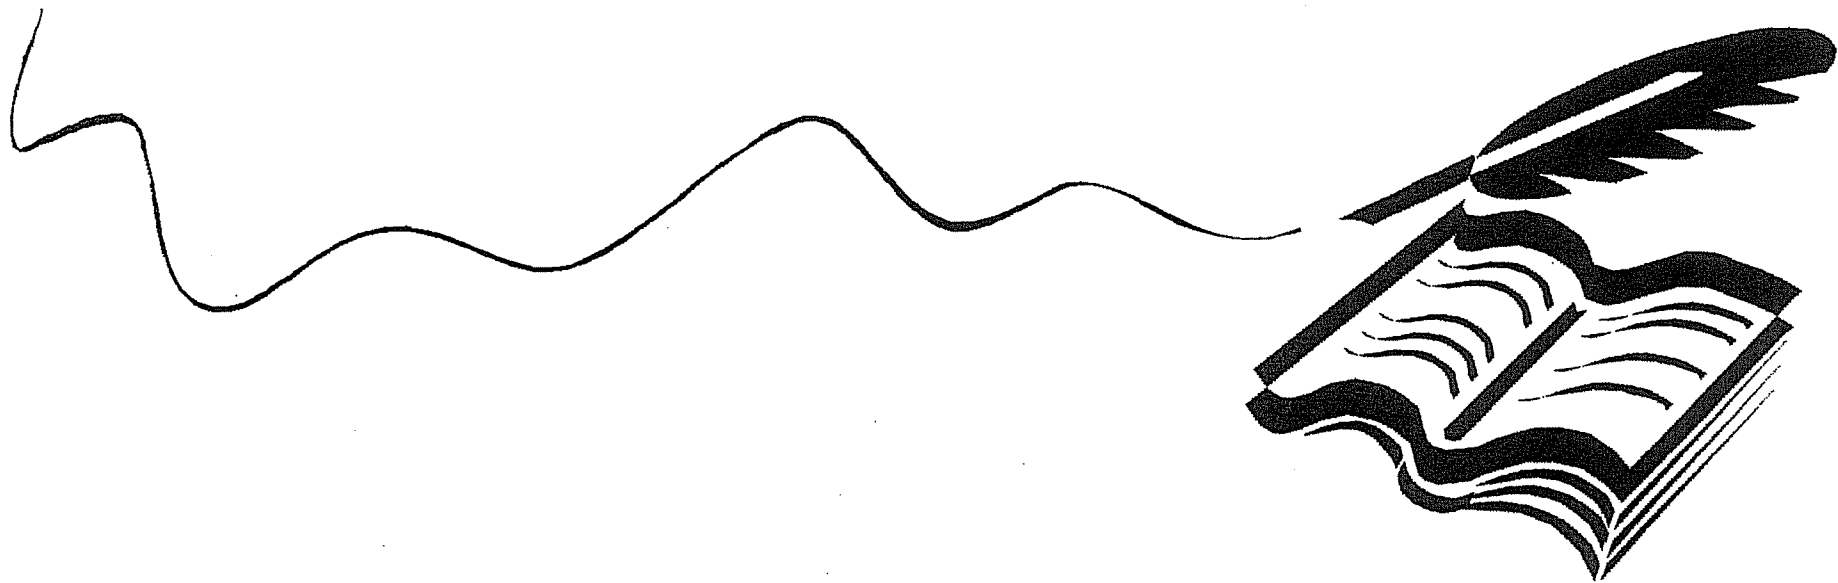

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 26, 2010

[Handwritten Signature]
 INSPECTOR'S SIGNATURE

10-26-10
 DATE




**COMPREHENSIVE SAFETY & SANITATION
 INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "CASUALTY SAFETY & SANITATION INSPECTION"
 IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101**

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16		OK								
17		NO EMERGENCY LIGHTS IN WHOLE BUILDING (IMPLEMENT THIS IN REMODEL SCHD. FOR 2011)			X					FBC 423.17.1
17	2	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
17	4	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
17	5	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
17	6	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
17	7	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

Clay

Superintendents

Office

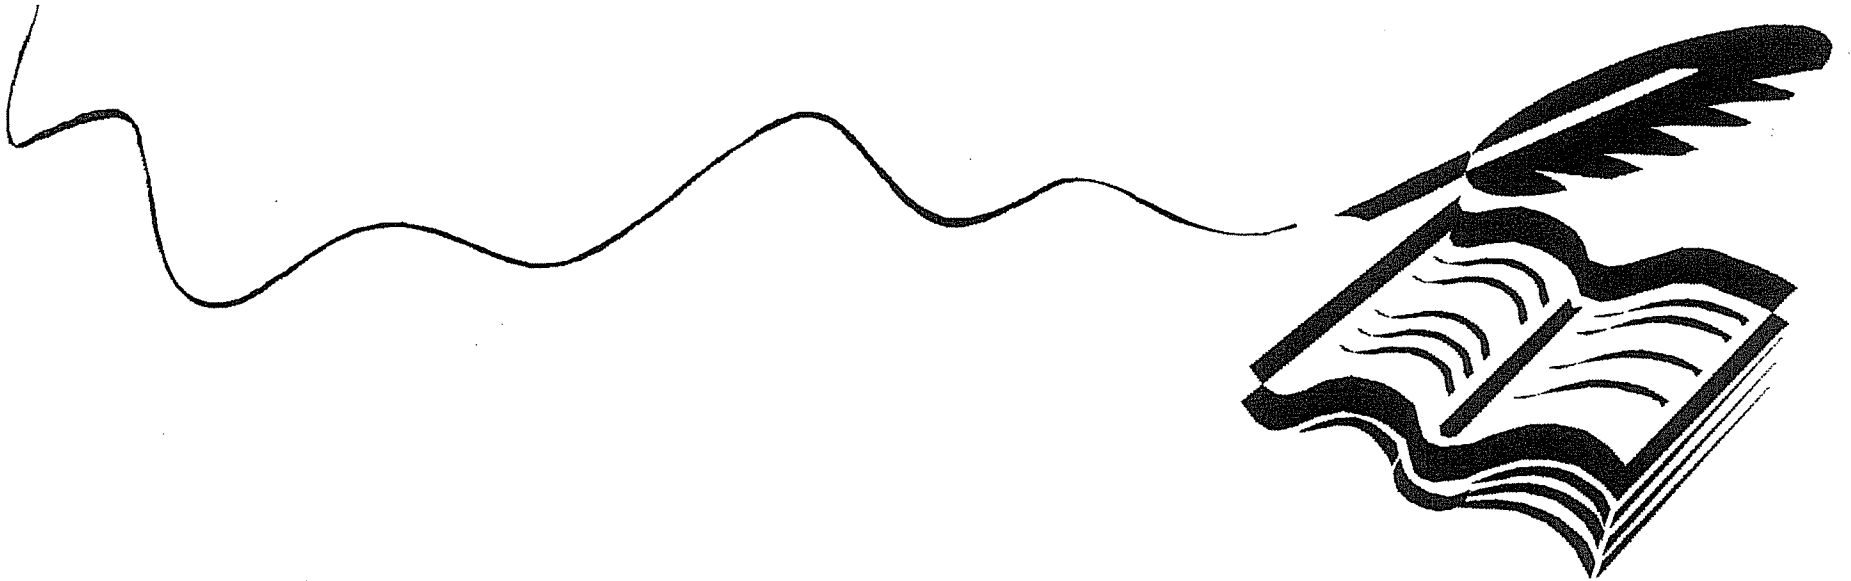

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0036

**COMPREHENSIVE SAFETY & SANITATION
 INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "CASUALTY SAFETY & SANITATION INSPECTION"
 IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY: CLAY SUPERINTENDENT'S OFFICE
900 WALNUT STREET
GREEN COVE SPGS., FLORIDA 32043

INSPECTION DATE: FEBRUARY 25, 2011

Zed Smeetham
 INSPECTOR'S SIGNATURE

Feb 25, 2011
 DATE



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	7	STORAGE TO HIGH - 18" FROM CEILING		X						
3	23	LIGHTS OUT		X						FBC 1016.3.1
3	25	FIRE ALARM IN TROUBLE MODE, ZONE 3	X							NFPA 1(2000)-10
3	25	FIRE ALARM OPEN IN CEILING	X							
3	15	CEILING TILES SLID OPEN	X							
3	48	LIGHT WITH NO COVER		X						

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0036

**COMPREHENSIVE SAFETY & SANITATION
 INSPECTION REPORT**
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: CLAY SUPERINTENDENT'S OFFICE
900 WALNUT STREET
GREEN COVE SPGS., FLORIDA 32043

INSPECTION DATE: FEBRUARY 25, 2011

Ed Sweatt

 INSPECTOR'S SIGNATURE

Feb 25, 2011


 DATE



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	FIRE ALARM NOT WORKING	X							NFPA 72
95	1	NO ROOM NUMBER		X						
95	2	NO ROOM NUMBER		X						


Food Services

Storage

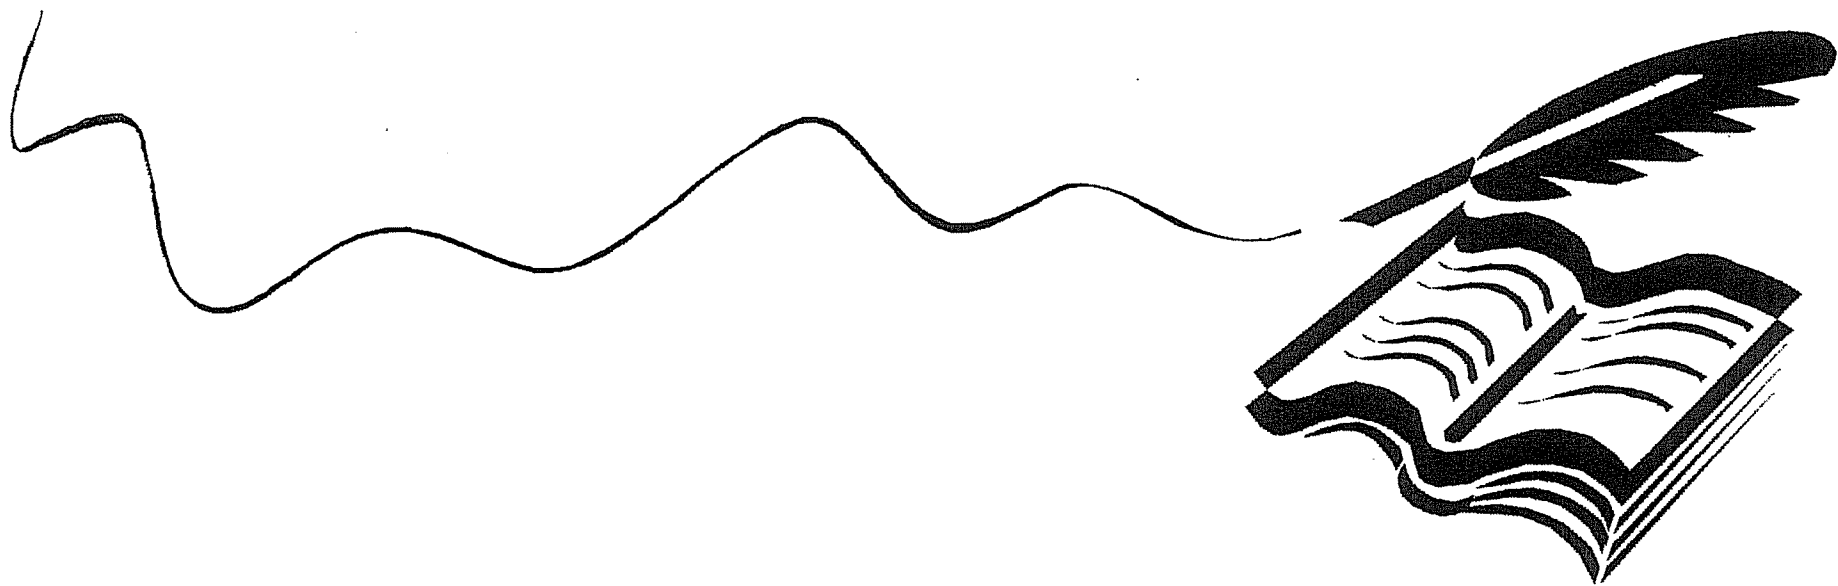

Harris C. Long

Administration

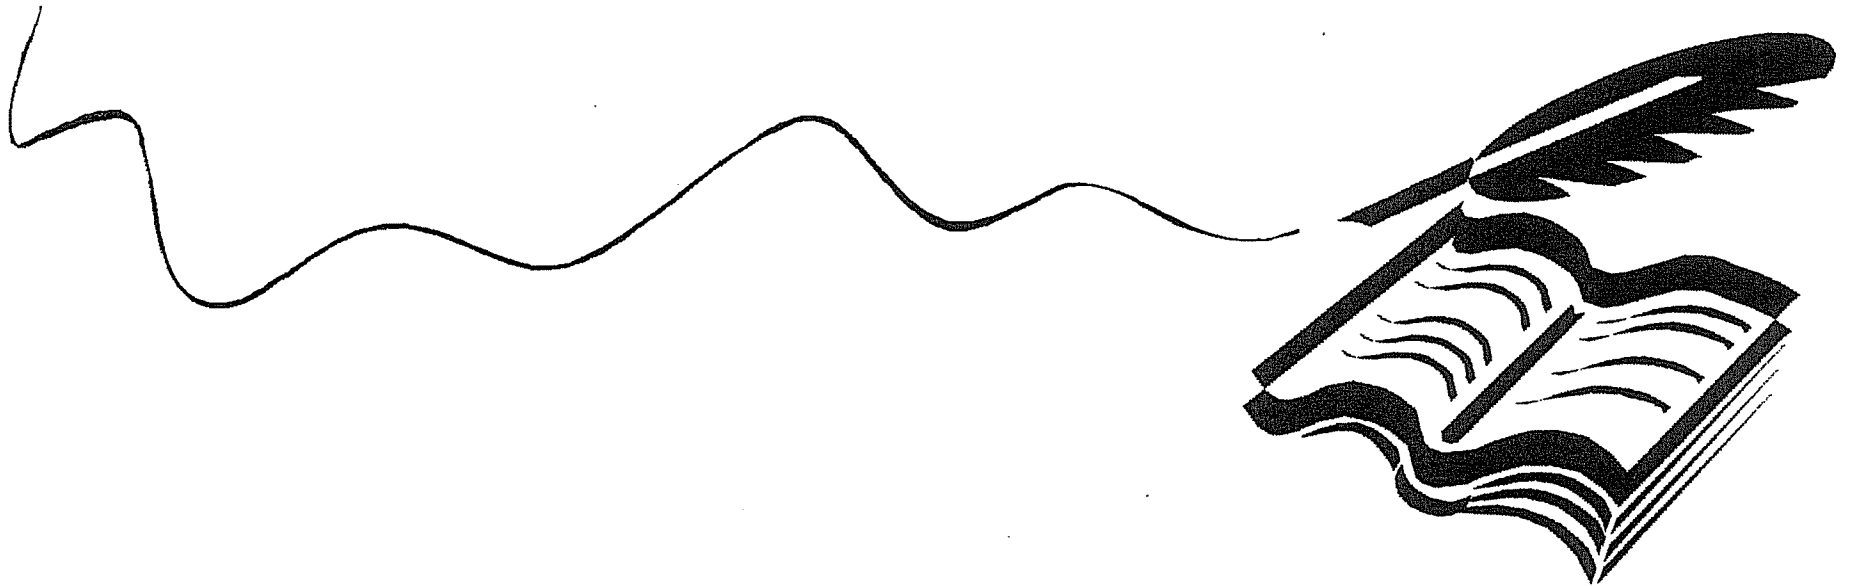

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0027

**COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY: H.C. LONG ADMINISTRATION BUILDING
23 SOUTH GREEN STREET
GREEN COVE SPGS., FLORIDA 32043

INSPECTION DATE: FEBRUARY 25, 2011

Ed Sweetland
INSPECTOR'S SIGNATURE


2-25-11
DATE



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	100	BOTH EMERGENCY LIGHTS OUT		X						FBC 423.17.1
1	127	LOTS OF STORAGE BLOCKING BATHROOM STALLS		X						
2		OK								
3	300	BOTH EMERGENCY LIGHTS OUT ELECTRICAL PANEL BEING REPLACED		X						FBC 423.17.1
4	407A	OUTLET COVER MISSING HIGH ON WALL		X						
4	407B	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	404A	NO EXIT LIGHT - ADD	X							FBC 1006.3.1

Keystone Heights

Transportation

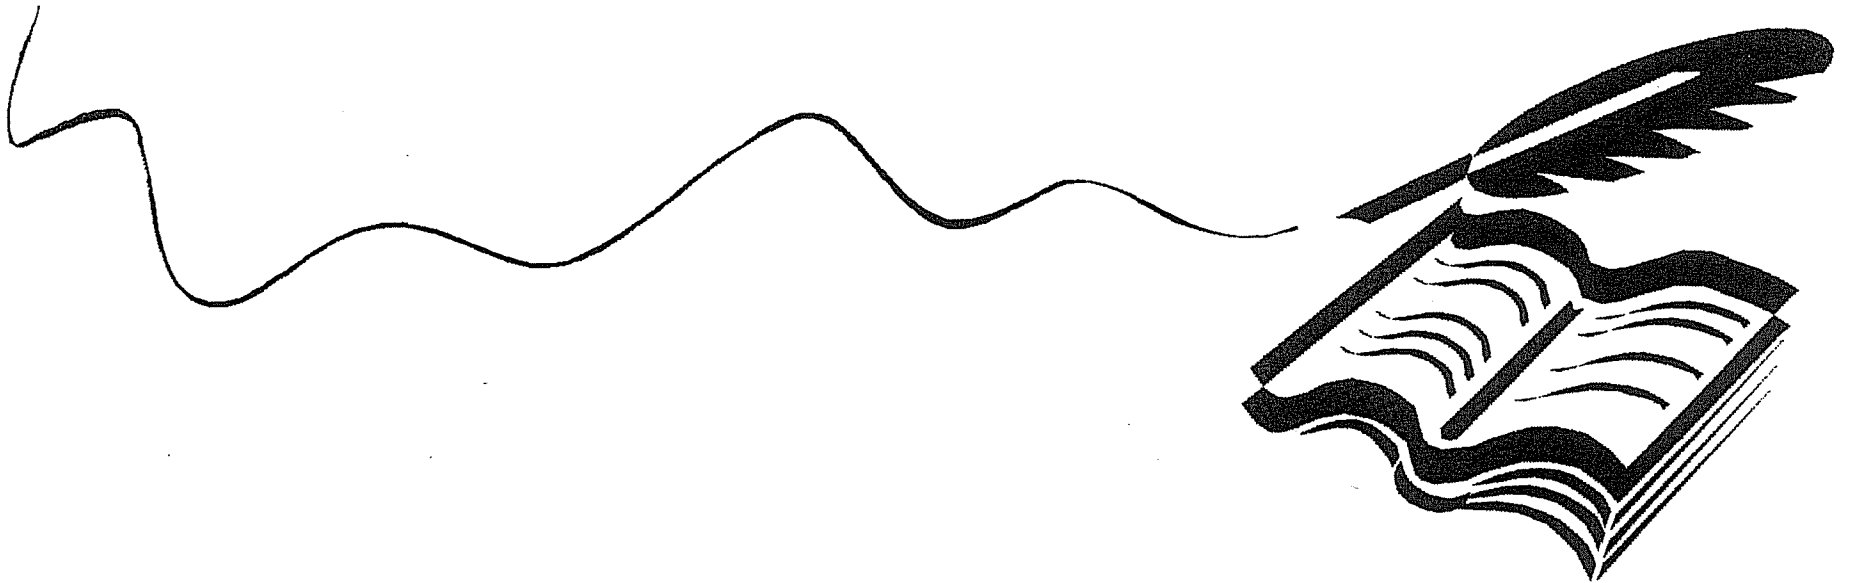

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0037

**COMPREHENSIVE SAFETY & SANITATION
 INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "CASUALTY SAFETY & SANITATION INSPECTION"
 IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY: KEYSTONE HEIGHTS TRANSPORTATION
6800 COUNTY ROAD 315
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: FEBRUARY 16, 2011


Tom Sweatland
 INSPECTOR'S SIGNATURE 2-16-11
DATE



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
91	1	OK								
95	2	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
95	2	NO ROOM NUMBER		X						69A-58
95	2	NO ACCESSIBLE PARKING OR WALKWAY			X					FBC - 11
95	2	SHELF BLOCKING ELECTRICAL PANEL - MOVE SHELF		X						NFPA-70-110

Middleburg

Transportation

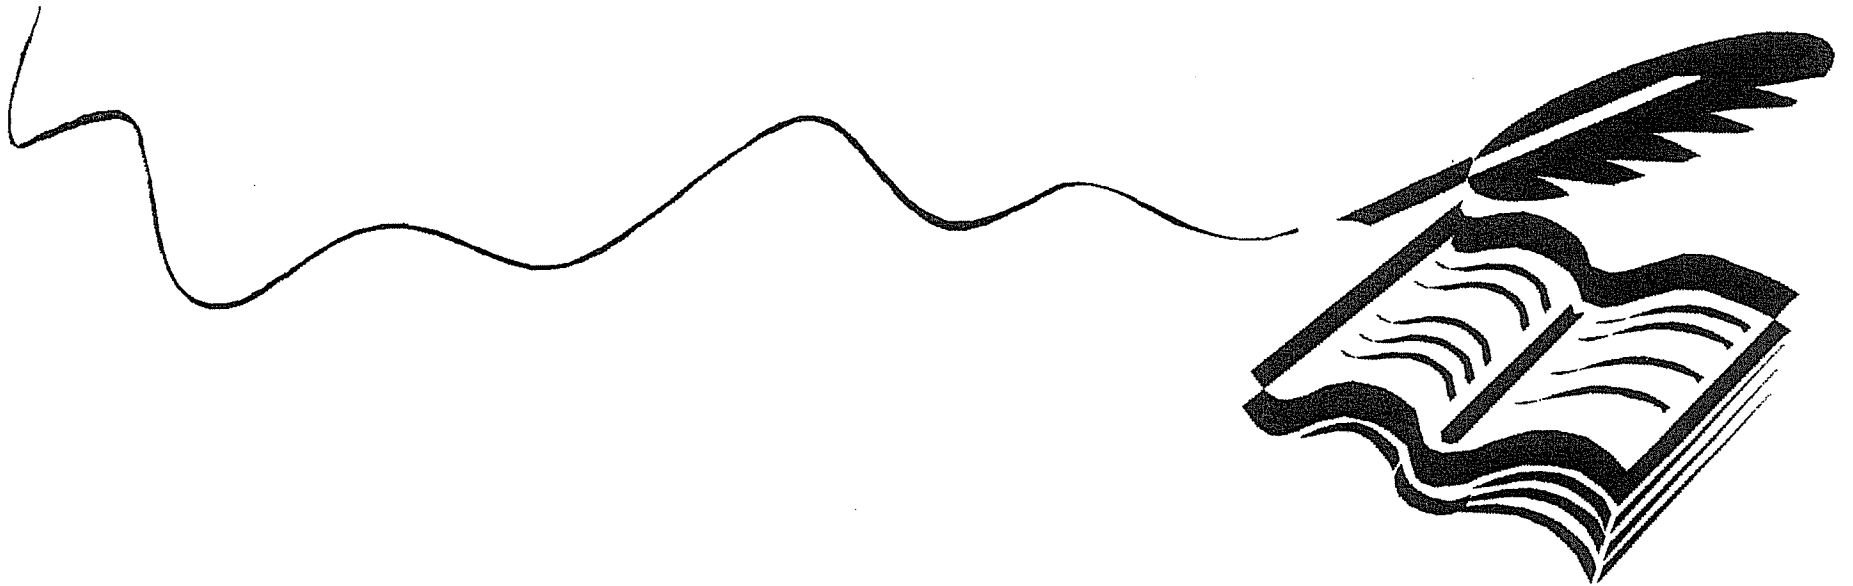

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0033

**COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT**

FACILITY: MIDDLEBURG TRANSPORTATION
3674 COUNTY ROAD 220
MIDDLEBURG, FLORIDA 32043



**STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

INSPECTION DATE: JANUARY 14, 2011


[Signature]
INSPECTOR'S SIGNATURE

1-14-11
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	102	MOISTURE PROBLEM - DRYWALL DETERIORATING	X							
1	111	TWO LIGHT COVERS MISSING BY ROOM113		X						
1	110	THREE LIGHT COVERS MISSING		X						
3		OK								

School Bus

Garage

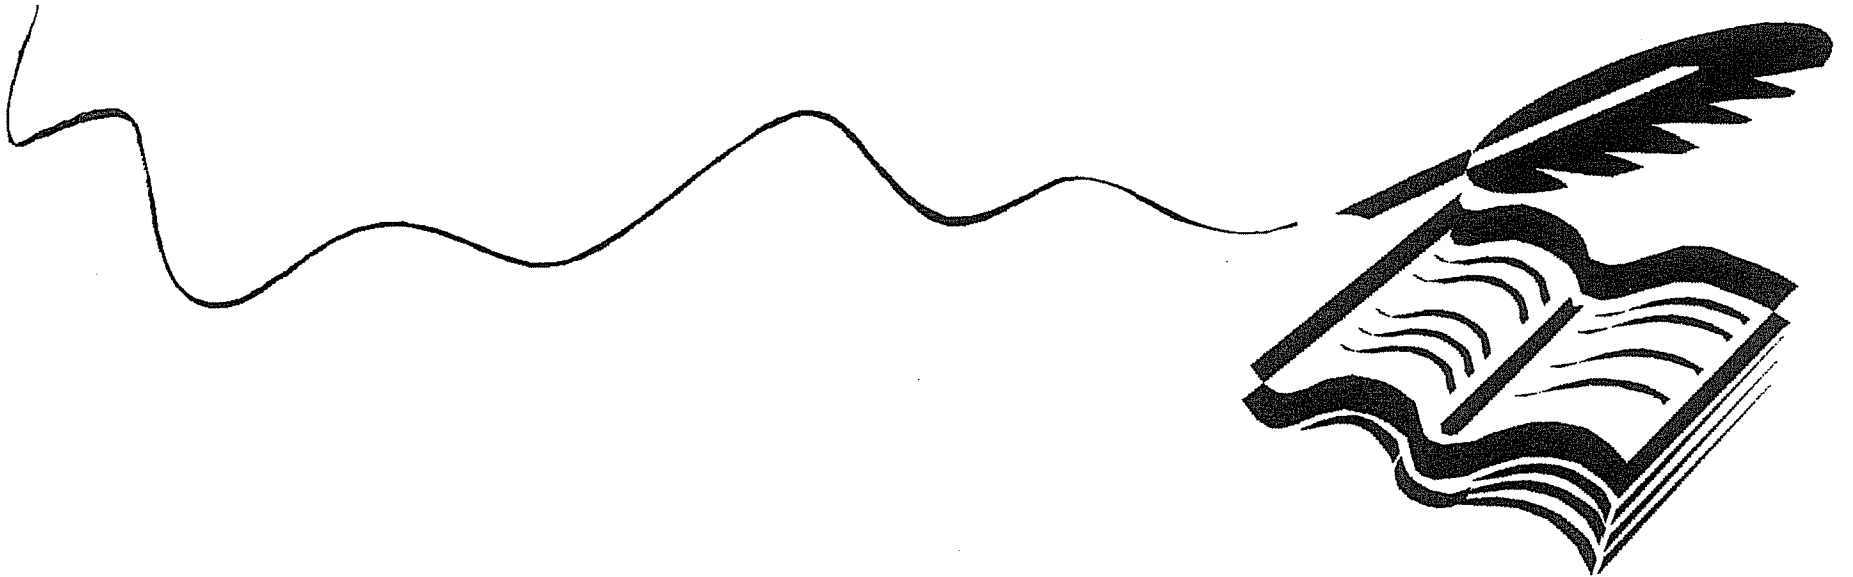

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0030

**COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT**

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION
800 CENTER STREET
GREEN COVE SPRINGS, FLORIDA 32043



**STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

INSPECTION DATE: FEBRUARY 2, 2011

Ted Sweatman
INSPECTOR'S SIGNATURE 2-2-11
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	11	EMERGENCY LIGHT OUT BY BACK DOOR		X						FBC 423.17.1
1	10	REMOVE EXIT STICKER FROM DOOR - NOT AN EXIT		X						
1	200	BOTH EMERGENCY LIGHTS OUT		X						FBC 423.17.1

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0030

**COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT**

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION
800 CENTER STREET
GREEN COVE SPRINGS, FLORIDA 32043



**STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

INSPECTION DATE: FEBRUARY 2, 2011


Ted Sweatland
INSPECTOR'S SIGNATURE

2-2-11
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	2	OK								
91	3	FIRE EXTINGUISHER NOT CURRENT		X						69A-58


Support Services

AG Lot

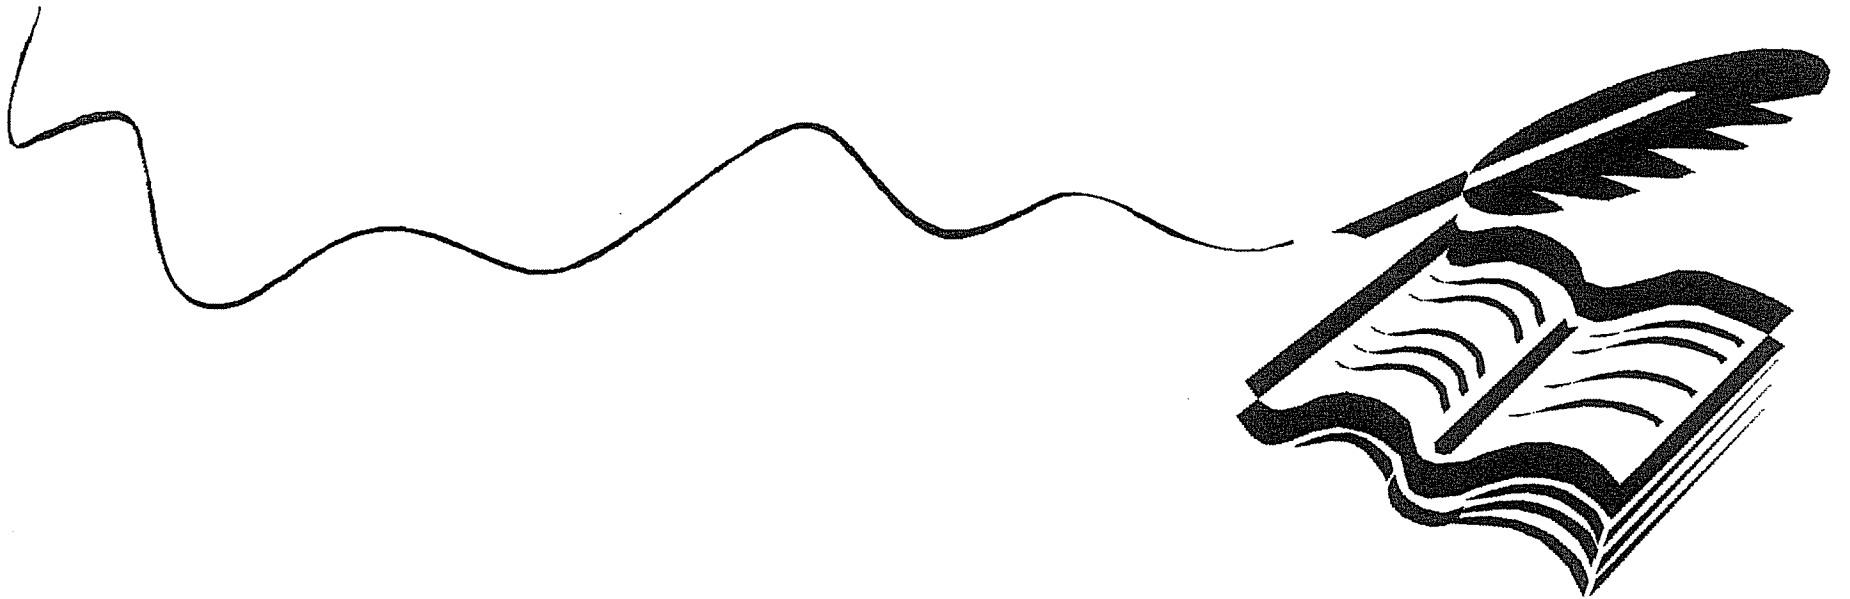

Support Services

Center

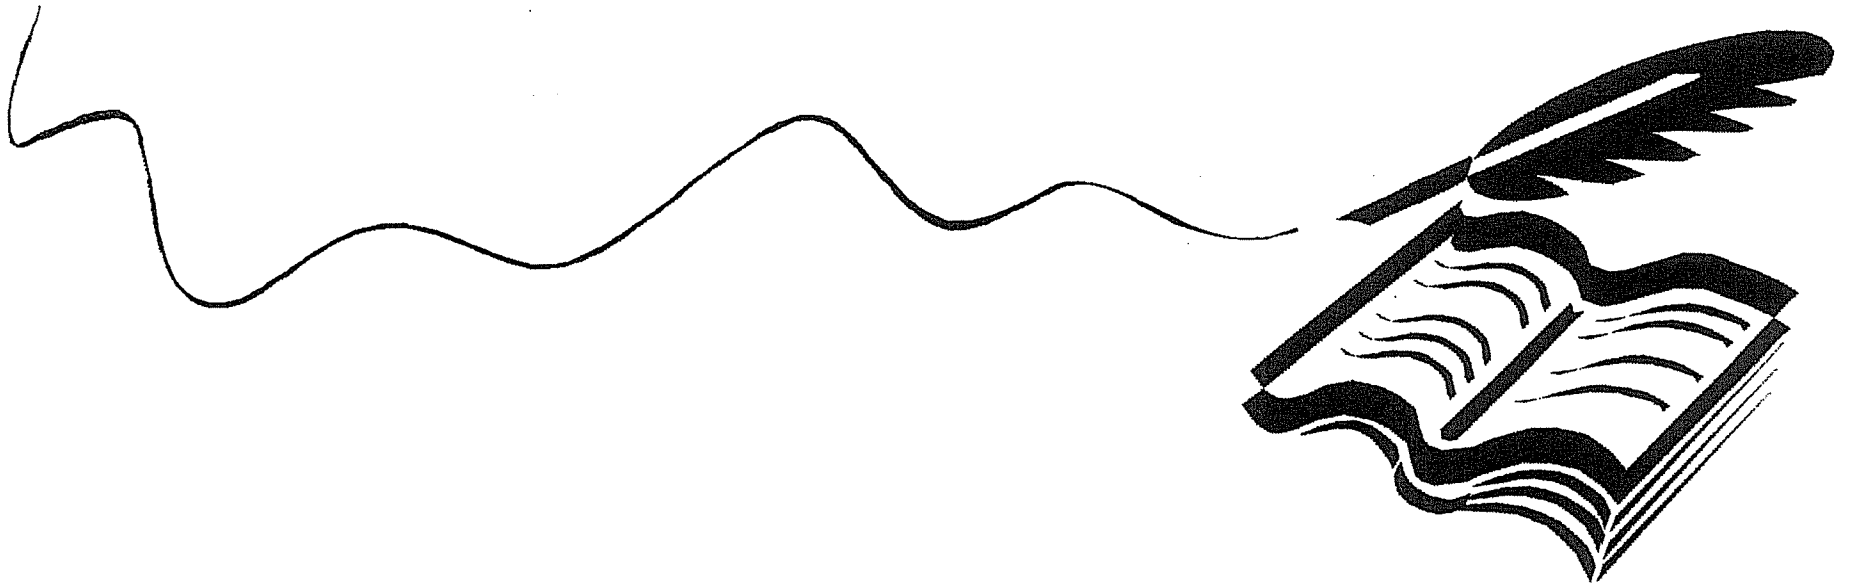

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0003

**COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY: SUPPORT SERVICES CENTER
925 WEST CENTER STREET
GREEN COVE SPGS., FLORIDA 32043

INSPECTION DATE: FEBRUARY 25, 2011

Ted Sweattane
INSPECTOR'S SIGNATURE

2-25-11
DATE



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	11A	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	11A	FIRE ALARM PANEL STICKER MISSING	X							69A-58
1	11C	OUTLET COVER MISSING @ COFFEE MAKER	X							NFPA - 70
1	20	LIGHTS WITH WIRES EXPOSED	X							
1	20	FIRE EXTINGUISHER NOT SIGNED		X						69A-58.008
2		OK								
3	1	FIRE EXTINGUISHER NOT SIGNED		X						69A-58.008
3	2	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	2	STORAGE IN FRONT OF ELECTRICAL PANEL		X						
3	2	BACK DOOR BLOCKED		X						
5		OK								
6		OK								
9	911A	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	906	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2010-2011

DISTRICT: CLAY FACILITY #: 0003

FACILITY: SUPPORT SERVICES CENTER
925 WEST CENTER STREET
GREEN COVE SPGS., FLORIDA 32043

INSPECTION DATE: FEBRUARY 25, 2011

Ed Sweetland
 INSPECTOR'S SIGNATURE 2-25-11
 DATE



**COMPREHENSIVE SAFETY & SANITATION
 INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "CASUALTY SAFETY & SANITATION INSPECTION"
 IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101**

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
10	107	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	108	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	104	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	101	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	115	EMERGENCY LIGHT OUT		X						FBC 423.17.1
11		OK								
12		OK								

