

### Calebeat Abage

### Clementary School





COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

A. C. A. S. A. C. C. C. A. C.		
DISTRICT: CLAY	FACILITY: 0049	<u> </u>
	The second secon	

FACILITY: OAKLEAF VILLAGE ELEMENTARYSCHOOL
410 OAKLEAF VILLAGE PARKWAY

ORANGE PARK, FLORIDA 32065

INSPECTION-DATE:	JANUARY 7, 2011
, , , , ,	

INSPECTOR'S SIGNATURE

1-741

Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
505	PAPER TREE IN CLASSROOM - REMOVE		Х						NFPA 101
515	PAPER TREE IN CLASSROOM - REMOVE		×						NFPA 101
728	STORAGE TO HIGH IN CLOSET		Х						NFPA 101
700	EXHAUST FANS NOT WORKING - ALL RESTROOMS		Х						69A-58-999
700	FIVE LIGHTS OUT; NEED LIFT TO CHANGE	Х							69A-58.204
20	OK								
25	ОК								
25	PLAYGROUND NEEDS SAND BY SMALLER SLIDES		X						69A-58-202
						e de la companya de l			
	505 515 728 700 700 20 25	505 PAPER TREE IN CLASSROOM - REMOVE 515 PAPER TREE IN CLASSROOM - REMOVE 728 STORAGE TO HIGH IN CLOSET 700 EXHAUST FANS NOT WORKING - ALL RESTROOMS 700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE 20 OK 25 OK 25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES	Room Deficiency Description and Corrective Action Required: "M"  505 PAPER TREE IN CLASSROOM - REMOVE  515 PAPER TREE IN CLASSROOM - REMOVE  728 STORAGE TO HIGH IN CLOSET  700 EXHAUST FANS NOT WORKING - ALL RESTROOMS  700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE  X  20 OK  25 OK  25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES	Room Deficiency Description and Corrective Action Required: "M" "O"  505 PAPER TREE IN CLASSROOM - REMOVE X  515 PAPER TREE IN CLASSROOM - REMOVE X  728 STORAGE TO HIGH IN CLOSET X  700 EXHAUST FANS NOT WORKING - ALL RESTROOMS X  700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE X  20 OK  25 OK  25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES X	Room Deficiency Description and Corrective Action Required:  "M" "O" "C"  505 PAPER TREE IN CLASSROOM - REMOVE X  515 PAPER TREE IN CLASSROOM - REMOVE X  728 STORAGE TO HIGH IN CLOSET X  700 EXHAUST: FANS NOT WORKING - ALL RESTROOMS X  700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE X  20 OK  25 OK  25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES X	Room Deficiency Description and Corrective Action Required: "M" "O" "C" "Serv. "I.S."  505 PAPER TREE IN CLASSROOM - REMOVE X  515 PAPER TREE IN CLASSROOM - REMOVE X  728 STORAGE TO HIGH IN CLOSET X  700 EXHAUST FANS NOT WORKING - ALL RESTROOMS X  700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE X  20 OK  25 OK  25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES X	Room Deficiency Description and Corrective Action Required: "M" CO" C" C" TI.S." Cost  505 PAPER TREE IN CLASSROOM - REMOVE X  515 PAPER TREE IN CLASSROOM - REMOVE X  728 STORAGE TO HIGH IN CLOSET X  700 EXHAUST FANS NOT WORKING - ALL RESTROOMS X  700 FIVE LIGHTS OUT; NEED LIFT TO CHANGE X  20 OK  25 OK  25 PLAYGROUND NEEDS SAND BY SMALLER SLIDES X	Room Deficiency Description and Corrective Action Required: "M" "O" "Fac. Serv. Cost Times Def. Cited"  505 PAPER TREE IN CLASSROOM - REMOVE X X STORAGE TO HIGH IN CLOSET X	Room Deficiency Description and Corrective Action Required: "M" C" C" Serv. Cost Cost Def. Cited for Correction    Solution



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT	CLAT TAGLETT. 6040
FACILITY:	OAKLEAF VILLAGE ELEMENTARYSCHOOL
•	410 OAKLEAF VILLAGE PARKWAY

**ORANGE PARK, FLORIDA 32065** 

EACH ITY

NSPECTION DATE: <u>JANUARY 7, 2011</u>

INSPECTOR'S SIGNATURE

DISTRICT: CLAY

1-9-11

nnaa

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	908	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
92	909	OK								
92	910	ОК								
92	911	OK								
92	912	OK.								
92	913	OK								
92	914	MOVE DESK BY EXIT DOOR; NEED MINIMUM OF 36" CLEAR PATH		х	,					FBC 1003.3.4
			2776							

### OMBE LANGE

# CENERAL SUSAN



### FISCAL YEAR <u>2010-2011</u>



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY		_ FACIL	ITY:	0004	:
Hali Walio	1	1.4.2		41		

FACILITY: ORANGE PARK ELEMENTARY SCHOOL

1401 PLAINFIELD AVENUE

ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 11, 2011

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ок								
2		OK								
3		ОК								
4		OK								
5		ОК								
7		OK								
					en e e e e e e e e e e e e e e e e e e					

### FISCAL YEAR <u>2010-2011</u>



IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	<b>FACILITY</b> : 0004	
		The state of the s	

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE

**ORANGE PARK, FLORIDA 32073** 

INSPECTION DATE: JANUARY 11, 2011

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	21	ОК								
92	22 A/B	OK								
92	23	ОК								60-400.0
.92	24	NO EMERGENCY EVACUATION SHEET		X						FBC 423:14.2.4
92	34	OK ·								
92	. 35	OK								T.
92	36	ок								
92	.37	OK:								
92	38	ROOM NUMBER MISSING – EXTERIOR		X						NFPA 1 10.13.1.1
92	39 A/B	ОК		14 (m. 15) 1 (m. 15)						
92	41	ок								
92	- 42	OK	Sec. 10 (1) (1)							
92	43	REPAIR HOLES IN CEILING FROM LIGHT REPLACEMENT	Х							

	The state of the s						
				OU ITY		3004	
ח	ICTDICT	CLAY		FACILITY		100 <b>4</b>	
_	1011/101	. ULA	and the second second	CACIFIE	•	700-1	
	the state of the state of						



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

FACILITY:	ORANGE PARK ELEMENTARY SCHOOL
•	1401 PLAINFIELD AVENUE
	ORANGE PARK, FLORIDA 32073

NSP	ECTION	DATE:	JANUARY	11,	2011
-	/ /	/ /			


NSPECTIOR'S SIGNATURE

/~//~// DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	OK .								
92	45	OK								
92	50	ОК							ne a sus reconstruente de la casa	
92	51	OK								
92	52	SHELF IN FRONT OF ELECRIC PANEL - MOVE		Х						NFPA 70
92	53	ОК					15750			
92	54	ОК								
			Angel Care							

### Mantation Oaks

### Elementary School

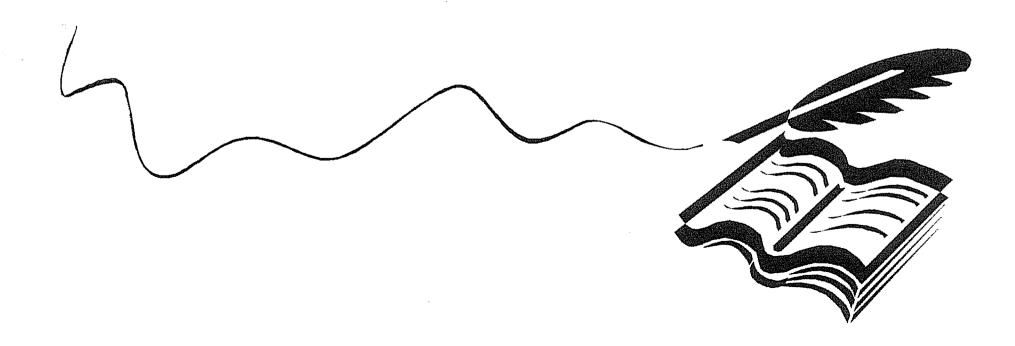



### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY	FACILITY: 002	4	
and the first terms of the second			

FACILITY: PLANTATION OAKS ELEMENTARY SCHOOL

4150 PLANTATION OAKS BOULEVARD

ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 7, 2011

NSPECTOR'S SIGNATURE

1-7-11

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	511	CYLINDER MISSING ON DOOR	Х							
20	2000	MOVE PROPANE TANKS TO FLAMMABLE STORAGE		X			1946-1-174 1746-1-174			NFPA 30
				A. F. C.						

### ROMESON.

# CEMENTALLY STATES





### **COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT** STATE BOARD OF EDUCATION **ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY: 0024	
FACILITY: ROBERT M. PATERSON ELEMENTARYSCI 5400 PINE AVENUE ORANGE PARK, FLORIDA 32003	100L
INSPECTION DATE: JANUARY 31, 2011  JANUARY 31, 2011    JANUARY 31, 2011    JANUARY 31, 2011    JANUARY 31, 2011	

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost.	No. of times Def. Cited	Scheduled for Correction	Rule
1	133	TRANSFORMER VERY LOUD								
1	144	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	145	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
1	143	MAINTAIN 6FT. WIDE PATH		Х	4.5					
1	142	TREAT FABRIC WITH FLAME PROOFING OR REMOVE OVER DESK		х						
2		ок								
3		ок								
4	401	EXIT LIGHT OUT		Х						FBC 1006.3.1
4	426	EXIT LIGHT OUT		Х						FBC 1006.3.1
5	515	EXIT LIGHT OUT		Χ						FBC 1006.3.1
6	600	EXIT LIGHT OUT		Х						FBC 1006.3.1
6	615	EXIT-LIGHT OUT		Х						FBC 1006.3.1
										·



DISTRICT: CLAY FACILITY: 0024
FACILITY: ROBERT M. PATERSON ELEMENTARYSCHOOL 5400 PINE AVENUE ORANGE PARK, FLORIDA 32003
INSPECTION DATE: JANUARY 31, 2011  Lad Meatlan [-3]-[
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	ОК								
92	2	OK								
92	3	OK								
92	4	OK								
92	5	ОК								
92	- 6	OK								
92	8	ОК								,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,
92	11	OK								
92	13	ОК								
.92	:14	ок								
92	15	ОК								
92	16	OK								
92	18	ОК								



DISTRICT: CLAY	FACILITY: 0024
5400 PINE AVEN	TERSON ELEMENTARYSCHOOL NUE , FLORIDA 32003
INSPECTION DATE:JAN	
INSPECTOR'S SIGNATURE	1-31-11 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	21	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
.92	22	OK								
92	23	ок		,						
92	24	OK								
92	25	OK								
.92	26	OK		Seyes (						
92	27	ОК								
92	28	oK								
92	29	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
.92	30	OK								
92	41	ОК								
92	42	OK			76					
92	43	ОК								



DISTRICT: CLAY FACILITY: 0024	
FACILITY: ROBERT M. PATERSON ELEMENTARYSCHOOL  5400 PINE AVENUE  ORANGE PARK, FLORIDA 32003	
INSPECTION DATE: JANUARY 31, 2011	
INSPECTOR'S SIGNATURE DATE	•

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac.	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	ок								
92	45	OK								
92	46	ОК						12017		No Comment of the
92	47	LOOSE SPINDLES ON RAMP	X							
92	48	ок								
92	:49	OK						Total Control		
92	50	ок								
92	51	OK	100							
92	52	ОК								
92	53	OK						49		
92	54	ОК								
				223.4.						

### 

# CIEMENTALLY SOLOGI





	DISTRICT: CLAY FACILITY: 0043	
	FACILITY: RIDEOUT ELEMENTARY SCHOOL  3065 APALACHICOLA BOULEVARD	
	MIDDLEBURG, FLORIDA 32068	
5	INSPECTION DATE: JANUARY 24, 2011	

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	336	EMERGENCY LIGHT NOT WORKING - WORK ROOM		Х						FBC 423.17.1

### FISCAL YEAR <u>2010-2011</u>



DISTRICT:_	CLAY	FACILITY: 0043	
FACILITY:	RIDEOUT ELE	MENTARY SCHOOL	
•	3065 APALAC	HICOLA BOULEVARD	
	MIDDLEBURG	, FLORIDA 32068	

INSPECTION DATE:	<b>JANUARY 24, 2011</b>	
Tod Swear	Man	1-24-11
<b>INSPECTOR'S SIGNA</b>	TURE	ATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	10	ОК								
92	11	OK								
92	12	ОК								
92	13	OK								
92	14	ОК								
92	20	OK								
92	21	ОК								
92	22	OK								
92	23A/B	ок								
92	24	OK		9-35 Th						
92	25	ОК								

### 

# EBRENTALL SUBSI





### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

NICTOICT.	OLAY.	FACILITY: 0020	
DISTRICT:	ULAY	FACILITY. 0020	

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE

**ORANGE PARK, FLORIDA 32065** 

NOD	ECTION	D AZPES	<b>JANUARY 18, 2011</b>
IN SP	<b>ECHON</b>		JANUART 10, 2011

INSPECTOR'S SIGNATURE

1-18-11 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No: of times Def. Cited	Scheduled for Correction	Rule
1	121	EXIT LIGHT BULB OUT		Х						FBC 1006.3.1
2	209	EXIT LIGHT BULB OUT		Х						FBC 1006.3.1
2	204	PANEL LE2 MISSING KNOCKOUT	Х							NFPA 70
3		OK								
4		ок								
6	603	PAPER TREE IN CLASSROOM – REMOVE		X						NFPA 70
6	607	PAPER TREE IN CLASSROOM – REMOVE		х						NFPA 70
6	613	LIGHTS OUT IN RESTROOM		Х						
7		ОК								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

			•
DISTRICT:	CLAY	 FACILITY:	0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE

**ORANGE PARK, FLORIDA 32065** 

INSPECTION DATE: JANUARY 18, 2011

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
96	738	RESTROOM – OK							h and the same of the same	
96	747	RESTROOM – OK								
92	711	ок							za, po velope bomogres ou vilo	
92	712	ОК							is all	
92	713	OUT OF SERVICE								
92	714	ОК							To the second	
92	715	ок								
92	716	OUT OF SERVICE					7:15:4			
92	717	ок								
.92	718	ок								
92	728	ОК								
92	729	ок								

### FISCAL YEAR <u>2010-2011</u>



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY:_	0020	

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE

ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 18, 2011

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	730	EMERGENCY LIGHTS NOT WORKING		Х						FBC 423.17.1
92	731	OK								
92	732	ок								
92	733	ок								
92	734	ок								
92	736	OUT OF SERVICE								
92	737	ок								
. 92	735	OK								
92	741	ок								
92	742	OUT OF SERVICE								
92	743	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	744	ок								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	 FACILITY:_	0020	
-				

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL 421 JEFFERSON AVENUE

ORANGE PARK, FLORIDA 32065

INSPECTION DATE: JANUARY 18, 2011

MSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	752	ок								
92	753	NO EMERGENCY EVACUATION SHEET		Х				-		FBC 423.14.2.4
92	754	ок							V-1-1-	
92	755	EMERGENCY LIGHT WEAK – OK		X						
92	756	ок								
92	757	OK							95	
92	758	ок								
92	759	ОК								
92	760	ок								
92	772	LIGHTS BEING REPLACED – EXPOSED WIRES AT CEILING WITH MISSING LIGHT FIXTURE	X							NFPA 70
				in the second se						

# SIBILITIES ENGINEERS ERENIN SIGN



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTI	RICT:	CLAY	FAC	ILITY: 00	12	
1.0						

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL 215 CORONA DRIVE

**ORANGE PARK, FLORIDA 32073** 

INSPECTION DATE: JANUARY 20, 2011

NSPECTOR'S SIGNATURE

1-20-11 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ОК								
2		ОК				k v				
3		ОК				7.0				
4		OK								
5		ок								
6	11A	NO EVACUATION SHEET		X						FBC 423.14.2.4
7		ок								
8		OK								
9	22A	NO EVACUATION SHEET		Х						FBC 423.14.2.4
9	23A	REMOVE OLD PROJECTOR		X						
9	25A	REMOVE EXTENSION CORD TO REFRIDGERATOR								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	FACILITY:_	0012	
· · · · · · · · · · · · · · · · · · ·		<u>-</u>		

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL 215 CORONA DRIVE

**ORANGE PARK, FLORIDA 32073** 

NSPEC	) HIGKI	DATE:	JANUARY 20, 2011
-------	------------	-------	------------------

INSPECTOR'S SIGNATURE

[-}0:11

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac: "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	ОК								
92	27	oK							100 mm - 100	
92	28	OK								
92	29	OK								
92	30	ОК								
92	32	OK								
92	33	ОК								
92	34	OK								
92	35	ок								
92	36	OK			THE STATE OF THE S					
92	37	ок								
92	38	OK	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1							
92	42	ОК								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY	FACILITY: 0012	_
· · · · · · · · · · · · · · · · · · ·			

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL 215 CORONA DRIVE

**ORANGE PARK, FLORIDA 32073** 

INSPECTION DATE: JANUARY 20, 2011

SPECTOR'S SIGNATURE D

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	ОК								
92	44	oK								
92	45	ОК						c~		
92	- 75	OK								
92	76	ОК						Pot dia Charles I. John D.		a gara a Sate-agaid dhaodh i lleada e Gli Morra e Ciline Wil
92	77	OK						7		
92	78	ОК					- 10			
92	79	OK			7.2		9 5 7			
92	80	ОК								
92	81	OK								

### 

# Elementary School





	DISTRICT:_	CLAY FACILITY: 0050
	FACILITY:	SHADOWLAWN ELEMENTARY SCHOOL
		2945 COUNTY ROAD 218 GREEN COVE SPRINGS, FLORIDA 32043
7	INSPECTIO	N DATE:

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	604	ADD FIRE EXTINGUISHERS WITHIN 15 ft OF STOVE		Х						NFPA 101
1	605	ADD FIRE EXTINGUISHERS WITHIN 15 ft OF STOVE		X						NFPA 101
1	608	ADD FIRE EXTINGUISHERS WITHIN 15 ft OF STOVE		Х						NFPA 101
1	609	ADD FIRE EXTINGUISHERS WITHIN 15 ft OF STOVE		Х						NFPA 101
1	403	FIRE ALARM PANEL STICKER MISSING	Х							FAC 69A-48.006
					1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1					
02437										




	DISTRICT: CLAY FACILITY: 0050
	FACILITY: SHADOWLAWN ELEMENTARY SCHOOL 2945 COUNTY ROAD 218
	GREEN COVE SPRINGS, FLORIDA 32043
7	INSPECTION DATE:

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	901	SMOKE DETECTOR HANGING FROM CEILING		Х						NFPA 1(03) 10.4.1
92	901	EMERGENCY LIGHT NOT WORKING		X						FBC 423,17.1
92	902	EMERGENCY LIGHT NOT WORKING		Х						FBC 423.17.1
									Schmann die ein der Michael	
						3377577933				

# SUMMING SER, CEES

### CREATIVE STATE OF THE STATE OF

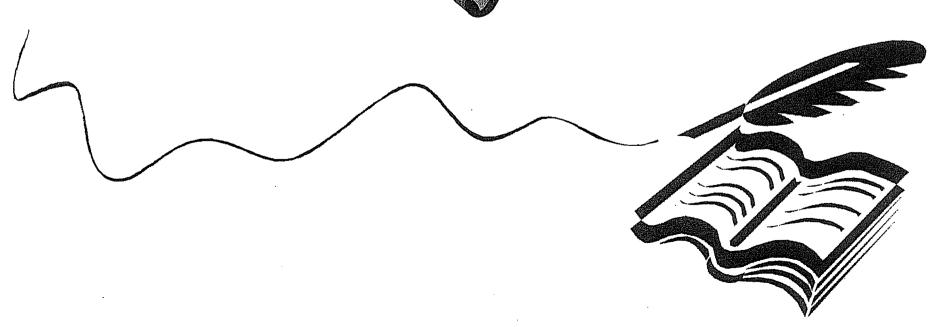



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	_ FACILITY:	0053	
FACILITY:	SWIMMING PE	N CREEK EL	EMENTAR	YSCHOOL
_				

FACILITY: SWIMMING PEN CREEK ELEMENTARYSCHOOL
1630 WOODPEPCKER LANE
MIDDLEBURG, FLORIDA 32073

INSPECTION DATE: JANUARY 25, 2011

NSPECTOR'S SIGNATURE

1-25-11

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ок								
2	213	BLACK MOLD ON CEILING		. X						
2	203	STORAGE TOO HIGH		Х						NFPA 13.8.5.5.3
. 3	301	EXTENSION CORD THROUGH CEILING	X							NFPA 70 (99) 370-15
4		ОК								
5	536	DRYWALL MISSING @ DUCT	X							
5	538	LOCK STICKS	Х							
5	502	EVACUATION SHEET FADED		X						FBC 423.14.2.4
6	613	STORAGE TOO HIGH		Х						NFPA 13.8.5.5.3



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

INSPECTION DATE: JANUARY 25, 2011

FACILITY: SWIMMING PEN CREEK ELEMENTARYSCHOOL

1630 WOODPEPCKER LANE MIDDLEBURG, FLORIDA 32073

INSPECTOR'S SIGNATURE

DISTRICT: CLAY

1.85-11

FACILITY: 0053

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	ок								
92	702	ок								
92	703	ОК								
92	704	OK OK								
92	705	ок								
92	706	EMERGENCY LIGHT OUT	X							NFPA 101.7.9
92	707	ок								
92	708	ОК								
92	801	ок								
92	803	ОК								
92	804	ОК								
92	805	ОК								

### FISCAL YEAR <u>2010-2011</u>



"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY: 0053			
	DISTRICT: CLAY	FACILITY:_	0053

FACILITY: SWIMMING PEN CREEK ELEMENTARYSCHOOL
1630 WOODPEPCKER LANE

**MIDDLEBURG, FLORIDA 32073** 

INSPECTION DATE: JANUARY 25, 2011

INSPECTOR'S SIGNATURE

1-25-11

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	809	OUT OF SERVICE						on to the sea		
92	810	OK		X						
								3 - 2 - 3 - 3 - 3 - 3 - 3 - 3 - 3 - 3 -		

### 

# EBURNANI SAGO





### **COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT** STATE BOARD OF EDUCATION **ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:_	CLAY	FACILITY	<u>/:0042</u>
	FACILITY:		BOLT ELEMEN DERBOLT RO	ITARY SCHOOL AD
		ORANGE PA	ARK, FLORID	A 32003
,	INSPECTIO	N DATE: _F	EBRUARY 1,	2011
	adn	reallan		2-1-11
	INSPECTO	R'S SIGNATU	JRE	DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper: "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def, Cited	Scheduled for Correction	Rule
1	118	STORED MATERIALS TOO HIGH		Х						NFPA 1 12-1
4	116	STORED MATERIALS TOO HIGH		X						NFPA 1 12-1
1	324	STORED MATERIALS TOO HIGH		X						NFPA 1 12-1
1	234	STORED MATERIALS TOO HIGH		Χ -						NFPA 1 12-1
1	309	ELECTRIC PANEL NOT LABELED	X			·				NFPA 70(99)110-22
1	301	STORED MATERIALS TOO HIGH		X						NFPA 1 12-1
1	303	STORED MATERIALS TOO HIGH		Х						NFPA 1 12-1
1	305	STORED MATERIALS TOO HIGH		X						NFPA 1 12-1



## COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY	FACILITY: 0042
2020	DERBOLT ELEMENTARY SCHOOL HUNDERBOLT ROAD GE PARK, FLORIDA 32003
Todhu	E: FEBRUARY 1, 2011  2-1-(1
INSPECTOR'S SIG	NATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	ОК							2 S	
92	702	OK								
92	703	ок						25 (25 (25 (25 (25 (25 (25 (25 (25 (25 (		
92	704	OK								
92	705	ок								
92	706	OK								
92	707	ок								
92	708	ОК								
92	709	ок								
92	710	ок		igane						
92	711	ок								
92	712	OK								



## COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY F	ACILITY:_	0042
	THUNDERBOLT I 2020 THUNDERBO ORANGE PARK, I	OLT ROAD	)
INSPECTIO	ON DATE: FEBRU	JARY 1, 20	11
INSPECTO	Weatond R'S SIGNATURE	<u> </u>	2-1-1( DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	722	ок								
92	723	ОК								
92	724	ок								
92	725	OK -								
92	726	ок								
92	727	OK								
92	728	ок								
92	729	OK.								
92	730	ок								
.92	731	ОК								
92	732	ок								
92	733	OK								




### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLA	<u>Y</u> F/	ACILITY:_	0042
	NDERBOLT E THUNDERBO NGE PARK, F	OLT ROAD	)
INSPECTION DA	TE: FEBRU	ARY 1, 20	<u>2-1-11</u>
INSPECTOR'S S	GNATURE		DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	734	ОК							SACRAMINA I NASA I COMPANDADO	
92	735	oK								
92	736	ОК								
92	737	OK								
92	738	ОК								
92	740	OK			al Control					
92	741	ОК			-					
92	742	OK								
92	743	ок								
92	744	OK							F	
The general education is a second of the se										

## Eleventary Strott

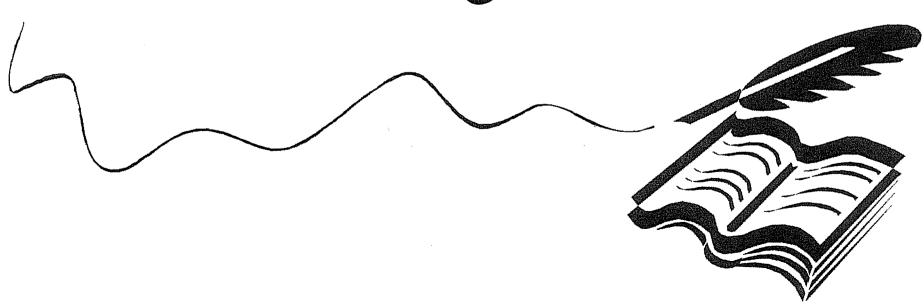



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

Military and the control of the cont			*	
DISTRICT:	CLAY	FACILITY:	0040	
747 H 7 H 7 H				

FACILITY: TYNES ELEMENTARY SCHOOL

1550 TYNES BOULEVARD

**MIDDLEBURG, FLORIDA 32068** 

NSPECTION DATE: _	FEBRUARY 9, 2011
-------------------	------------------

INSPECTOR'S SIGNATURE

ATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		ОК						75 m 1207 44	Charles and Was Selection Se	
- 2		ОК								
3		ОК								
4		ОК					Ten and the			
5		ОК								
6		ОК								
								45		
<u> </u>	e grand yet o'r a dreif bedery kjore	a safe garante.			-					



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY:_	0040
FACILITY:		EMENTARY SCHOOLS BOULEVARD	OOL
		RG, FLORIDA 32	068

INSPECTION DATE: FEBRUARY 9, 2011

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	ОК								
92	2	OK								
92	3	ОК								I
92	4	oK								
92	5	ОК								
92	6	OK								
92	7	ОК								
92	8:	ÖK								
92	10	EMERGENCY LIGHT OUT		Х						FBC 423.17.1
92	21	OK					11 pr 11 12 13 13 13 13 13 13 13 13 13 13 13 13 13			
92	22	ОК								
92	23	OK								

### FISCAL YEAR <u>2010-2011</u>



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY FACILITY: 0040
FACILITY:	TYNES ELEMENTARY SCHOOL  1550 TYNES BOULEVARD
	MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2011

INSPECTOR'S SIGNATURE

ΔTF

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	ОК								
92	27	oK								
92	28	ОК								
92	29	oK								
92	30	ОК								
92	41	OK								
92	43	ОК								
92	61	OK								
92	62	ОК								
92	63	ok								
92	64	ОК								
92	65	ОК								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	<b>FACILITY</b> : 0040
FACILITY:	1550 TYNES	MENTARY SCHOOL BOULEVARD RG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 9, 2011


INSPECTOR'S SIGNATURE

)ATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rulė
92	66	ОК								
92	67	oK					4 - 4 E			
92	68	OK								
							5.20			

### M E GEN

### CENERAL SINGS

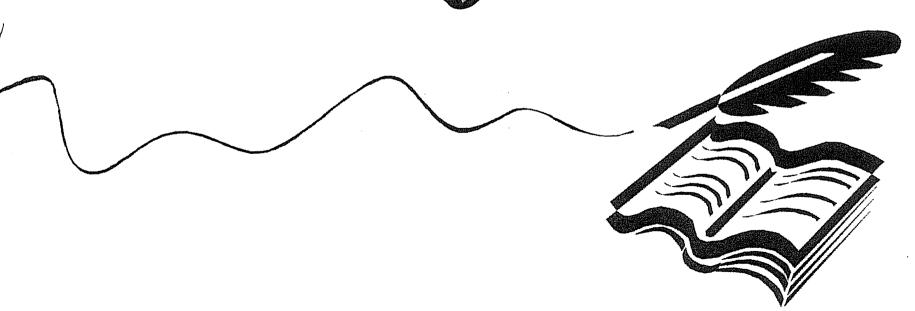



STATE BOARD OF EDUCATION

**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH

F.S.	1013.	12,	1013.20	&	NFPA	101
		•				

NOTDICT.	CLAY	FACILITY: 0006
DISTRICT:	CLAT	FACILITI. 0000
and the second of the second of		

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

**420 EDSON DRIVE** 

**ORANGE PARK, FLORIDA 32073** 

INSPECTION DATE: FEBRUARY 8, 2011

3-8-11

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	47	EXHAUST FAN NOT WORKING		Х						
1	54	BULB EXPOSED - NEEDS COVER	10 m	Х	1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 - 1 -					
2		ок								
3	61	MISSING CEILING TILE		Χ						
3	16	EVACUATION SHEET MISSING		Х						FBC 423.14.2.4
3	18	EVACUATION SHEET MISSING		Х		interest				FBC 423.14.2.4
4	22	EVACUATION SHEET MISSING		Х						FBC 423.14.2.4
4	69	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
						Flants For Fig. 7-50 Section 1				

### FISCAL YEAR <u>2010-2011</u>



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY:_	0006	

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL 420 EDSON DRIVE

**ORANGE PARK, FLORIDA 32073** 

INSPECTION BATE: FEBRUARY 8, 2011

INSPECTOR'S SIGNATURE

ATE

No. of Info. Scheduled Fac. times Rule Maint. Oper. Cost Deficiency Description and Corrective Action Required: Serv. for Building Room "O" "C" Def. "M" "I.S." Correction Cited OK 26 95 OK 27 92 28 OK 92 92 29 ÖΚ OK 30 92 31 OK 92 32 OK 92 OK 92 33 OK 92 34 OK 92 36 37 OK 92 38 OK 92



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"

IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY	FACILITY: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL 420 EDSON DRIVE

**ORANGE PARK, FLORIDA 32073** 

INSPECTION-PATE: FEBRUARY 8, 2011

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	39	OK (CLINIC)								
92	40	oK						2 1 2 7 3 2 5 5		
92	41	ОК								
92	42	ок								
92	43	ок								
92	49	OK								
92	50	ОК								
92	51	OK								
96	47	OK (RESTROOMS)								
92	48	KNOCKOUT MISSING IN ELECTRICAL PANEL	Χ							NFPA 70
92	53	ОК								
92	54	OK								

### FISCAL YEAR <u>2010-2011</u>



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

T. Marine	
ACILITY:	W.E. CHERRY ELEMENTARY SCHOOL
•	420 EDSON DRIVE
•	ORANGE PARK, FLORIDA 32073

FACILITY: 0006

INSPECTION DATE: \_\_FEBRUARY 8, 2011\_

INSPECTOR'S SIGNATURE

DISTRICT: CLAY

MATE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Pac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	55	ОК							A-11-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-	
92:	56	OK								
92	57	ок						. Paul B MA Den Saas	New Arthropid Received	
92	60	OK								
92	58	LIGHT COVER MISSING – RESTROOM		Х						NFPA 70 -410
92	59	EXHAUST FAN NOT WORKING – STOVE		X						FBC 423.15.4
92	61	EMERGENCY LIGHT OUT		х						FBC 423.17.1
92	62	OK								
92	63	ок								
92	64	oK								
92	65	ок								Normal Control of the
92	66	ok								



COMPREHENSIVE SAFETY & SANITATION
INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"CASUALTY SAFETY & SANITATION INSPECTION"
IN COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT	: CLAY	FACILITY:	0006	

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL

420 EDSON DRIVE

ORANGE PARK, FLORIDA 32073

NSP	ECTION	DATE:	FEBRUARY 8,	2011
,				

NSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	67	ОК								
. 92	- 68	OK-								
92	69	ОК								
.92	70	OK								
								100000		

### 

# Elementary Stroot





### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

	DISTRICT:_	CLAY	FACIL	_ITY: <u>(</u>	0026	
	FACILITY:	WILKINS 4966 C.R	ON ELEMEN	TARY S	CHOOL	<del></del>
			BURG, FLORI	DA 3206	88	_
9	INSPECTIO	N DATE:	FEBRUARY	′ 11, 20 <u>1</u>	1	
	Toll	meal	Hard		2-11-11	

DATE

INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	2.55 (1.55 - 1.34 - 1.55	ОК								
2	203	WHEEL CHAIR LIFT INSPECTION CERTIFICATE NOT CURRENT		Х	77.77 19.77					
3	303	STORAGE TOO HIGH IN CLOSETS		Х						NFPA 1 12-1
3	313	STORAGE TOO HIGH IN CLOSETS "18" DOWN		X						NFPA 1 12-1
4	400	MOVE BANNERS BACK AGAINST WALLS SO THAT EXIT SIGHTS ARE VISABLE		х						FBC 423.20.1
4	401	TILE FLOOR COMING LOOSE BY TAHTROOM	X							
4	420	EXTENSION CORD TO TAPE RECORDER ACROSS FLOOR - REMOVE		х						NFPA 70 400.8
5	500	PULL BANNERS BACK BLOCKING EXIT LIGHTS		X						FBC 423.20.1
5	521	STORAGE TOO HIGH – 18"FROM CEILING		Х						NFPA 1 12-1
				7. 57						



### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY:_	0026

FACILITY: WILKINSON ELEMENTARY SCHOOL

4966 C.R. 218

MIDDLEBURG, FLORIDA 32068

I١	18	P	EC	T	ON	DA	TE	:	FE	BR	U	٩R	Υ	1	1,	20	11	

INSPECTOR'S SIGNATURE

2-11-1(

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
96	1	ок								
.92	2	POWER OFF								
92	3	ок								
92	4	OK								
92	5	EMERGENCY LIGHT OFF		Х						NFPA 101.7.9
92	6	ОК								
92	7	ок								
92	8	ОК								
92	10	ОК								
92	11	ОК								
92	12	ок								
92	13	ОК								



### **COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT** STATE BOARD OF EDUCATION **ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5** "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:	CLAY FA	CILITY: 0026
FACILITY:	WILKINSON ELEMI 4966 C.R. 218 MIDDLEBURG, FLO	
INSPECTIO	ON DATE: FEBRUA	_
INSPECTO	R'S SIGNATURE	2-11-1( DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I,S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	14	ОК								
92	15	OK								
92	16	EMERGENCY EVACUATION SHEET MISSING		Х						FBC 423.14.2.4
92	17	ок								
92	18	ок								
92	22	ОК								
92	31	ОК								
92	34	ОК								
92	35 A/B	ок								
92	19	STAINED CEILING TILE BY RESTROOM – REPLACE & FIX ROOF LEAK		X						
92	20	EMERGENCY EVACUATION SHEET COVERED WITH POSTER – MOVE		х						FBC 423.14.2.4
92	33	PRINTER/TABLE BLOCKING ELECTRICAL PANEL								NFPA 70



### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY:_	0026

FACILITY: WILKINSON ELEMENTARY SCHOOL

4966 C.R. 218

MIDDLEBURG, FLORIDA 32068

NSPECTION DATE:	FEBRUARY 11, 2011	

Loa Xweattan	
INSPECTOR'S SIGNATURE	ĺ

2-1	1-11
DATE	

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	36	POWER OFF								
92	37	OΚ								
92	38	ОК								
92	39	OΚ								
92	40	ок								
92	41	oκ					and the state of			
92	42	ОК								
92	43	ELECTRICAL PANEL BLOCKED BY CLUTTER	X							NFPA 70
92	44	DRAPERIES NEED FIRE RESISTANT SPRAY	Х							NFPA 1
-92	45	OK								
92	56	ОК								
92	47	ОК					V			



### COMPREHENSIVE SAFETY & SANITATION INSPECTION REPORT STATE BOARD OF EDUCATION ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5 "CASUALTY SAFETY & SANITATION INSPECTION" IN COMPLIANCE WITH F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT:_	CLAY	FACILITY: 0026	
FACILITY:		ON ELEMENTARY SCHOOL	
	4966 C.R.		
	MIDDLEE	BURG, FLORIDA 32068	
INSPECTIO	N DATE:	FEBRUARY 11, 2011	_

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	48	ок								
92	49	OK:								
92	50	ок								
92	51	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	51	POWER STRIPS PLUGGED INTO POWER STRIPS - THEY CANNOT BE USED THIS WAY		х						NFPA 70 400.8
92	52	OK								
92	53	ок								
92	62	OK				7 3 6				
92	64	ок								
92	68	ОК								
92	66	BACK DOOR BLOCKED BY P.E EQUIPMENT		Х						