


Mountain

Elementary School

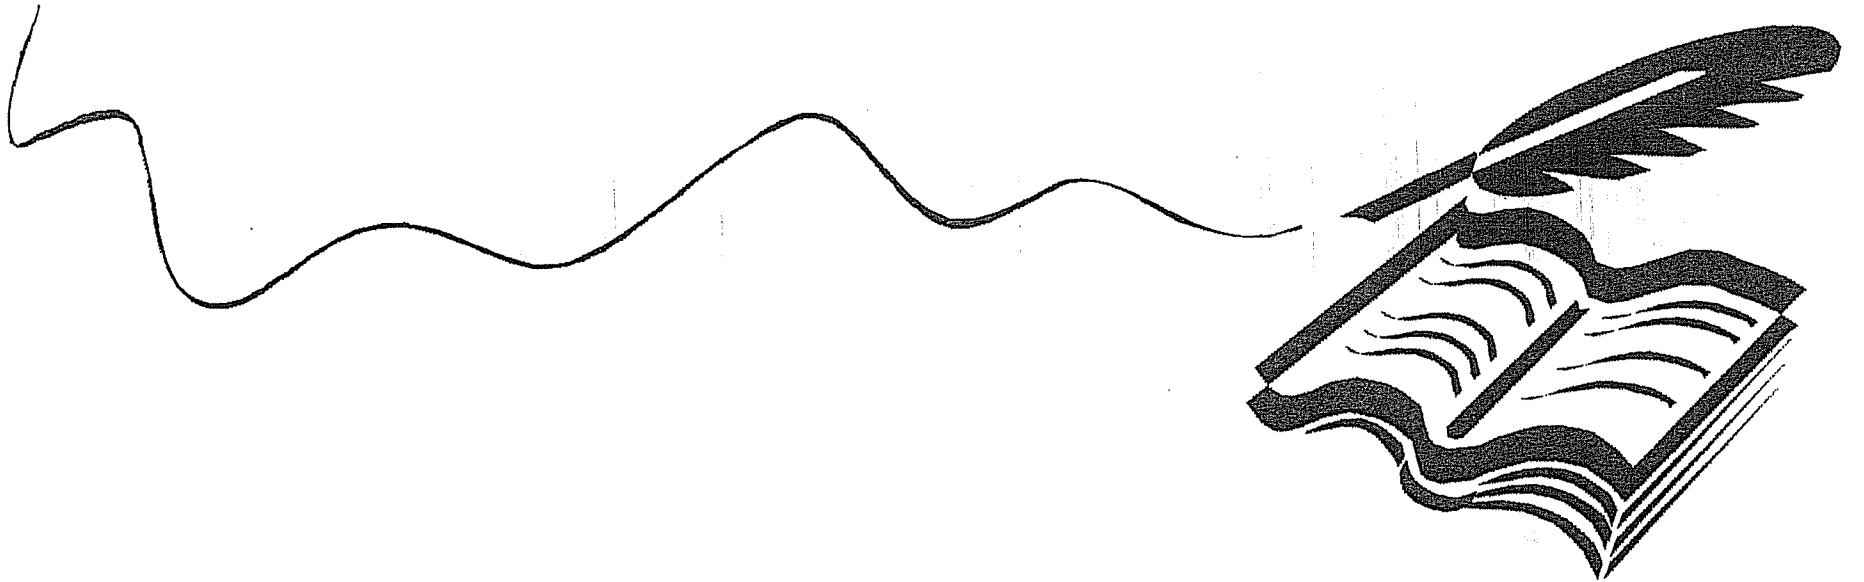

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL
2398 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 22, 2008

[Signature]
INSPECTOR'S SIGNATURE

1.22.08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	109	FIRE ALARM PANEL MISSING CURRENT CERTIFICATION STICKER	X							NFPA 72
1	126	OCCUPANCY LOAD SIGN MISSING: <u>80</u> MAX. OCCUPANCY		X						FBC 423.14.2.2
4	430	GAS GRILL STORED WITH BOTTLE IN ELECTRICAL ROOM		X						NFPA 1.21.1.3.3.5

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL
2398 MOODY ROAD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 22, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

[Signature]
INSPECTOR'S SIGNATURE 1-22-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	21	OK								
92	22	OK								
92	23	OK								
92	25A	OK								
92	25B	OK								
92	26	OK								
92	27	OK								
92	28	OK								
92	31	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	OK								
92	36	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0018

FACILITY: MONTCLAIR ELEMENTARY SCHOOL
2398 MOODY ROAD
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: JANUARY 22, 2008

Larry H. [Signature]
INSPECTOR'S SIGNATURE 1-22-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	37	OK								
92	38	OK								
92	39	OK								
92	40	OK								
92	41	OK								
92	44	OK								
92	45	OK								
92	46A	OK								
92	46B	OK								

Orange Park

Elementary School

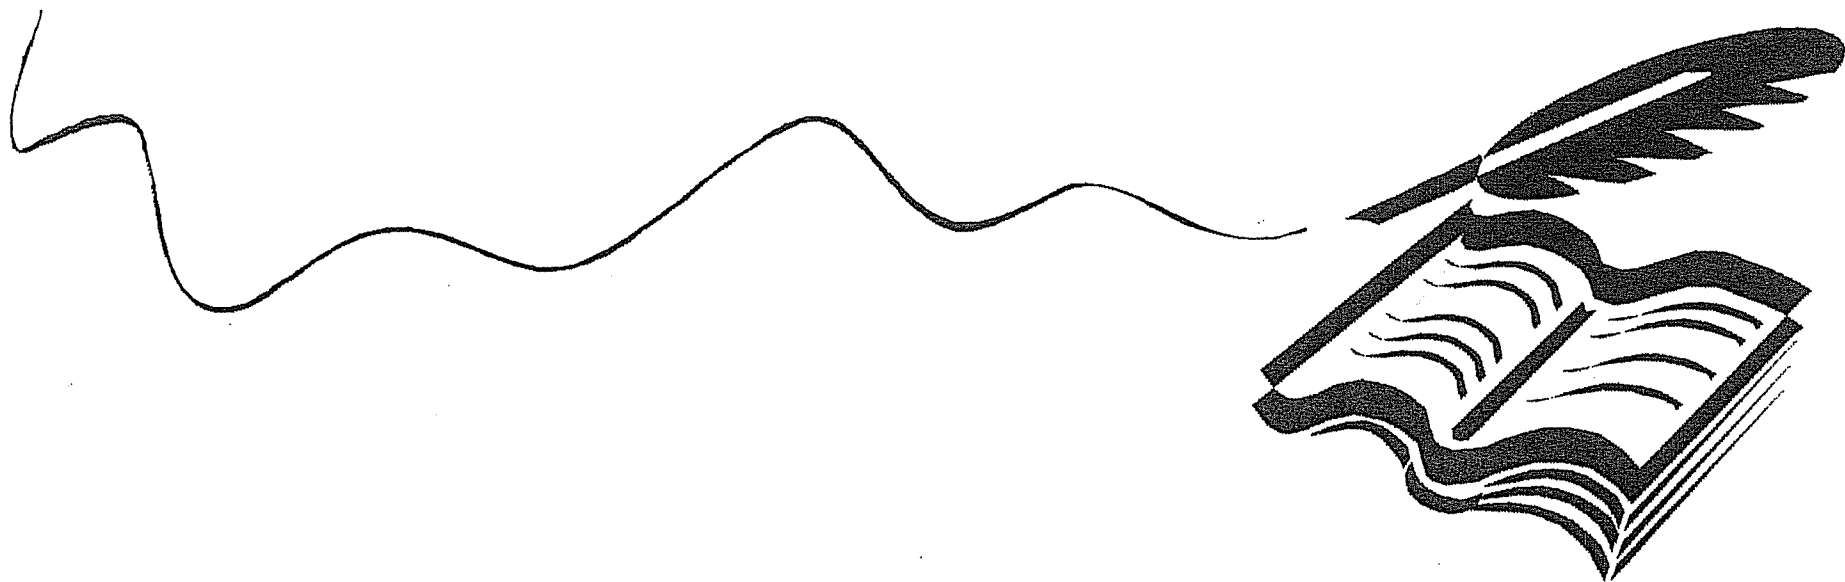

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 24, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

Larry J. Swain
INSPECTOR'S SIGNATURE 1-24-08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	4	TABLE BLOCKING 2 ND EXIT		X						FBC 423.20.1
2	5	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	80	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	82	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	89	EMERGENCY LIGHT OUT		X						FBC 423.17.1
7	13	EMERGENCY LIGHT OUT		X						FBC 423.17.1
7	75	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 24, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Garrett P. ...
INSPECTOR'S SIGNATURE

1.24.08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	21	OK								
92	22	OK								
92	34	OK								
92	35	OK								
92	36	OK								
92	37	OK								
92	38	OK								
92	39A	OK								
92	39B	OK								
92	41	OK								
92	42	OK								
92	43	OK								
92	44	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 24, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

Larry P. ...
INSPECTOR'S SIGNATURE


1.24.08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	45	OK								
92	50	OK								
92	51	OK								
92	51	OK								
92	52	OK								
92	53	OK								
92	54	OK								

R. M. Patterson

Elementary School

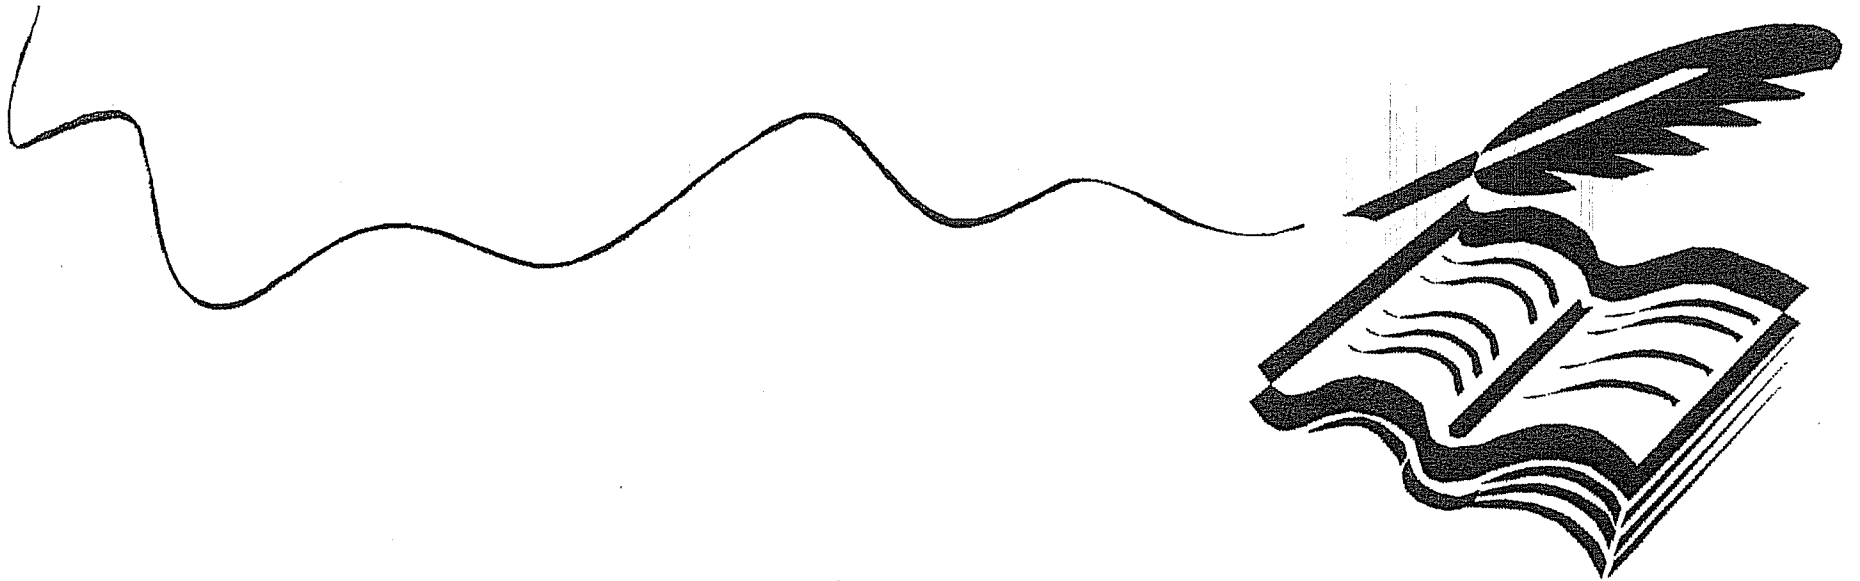

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 29, 2008

[Signature]
INSPECTOR'S SIGNATURE 1-29-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	142	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
2	208	VENDING MACHINE BLOCKING STORAGE		X						NFPA 1
3		OK								
4	412	NO EVACUATION SHEET		X						FBC 423.14.2.4
5		OK								
6		OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 29, 2008

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

Laurel F. [Signature]
INSPECTOR'S SIGNATURE

1.29.08
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	OK								
92	2	OK								
92	3	OK								
92	4	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	5	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	6	OK								
92	8	OK								
92	11	OK								
92	13	OK								
92	14	OK								
92	15	OK								
92	16	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	18	OK								
92	21	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 29, 2008

[Signature]
INSPECTOR'S SIGNATURE

1-29-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	22	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	23	OK								
92	24	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	25	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	26	OK								
92	27	OK								
92	28	OK								
92	29	OK								
92	9230	OK								
92	41	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	42	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	43	OK								
92	44	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	45	EMERGENCY LIGHT OUT	X							FBC 423.17.1

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: JANUARY 29, 2008


FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

[Signature]
INSPECTOR'S SIGNATURE 1-29-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	46	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	47	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	48	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	49	OK								
92	50	OK								
92	51	OK								
92	52	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	53	OK								
92	54	OK								

Ride Out

Elementary School

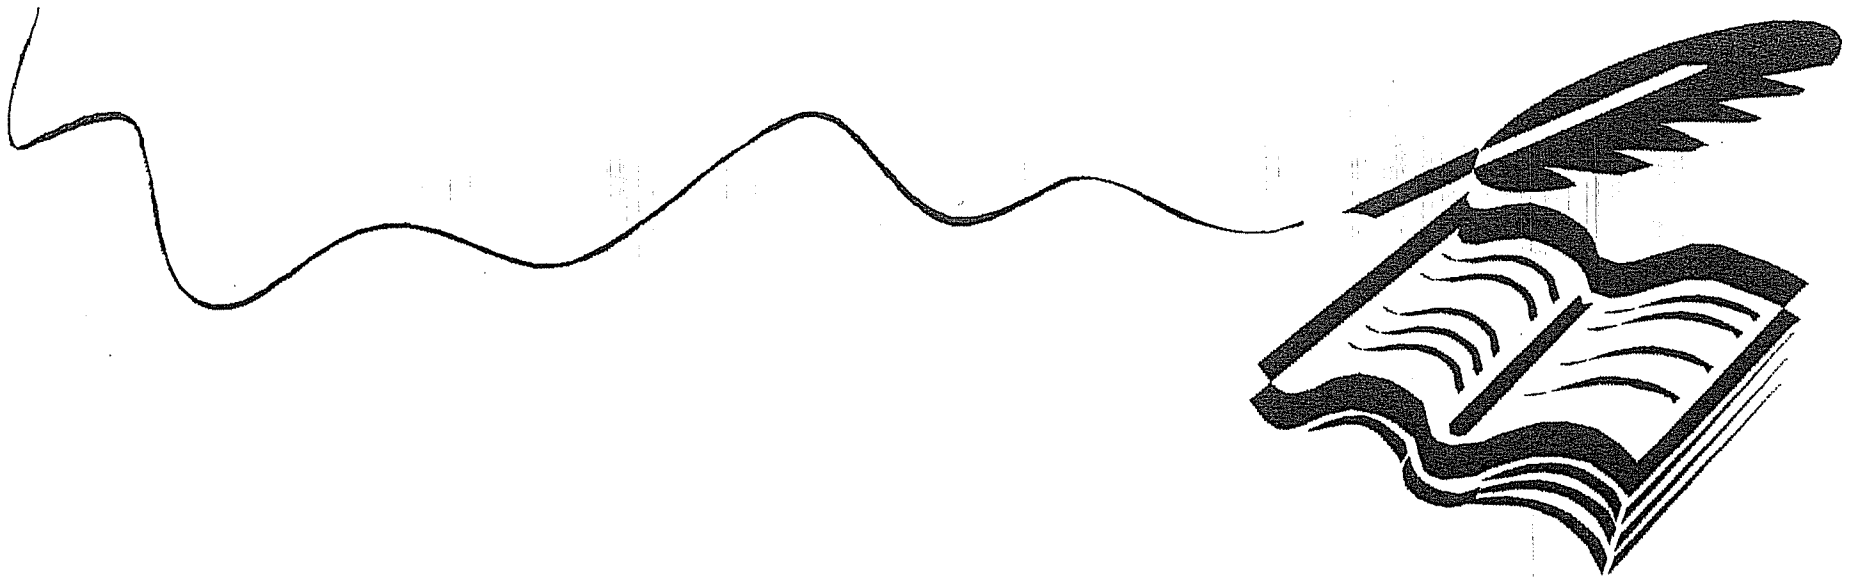

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 1, 2008

Tod Sweatt
INSPECTOR'S SIGNATURE

Feb 1, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	110	SHELF UNIT PARTIALLY BLOCKS EXIT		X						FBC 423.20.1
1	134	CLASSROOM NOT BY DESIGN, DOOR SWINGS WRONG WAY *** CANNOT BE CLASSROOM - NEEDS EXIT TO EXTERIOR TO BE A CLASSROOM		X						FBC 423.13.1
1	457	DOOR NUMBER/DOOR/WINDOW COVERED WITH DÉCOR		X						FBC 423.13.7
1	457	NO EMERGENCY EVACUATION SHEET		X						FBC 423,14,2,4
1	457	FIRE EXTINGUISHER COVERED WITH DECORATIONS		X						69A-58

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 1, 2008


Ted Sweetman
INSPECTOR'S SIGNATURE

Feb 1, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	13	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	14	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	22	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	24	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Ridgewood

Elementary School

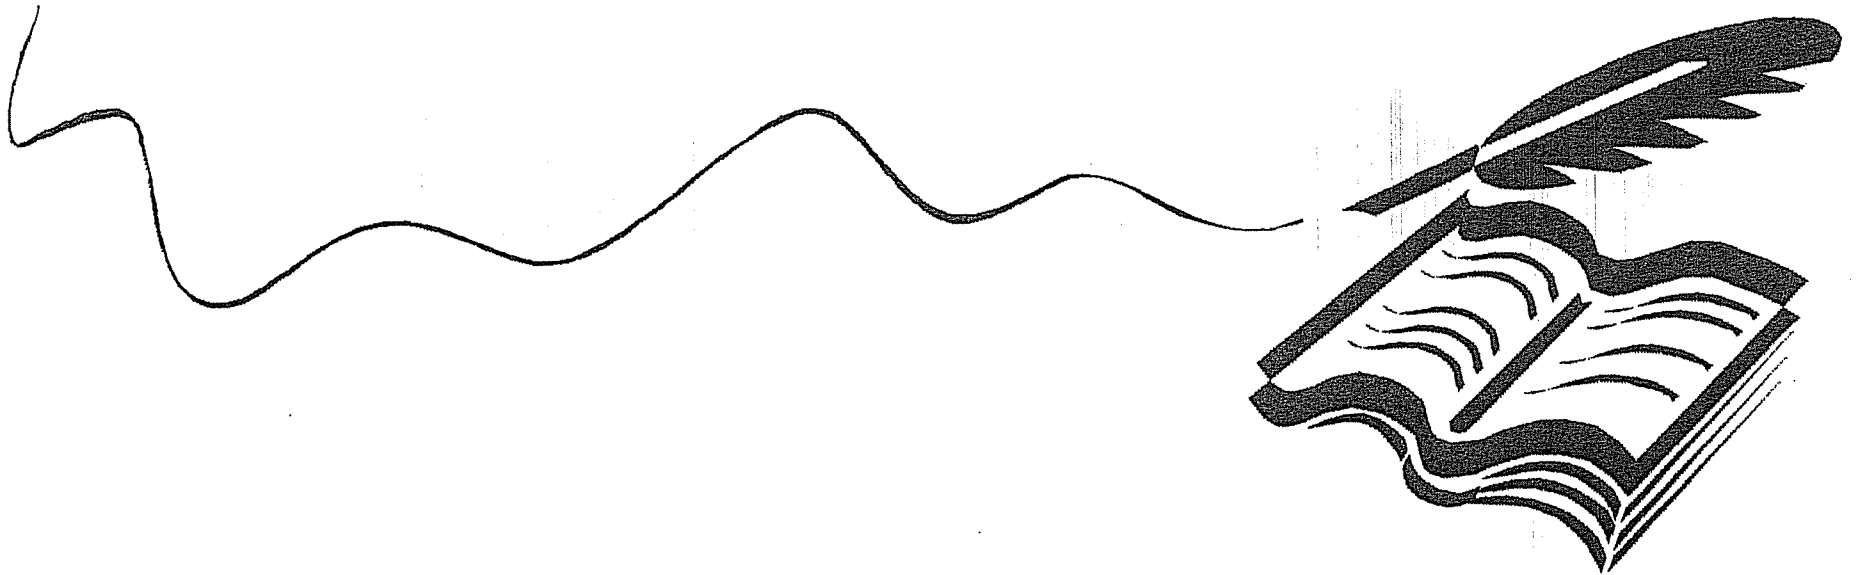

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: FEBRUARY 5, 2008
Ted Sweetland Feb 5, 2008
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2	223	EXIT LIGHT OUT	X							FBC 1016.3.1
3		OK								
4	401	OLD BATTERIES STORED INSIDE		X						
6		OK								
7	711	FIRE ALARM BOX OPEN, NO DEVICE ON CEILING	X							NFPA 70 110.26
7	711	FIRE ALARM BOX OPEN, NO DEVICE ON CEILING	X							NFPA 70 110.26

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: FEBRUARY 5, 2008

Bob Sweetland Feb 5, 2008
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	711	OK								
92	712	OK								
92	713	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	714	OK								
92	715	OK								
92	716	LENS COVER MISSING		X						NFPA 70 401.3
92	717	OK								
92	718	OK								
92	728	OK								
92	729	OK								
92	730	OK								
92	731	OK								
92	732	OK								
92	733	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: FEBRUARY 5, 2008
Ted Sweetland Feb 5, 2008
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	734	OK								
92	735	OK								
92	736	OK								
92	737	OK								
92	738	OK								
92	739	OK								
92	740	OK								
92	741	OK								
92	742	OK								
92	743	OK								
92	744	OK								
92	745	OK								
92	746	OK								
92	734	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: FEBRUARY 5, 2008

Tom Sweatt
INSPECTOR'S SIGNATURE

Feb 5, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	748	OK								
92	749	OK								
92	750	OK								
92	751	OK								
92	752	OK								
92	753	FILING CABINET IN FRONT OF ELECTRICAL PANEL		X						NFPA 70
92	748	OK								
92	754	OK								
92	755	OK								
92	756	OK								
92	757	OK								
92	758	OK								
92	759	OK								
92	760	OK								

