


Auguste

Elementary School

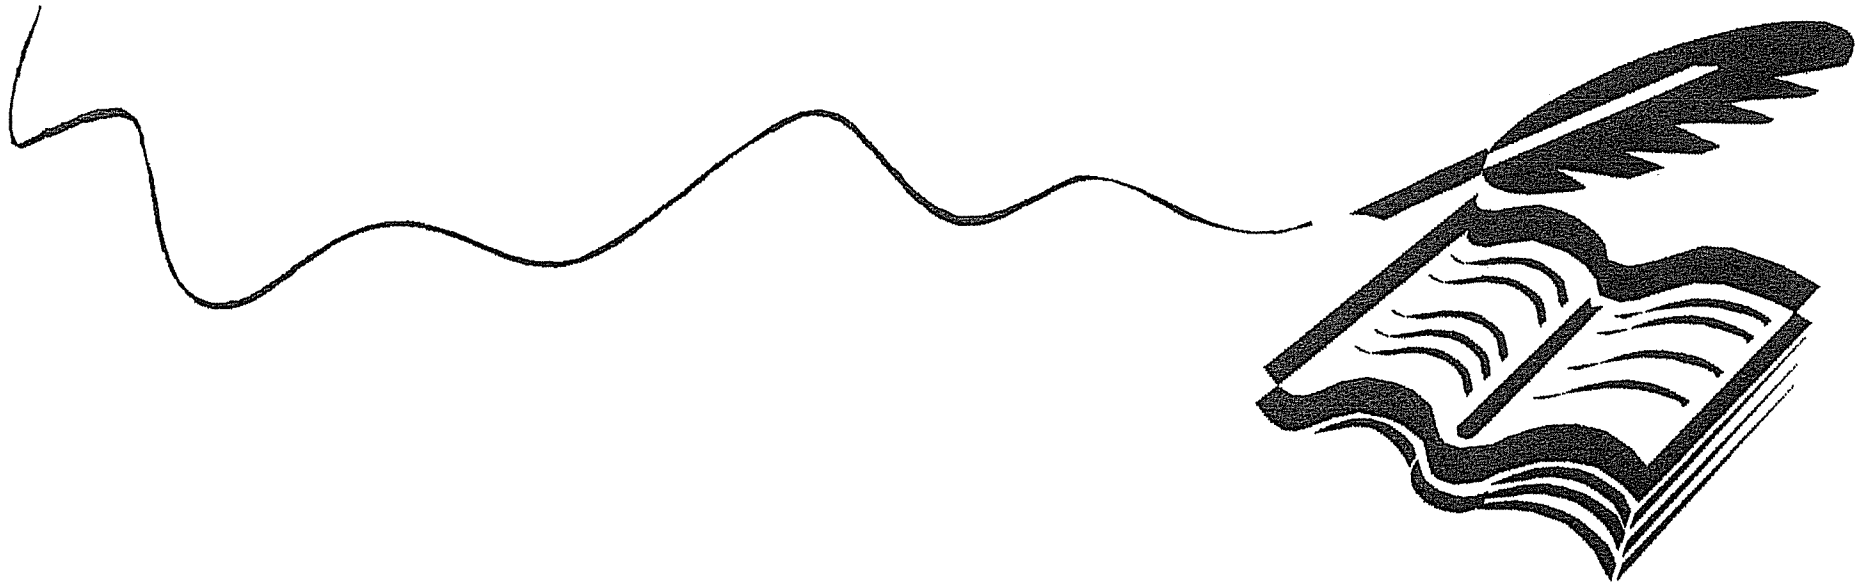

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0046

FACILITY: ARGYLE ELEMENTARY SCHOOL
2625 SPENCER PLANTATION BOULEVARD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 29, 2007

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: ✓ NUMBER OF DRILLS PERFORMED: 4

Larry J. ...
INSPECTOR'S SIGNATURE

11-29-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
ALL		NO DEFICIENCIES NOTED								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0046

FACILITY: ARGYLE ELEMENTARY SCHOOL
2625 SPENCER PLANTATION BOULEVARD
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: NOVEMBER 29, 2007

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

Larry A. ...
INSPECTOR'S SIGNATURE


11-29-07
DATE

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	703	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	708	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	713	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	812	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

Charles E. Bennett

Elementary School

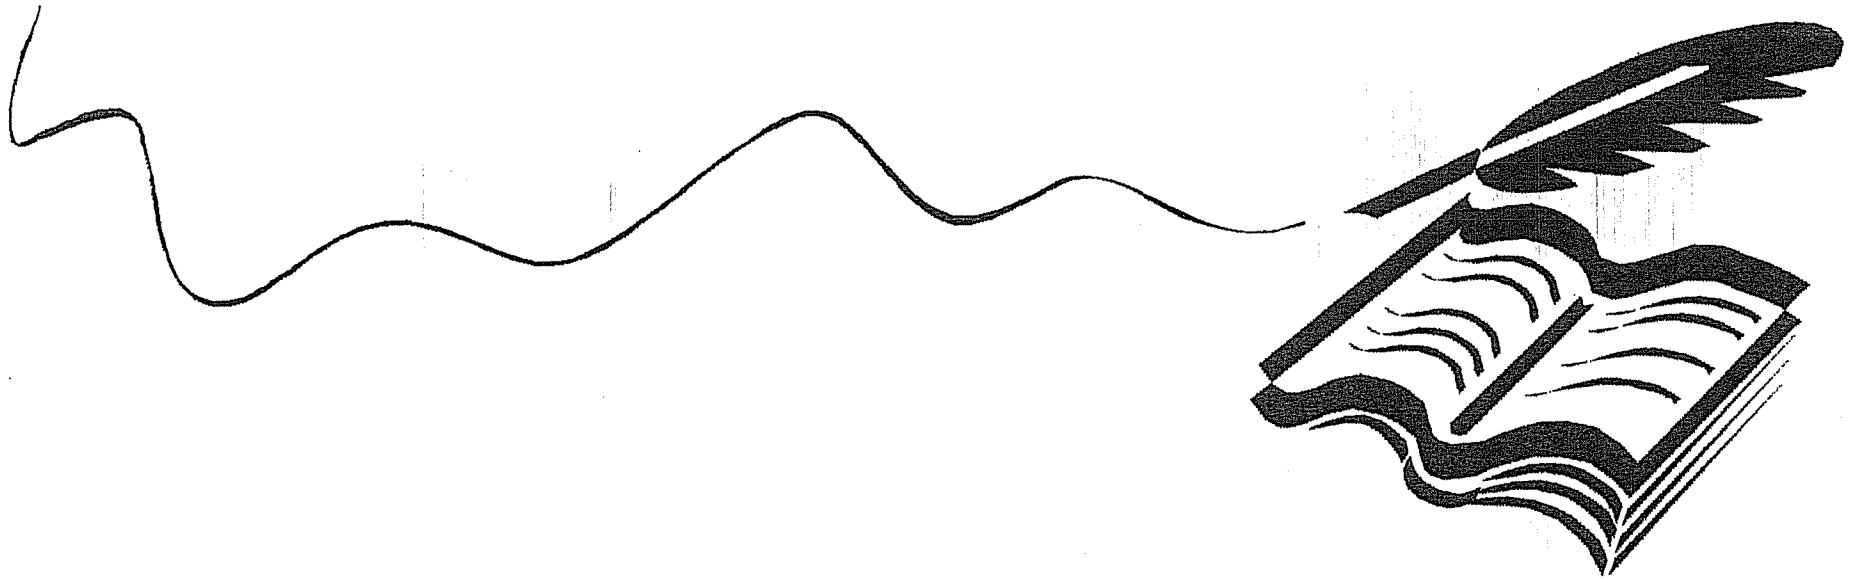

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL
1 SOUTH OAKRIDGE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: DECEMBER 12, 2007

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

[Handwritten Signature]
INSPECTOR'S SIGNATURE
12-6-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
		NO VIOLATIONS								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL
1 SOUTH OAKRIDGE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: DECEMBER 12, 2007

[Handwritten Signature]
INSPECTOR'S SIGNATURE

12-6-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	40	OK								
92	41	OK								
92	42	OK								
92	43	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	45	OK								
92	46	OK								
92	47	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	48	OK								
92	49	OK								
92	50	OK								
92	51	EXIT STAIR LOOSE	X							FBC 1001.3
92	52	OK								
92	53	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL
1 SOUTH OAKRIDGE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 12, 2007

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

[Handwritten Signature]
INSPECTOR'S SIGNATURE

12.6.07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	54	OK								
92	56	OK								
92	57	OK								
92	59	OK								
92	59	OK								
92	59	OK								
92	502	OK								
92	602	OK								
92	603	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	604	OK								
92	605	OK								
92	606	OK								
92	702	EMERGENCY LIGHT OUT	X							FBC 423.17.1

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL
1 SOUTH OAKRIDGE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 12, 2007


FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

[Signature]
INSPECTOR'S SIGNATURE 12-6-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	704	OK								
92	803	OK								
92	805	OK								

Clay Hill

Elementary School

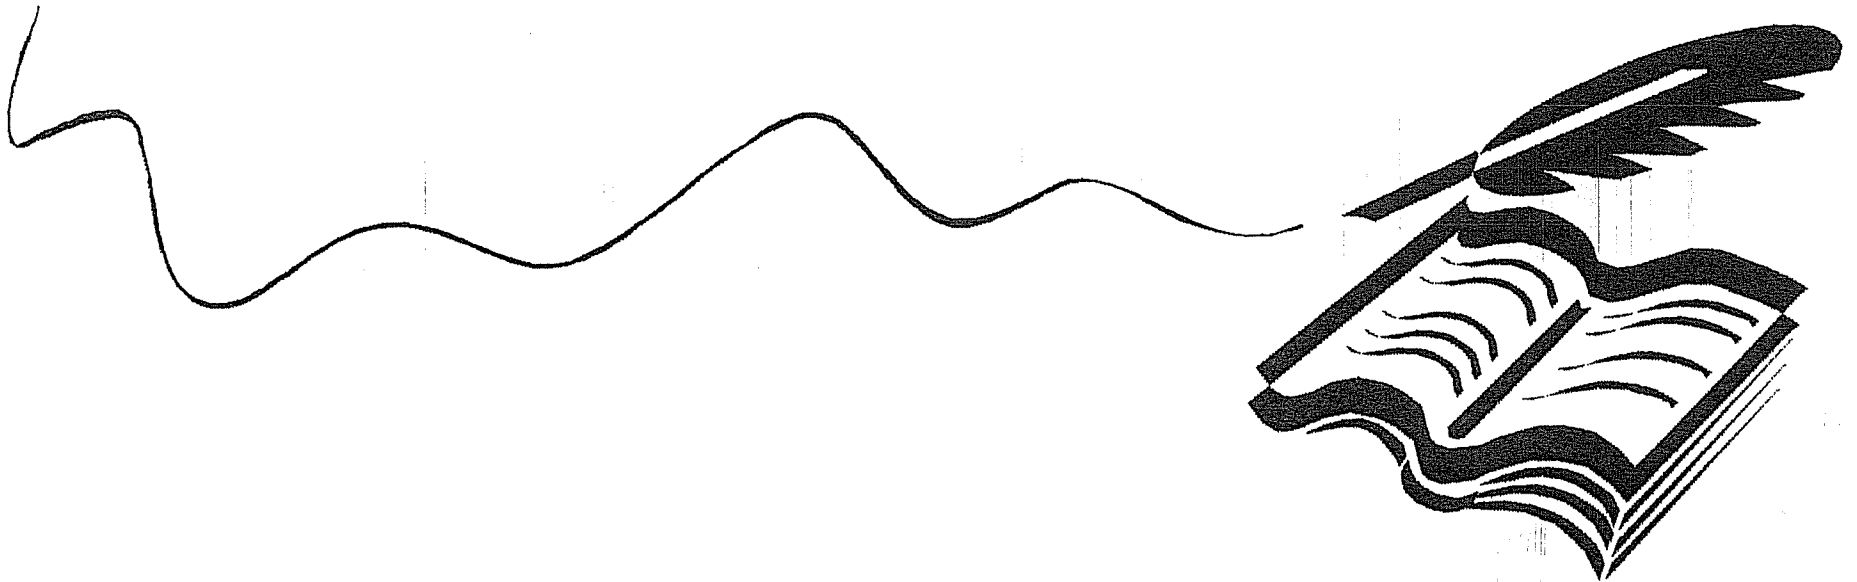

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0021

FACILITY: CLAY HILL ELEMENTARY SCHOOL
6345 STATE ROAD 218
JACKSONVILLE, FLORIDA 32234

INSPECTION DATE: DECEMBER 11, 2007


INSPECTOR'S SIGNATURE 12-11-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
5	504	STORM SHUTTERS NOT OPERATING PROPERLY			X					

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0021

FACILITY: CLAY HILL ELEMENTARY SCHOOL
6345 STATE ROAD 218
JACKSONVILLE, FLORIDA 32234

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 11, 2007


FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

[Handwritten Signature]
INSPECTOR'S SIGNATURE DATE 12-11-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	682	OK								
92	701	OK								
92	703	OK								
92	704	OK								
92	706	OK								
92	707	OK								
92	708	OK								
92	710	OK								
92	712	OK								
92	762	OK								
92	764	OK								
92	766	OK								

Doctors Inlet

Elementary School

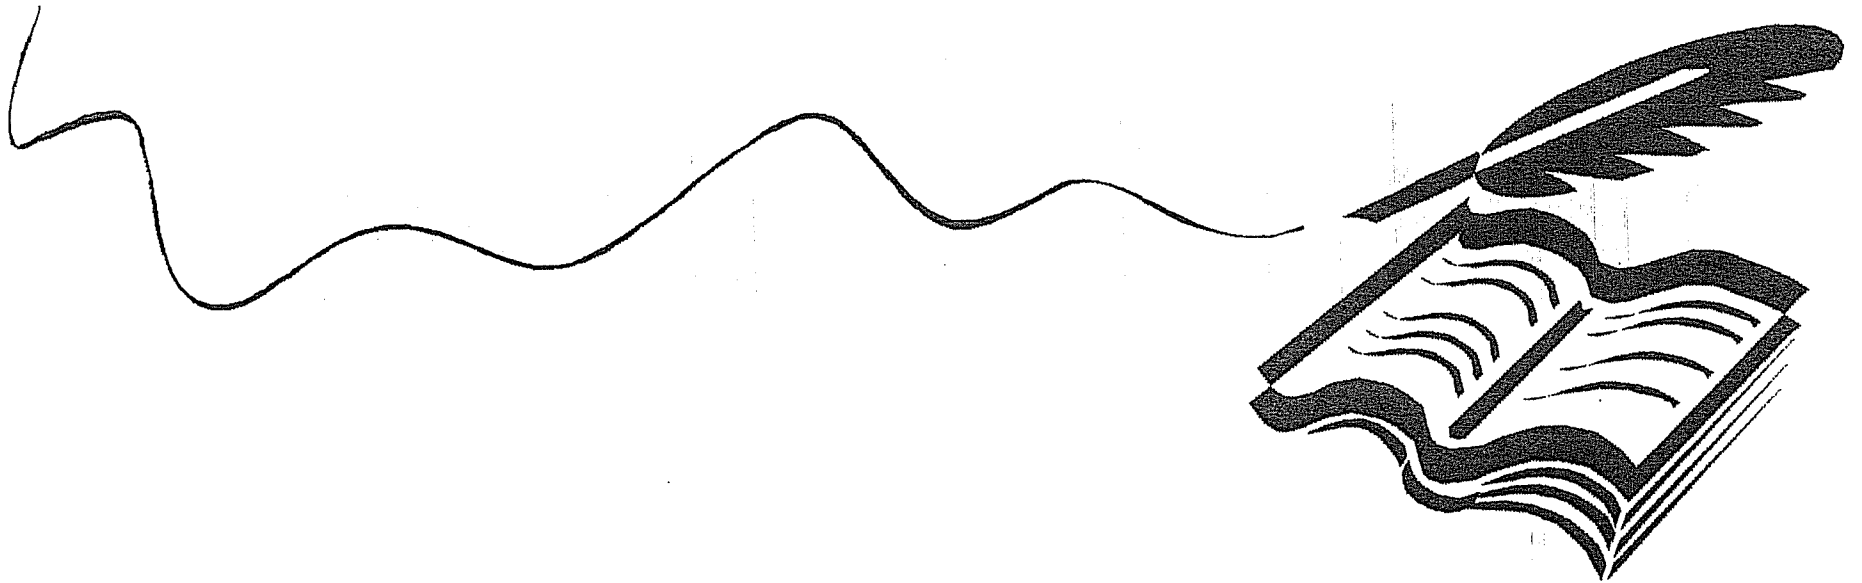

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 12, 2007

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

[Signature]
INSPECTOR'S SIGNATURE DATE 12-12-07

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4		OK								
5		OK								
7		OK								
8		OK								
9		OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 12, 2007

Larry St. John
INSPECTOR'S SIGNATURE

12-12-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	892	OK								
92	893	OK								
92	894	OK								
92	895	OK								
92	896	EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
92	897	OK								
92	898	OK								
92	920	EMERGENCY LIGHT INOPERABLE	X							FBC 423.17.1
92	921	OK								
92	922	OK								
92	923	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	924	OK								
92	836	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 12, 2007

[Signature]
INSPECTOR'S SIGNATURE

12-18-07
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	839	EXCESSIVE COMBUSTIBLES & CLUTTER IN ROOM		X						NFPA 70 110.28
92	840	OK								
92	841	OK								
92	843	OK								
92	844	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	847	OK								
92	849	OK								
92	851	LIGHT FALLING FROM CEILING	X							NFPA 70 110.12
92	875	OK								
92	876	OK								
92	874	LIGHT COVER MISSING		X						NFPA 70 401.3
92	873	OK								
92	871	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 12, 2007

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE


12-12-07
DATE

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	872	OK								
92	870	OK								
92	869	OK								
92	888	OK								
92	889	OK								
92	890	OK								
92	891	OK								

Fleming Island

Elementary School

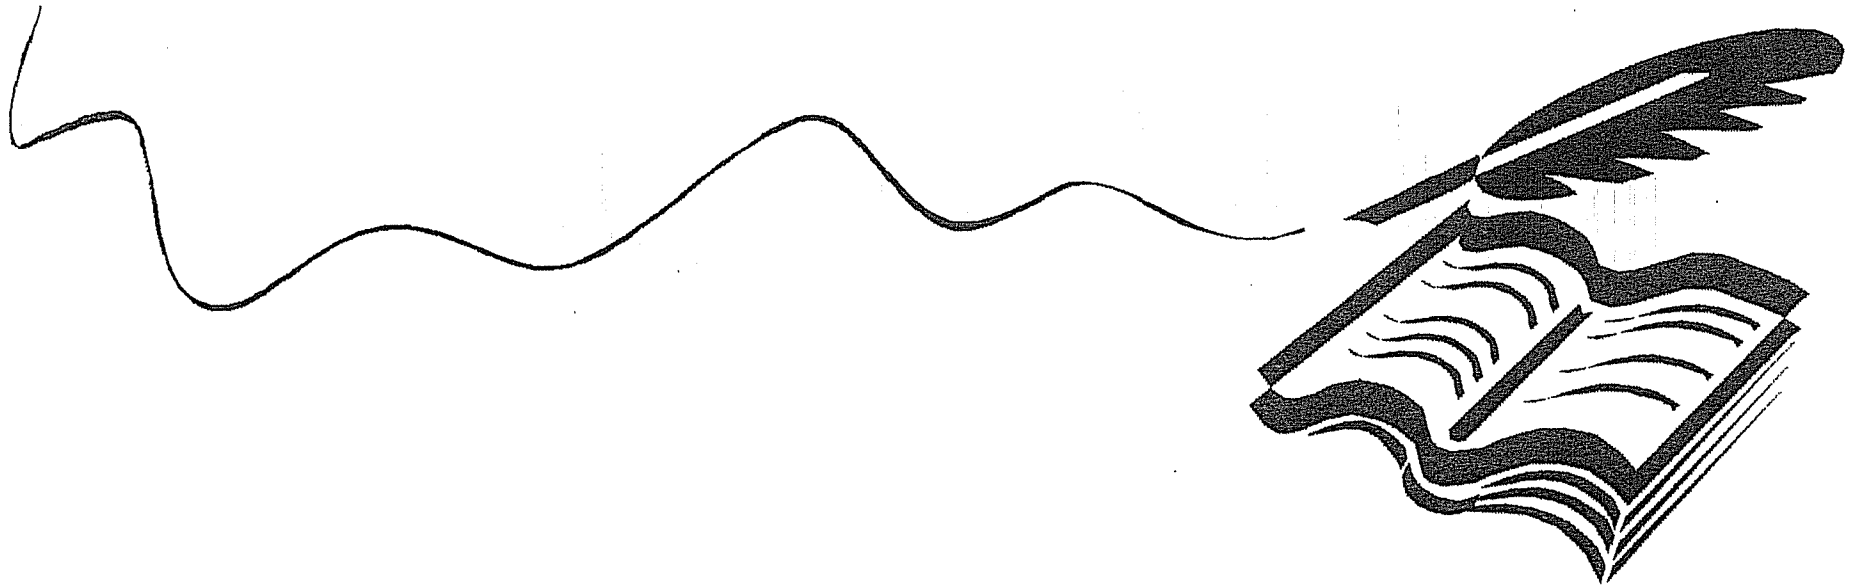

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 18, 2007

Ted Swettenham
INSPECTOR'S SIGNATURE

Dec 18, 2007
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	219	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
2	229	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
3	314	OCCUPANCY LOAD SIGN INCORRECT, SAYS 600 PEOPLE, SHOULD BE 150 PEOPLE		X						FBC 423.14.2.2
3	314	EXIT LIGHT OUT		X						FBC 423.17.1
3	304	EXIT LIGHT OUT		X						FBC 423.17.1
3	303	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
4	400	FIRE EXTINGUISHER NOT SIGNED		X						69A-58

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 18, 2007


Ted Sweetland
INSPECTOR'S SIGNATURE

Dec 18, 2007
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	602	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	607	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	808	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	812	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	832	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	845	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	860	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	904	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	910	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Grove Park

Elementary School

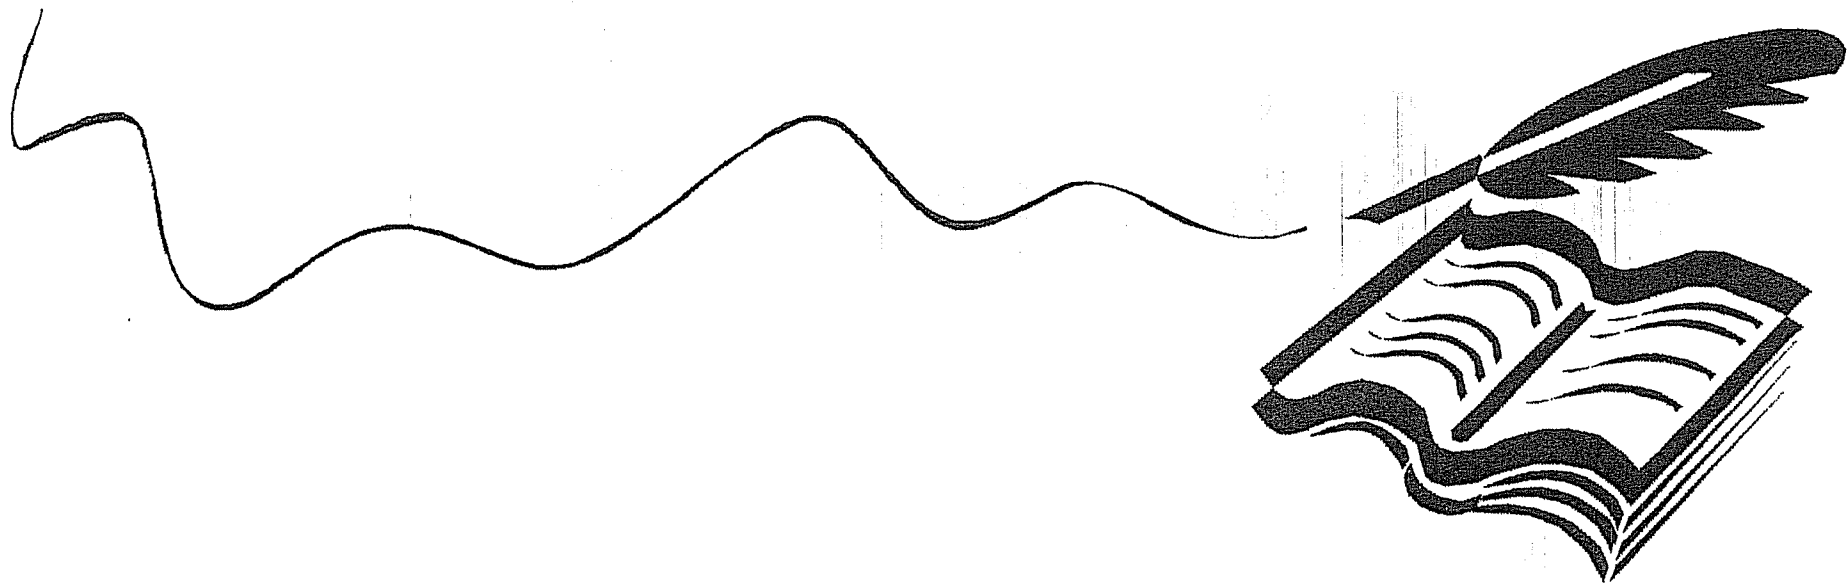

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
1643 MILLER STREET
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

Ted Sweetow
INSPECTOR'S SIGNATURE

Feb 6, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	110	OCCUPANCY LOAD SIGN MISSING – MAX OCC 80		X						FBC 423.14.2.2
7	701	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
8	11A	ELECTRICAL WIRE ABANDONED – REMOVE	X							NFPA 70
9	1	EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
1643 MILLER STREET
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

J. Sweet
INSPECTOR'S SIGNATURE

Feb 6, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	5	OK								
92	6	OK								
92	7	OK								
92	8	OK								
92	9	OK								
92	10	OK								
92	27	OK								
92	28	OK								
92	29	OK								
92	30	OK								
92	31	OK								
92	37	OK								
92	38	OK								
92	43	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
1643 MILLER STREET
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

Joe Swearington
INSPECTOR'S SIGNATURE

Feb 6, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	44	OK								
92	71	OK								
92	500	OK								
92	501	OK								
92	503	OK								
92	504	OK								
92	505	OK								
92	520	OK								
92	521	OK								
92	522	OK								
92	523	OK								
92	524	OK								
92	525	OK								
92	526	OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
1643 MILLER STREET
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 6, 2008

[Signature]
INSPECTOR'S SIGNATURE

Feb 6, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	527	OK								
92	528	OK								