


S. Bryan Lewis

Elementary School

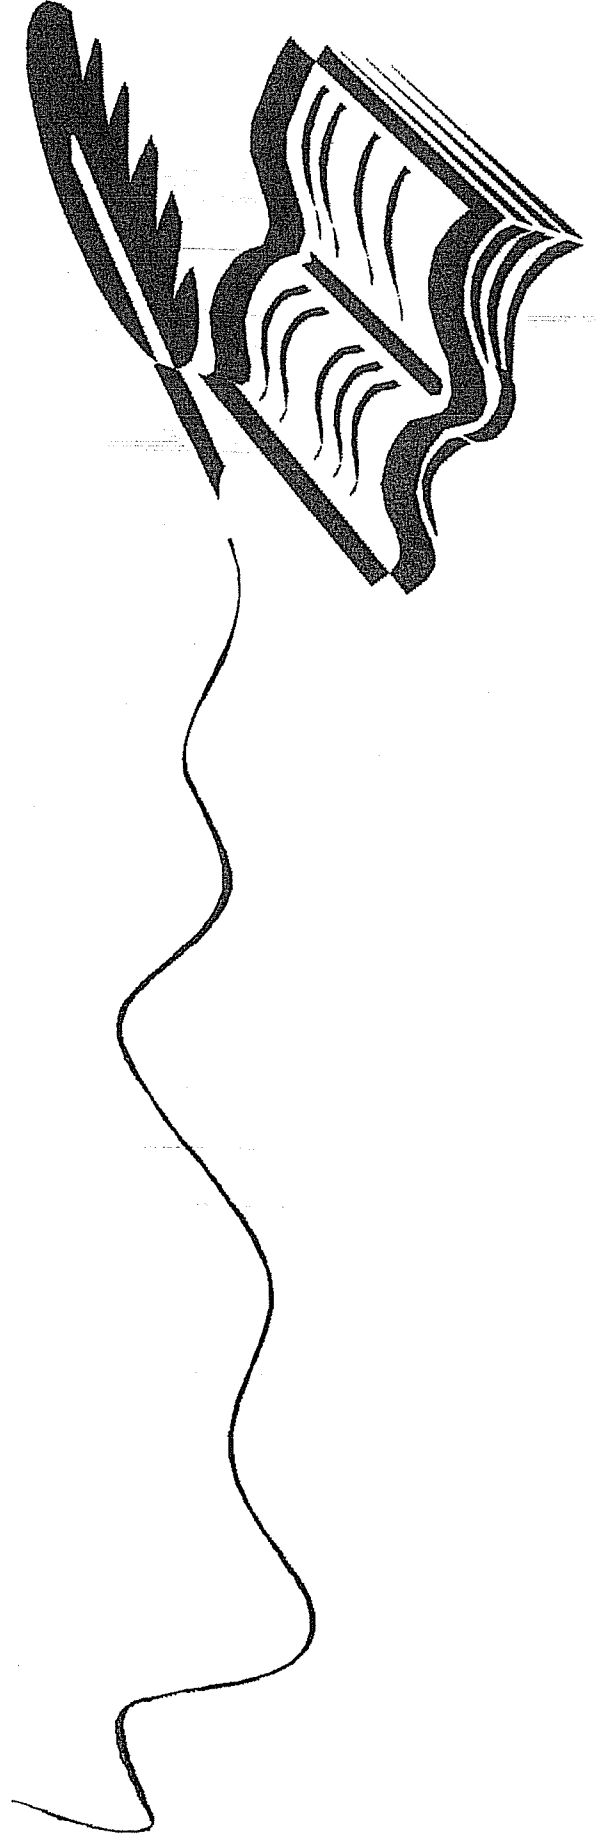

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES**

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 7, 2008

INSPECTOR'S SIGNATURE: *Paul Swedlow* DATE: Feb 7, 2008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	31A	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	31B	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	37A	HALF EMERGENCY LIGHT OUT - REPLACE BULB		X						FBC 423.17.1
2	36A	REMOVE EXTENSION CORD - GET NEW RECEPTACLE		X						NFPA 70 110
3	43D	FIRE ALARM PANEL MISSING		X						NFPA 70
4	1E	FIRE ALARM BOC MISSING COVER - ON SHELF		X						NFPA 70
7	14B	FIRE ALARM BOX COVERS MISSING OVER SINK		X						NFPA 70
8	173	FIRE ALARM BOX COVERS MISSING OVER SINK		X						NFPA 70

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S. B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: FEBRUARY 7, 2008

Bob Swanton
INSPECTOR'S SIGNATURE Feb 7, 2008
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	29	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	30	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	32	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	43	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	50	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	44	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Swimming Pool Club

Elementary School

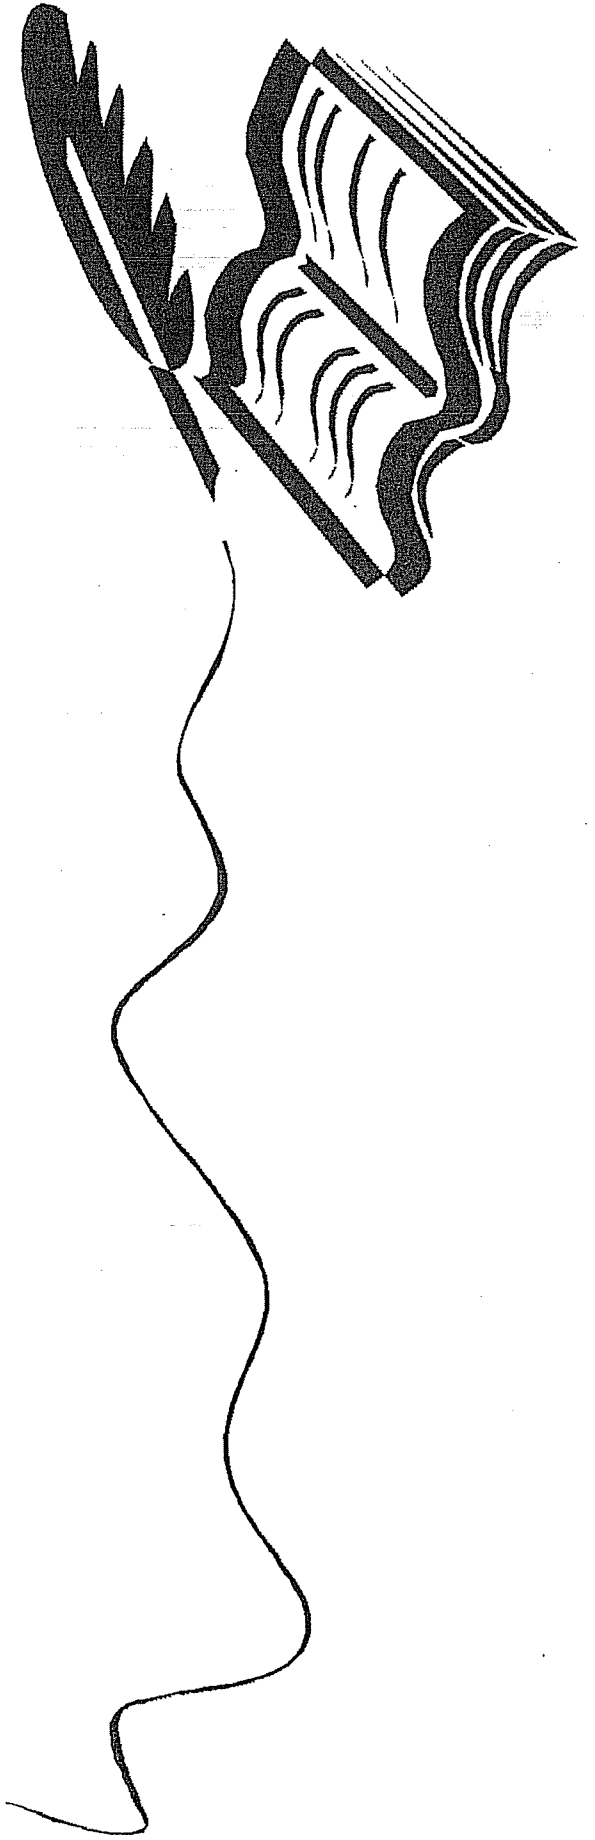

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES**

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 12, 2008

[Signature]
INSPECTOR'S SIGNATURE
DATE 2/12/08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	304	USED FOR CLASSROOM – DOOR SWINGS WRONG DIRECTION			X					FBC 804.2.3
4	433	USED FOR CLASSROOM – NO DOOR TO EXTERIOR			X					NFPA 15.2.5.4
5	533	USED FOR CLASSROOM – NO DOOR TO EXTERIOR			X					NFPA 15.2.5.4

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
MIDDLEBURG, FLORIDA 32068



INSPECTION DATE: FEBRUARY 12, 2008

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 2/12/08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	703	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	707	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	808	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Thornapple

Elementary School

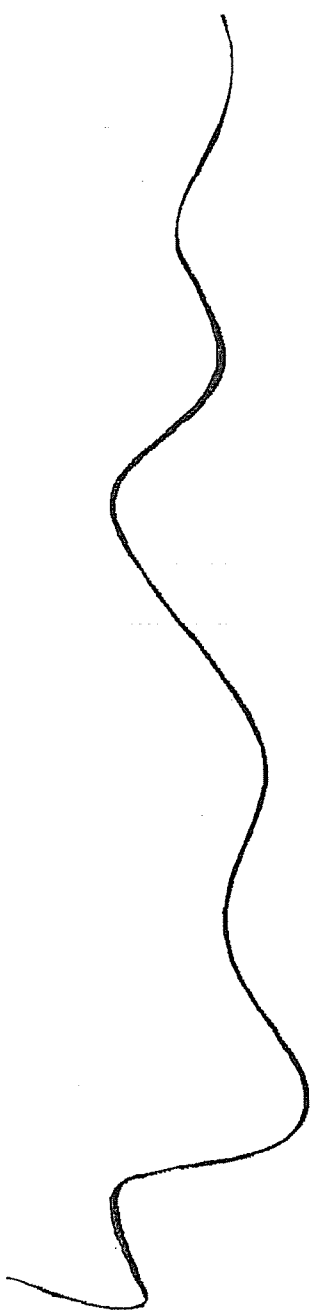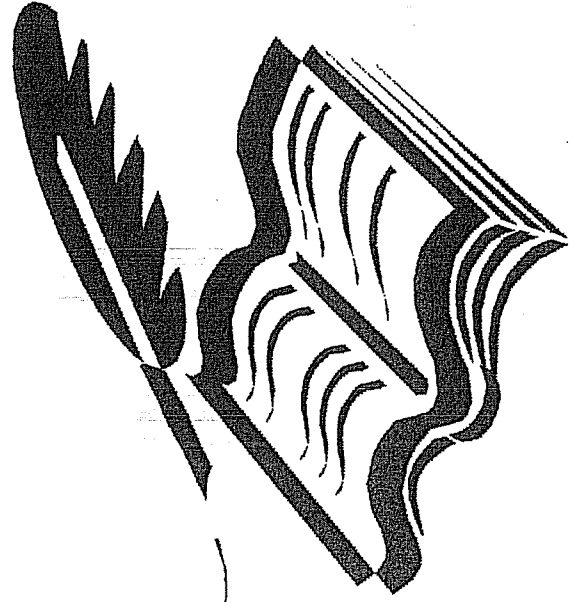

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES**

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL
2020 THUNDERBOLT ROAD
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: FEBRUARY 14, 2008

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		CEILING LOOSE	X							
25		SOFFIT LOOSE OVER BARD UNIT	X							

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL
2020 THUNDERBOLT ROAD
ORANGE PARK, FLORIDA 32003


INSPECTION DATE: FEBRUARY 14, 2008

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92		ALL RELOCATABLES OK								

Times

Elementary School

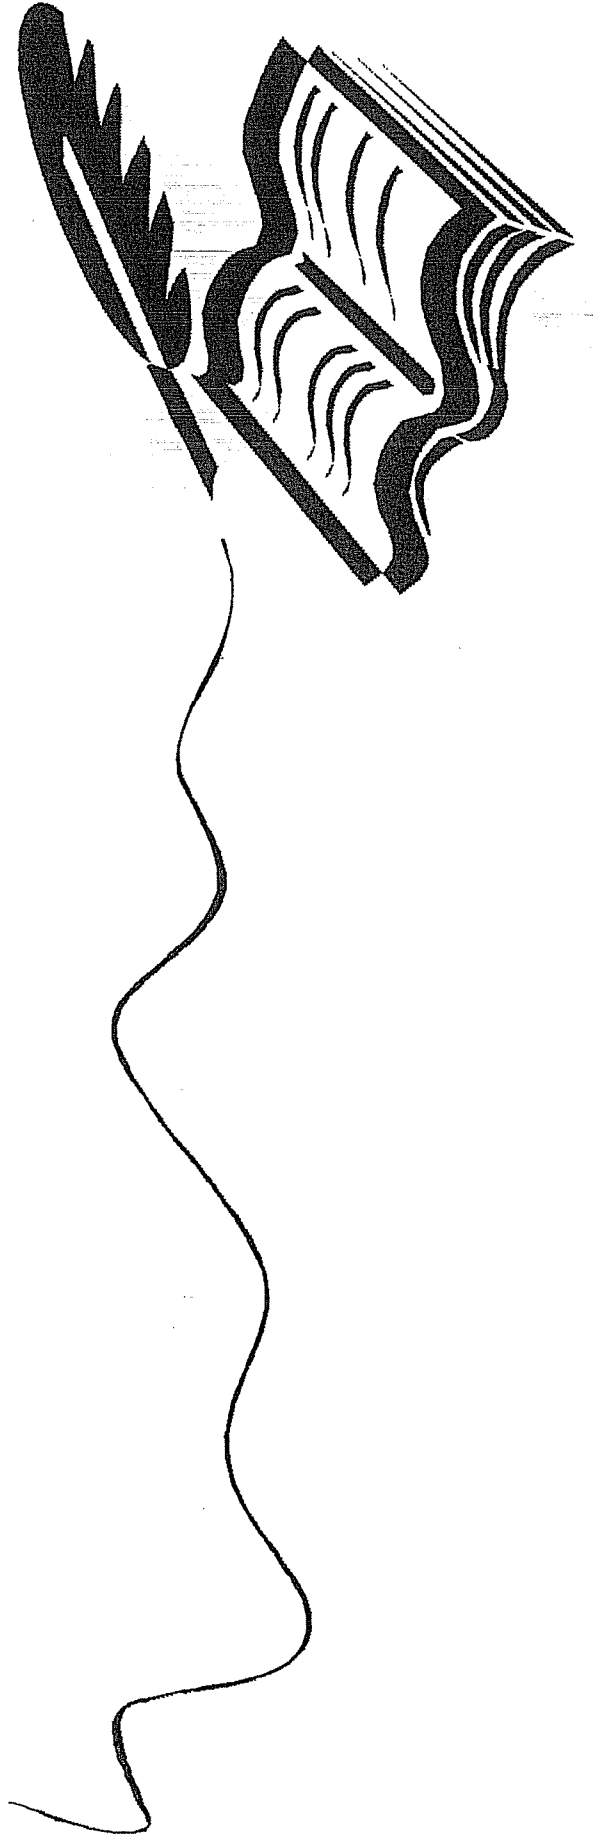

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0040

FACILITY: TYNES ELEMENTARY SCHOOL
1550 TYNES BOUEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 19, 2008

[Signature]
INSPECTOR'S SIGNATURE
DATE 2/19/08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		FIRE ALARM CERTIFICATION NOT CURRENT	X							69A-58.008
3	302	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
3	324	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
4	400	EXIT LIGHT OUT	X							FBC 1016.3
3	323	EXIT LIGHT OUT	X							FBC 1016.3

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0040

FACILITY: TYNES ELEMENTARY SCHOOL
1550 TYNES BOUEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 19, 2008


[Signature]
INSPECTOR'S SIGNATURE

2/19/08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	7	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	8	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	25	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	26	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	41	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	66	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	67	EMERGENCY LIGHT OUT	X							FBC 423.17.1

W. E. QUINN

Elementary School

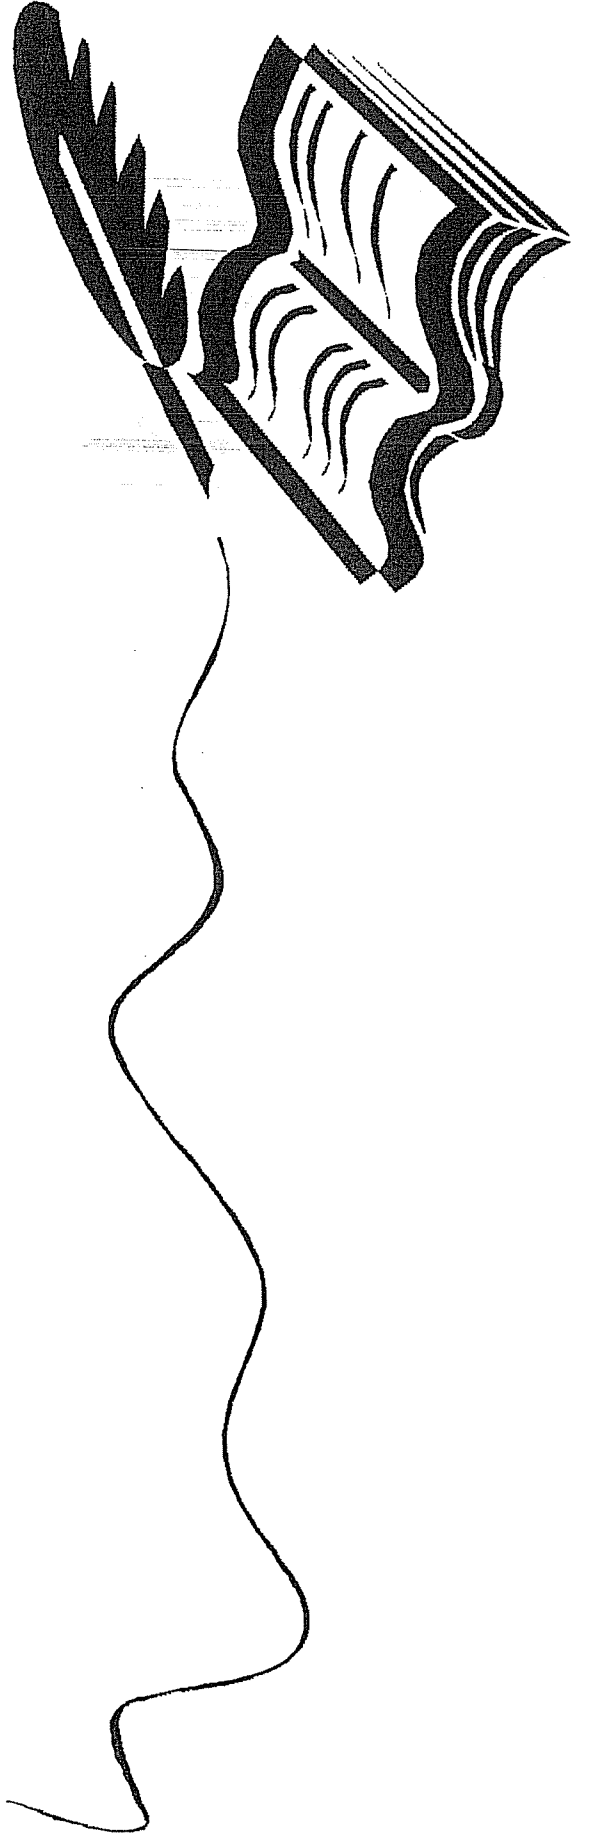

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL
420 EDSON DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 21, 2008

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 2/21/08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	8A	EMERGENCY LIGHT	X							FBC 423.17.1
1	8B	EMERGENCY LIGHT OUT	X							FBC 423.17.1
1	48	OPEN J-BOX	X							NFPA 70 312.5
1	3A	WIRES HANGING FROM CEILING	X							NFPA 70 312.5
2	53	EMERGENCY LIGHT OUT	X							FBC 423.17.1
2	75	COVER MISSING ON J-BOX	X							NFPA 70 312.5
3	64	LIGHT COVER MISSING		C						NFPA 70 401.3
4	810	CEILING BEING REPAIRED, RECOMMEND ENGINEER LOOK AT CAUSE OF CRACK AND SPAULING	X							

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES**

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL
420 EDSON DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 21, 2008
[Signature]
INSPECTOR'S SIGNATURE DATE 2/21/08

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	31	RAMP EXCEEDS 1/12 SLOPE	X							FBC 11.4.8
92	37	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	40	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	49	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	48	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	50	EMERGENCY LIGHT OUT	X							FBC 423.17.1

Williamson

Elementary School



FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: $\sqrt{\quad}$ NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 26, 2008

[Signature]
 INSPECTOR'S SIGNATURE

2-26-08
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
3		OK								
4		OK								
5		OK								

FISCAL YEAR 2007-2008

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES**

FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 26, 2008 2-26-08
INSPECTOR'S SIGNATURE: [Signature] DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	OK								
92	2	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	3	OK								
92	4	OK								
92	5	OK								
92	6	OK								
92	7	OK								
92	8	OK								
92	9	OK								
92	10	OK								
92	11	OK								
92	12	OK								
92	13	OK								
92	14	OK								

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 26, 2008

J. L. Swickard
INSPECTOR'S SIGNATURE

2-26-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	15	OK								
92	16	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	17	OK								
92	18	OK								
92	19	OK								
92	20	OK								
92	22	OK								
92	31	OK								
92	33	OK								
92	34	OK								
92	35	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	36	OK								
92	37	OK								
92	38	EMERGENCY LIGHT OUT	X							FBC 423.17.1

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 26, 2008 DATE 2-26-08
INSPECTOR'S SIGNATURE *[Signature]*

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	39	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	40	EMERGENCY LIGHT OUT								
92	41	OK								
92	42	OK								
92	43	OK								
92	44	OK								
92	45	OK								
92	46	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	47	OK								
92	48	OK								
92	49	OK								
92	50	OK								
92	51	OK								
92	52	OK								

FISCAL YEAR 2007-2008

FIRE SAFETY INSPECTION REPORT FOR EDUCATIONAL FACILITIES FLORIDA STATUTES 1013.12 & RULE 69A-58

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J. L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 26, 2008
[Signature] 2-26-08
INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	53	OK								
92	61	OK								
92	62	OK								
92	63	OK								
92	64	OK								
92	66	OK								
92	68	MISSING TRIM AT EXTERIOR DOOR	X							
92	68	ROOF TERMINATION STRIP LIFTING	X							