


**Administrative Office**

**Orange Park High**



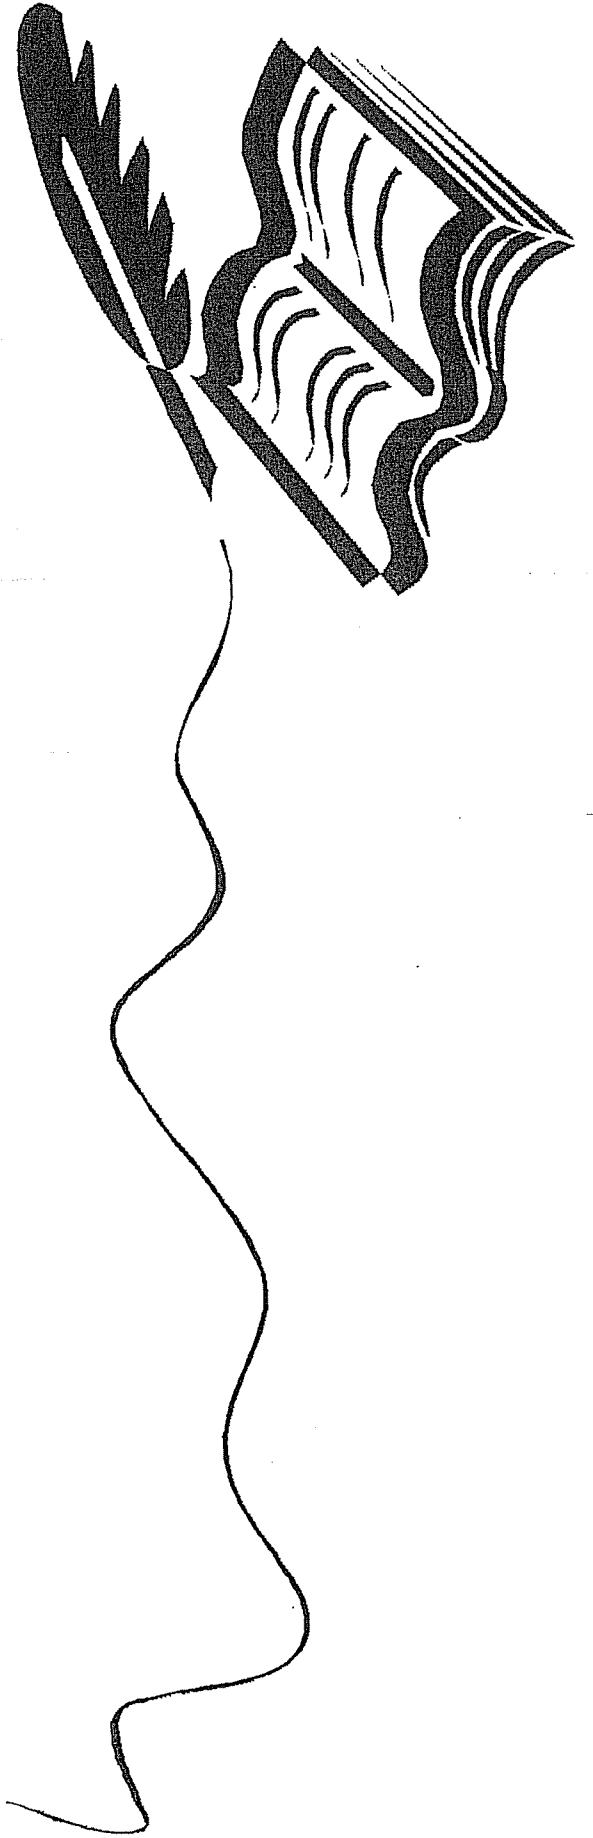

FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
 COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073



INSPECTION DATE: OCTOBER 23, 2007  
*[Signature]*  
 INSPECTOR'S SIGNATURE DATE 10-23-2007

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
17	3C	FIRE EXTINGUISHER NOT SIGNED		X						69A-58
17	3B	DOOR STICKS TO FLOOR, HARD TO OPEN		X						FBC 1003

Q&A

Superintendent's

Office

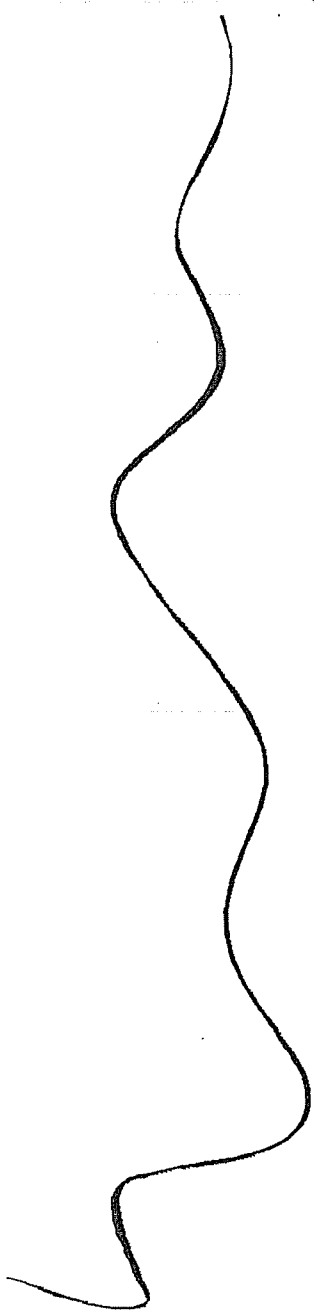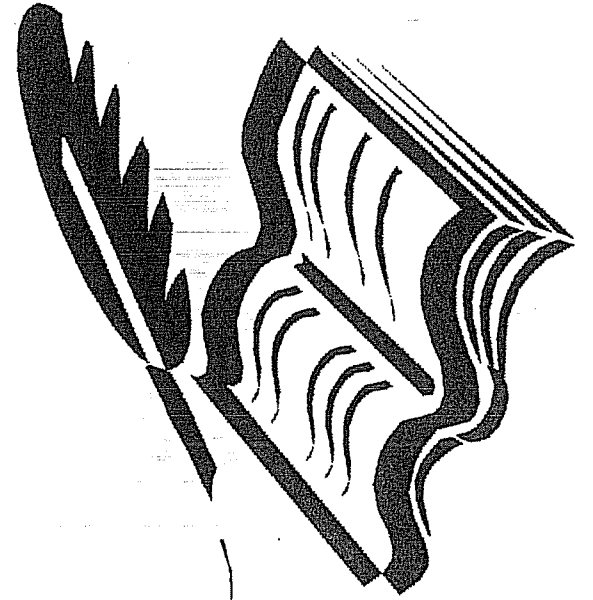



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0036


FACILITY: CLAY SUPERINTENDENT'S OFFICE  
900 WALNUT AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: APRIL 1, 2008 DATE 4-1-2008  
 INSPECTOR'S SIGNATURE [Signature]

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	27	CEILING TILE STAINED		X						
3	15	OUTLET COVER MISSING - BEHIND COPIER		X						NFPA 70
	49	FIRE ALARM PULL STATION BLOCKED BY CABINET - MOVE		X						NFPA 72

**Food Services**

**Stores**

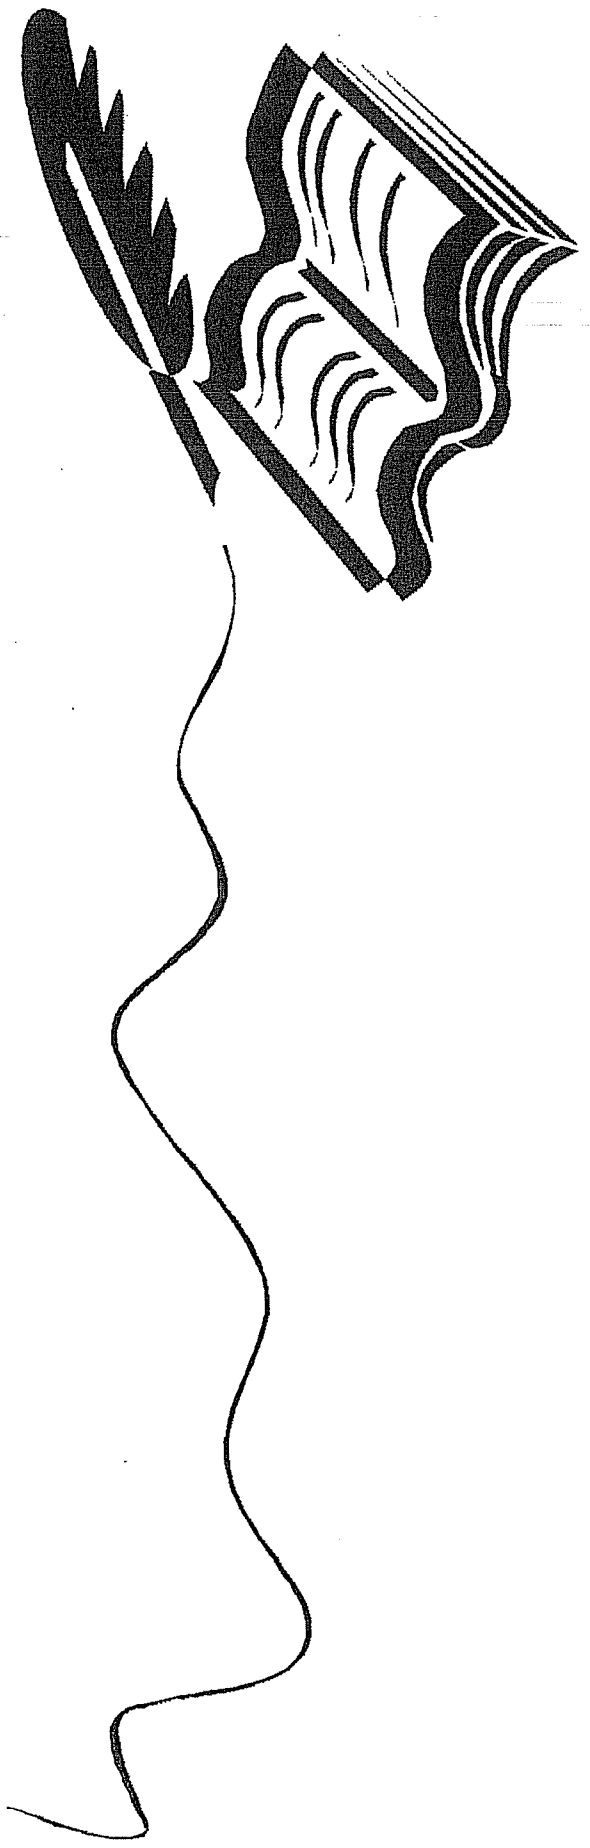



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT  
STATE BOARD OF EDUCATION  
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
COMPLIANCE WITH  
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0035


FACILITY: FOOD SERVICE STORAGE  
720 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: APRIL 18, 2008  
*[Signature]* DATE  
INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	OK								

Harris C. Lewis

Administrative

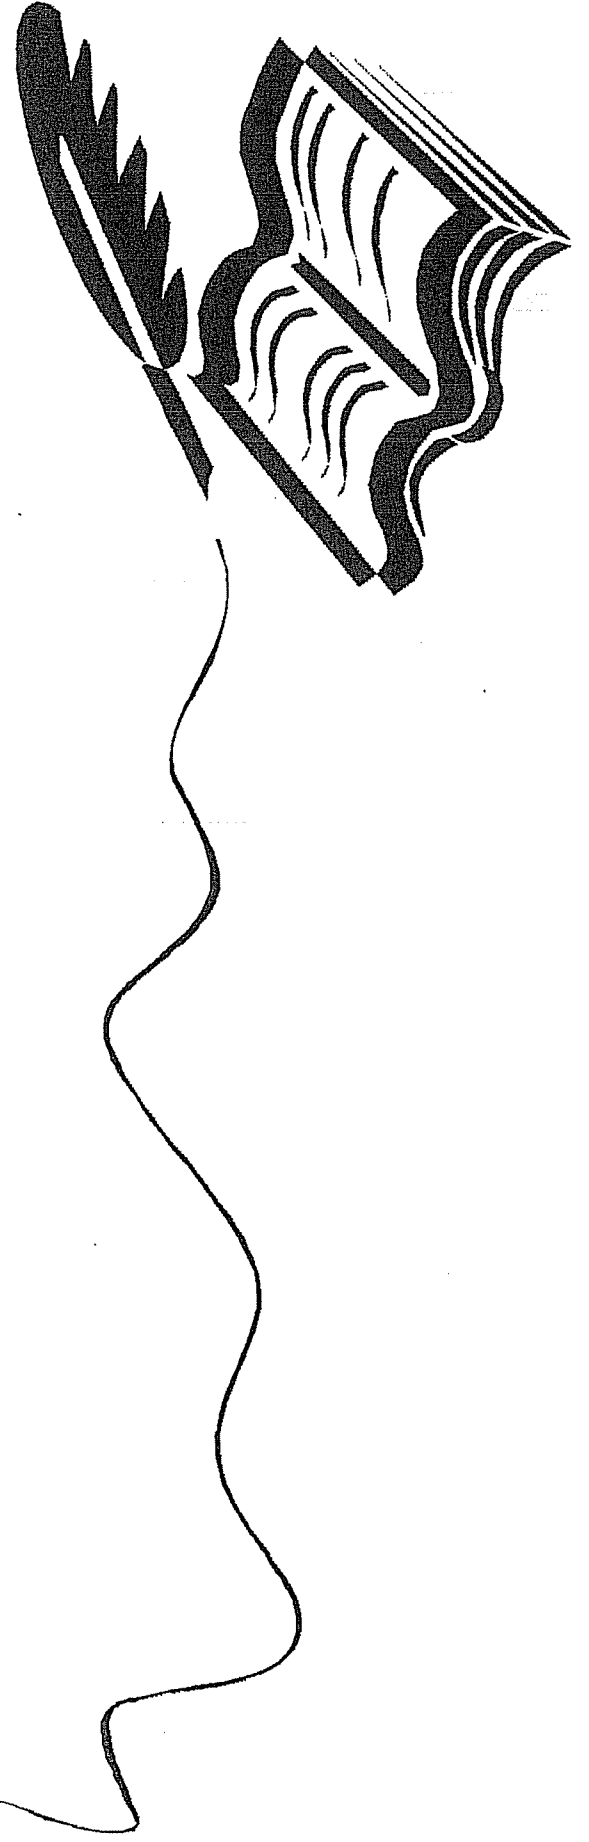



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0027

FACILITY: HARRIS C. LONG ADMINISTRATION  
 23 SOUTH GREEN STREET  
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: APRIL 1, 2008


INSPECTOR'S SIGNATURE: *[Signature]* DATE: 4-1-2008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	127	EMERGENCY LIGHT OUT		X						FBC 1006.2
3	300	STAINED CEILING TILE – POSSIBLE LEAK		X						
3	310	LOTS OF STORED PAPER		X						NFPA 101
4	405B	HALF OF EXIT LIGHTS OUT		X						FBC 1006.3.8
4	407B	OUTLET COVER MISSING		X						NFPA 70
4	416	STORAGE IN FRONT OF ELECTRICAL PANEL, MOVE FOR ACCESS		X						NFPA 70
4	416	EXTENSION CORD TO EQUIPMENT PUT IN PERMANENT WIRING	X							NFPA 70
4	413	REPLACE EXIT SIGH – FADED OUT		X						



Keystone Hints

Transposition

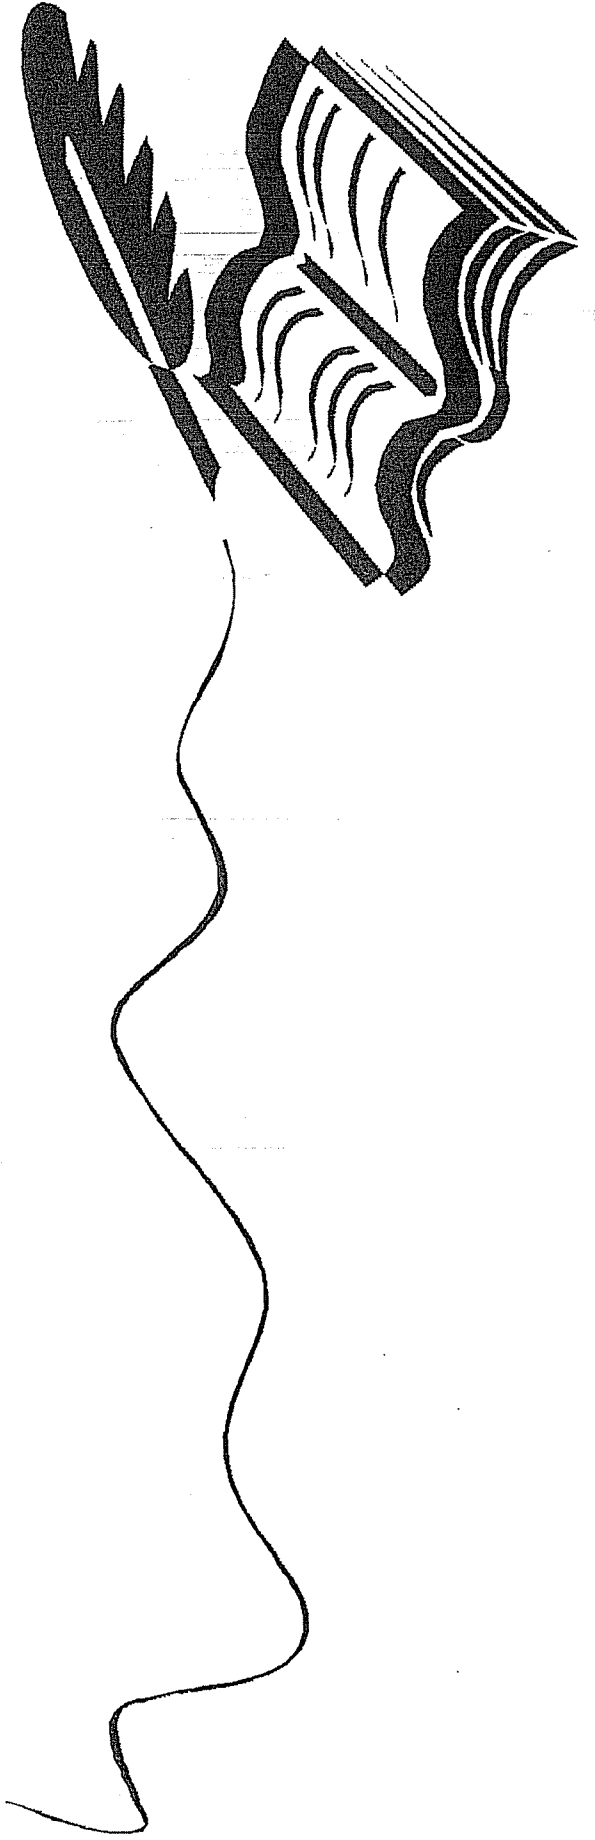

DISTRICT: CLAY FACILITY #: 0037

**FISCAL YEAR 2007-2008**

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
 COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101


FACILITY: KEYSTONE HEIGHTS TRANSPORTATION  
6800 COUNTY ROAD 315  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: MARCH 26, 2008  
INSPECTOR'S SIGNATURE: *Adrian Esteban* DATE: *March 26, 2008*

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	ROOF VENT NEEDS TO BE REPLACED, CEILING LEAKS AND HAS STAINS	X							

Middlebarns

Transportation

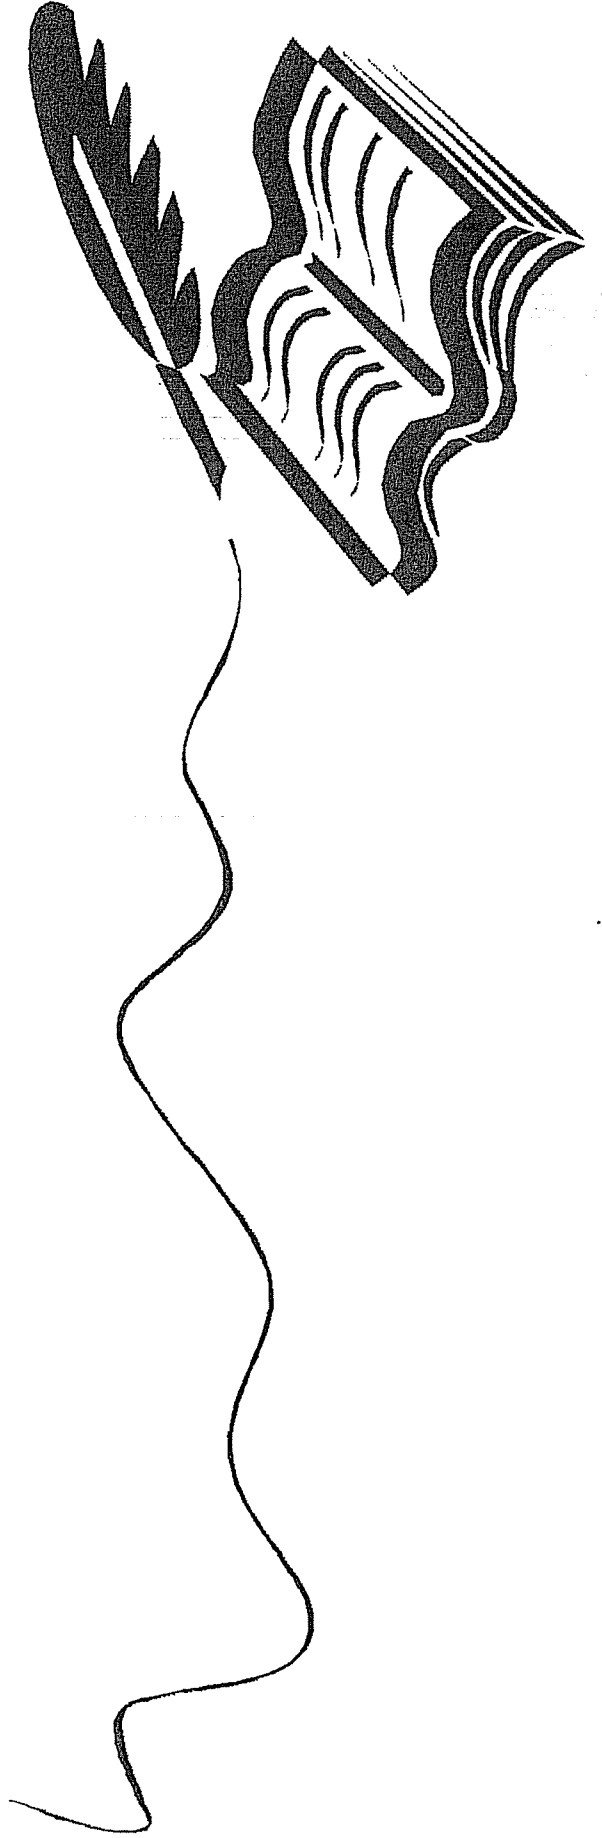



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**“FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0033

FACILITY: MIDDLEBURG TRANSPORTATION  
 3674 COUNTY ROAD 220  
 MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: APRIL 18, 2008

*[Signature]*  
 INSPECTOR'S SIGNATURE

*[Signature]*  
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	111	OK								



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0033

FACILITY: MIDDLEBURG TRANSPORTATION  
3674 COUNTY ROAD 220  
MIDDLEBURG, FLORIDA 32068


INSPECTION DATE: APRIL 18, 2008

INSPECTOR'S SIGNATURE: [Signature]  
 DATE: April 18, 2008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	2	OK								
92	3	OK								

School Traps

Games

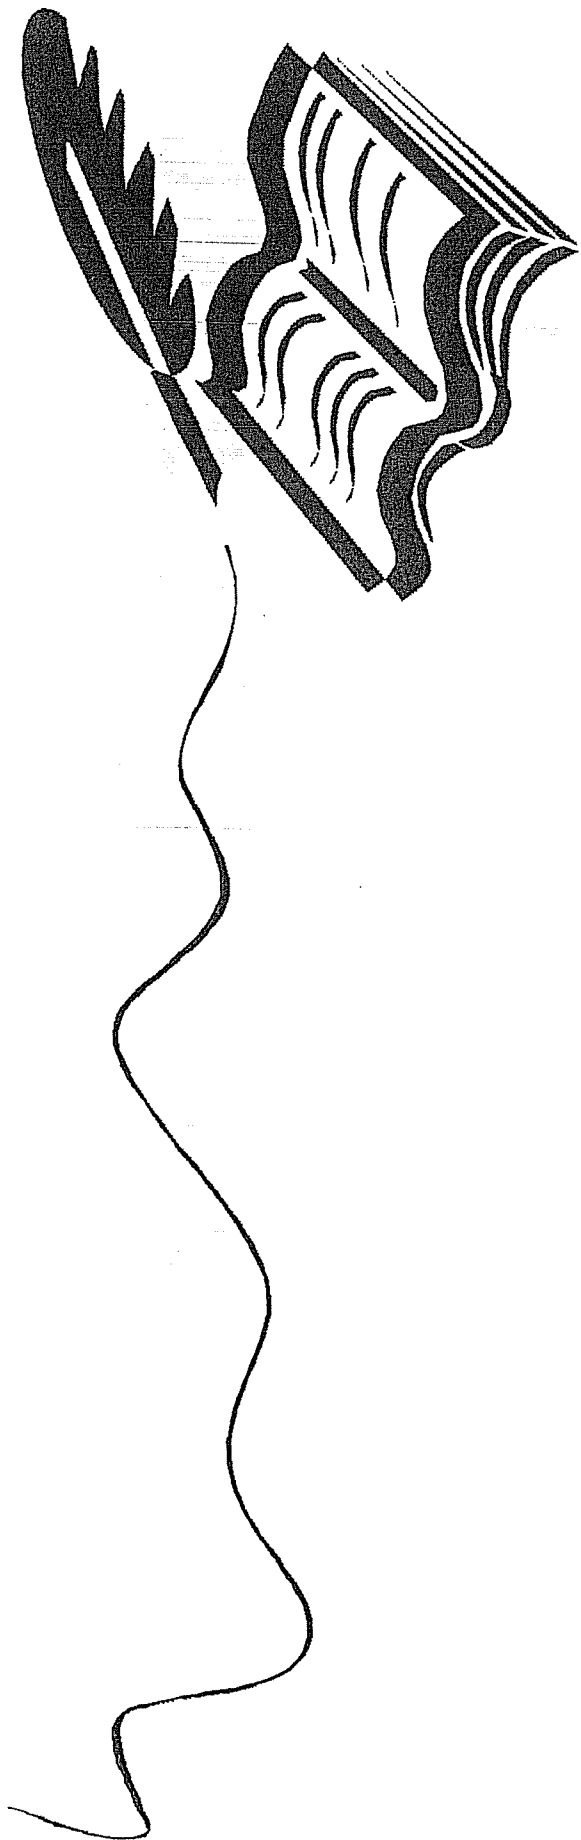



FISCAL YEAR 2007-2008

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
 COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY # 0030

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION  
 800 CENTER STREET  
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 25, 2008

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 3-25-2008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac: "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NO HANDICAPPED PARKING SIGN	X							FBC 11-4.6
1	200	EMERGENCY LIGHT OUT		X						FBC 1006.2
1	211	LIGHTS NOT PROTECTED		X						NFPA 70



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 “FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION” IN  
 COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0030

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION  
800 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 25, 2008


*Pat Swafford*  
 INSPECTOR'S SIGNATURE  
3-25-2008  
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS"	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	3	OK								
92	95	OK								



# Support Services

for  
Lat

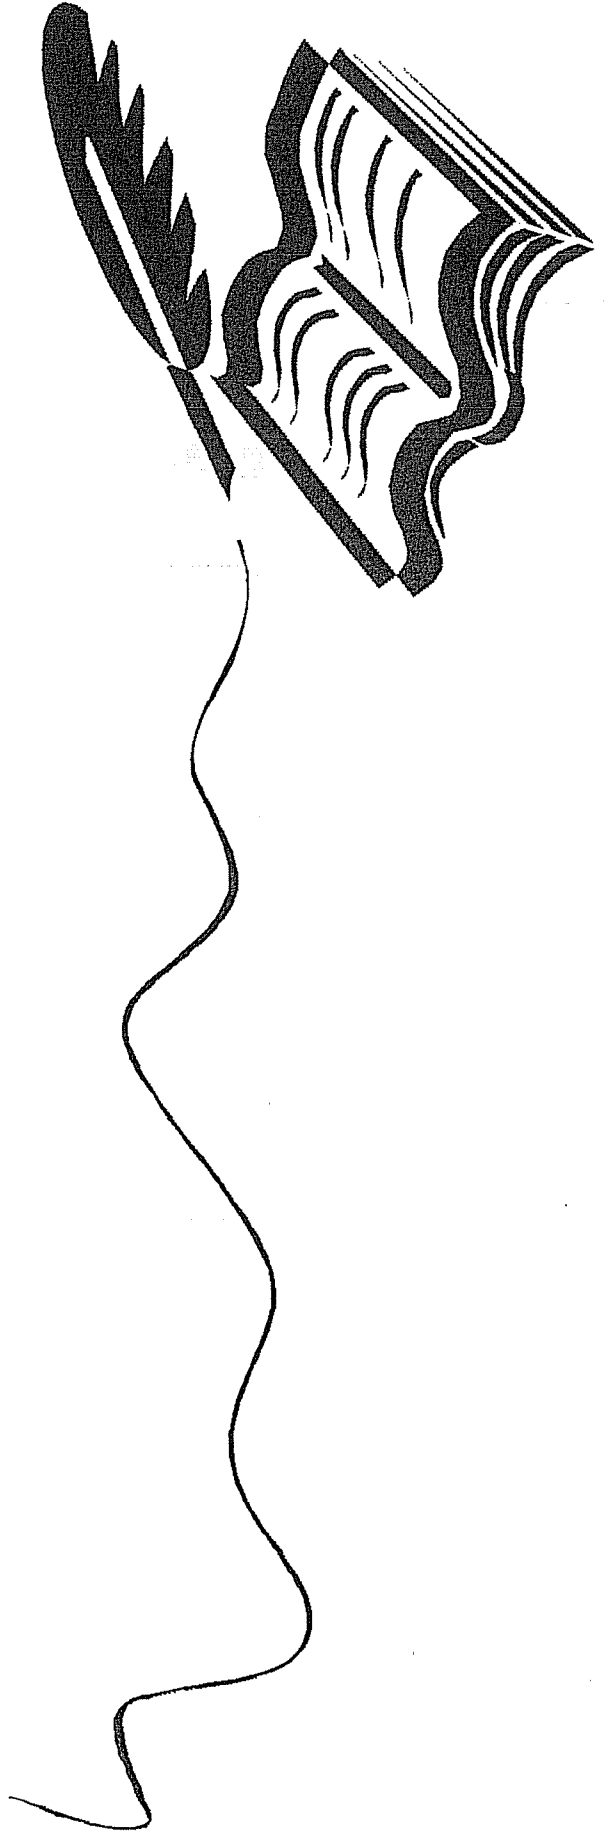



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0028

FACILITY: SUPPORT SERVICES AG LOT  
ROBERT STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: APRIL 18, 2008


*Tom Wheatland*  
 INSPECTOR'S SIGNATURE

Apr 18, 2008  
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								
95	2	NOT OCCUPIED								
95	3	NOT OCCUPIED								
95	4	NOT OCCUPIED								
95	5	NOT OCCUPIED								
95	6	NOT OCCUPIED								

**Support Services**

**Center**

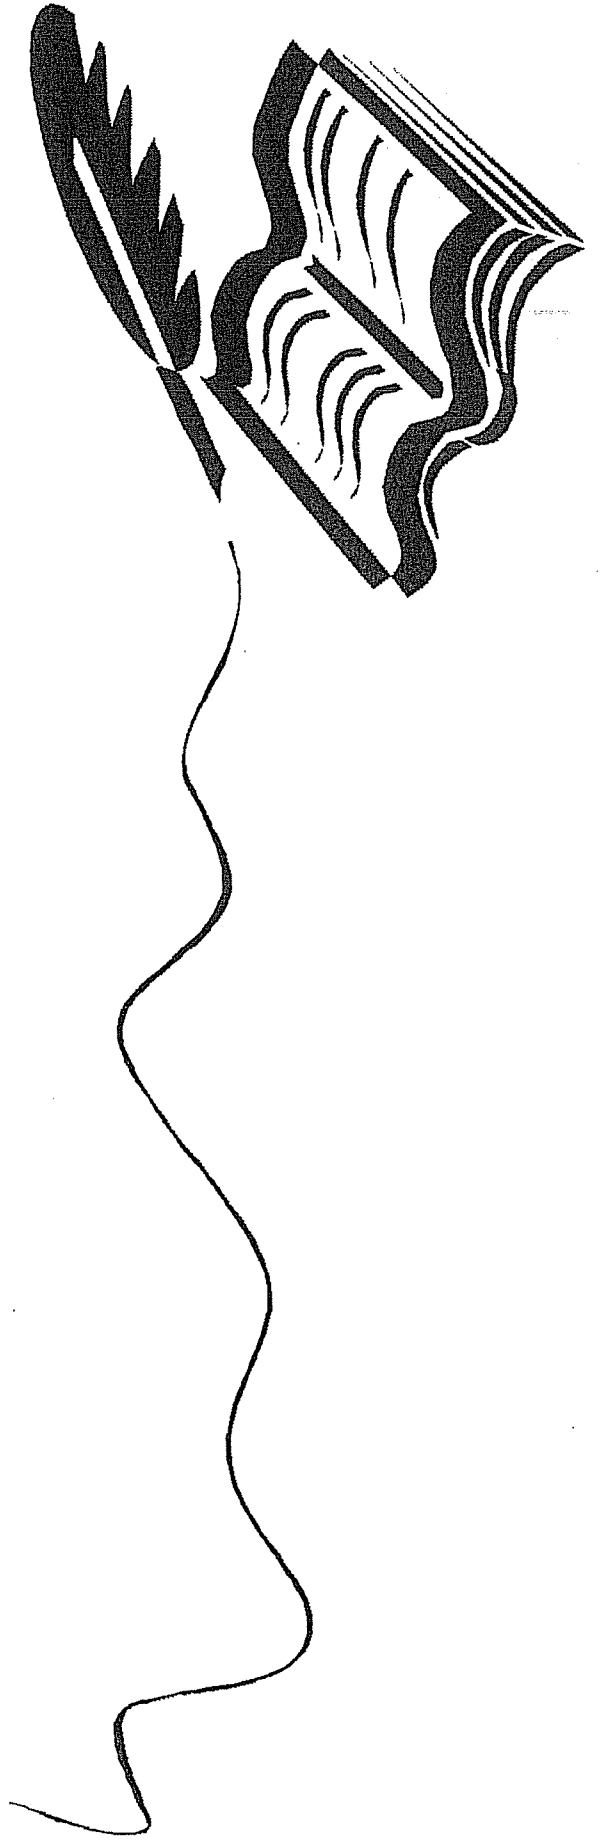



FISCAL YEAR 2007-2008

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN**  
**COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0029

FACILITY: SUPPORT SERVICES CENTER  
925 WEST CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 25, 2008

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 3-25-2008

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	908	NO HANDICAPPED PARKING SPACES	X							FBC 11-4.6
1	4C	NEED LIGHT IN HALL FOR EGRESS	X							FBC 1006.2
1	11A	EMERGENCY LIGHT OUT		X						FBC 1006.2
1	11A	NO EXIT LIGHT OVER BACK DOOR	X							FBC 1006.2
1	16A	EMERGENCY LIGHT OUT		X						FBC 1006.2
1	18	ADD EMERGENCY LIGHT	X							FBC 1006.2
1	20	EXPOSED WIRES ON LIGHT FIXTURE, BULB NOT PROTECTED	X							NFPA 70
1	18A	NO HANDICAPPED PARKING BY WAREHOUSE ENTRANCE	X							FBC 11-4.6
1	34A	STAIRS NEED NON-SLIP	X							FBC 1003.4
1	34A	RAILING NEEDS TO BE REPAIRED OR REPLACED	X							FBC 1003.E