


Administrative Office

Orange Park Annex

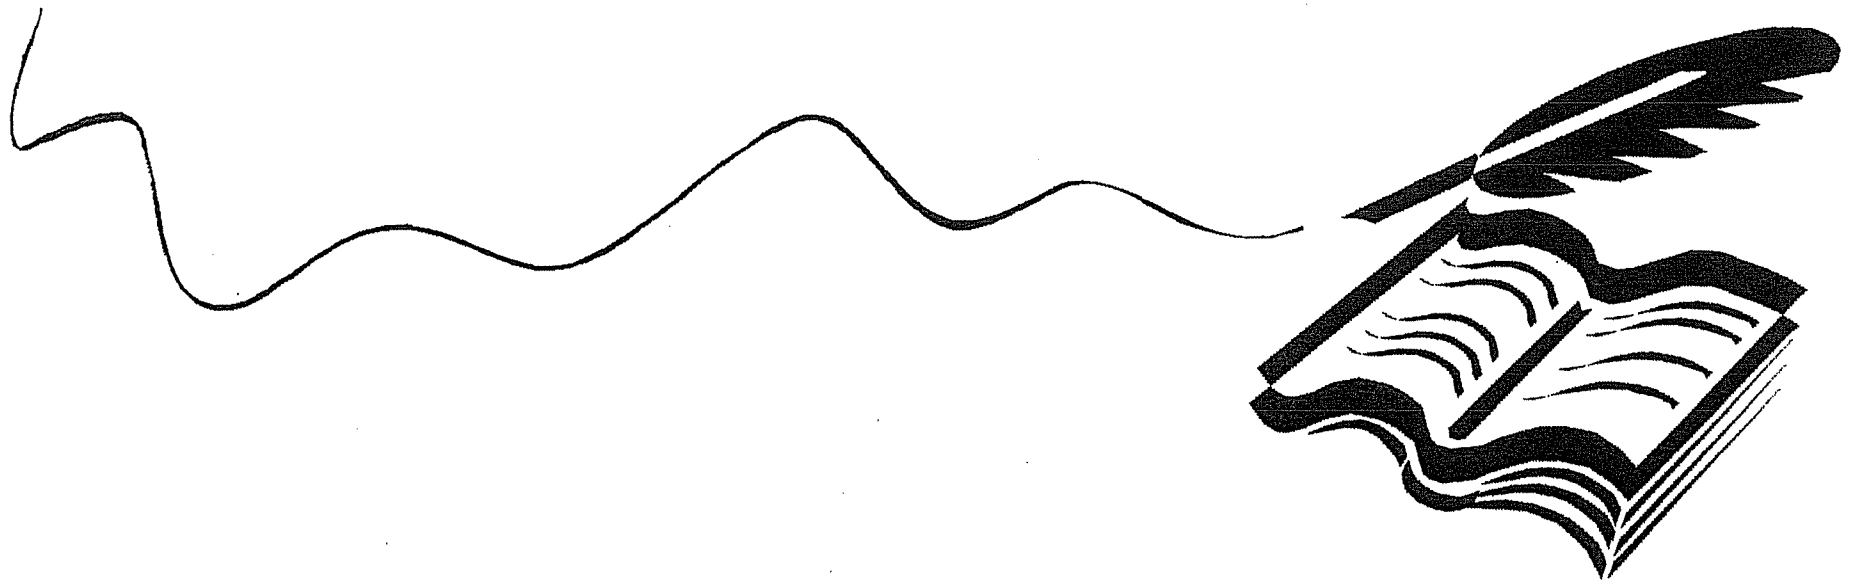

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX  
2300 KINGSLEY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 24, 2006

*Larry A. Brown*  
INSPECTOR'S SIGNATURE


10-24-06  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16A		NONE OF THE FIRE EXTINGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
16A	11	EMERGENCY LIGHT OUT	X							FBC 423.17.1
16A	3	EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17B		NONE OF THE FIRE EXTIGUISHERS HAVE BEEN SIGNED SINCE INSTALLATION JUNE 2006		X						
17B	4	FILING CABINET BLOCKING EXIT		X						
17B	5	FILING CABINET BLOCKING EXIT		X						
17B	7	EXIT BLOCKED		X						
17B	7	EVACUATION SHEET MISSING		X						FBC 423.14.2.4

Clay  
Superintendents  
Office

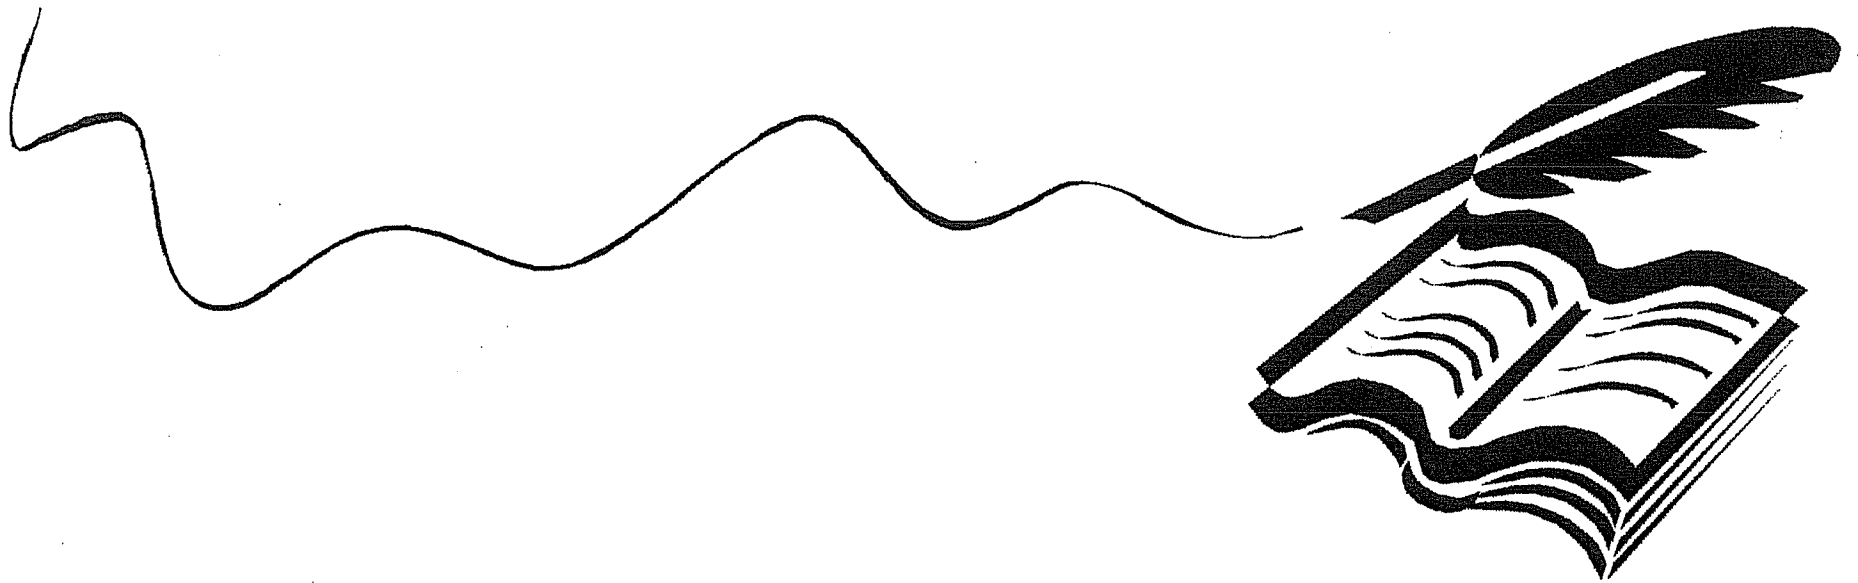

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0036

FACILITY: CLAY SUPERINTENDENT'S OFFICE  
900 WALNUT AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 6, 2007  
*Jed Sweetland*  
INSPECTOR'S SIGNATURE March 6, 2007  
DATE


ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3		EMERGENCY LIGHT OUT		X						FBC 423.17.1

**Food Services**

**Storage**

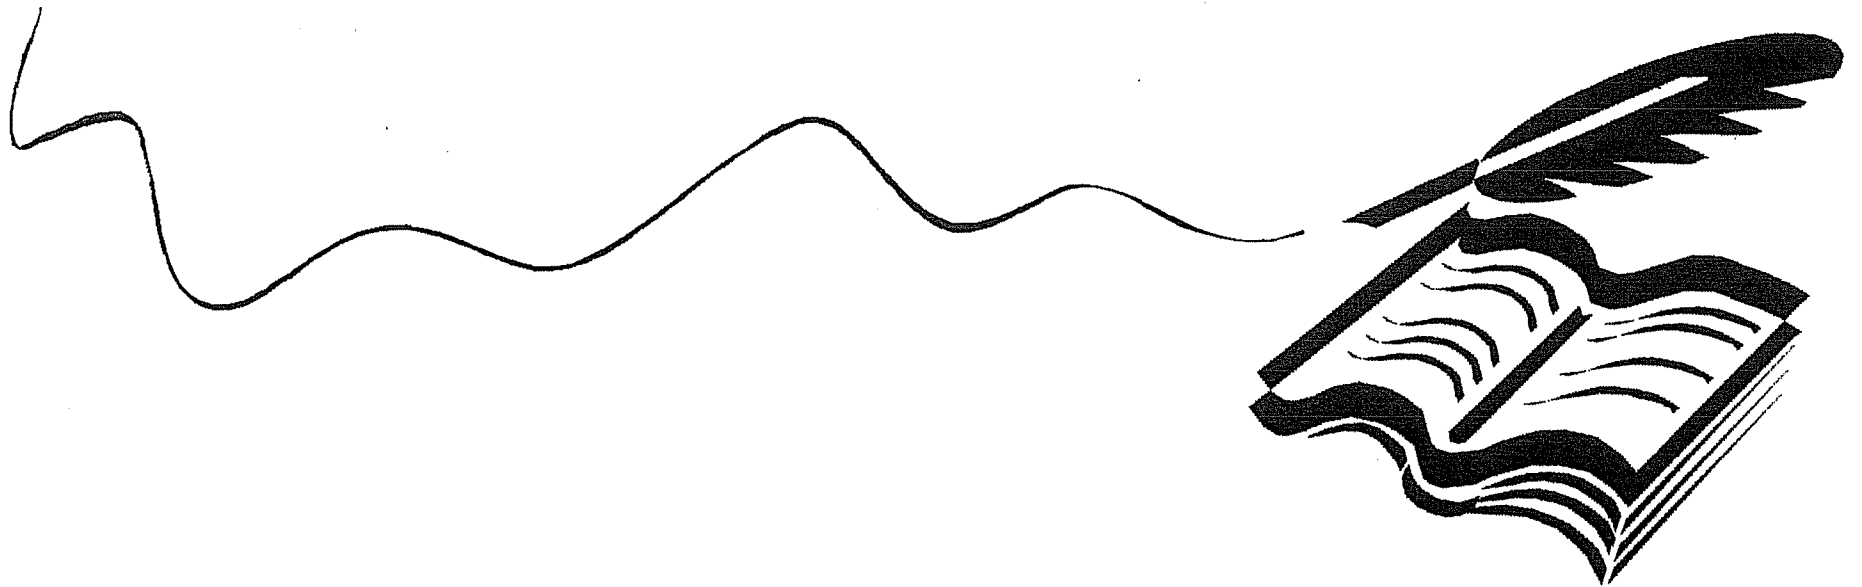

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0035

FACILITY: FOOD SERVICE STORAGE  
720 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 6, 2007


*Tom Swearingen*  
INSPECTOR'S SIGNATURE

March 6, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	OK								

Harris C. Long

Administration

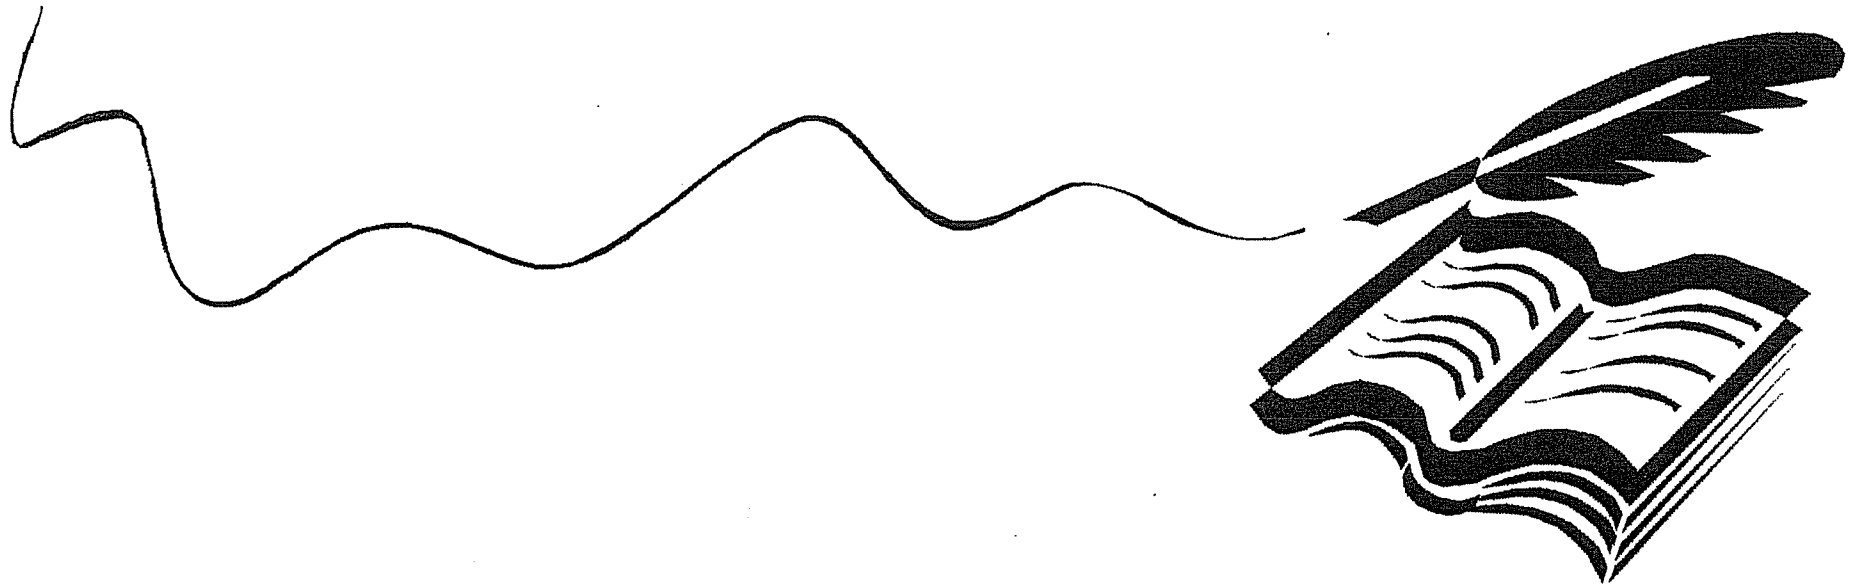

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0027

FACILITY: HARRIS C. LONG ADMINISTRATION  
23 SOUTH GREEN STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 7, 2007

*Tod Sweetland*  
INSPECTOR'S SIGNATURE

*March 7, 2007*  
DATE

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION


FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
1	300	EMERGENCY LIGHT IN HALL NOT WORKING		X						FBC 423.17.1
2		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
4	407B	EXIT SIGN MISSING		X						FBC 1006.3
4	413	EXIT SIGN MISSING COVER		X						NFPA 70
5		NO EMERGENCY LIGHT	X							FBC 423.17.1



*Keystone Heights*

*Transportation*

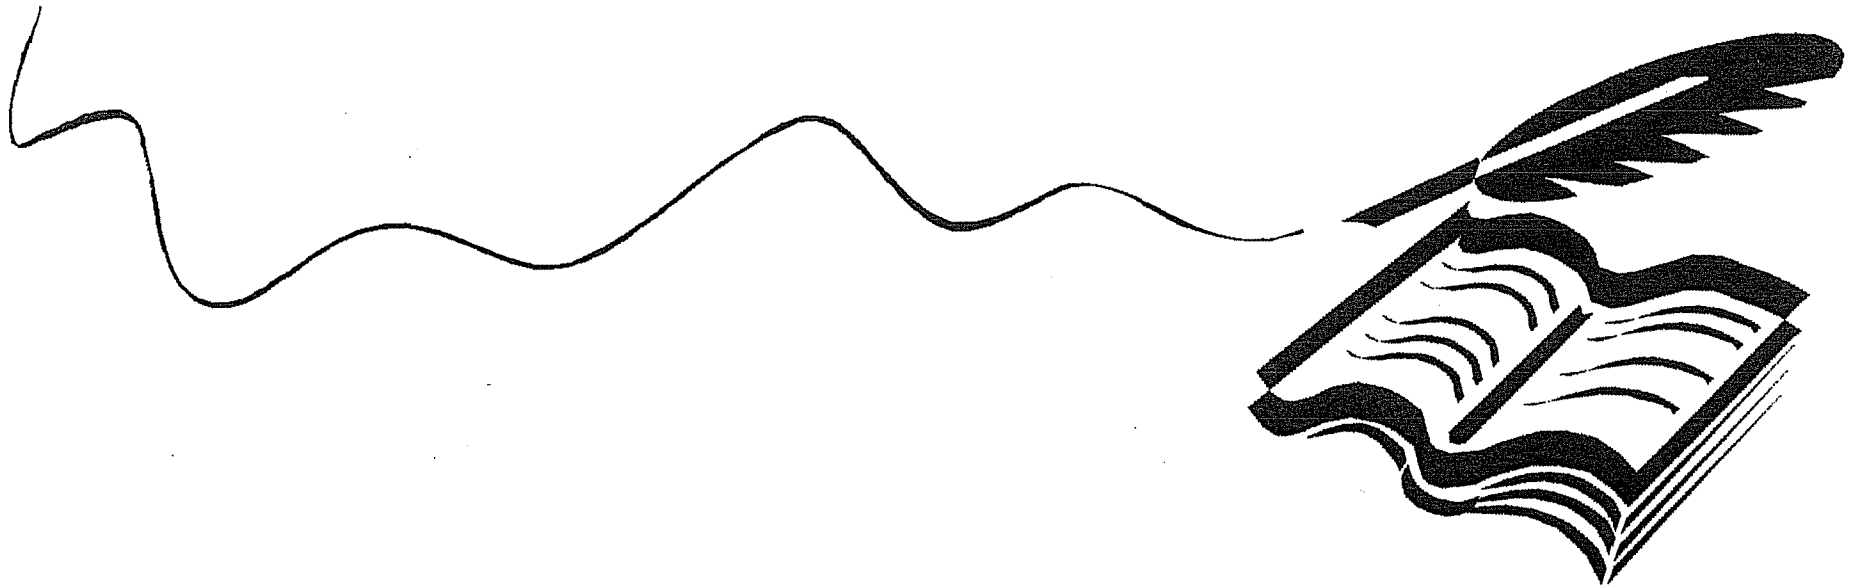

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0037

FACILITY: KEYSTONE HEIGHTS TRANSPORTATION  
6800 COUNTY ROAD 315  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: MARCH 7, 2007

*Tom So-called*  
INSPECTOR'S SIGNATURE DATE March 7, 2007


ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	OK								

Middleburg

Transportation

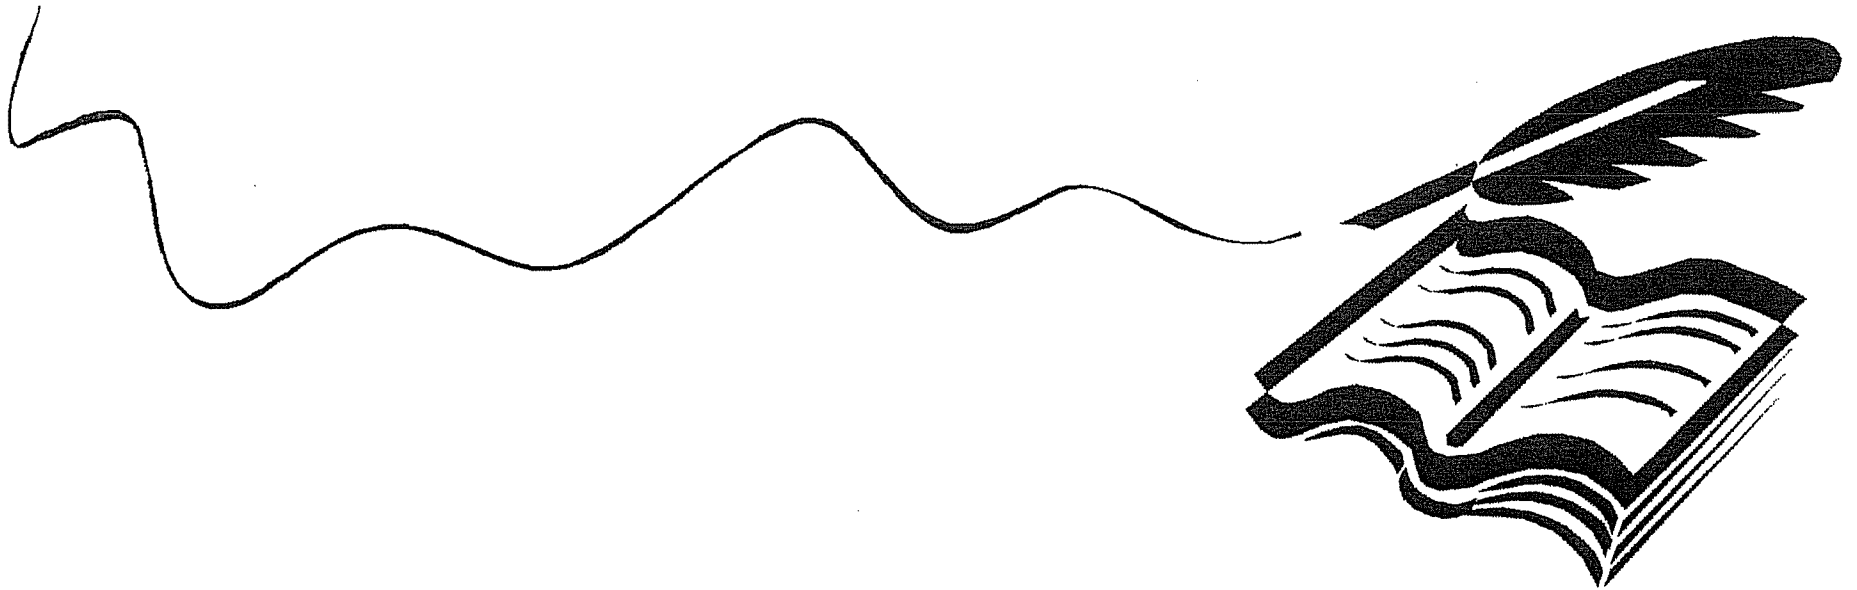

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0033

FACILITY: MIDDLEBURG TRANSPORTATION  
3674 COUNTY ROAD 220  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBUARY 27, 2007


*Ted Sweatt*  
INSPECTOR'S SIGNATURE

Feb 27, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	111	TWO GAS WEED EATERS STORED BY ELECTRICAL PANEL		X						NFPA 70
3		EMERGENCY LIGHT OUT AT STAIRS & UPSTAIRS		X						FBC 423.17.1

School Bus

Garage

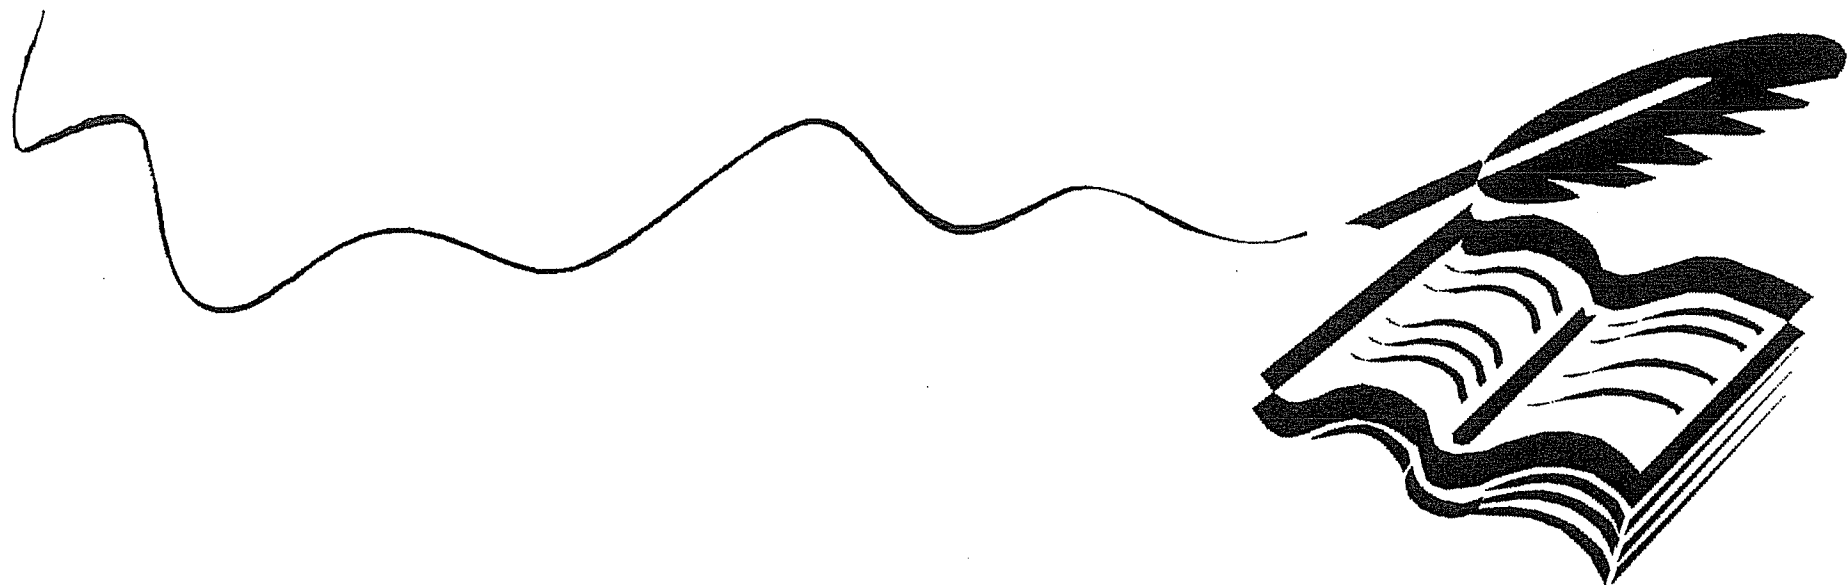

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0030

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION  
800 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 6, 2007


*Ted Swattans*  
INSPECTOR'S SIGNATURE

March 6, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	211	ADD EXIT LIGHT	X							FBC 1006.3

# Support Services

AG Lot

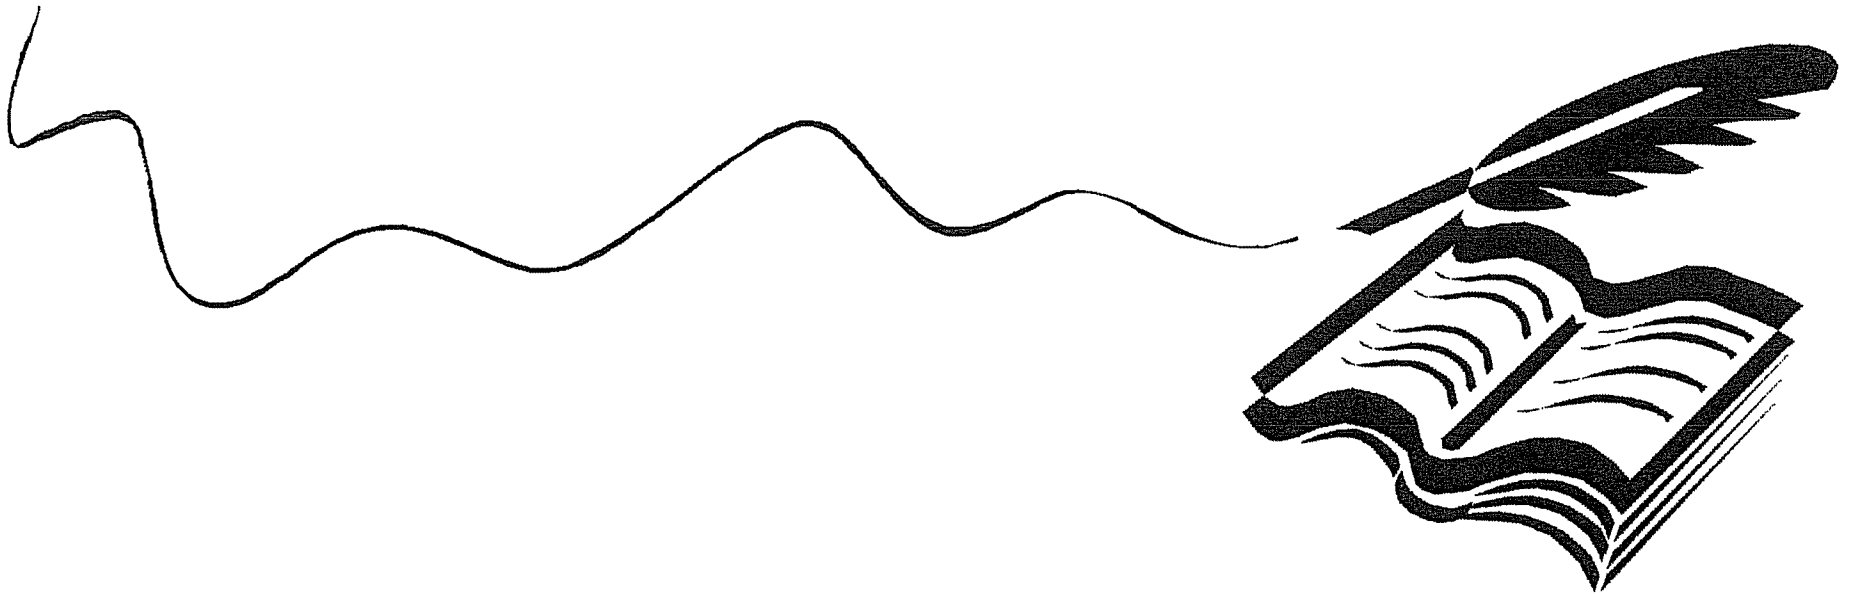

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0028

FACILITY: SUPPORT SERVICES AG LOT  
ROBERTS STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 6, 2007

*Ted Sweetland*  
INSPECTOR'S SIGNATURE DATE March 6, 2007

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION


FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								
95	2	NOT OCCUPIED								
95	3	NOT OCCUPIED								
95	4	NOT OCCUPIED								
95	5	NOT OCCUPIED								
95	6	NOT OCCUPIED								



Support Services

Center

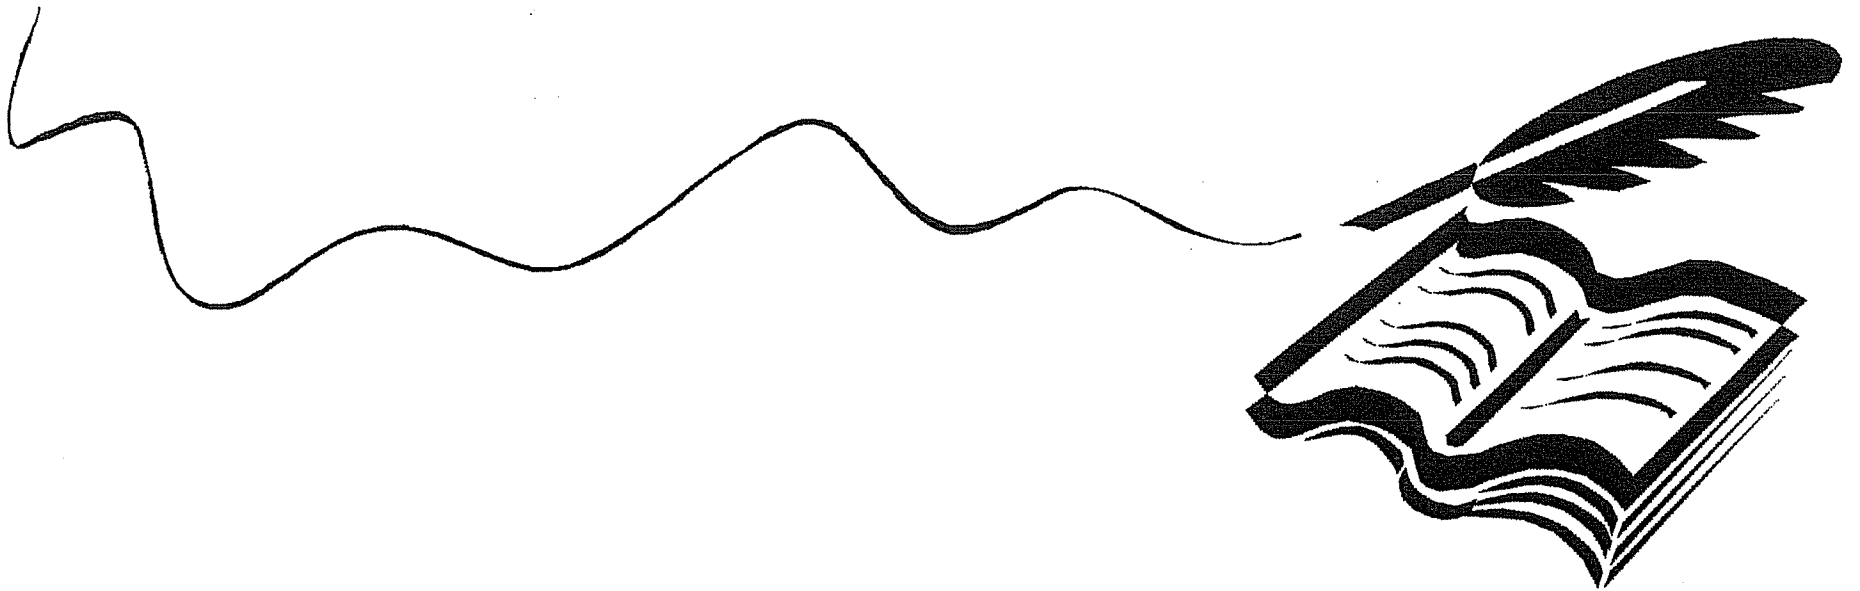

**FISCAL YEAR 2006-2007**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0029

FACILITY: SUPPORT SERVICES CENTER  
925 WEST CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: MARCH 1, 2007

*Tom Sweattone*  
INSPECTOR'S SIGNATURE

March 1, 2007  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	4D	EXIT LIGHT BULB HALF OUT		X						FBC 1006.3
1	2 <sup>ND</sup> FLR.	EMERGENCY EVACUATION SHEETS NEED TO BE UPDATED		X						FBC 423.14.2.4
10		NO EMERGENCY EVACUATION SHEETS		X						69A-58
10	208	EMERGENCY LIGHT OUT		X						FBC 423.17.1
9	908	EMERGENCY LIGHT OUT		X						FBC 423.17.1