



COVINGTON COUNTY ARTS / OFFICES

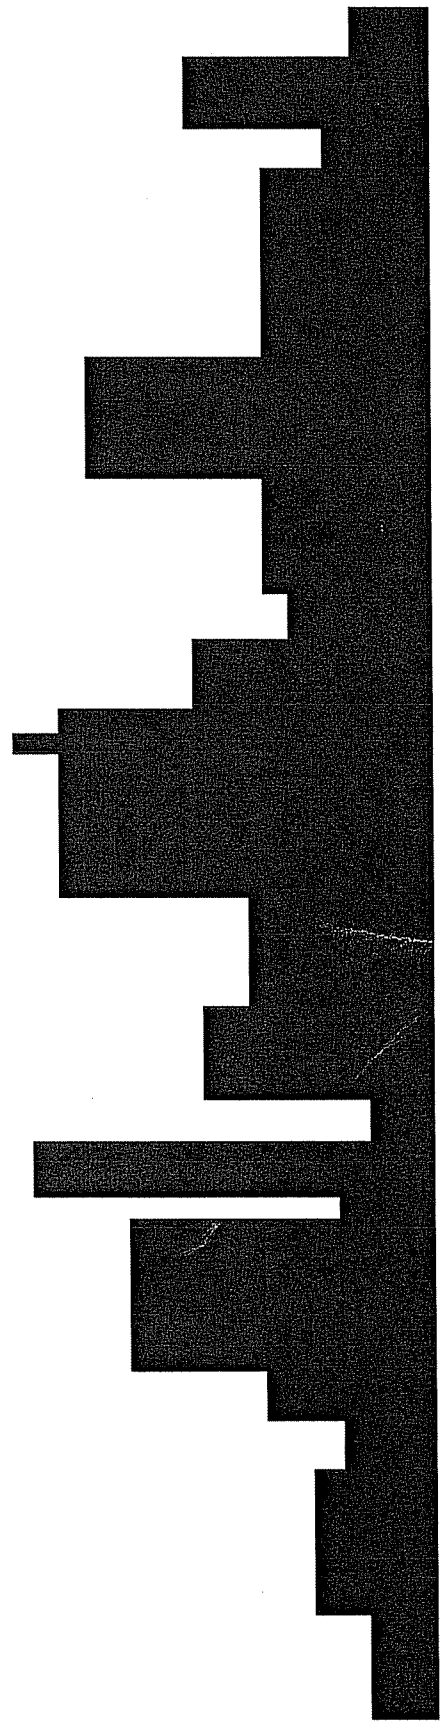

ADMINISTRATIVE OFFICE

ORANGE PARK ANNEX

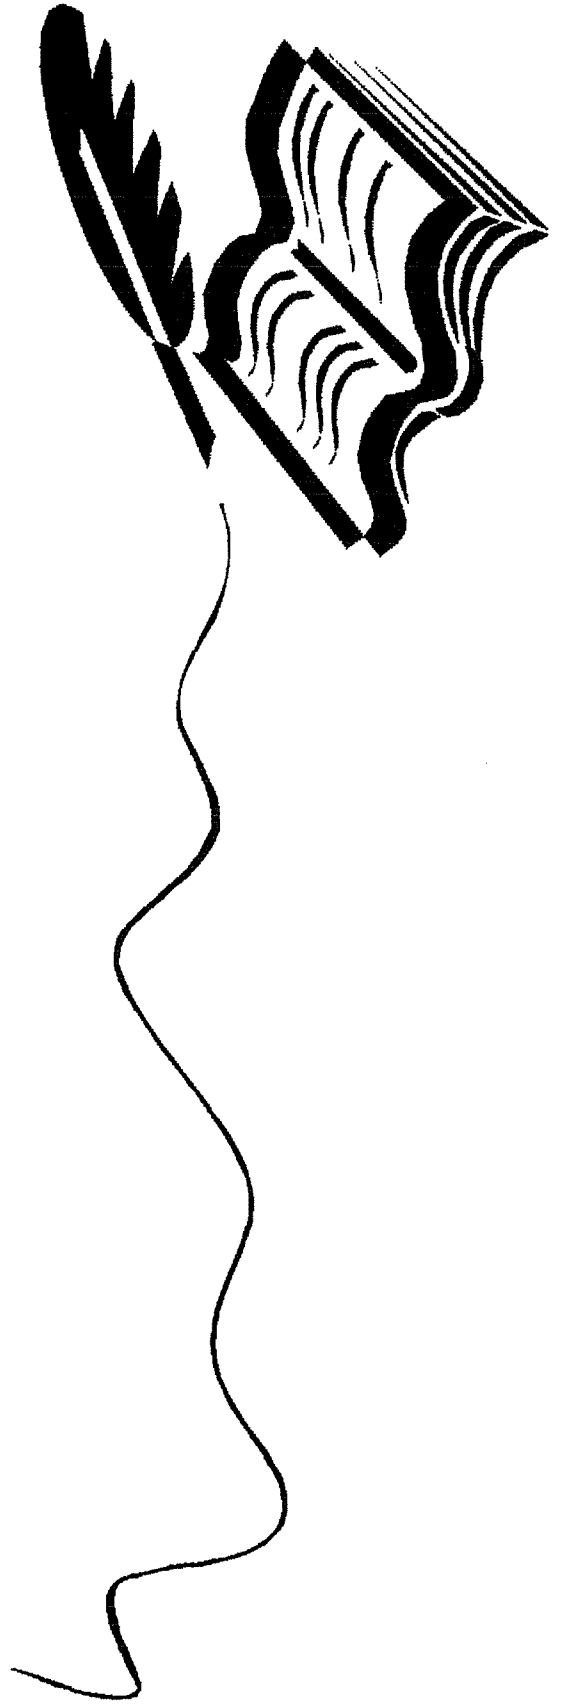

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX
 2300 KINGSLEY AVENUE
 ORANGE PARK, FLORIDA 32073


INSPECTION DATE: SEPTEMBER 23, 2005

[Signature] DATE: Sept 23, 2005
 INSPECTOR'S SIGNATURE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16	1C	EXIT LIGHT MISSING	X							FBC 1016.3.1
16	1C	NO EMERGENCY LIGHTS IN WHOLE BUILDING	X							FBC 423.17.1
16	5	EXTENSION CORD TO STRIP		X						NFPA 70 527.2
17		NO EMERGENCY LIGHTS IN WHOLE BUILDING	X							FBC 423.17.1
17	1	ROOF LEAK	X							
17	2	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EXTENSION CORD PLUGGED INTO EACH OTHER		X						NFPA-70 527.2
17	8	EXTENSION CORD PLUGGED INTO EACH OTHER		X						NFPA-70 527.2
17	8	SECOND EXIT BLOCKED BY FILING CABINET		X						NFPA 14.4.3.1

CLAY SUPERINTENDENTS

OFFICE

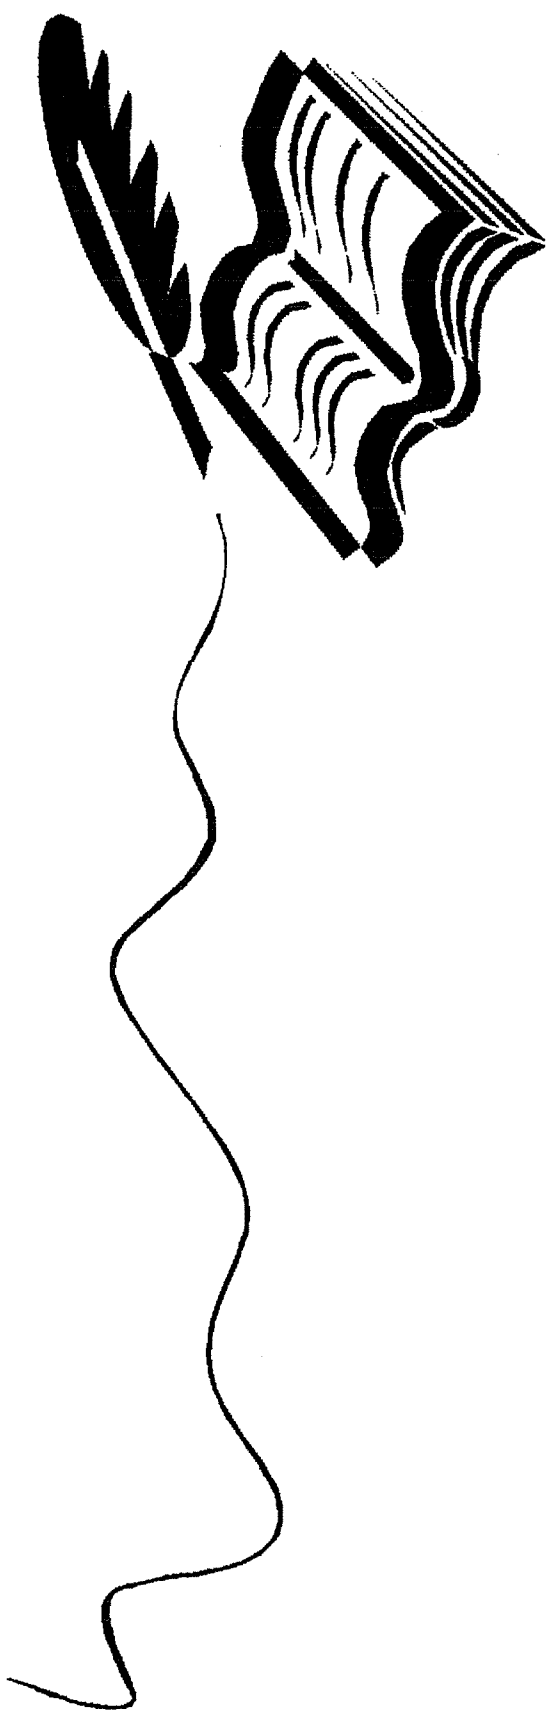

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0036

FACILITY: CLAY SUPERINTENDENT'S OFFICE
 900 WALNUT AVENUE
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006

[Signature]
 INSPECTOR'S SIGNATURE

Feb 24, 2006
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
2	10	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
2	20	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
2	14	DOOR CLOSURE BROKEN - PART OF SMOKE COMPARTMENT	X							
92	1	DOOR CLOSURE BROKEN	X							
3		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.17.1
3	7	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	15A	CEILING TILES MISSING		X						FBC 803.43
3	49	EXIT PARTIALLY BLOCKED BY COKE MACHINE/TRASH CAN		X						FBC 1003.6

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0036


FACILITY: FHS TEACHERS INSERVICE CENTER
2233 VILLAGE SQUARE PARKWAY
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: SEPTEMBER 23, 2005

Barry F. Burton
INSPECTOR'S SIGNATURE DATE 9.23.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
10	1019	OK								

FOOD SERVICES/STORAGE

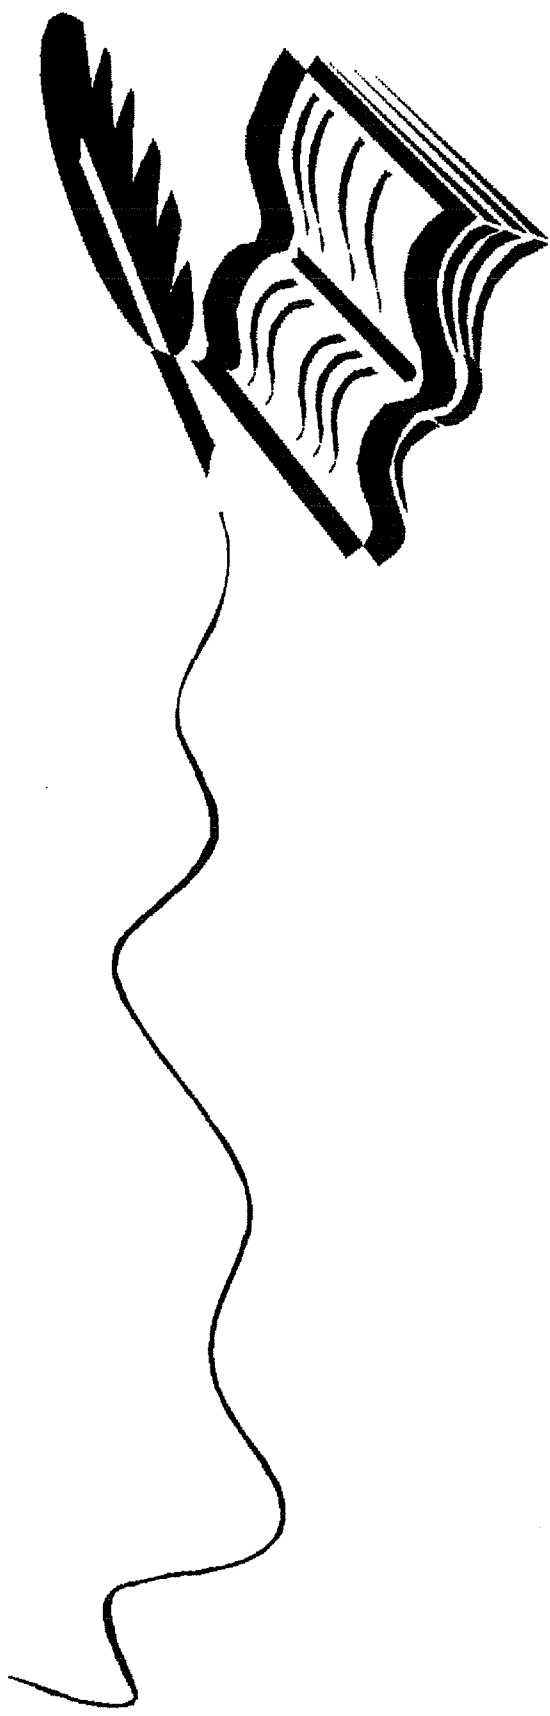

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0035


FACILITY: FOOD SERVICE STORAGE
720 CENTER STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 15, 2006

INSPECTOR'S SIGNATURE: [Signature] DATE: Feb 15, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	OK								

HARRIS C. LONG BUILDING

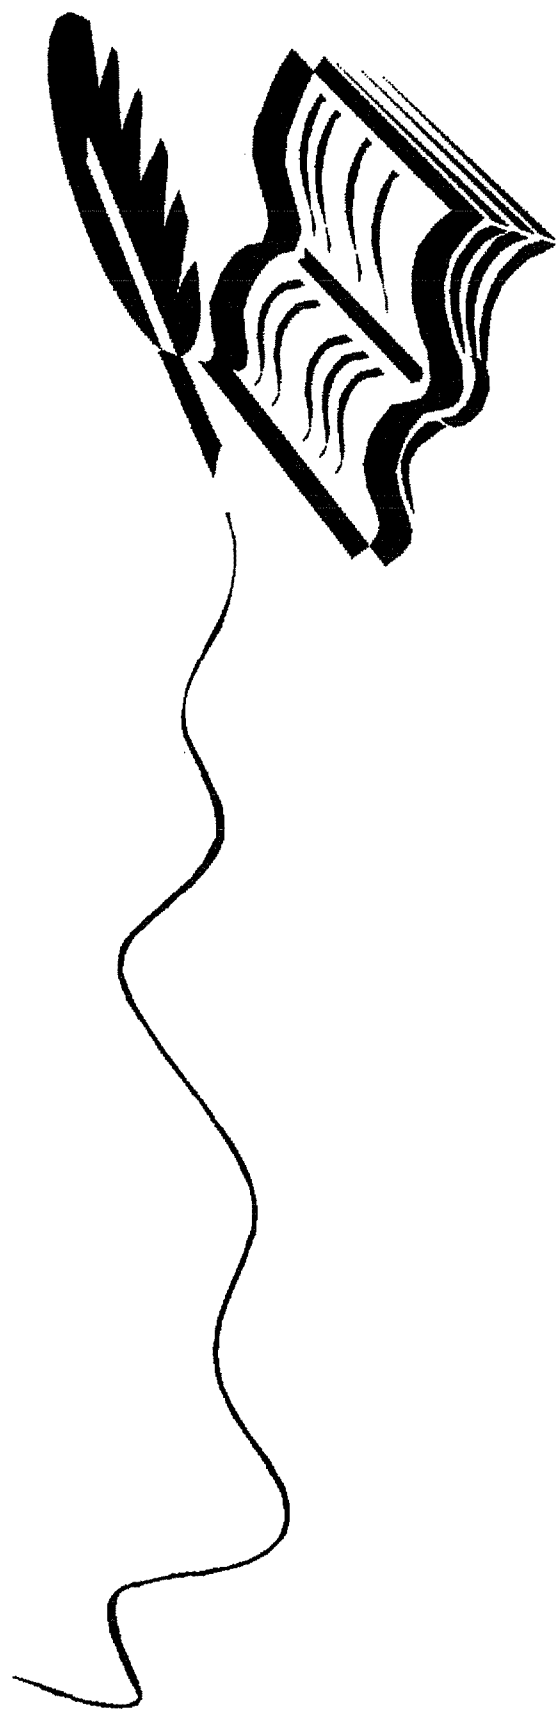

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0027

FACILITY: HARRIS C. LONG ADMINISTRATION
 23 SOUTH GREEN STREET
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006


John Swanton
 INSPECTOR'S SIGNATURE

Feb 24, 2006

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
2		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
3		NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
4	404A	OUTLET COVER MISSING		X						NFPA 70
4	407A	OUTLET COVER MISSING		X						NFPA 70
5		NO EMERGENCY LIGHTS	X							FBC 423.17.1

KEYSTONE HEIGHTS TRANSPORTATION

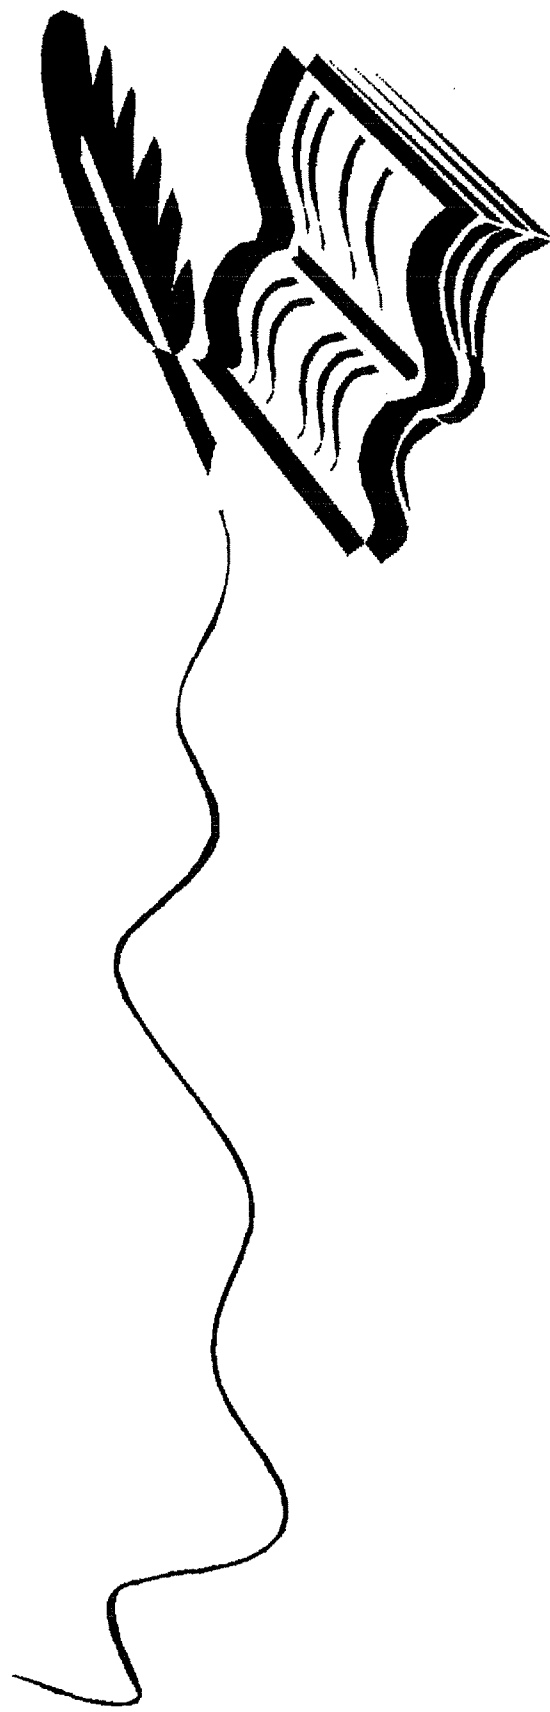

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0037

FACILITY: KEYSTONE HEIGHTS TRANSPORTATION
 6800 COUNTY ROAD 315
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: FEBRUARY 15, 2006


Tad Swettenham
 INSPECTOR'S SIGNATURE

Feb 15, 2006
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								

MIDDLEBURG

TRANSPORTATION

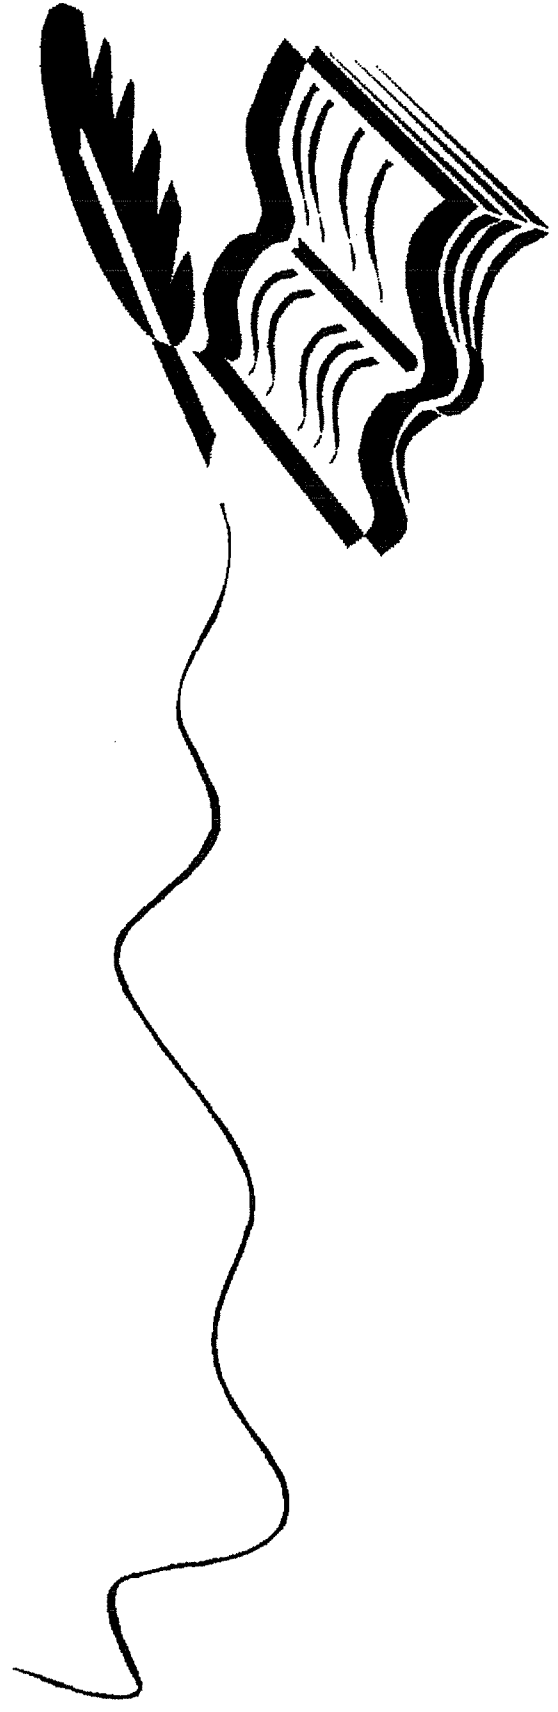

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0033

FACILITY: MIDDLEBURG TRANSPORTATION
 3674 COUNTY ROAD 2
 MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 22, 2006


Zed Swartz
 INSPECTOR'S SIGNATURE

Feb 22, 2006
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Schedule d for Correctio n	Rule
3	1	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36
3	5	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	8	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
3	8	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36
3	801	FIRE EXTINGUISHER NOT SIGNED SINCE MARCH 2005		X						69A-36
92	9	OK								

SCHOOL BUS

GARAGE

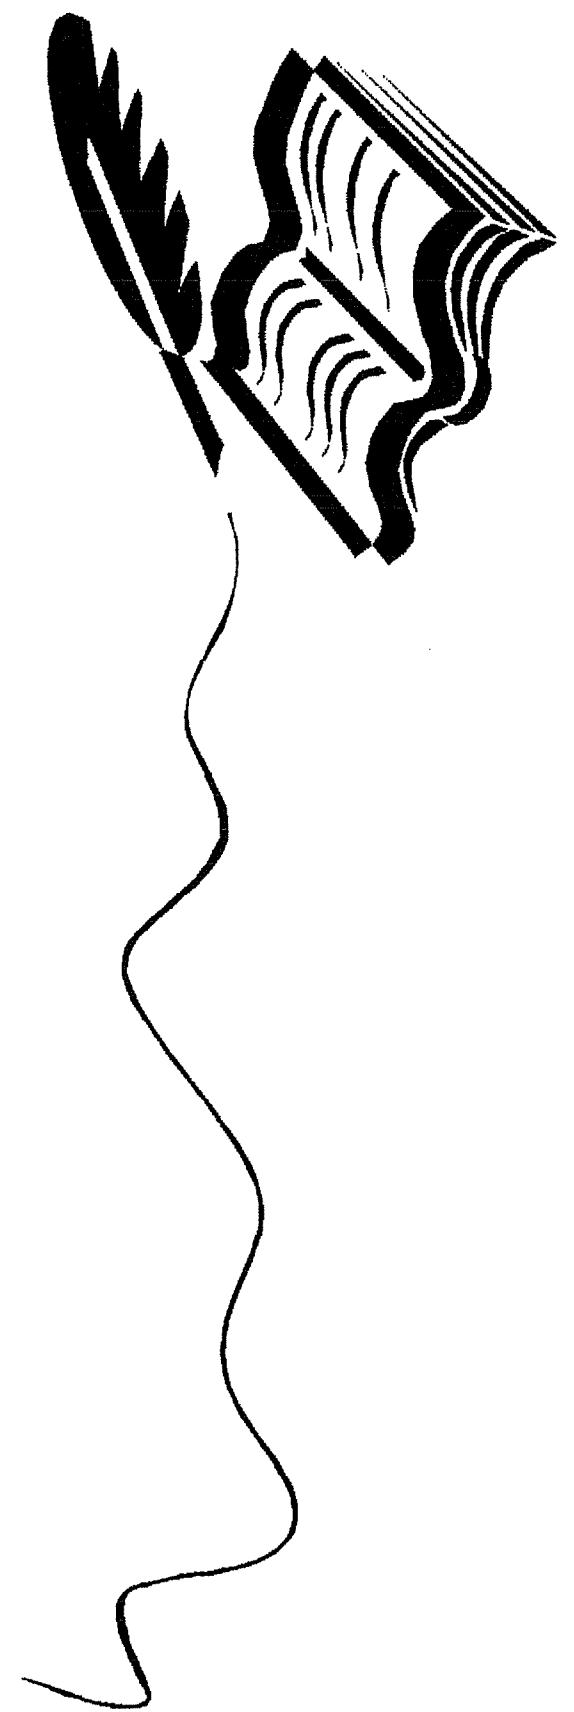

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY # 0030

FACILITY: SCHOOL BUS GARAGE - TRANSPORTATION
 800 CENTER STREET
 GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 24, 2006

Paul Swartley
 INSPECTOR'S SIGNATURE DATE Feb 24, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	8	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
1	11	FIRE EXTINGUISHER NOT SIGNED (5) GARAGE		X						69A-36
2		FIRE EXTINGUISHER NOT SIGNED		X						69A-36

SUPPORT SERVICES

AG LOT

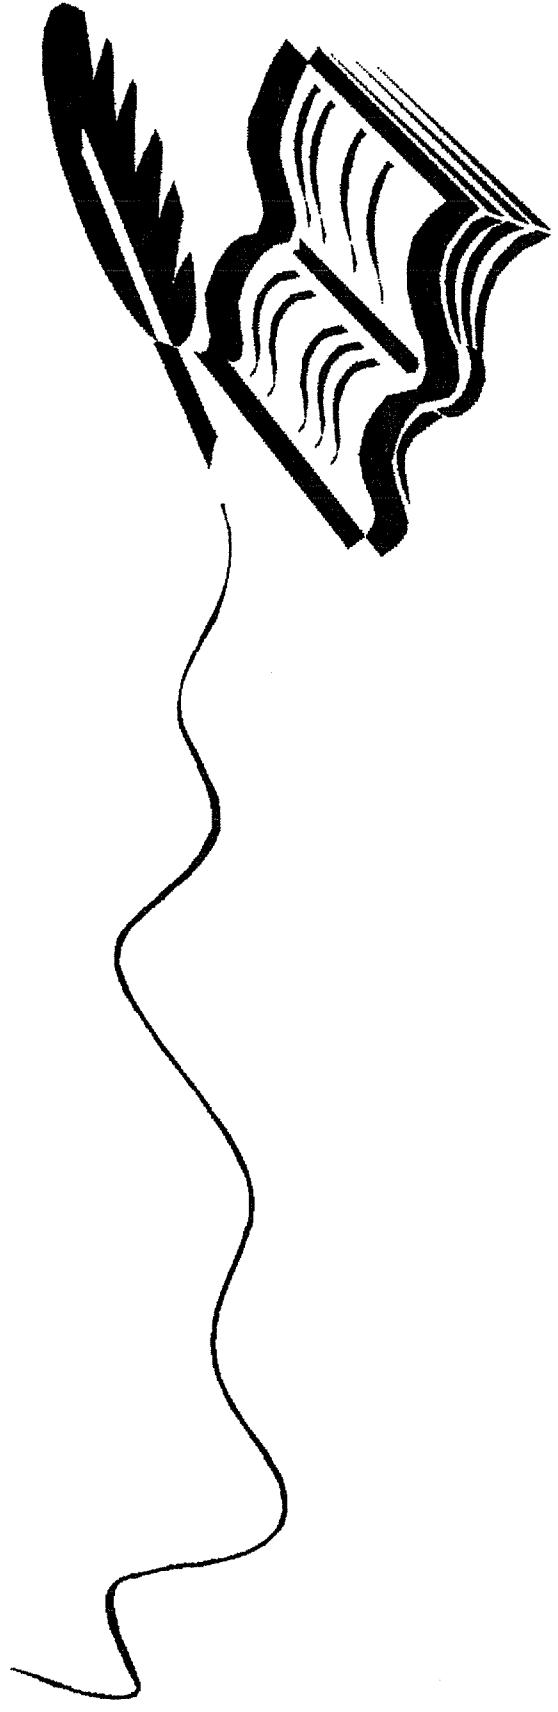

FISCAL YEAR 2005-2006



**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0028

FACILITY: SUPPORT SERVICES AG LOT
ROBERTS STREET
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 15, 2006

INSPECTOR'S SIGNATURE: *Tom Swartz* DATE: Feb 15, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								
95	2	STORAGE BUILDING NOT OCCUPIED								
95	3	STORAGE BUILDING NOT OCCUPIED								
95	4	STORAGE BUILDING NOT OCCUPIED								
95	5	STORAGE BUILDING NOT OCCUPIED								
95	6	STORAGE BUILDING NOT OCCUPIED								

SUPPORI SERVICES

CENTER

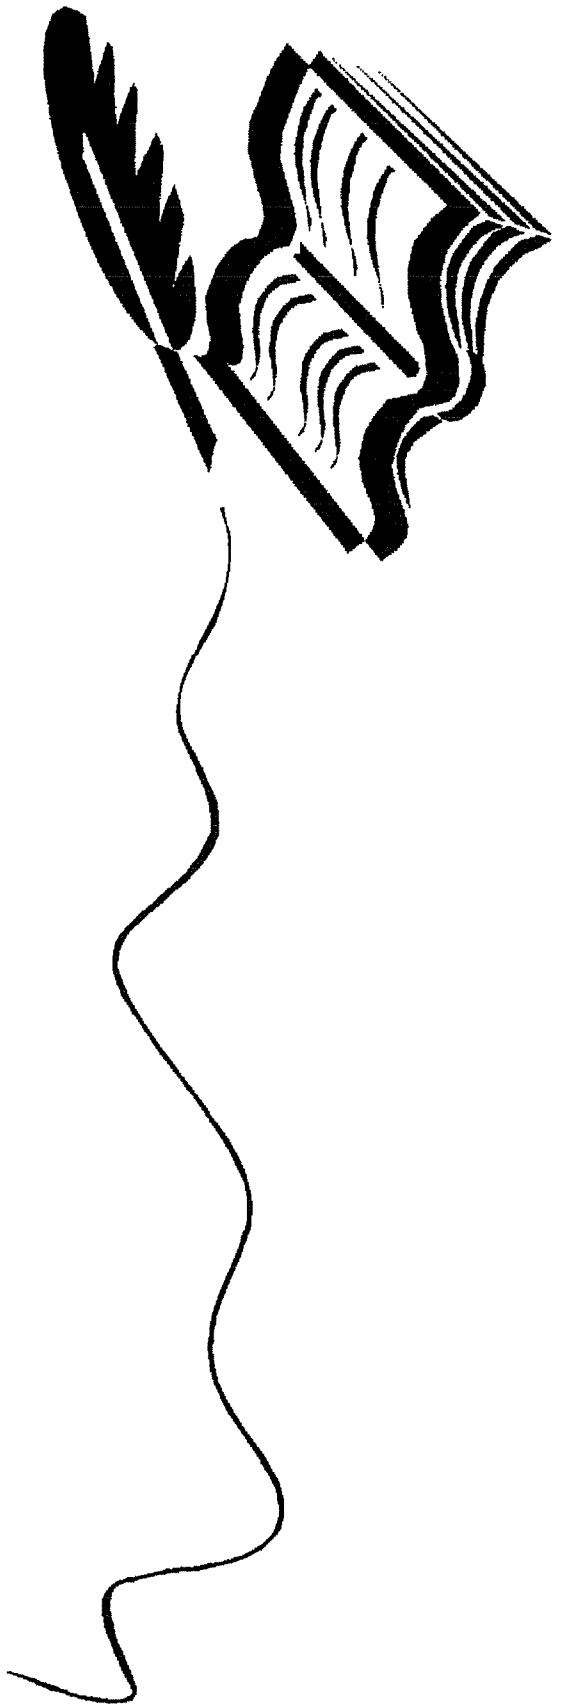

FISCAL YEAR 2005-2006



**COMPREHENSIVE SAFETY INSPECTION REPORT
STATE BOARD OF EDUCATION
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
"FIRE SAFETY, CASUALTY SAFETY & SANITATION
INSPECTION" IN COMPLIANCE WITH
F.S. 1013.12, 1013.20 & NFPA 101**

DISTRICT: CLAY FACILITY #: 0029

FACILITY: SUPPORT SERVICES CENTER
925 WEST CENTER STREET
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 24, 2006

[Signature]
INSPECTOR'S SIGNATURE

Feb 24, 2006
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
SS1		EMERGENCY EVACUATION SHEETS MISSING ON 2 ND FLOOR		X						
	EXTERIOR	NO DESIGNATED ADA PARKING								
1		HANDICAP PARKING SPACE NOT PROVIDED - NO SIGN	X							FBC 11-4.1
2		ROOF LEAK	X							
5		HANDICAP PARKING SPACE NOT PROVIDED - NO SIGN	X							FBC 11-4.1
5	14	FIRE EXTINGUISHER NOT SIGNED OFF		X						69A-36
9	911	EMERGENCY LIGHT NOT WORKING - STREET SIDE		X						FBC 423.17.1
11	2 nd Fl.	NO EMERGENCY LIGHTS	X							FBC 423.17.1
11		NO EVACUATION SHEETS		X						FBC 423.14.2.4
11	102A	NO SAFETY GLASS AT STAIR/DOOR AREA	X							FBC 2406.3
11	107A	NO EMERGENCY EVACUATION SHEETS		X						FBC 423.14.2.4
11		NO EMERGENCY LIGHTS	X							FBC 423.17.1
11		ADA RAMP DOES NOT MEET ADA RAILING	X							FBC 11-4.1