


CHARLES E. BENNETT

ELEMENTARY SCHOOL

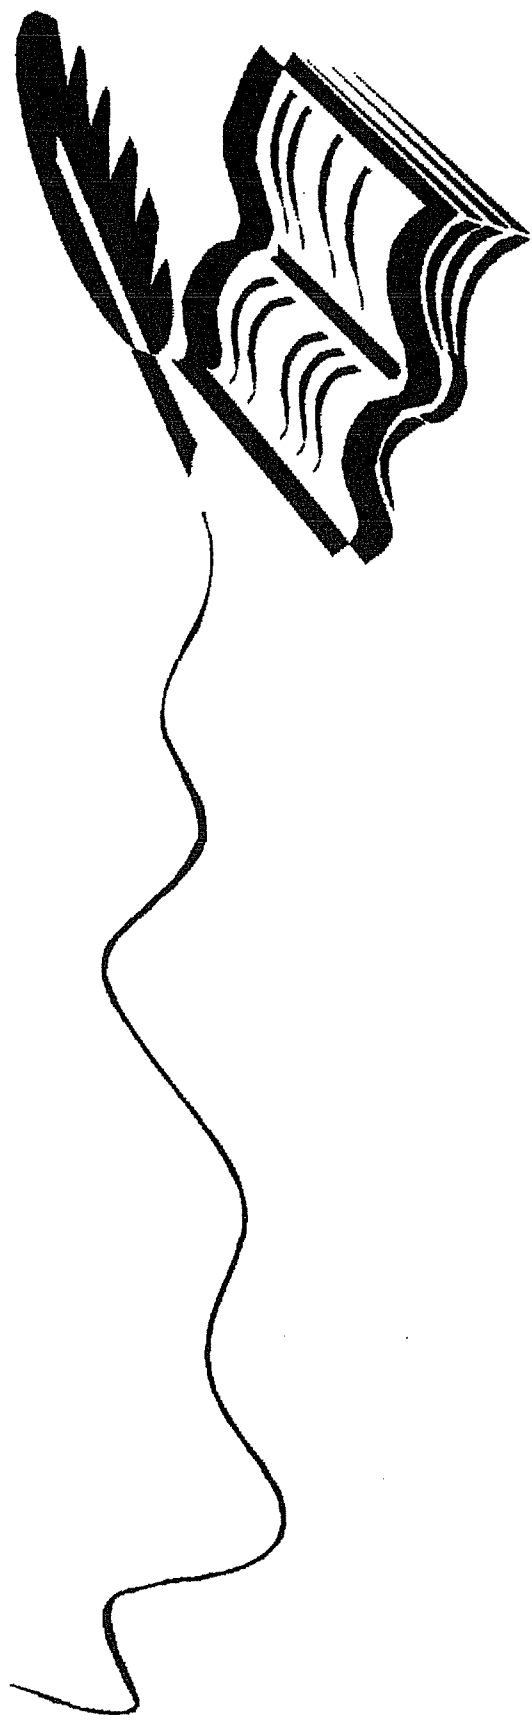

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0002


FACILITY: CHARLES E. BENNETT ELEMENTRY
1 S. OAKRIDGE AVENUE
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 4, 2005

INSPECTOR'S SIGNATURE: [Signature] DATE: Oct 4, 2005


Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
BLD 1	5	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
2	5	MISSING "K" TYPE EXTINGUISHER WITHIN 15 FT		X						NFPA
3	10	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	9a	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
	9b	EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
		BULB OUT EMERGENCY LIGHT		X						FBC 423.17.1
	13	BULB OUT EMERGENCY LIGHT		X						FBC 423.17.1
5	21	ELECTRICAL BOX COVER MISSING HALL OVER DOOR (LB)	X							NFPA-70 314.1
8	29	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
10	1b	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	1	OCCUPANCY LOAD SIGN MISSING		X						FBC 1004.3
	1	BULB OUT EMERGENCY LIGHT		X						FBC 423.17.1

CLAY HILL ELEMENTARY SCHOOL

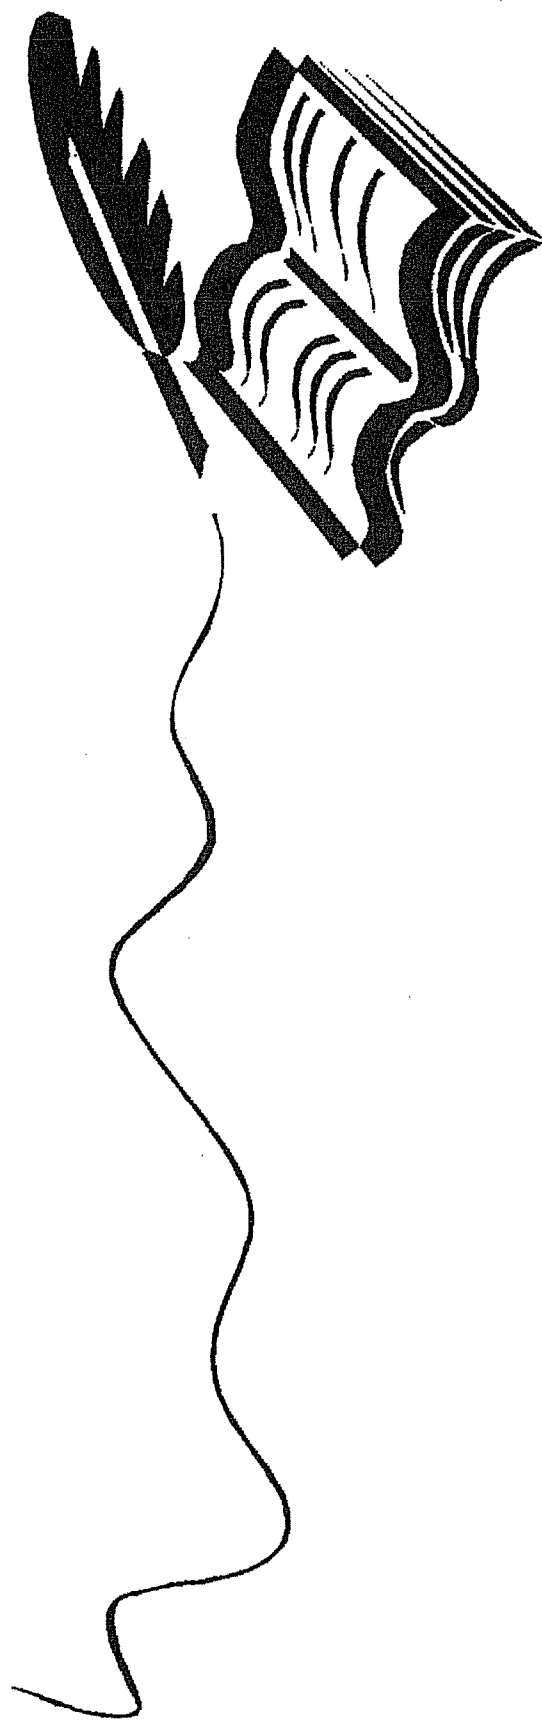

DOCTORS INLET

ELEMENTARY SCHOOL

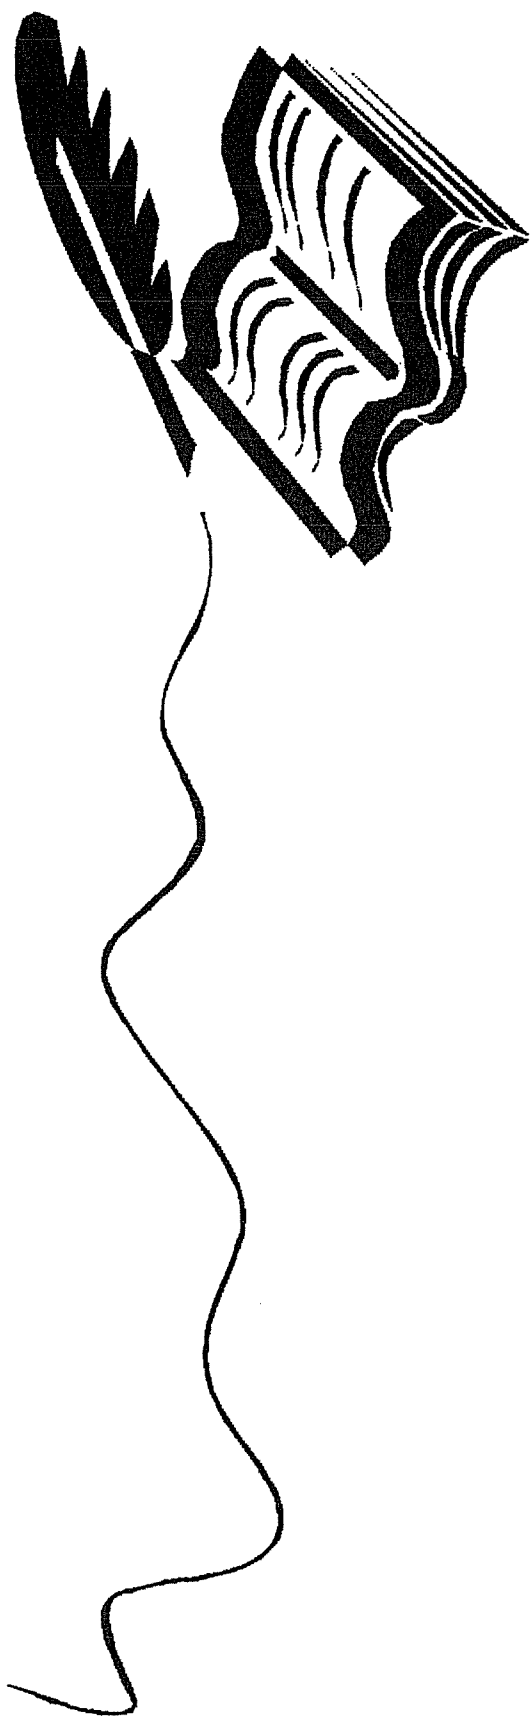

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: OCTOBER 11, 2005

INSPECTOR'S SIGNATURE: *Zed Swartz*
DATE: Oct 11, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	108	Covers missing on electrical boxes	X							NFPA 70 314.1
4	122	Emergency light out		X						FBC 423.17.1
7		Building numbers not on exterior		X						FBC 423.14.2.3
8	815	J-box on air handler open	X							NFPA 70 314.1
8	815	Door sticking	X							NFPA 14.5.2
9		Building numbers not on exterior			X					FBC 423.14.2.3


FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION


ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0008
 FACILITY: DOCTORS INLET ELEMENTARY
2634 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068
 INSPECTION DATE: OCTOBER 11, 2005

 INSPECTOR'S SIGNATURE DATE Oct 11, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	875 A & B	Emergency light inoperable		X						FBC 423.17.1
92	875 A & B	Fire exiting not checked monthly		X						NFPA 10, 4-2.1

FLEMING ISLAND

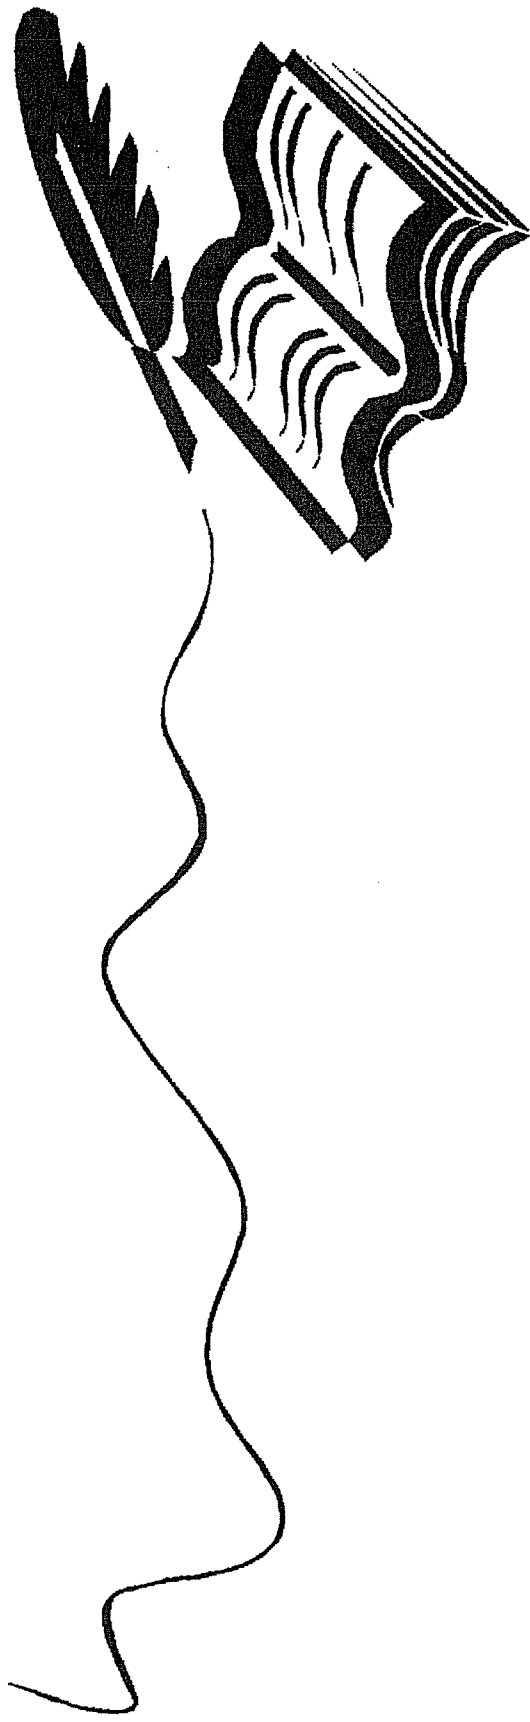ELEMENTARY SCHOOL



FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 13, 2005

[Handwritten Signature]

INSPECTOR'S SIGNATURE DATE Oct 13, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	114	NO FIRE EXTINGUISHER BY RANGE		X						69A-36
	120	EXCESSIVE STORAGE IN ELECTRICAL ROOM		X						NFPA-70 110.26
2		EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
4		NO EXTERIOR BUILDING NUMBERS		X						NFPA-1 10.13
7		NO EXTERIOR BUILDING NUMBERS		X						NFPA-1 10.13
	712	NO FIRE EXTINGUISHER BY RANGE		X						69A-36
	721	NO FIRE EXTINGUISHER BY RANGE		X						69A-36

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 13, 2005

[Signature]
 INSPECTOR'S SIGNATURE DATE Oct 13, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint "M"	Oper: "O"	Fac: "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	608	FIRE EXTINGUISHER NOT SIGNED		X						NFPA-1 7.6.4.1
	805	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	808	BATHROOM LIGHT OUT		X						
	809	FIRE EXTINGUISHER MISSING		X						
	810	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	841	FIRE EXTINGUISHER NOT SIGNED		X						NFPA-1 7-6.4.1
	842	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	844	FIRE EXTINGUISHER NOT SIGNED		X						NFPA-1 7-6.4.1
	850	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	852	BATHROOM LIGHT OUT		X						
	860	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	860	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	902	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
	904	FIRE EXTINGUISHER NOT SIGNED		X						69A-36

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY
4425 LAKE SHORE DRIVE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: OCTOBER 13, 2005

INSPECTOR'S SIGNATURE: [Signature] DATE: Oct 13, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	904	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	905	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
	907	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
	909	FIRE EXTINGUISHER NOT SIGNED		X						69A-36
	910	FIRE EXTINGUISHER NOT SIGNED		X						69A-36