


GROVE PARK

ELEMENTARY SCHOOL

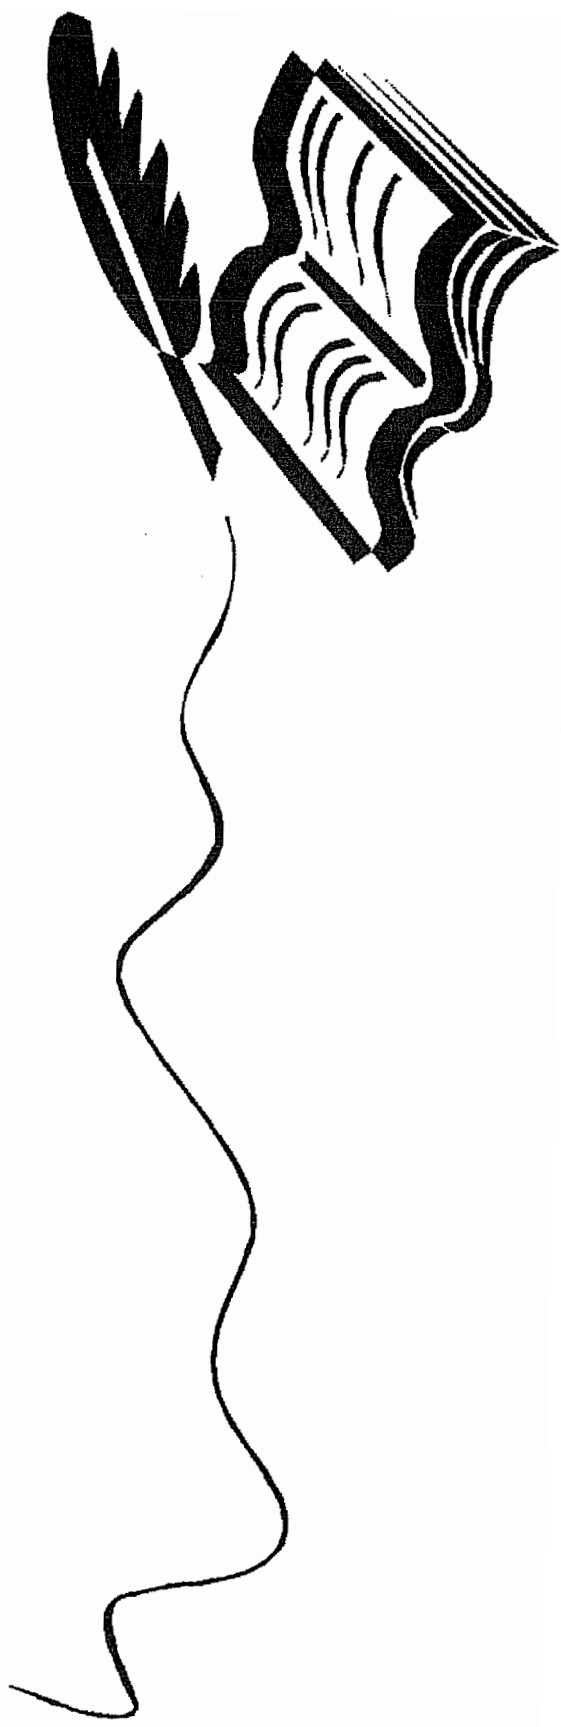

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY
1643 MILLER STREET
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 18, 2005


 INSPECTOR'S SIGNATURE
Oct 18, 2005
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost.	No. of times Def. Cited	Scheduled for Correction	Rule
1	110b	EMERGENCY LIGHT OUT		X						FBC 423.17.1
6	607	TV STAND NEEDS PADDING		X						FBC 423.14.3
	607	TV STAND NEEDS PADDING		X						FBC 423.14.3
	611	EMERGENCY LIGHT OUT		X						FBC 423.17.1
7	707	TV STAND NEEDS PADDING		X						FBC 423.14.3
8	11	TRIP HAZARD @ DOOR THRESHOLD	X							FBC 11-4.13.8
	144	TRIP HAZARD @ DOOR THRESHOLD	X							FBC 11-4.13.8

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY
 1643 MILLER STREET
 ORANGE PARK, FLORIDA 32073


INSPECTION DATE: OCTOBER 18, 2005

Leslie Sweet
 INSPECTOR'S SIGNATURE DATE Oct 18, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	71	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

KEYSTONE HEIGHTS

ELEMENTARY SCHOOL

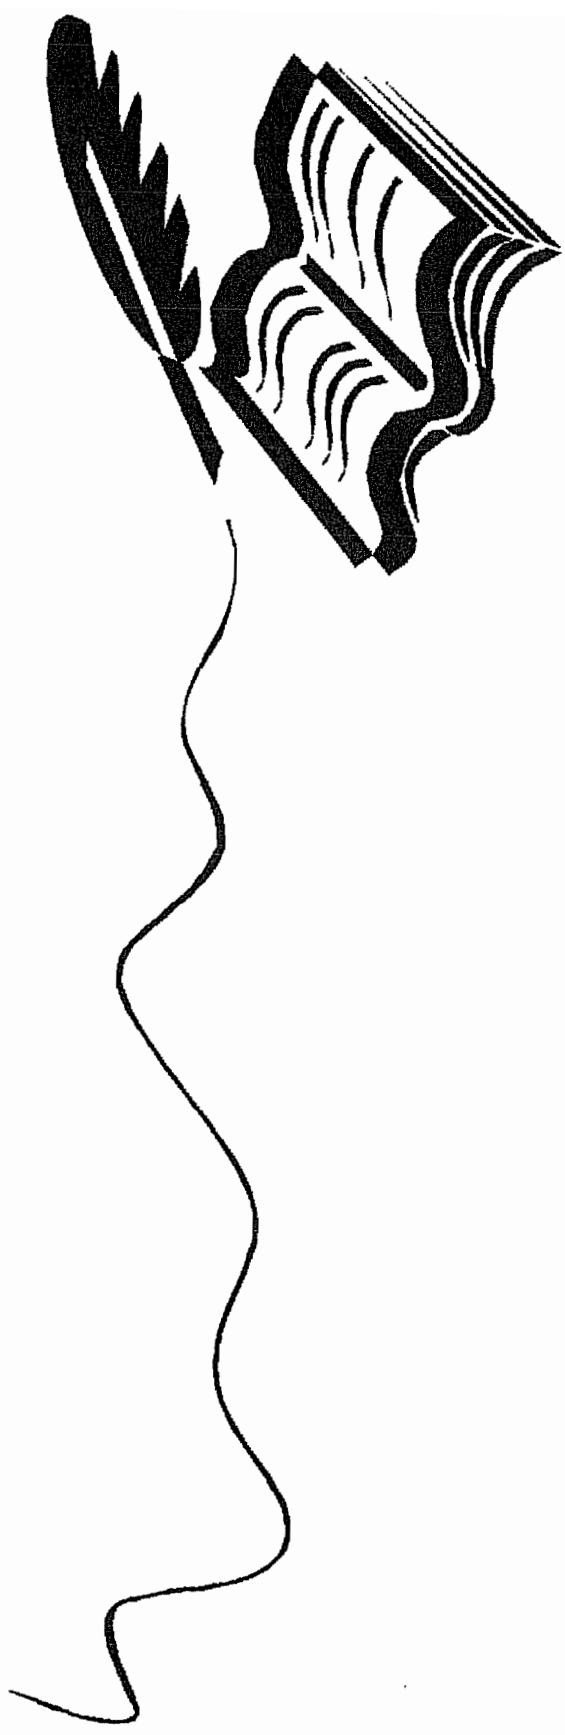

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: OCTOBER 20, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 2

INSPECTOR'S SIGNATURE: *Col Sweetman* DATE: Oct 20, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	201	NO EMERGENCY LIGHTS	X							FBC 423.17.1
	204	EXPOSED WIRES AT TIMER	X							NFPA-70 314.1
	207	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	1	EXT. FIRE ALARM BOX OPEN		X						NFPA-70 314.1
4	910	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	911	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
335 S. PECAN STREET
KEYSTONE HEIGHTS, FLORIDA 32656


INSPECTION DATE: OCTOBER 20, 2005

Carl Swartz
INSPECTOR'S SIGNATURE DATE Oct 20, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	701	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	702	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	716	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	721	OPEN ALARM BOX		X						NFPA-70 314.1
	724	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	751	A/B BATHROOM LIGHT OUT		X						

LAKELAKE ASHBURY

ELEMENTARY SCHOOL

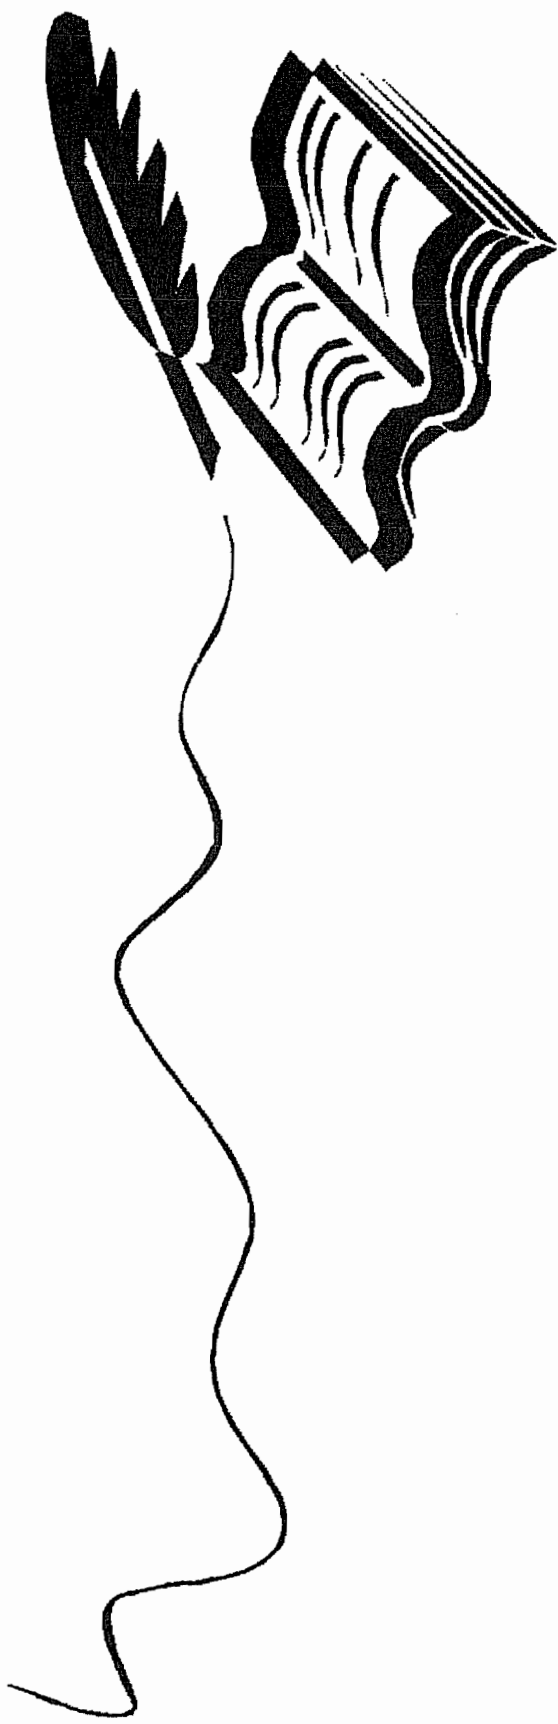

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
2901 SANDRIDGE ROAD
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 25, 2005


Ed Sp... ..
INSPECTOR'S SIGNATURE

Oct 25, 2005
DATE


Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
5		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3
6		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3
7		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3

LAKESIDE

ELEMENTARY SCHOOL

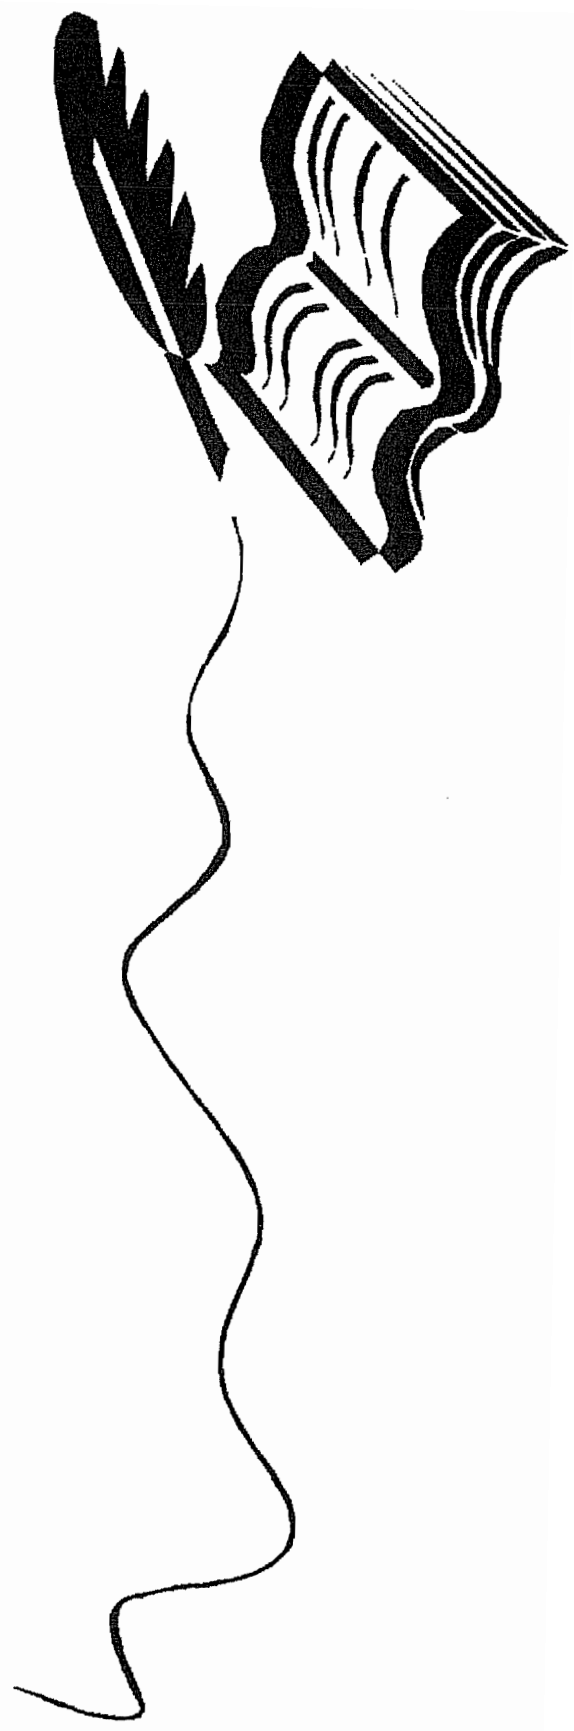

MACRAE ELEMENTARY SCHOOL

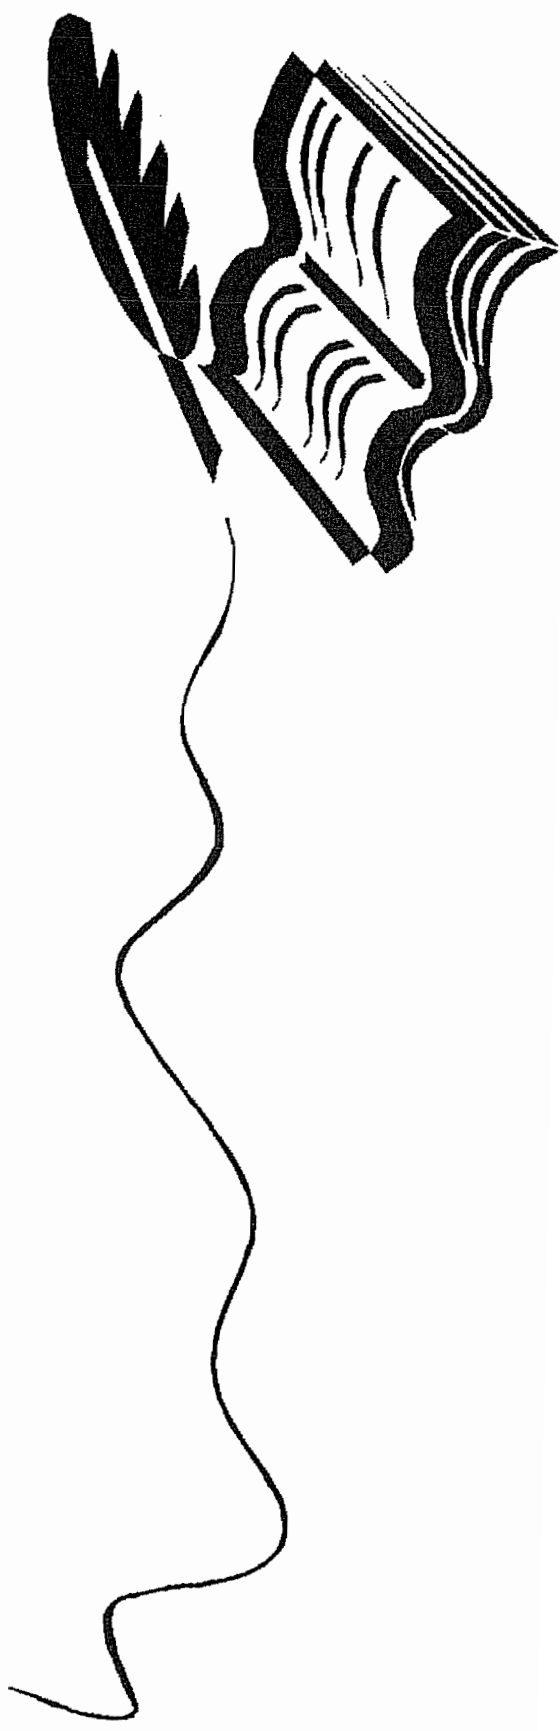

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: NOVEMBER 1, 2005

Ed Sweeting
INSPECTOR'S SIGNATURE DATE: Nov 1, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	120	COVER PLATE MISSING ON J-BOX	X							NFPA-70 314.1
2	203	COVER PLATE MISSING ON J-BOX	X							NFPA-70 314.1
3	312	EXCESSIVE MATERIALS STORED IN ELEC ROOM		X						NFPA-70 160.26
6	614	EXIT LIGHT OUT		X						FBC 1016.3.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
6770 COUNTY ROAD 315 C
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: NOVEMBER 1, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: Nov 1, 2005

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	802	COVER PLATE MISSING IN BATHROOM	X							NFPA-70 314.1
	705	EMERGENCY LIGHT OUT		X						FBC 423.17.1