


GROVE PARK

ELEMENTARY SCHOOL

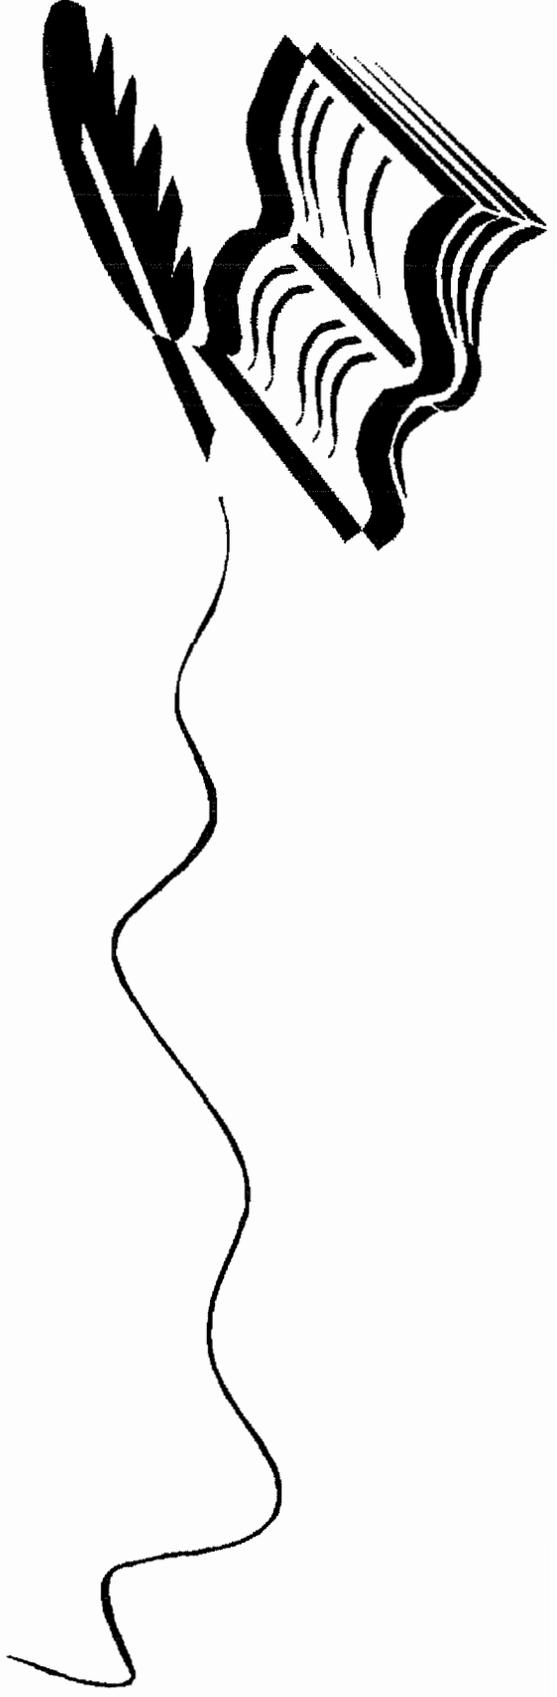

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY #: 0005



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: GROVE PARK ELEMENTARY SCHOOL
 1643 MILLER STREET
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 18, 2005

INSPECTOR'S SIGNATURE: *Janet H. Swann* DATE: 10-18-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Pac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	110b	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
	110	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
2	129a	ROOF LEAK @REAR WALL OF STAGE	X							
	129	MOVE OCCUPANCY LOAD SIGN INSIDE		X						FBC 423.14.2.2
	129	RETURN DUCT EXCESSIVELY DIRTY	X							
6	605b	BASEBOARD LOOSE NEEDS ADHESIVE		X						
	607	TV STAND NEEDS PADDING		X						FBC 423.14.3
	608	TV STAND NEEDS PADDING		X						FBC 423.14.3
	611	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
	613	AC COVER REMOVED	X							
7	701b	BATHROOM DOOR SWINGS OPEN NEEDS ADJUST.	X							FBC 423.13.1
	707	TV STAND NEEDS PADDING		X						FBC 423.14.3
	710	LOCK NEEDS ADJUSTMENT	X							
	713	AC COVER REMOVED	X							

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
 1643 MILLER STREET
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 18, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10/18/05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
8	11	TRIP HAZARD @ DOOR	X							FBC 11-4.13.8
	144	TRIP HAZARD @ DOOR	X							FBC 11-4.13.8
9	140	CEILING PEALING/POPCORN FALLING	X							
	141	CEILING PEALING/POPCORN FALLING	X							
	142	CEILING PEALING/POPCORN FALLING	X							
92	5	OK								
	6	OK								
	7	OK								
	8	OK								
	9	OK								
	10	OK								
	27	OK								

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
 1643 MILLER STREET
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 18, 2005

Janell Swann
 INSPECTOR'S SIGNATURE DATE 10.18.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	28	OK								
	29	OK								
	30	OK								
	31	OK								
	37	OK								
	38	OK								
	40	NOT FOR STUDENTS USE STORAGE ONLY								
	41	NOT FOR STUDENTS USE STORAGE ONLY								
	42	NOT FOR STUDENTS USE STORAGE ONLY								
	43	OK								
	44	OK								
	71	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	500	OK								
	501	OK								

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY #: 0005

FACILITY: GROVE PARK ELEMENTARY SCHOOL
 1643 MILLER STREET
 ORANGE PARK, FLORIDA 32073


INSPECTION DATE: OCTOBER 18, 2005

INSPECTOR'S SIGNATURE: *David F. Burton* DATE: 10-18-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	503	OK								
	504	OK								
	505	OK								
	520	OK								
	521	OK								
	522	OK								
	523	OK								
	524	OK								
	525	OK								
	526	OK								
	527	OK								
	528	OK								
	*****	REPLACE WOOD RAMP TO MEET ADA REQ	X							FBC 11-4.9.4

KEYSTONE HEIGHTS

ELEMENTARY SCHOOL

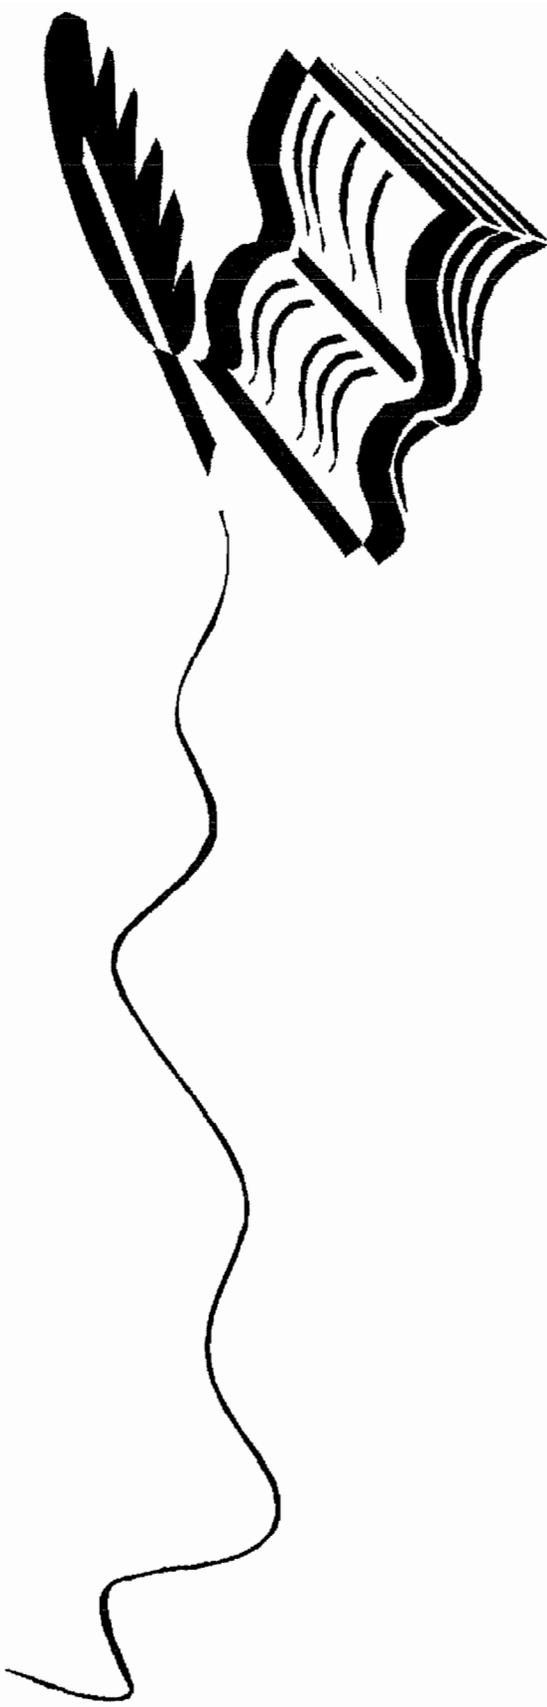

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0010

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
 335 S. PECAN STREET
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: OCTOBER 20, 2005

INSPECTOR'S SIGNATURE: *Samuel J. Burrows* DATE: 10.20.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Exc. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	201	EMERGENCY LIGHTS MISSING	X							FBC 423.17.1
	204	WIRES EXPOSED IN TIMER	X							NFPA-70 314.1
	207	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	1	EXTERIOR FIRE ALARM BOX OPEN		X						NFPA-70 314.1
4	260	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
9	910	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	911	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	701	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	702	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	703	OK								
	704	OK								
	705	OK								
	706	OK								
	707	OK								

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY #: 0010



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
 335 S. PECAN STREET
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: OCTOBER 20, 2005

INSPECTOR'S SIGNATURE: *David A. ...* DATE: 10.20.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	708	EMERGENCY LIGHTS OUT		X						FBC 423.17.1
	709	OK								
	710	FLOOR LOOSE BY ELECTRIC PANEL		X						
	713	OK								
	714	OK								
	715	OK								
	716	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	717	OK								
	718	OK								
	719	NAILING STRIP ON FLOOR TRIP HAZARD			X					
	720	NAILING STRIP ON FLOOR TRIP HAZARD			X					
	720	END COVERS NOT INSTALLED			X					
	721	OPEN ALARM BOX		X						NFPA-1 314.1
	722	OK								
	723	OK								

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY # 0010



COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101

FACILITY: KEYSTONE HEIGHTS ELEMENTARY SCHOOL
 335 S. PECAN STREET
 KEYSTONE HEIGHTS, FLORIDA 32656


INSPECTION DATE: OCTOBER 20, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 10.20.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	724	EMERGENCY LIGHT OUT		X						FBC 423.17.1
	750	OK								
	751	A/B BATHROOM LIGHT OUT		X						
	760	OK								
		** REPLACE WOOD RAMPS TO MEET ADA COMPLY.	X							FBC 11-4.9.4

LAKE ASBURY

ELEMENTARY SCHOOL

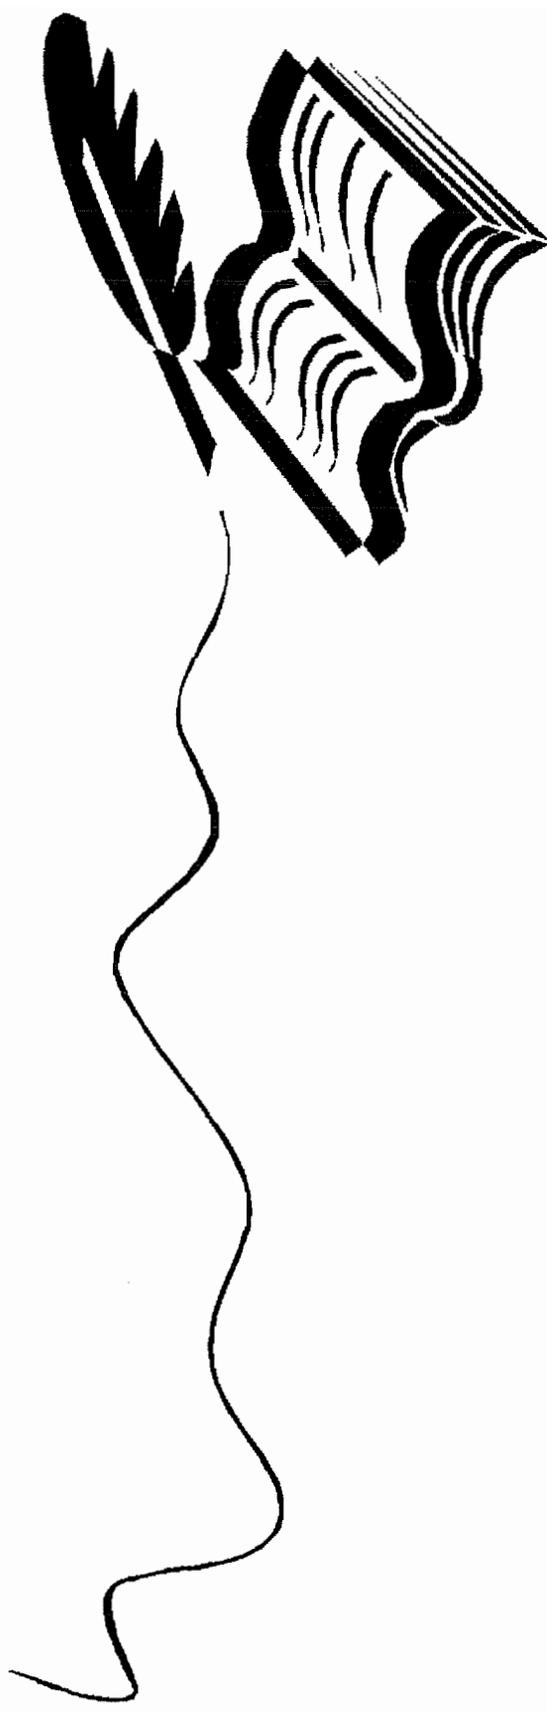

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
 2901 SANDRIDGE ROAD
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 25, 2005

INSPECTOR'S SIGNATURE: *Russell Brown* DATE: 10.25.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		EMERGENCY EVACUATION SHEETS MISSING		X						FBC 423.14.2.4
5		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3
6		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3
7		EXTERIOR BUILDING NUMBERS MISSING	X							FBC 423.14.2.3
92	*****	ALL WOOD RAMPS NEED NON-SKID REPLACED		X						FBC 1013.9
	9	OK								
	10	OK								
	11	OK								
	12	OK								
	13	OK								
	14	OK								
	15	OK								
	16	OK								
	18	OK								

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
 2901 SANDRIDGE ROAD
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 25, 2005

INSPECTOR'S SIGNATURE: *Danell J. Swanson* DATE: 10-25-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	19	OK								
	20	OK								
	39	OK								
	40	OK								
	41	OK								
	42	OK								
	43	OK								
	44	OK								
	45	OK								
	46	OK								
	47	OK								
	48	OK								
	69	OK								
	70	OK								

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0023

FACILITY: LAKE ASBURY ELEMENTARY SCHOOL
 2901 SANDRIDGE ROAD
 GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: OCTOBER 25, 2005


Samuel A. Swann
 INSPECTOR'S SIGNATURE

10.25.05
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	71	OK								
	72	OK								
	73	OK								
	74	OK								
	75	OK								
	76	OK								
	77	OK								
	78	OK								
	79	OK								
	81	OK								
	82	OK								
	85	OK								
	86	OK								
	87	OK								
	****	REPLACE ALL WOOD RAMPS TO MEET ADA REQ.	X							FBC 11-4.9.4

LAKESIDE

ELEMENTARY SCHOOL

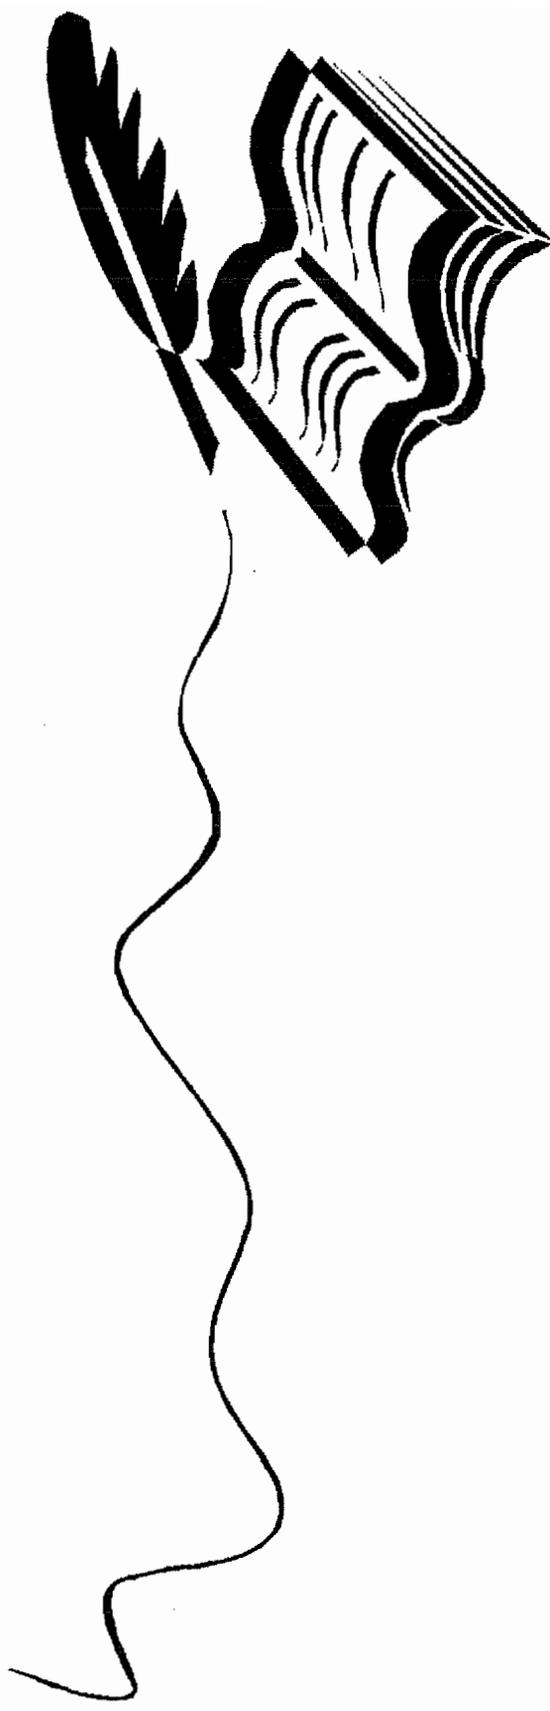

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0015

FACILITY: LAKESIDE ELEMENTARY SCHOOL
 2752 MOODY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 27, 2005

INSPECTOR'S SIGNATURE: *Darryl H. Simpson* DATE: 10-27-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	128	NO EMERGENCY LIGHT	X							FBC 423.17.1
	136	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
	142	NO EMERGENCY LIGHT	X							FBC 423.17.1
6		NO BUILDING NUMBERS		X						FBC 423.14.2.3
7		NO BUILDING NUMBERS		X						FBC 423.14.2.3
8		NO BUILDING NUMBERS		X						FBC 423.14.2.3
92	10	ROOF LEAK NEAR CENTER OF ROOM	X							
92	11	OK								
92	12	CLOSET LIGHT OUT		X						
	13	ROOF LEAK BY AC UNIT	X							
92	14	OK								
92	15	OK								
92	16	OK								
92	17	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	20	CABINET IN FRONT OF EMERGENCY LIGHT		X						FBC 423.17.1

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0015


FACILITY: LAKESIDE ELEMENTARY SCHOOL
 2752 MOODY AVENUE
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: OCTOBER 27, 2005

INSPECTOR'S SIGNATURE: *Lawrence J. Swann* DATE: 10-27-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	22	OK								
92	23	OK								
92	24	OK								
92	25	OK								
92	26	OK								
92	27	OK								
92	42	OK								
92	43	EXTINGUISHER NOT SIGNED		X						69A-36
92	44	OK								
92	45	OK								
92	46	OK								
92	47	OK								
92	51	OK								
	*****	REPLACE WOOD RAMPS TO MEET ADA REQ	X							FBC 11-4.9.4

MACRAE ELEMENTARY SCHOOL

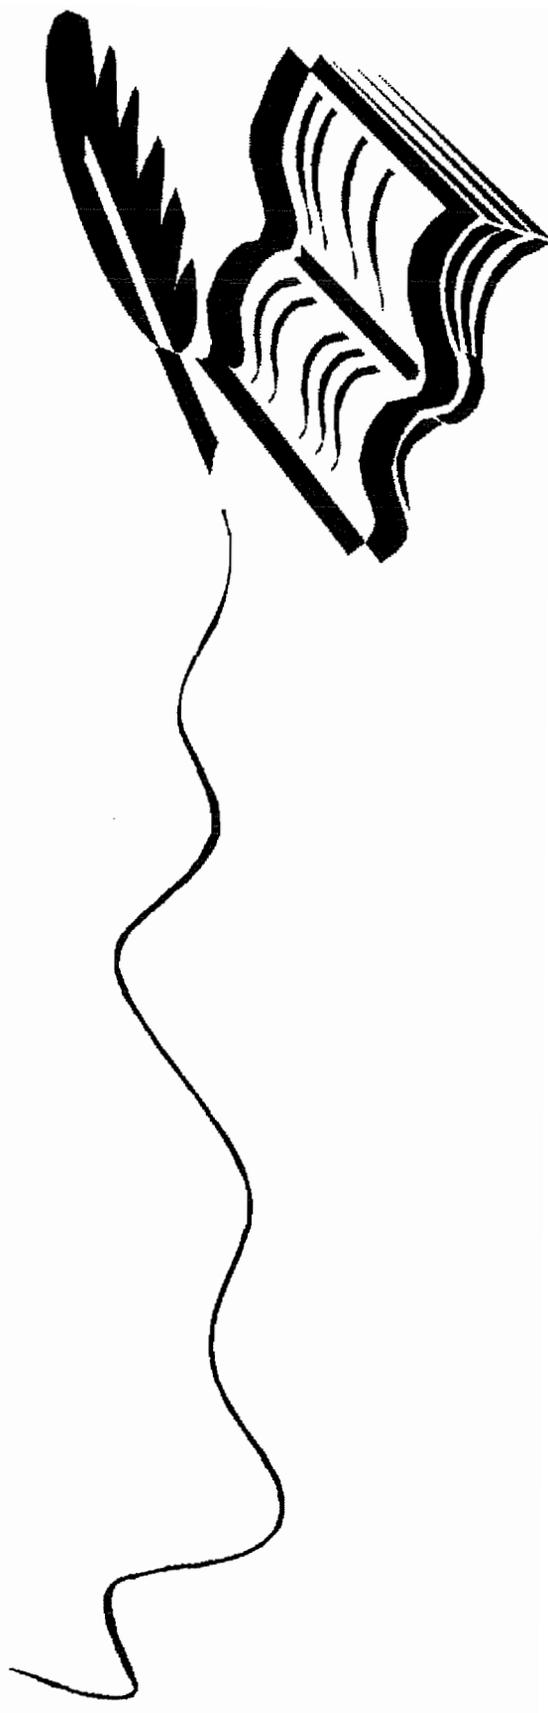

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRAE ELEMENTARY SCHOOL
 6770 COUNTY ROAD 315 C
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: NOVEMBER 1, 2005

Denise Swanson
 INSPECTOR'S SIGNATURE DATE 11-1-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	****	REPLACE NON-SKID ON WOOD RAMPS		X						FBC 1013.9
	401	OK								
	402	OK								
	403	OK								
	404	OK								
	405	OK								
	406	OK								
	407	OK								
	408	OK								
	701	OK								
	702	OK								
	703	OK								
	704	OK								
	705	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT
 STATE BOARD OF EDUCATION
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION
 INSPECTION" IN COMPLIANCE WITH
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0041

FACILITY: MCRRAE ELEMENTARY SCHOOL
 6770 COUNTY ROAD 315 C
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: NOVEMBER 1, 2005

Carroll J. Swann
 INSPECTOR'S SIGNATURE

11-1-05
 DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	706	OK								
	707	OK								
	708	OK								
	801	OK								
	802	MISSING COVER PLATE IN BATHROOM	X							NFPA-70 314.1
		MISSING CEILING TILE IN BATHROOM		X						FBC 804.2.3
		FAUCET IN BATHROOM DRIPS	X							
	803	OK								
	804	BATHROOM DOOR STICKS		X						
	821	OK								
	823	TV NOT TIED DOWN		X						
	824	OK								
	825	OK								
	826	OK								

