


KEYSTONE HEIGHTS

JUNIOR/SENIOR HIGH SCHOOL

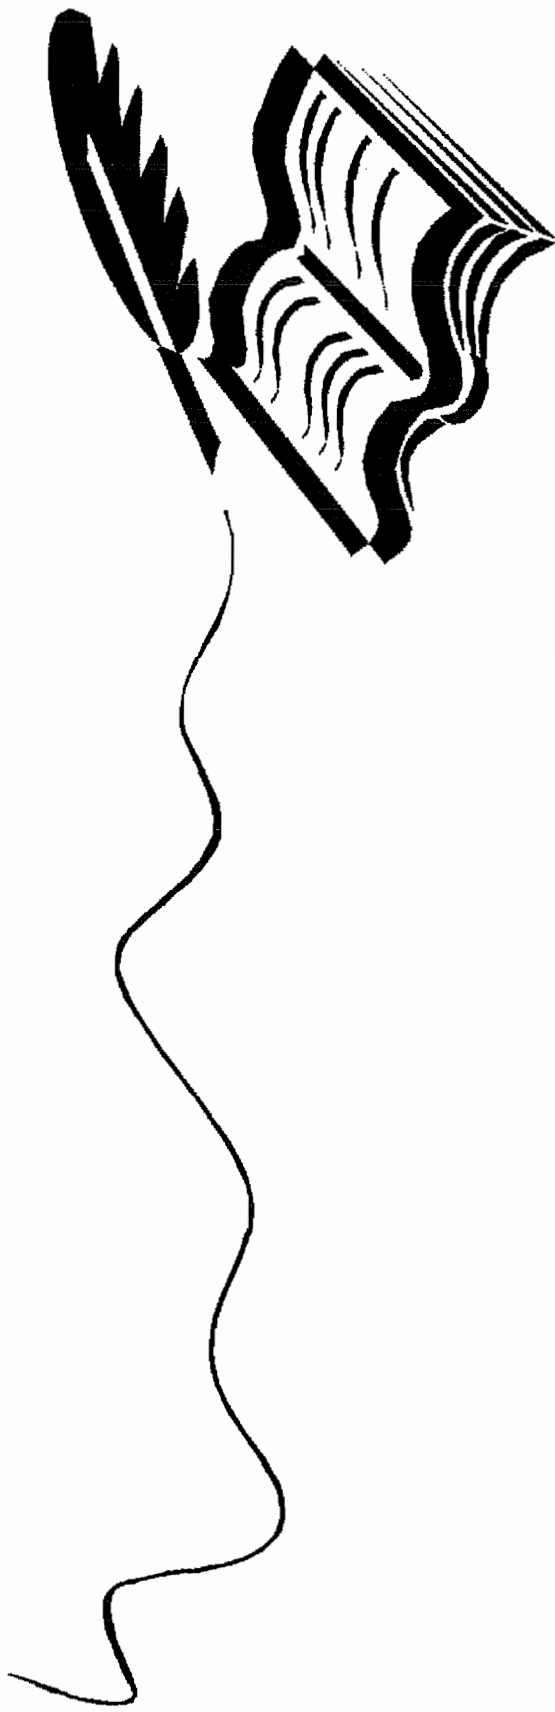

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY # 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 3

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.15.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	124	Emergency light out		X						FBC 423.17.1
1	150	Emergency light out		X						FBC 423.17.1
1	167	Material stored in front of electrical panel		X						NFPA 70 160.28
1	170	Exit light out		X						FBC 1016.3.1
1	177	Emergency light out		X						FBC 423.17.1
1	178	Emergency light out		X						FBC 423.17.1
1	173	Electrical room filled with computers; can't get to electrical panel		X						NFPA 70 110.26
1	189	Emergency light out		X						FBC 423.17.1
1	190	Emergency light out		X						FBC 423.17.1
1	192	Emergency light out		X						FBC 423.17.1
4	410	Emergency evacuation sheets missing		X						FBC 423.14.2.4
4	411	Emergency evacuation sheets missing		X						FBC 423.14.2.4
4	407	Emergency evacuation sheets missing		X						FBC 423.14.2.4
4	409	Emergency evacuation sheets missing		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY # 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

9.15.05

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS"	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
5	507	Magnetic hood opens inoperable; cafeteria	X							FBC 423.14.2.4
5	549	Excessive storage in mechanical room		X						NFPA 70 110.26
6	609E	Coffee maker in electrical closet		X						NFPA 70 110.26
6	604	Emergency evacuation sheets missing		X						FBC 423.14.2.4
6	605	Emergency evacuation sheets missing		X						FBC 423.14.2.4
6	606	Emergency evacuation sheets missing		X						FBC 423.14.2.4
6	609A	Classroom not by design - door swing			X					FBC 423.13.1
6	601	Emergency evacuation sheets missing		X						FBC 423.14.2.4
7	701	Emergency evacuation sheets missing		X						FBC 423.14.2.4
7	715	Emergency evacuation sheets missing		X						FBC 423.14.2.4
7	714	Emergency evacuation sheets missing		X						FBC 423.14.2.4
8	800	Replace electrical cover plate at S.E. door	X							NFPA 70 314.1
9	903	Electrical cover plate missing by Pepsi machine	X							NFPA 70 314.1
9	906	North exit sign broken		X						NFPA 7.10.6

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY # 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

9.15.05

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "IS"	Cost	No. of times Def. Cited	Schedule for Correction	Rule
9	911	Exit blocked		X						NFPA 4.4.3.1
18	901	Emergency light inoperable		X						FBC 423.17.1
18	905	Emergency light inoperable		X						FBC 423.17.1
18	906	Oil based stain not stored in paint locker		X						FBC 423.20.4.2
18	917	Emergency evacuation sheets missing		X						FBC 423.14.2.4
18	910	Emergency evacuation sheets missing		X						FBC 423.14.2.4
20	17	Emergency evacuation sheets missing		X						FBC 423.14.2.4
34		STADIUM BLEACHERS (HANDRAILS)			X					NFPA 12.2.5.6.7

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: x NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY # 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

[Signature]
 9.15.05

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	1	Re-coat non-skid ramp		X						FBC 1013.9
92	2	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	3	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	3	Re-coat non-skid ramp		X						FBC 1013.9
92	4	Re-coat non-skid ramp		X						FBC 1013.9
92	5	Electrical panel blocked		X						NFPA 70 110.26
92	6	Re-coat non-skid ramp		X						FBC 1013.9
92	7	Re-coat non-skid ramp		X						FBC 1013.9
92	59	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	90	Fire extinguisher missing tag		X						NFPA 5.3 & 5.6.4
92	91	Emergency evacuation sheet missing		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: ___ x ___ NUMBER OF DRILLS PERFORMED: ___ 3 ___

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY # 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-15-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	1	Re-coat non-skid ramp		X						FBC 1013.9
92	2	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	3	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	3	Re-coat non-skid ramp		X						FBC 1013.9
92	4	Re-coat non-skid ramp		X						FBC 1013.9
92	5	Electrical panel blocked		X						NFPA 70 110.26
92	6	Re-coat non-skid ramp		X						FBC 1013.9
92	7	Re-coat non-skid ramp		X						FBC 1013.9
92	11	Re-coat non-skid ramp		X						FBC 1013.9
92	12	Re-coat non-skid ramp		X						FBC 1013.9
92	13	Re-coat non-skid ramp		X						FBC 1013.9
92	14	Re-coat non-skid ramp		X						FBC 1013.9
92	15	Re-coat non-skid ramp		X						FBC 1013.9

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-15-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	15	Repair siding on ramp		X						
92	16	Replace non-skid on ramp		X						FBC 1013.9
92	17	Replace non-skid on ramp		X						FBC 1013.9
92	18	Replace non-skid on ramp		X						FBC 1013.9
92	19	Replace non-skid on ramp		X						FBC 1013.9
92	20	Replace non-skid on ramp		X						FBC 1013.9
92	21	Replace non-skid on ramp		X						FBC 1013.9
92	21	Missing evacuation sheet		X						FBC 423.14.2.4
92	22	Replace non-skid on ramp		X						FBC 1013.9
92	22	Repair pickets at stairs		X						FBC 1007.5
92	23	Replace non-skid on ramps		X						FBC 1013.9
92	24	Replace non-skid on ramp		X						FBC 1013.9
92	25	Replace non skid on ramp		X						FBC 1013.9
92	25	Emergency light not working		X						FBC 1016.3.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: x NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
 900 S. W. ORCHID AVENUE
 KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: SEPTEMBER 15, 2005

9.15.05

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	Replace non-skid on ramp		X						FBC 1013.9
92	27	Replace non-skid on ramp		X						FBC 1013.9
92	28	Replace non-skid on ramp		X						FBC 1013.9
92	29	Replace non-skid on ramp		X						FBC 1013.9
92	30	Replace non-skid on ramp		X						FBC 1013.9
92	51	OK								
92	52	Replace non-skid on ramp		X						FBC 1013.9
92	53	Electrical panel blocked		X						NFPA 70 110-26
92	54	Evacuation sheet missing		X						FBC 423.14.2.4
92	54	Replace non-skid on ramp		X						FBC 1013.9
92	55	OK								
92	56	Replace non-skid on ramp		X						FBC 1013.9
92	57	OK								
92	58	Replace non-skid on ramp		X						FBC 1013.9

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: x NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0011

FACILITY: KEYSTONE HEIGHTS HIGH SCHOOL
900 S. W. ORCHID AVENUE
KEYSTONE HEIGHTS, FLORIDA 32656


INSPECTION DATE: SEPTEMBER 15, 2005

INSPECTOR'S SIGNATURE: *Col Sweetman* DATE: Sept 15, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	59	Emergency evacuation sheet missing		X						FBC 423.14.2.4
92	60	Replace non-skid on ramp		X						FBC 1013.9
92	61	OK								
92	62	Replace non-skid on ramp		X						FBC 1013.9
92	63	Lights not working (5)		X						
92	64	Replace non-skid on ramp		X						FBC 1013.9
92	65	Lights not working (6)		X						
92	90	Fire extinguisher missing tag		X						NFPA 5.3 & 5.6.4
92	91	Emergency evacuation sheet missing		X						FBC 423.14.2.4

MIDDLEBURG

HIGH SCHOOL

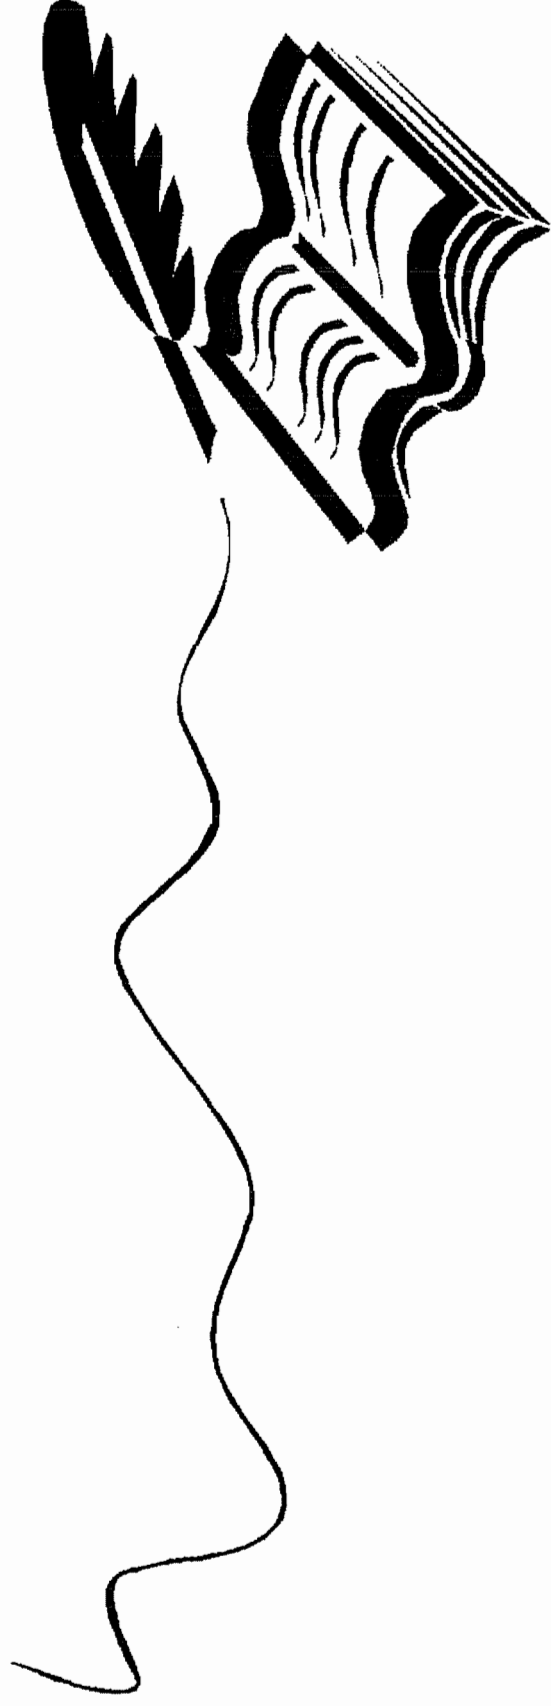

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: SEPTEMBER 20, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.20.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	58	No emergency light	X							FBC 423.17.1
1	26	Extension cord from strip to strip		X						NFPA 70 400-8
1	68	Evacuation sheet missing		X						FBC 423.14.2.4
1	71	Evacuation sheet missing		X						FBC 423.14.2.4
1	123	Hall ceiling tiles hanging down; track bent	X							NFPA 1 10.4.1
1	142	Chair prop open door with extension cord to fan		X						NFPA 70 400-8
1	136	Evacuation sheet		X						FBC 423.14.2.4
1	164	Door swings into room			X					FBC 423.13.1
1	164	No evacuation sheet		X						FBC 423.14.2.4
1	163	Storage too close to sprinkler in ceiling		X						NFPA 13 13.8.5.5.3
1	148	Communication cables run across floor				X				FBC 423.28.2.18.1
1	178	Extension cord to extension cord to strip		X						NFPA 70 400-8
1	187	Junction box cover missing - over fire alarm	X							NFPA 70 312.5
1	259	Evacuation sheet missing		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: x NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: SEPTEMBER 20, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-20-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	263	Extension cords to sewing machines need tower		X						NFPA 70 400-8
1	226	Outlet needs to be moved for TV	X							FBC 423.28.2 18.1
1	241	Evacuation sheet		X						FBC 423.14.2.4
1	244	Information services directly in front of electrical panel				X				NFPA 70 110-26
1	245	Evacuation sheet		X						FBC 423 14.2.4
1	245	Extension cord around wall to strip		X						NFPA 70 400-8
1	239	Extension cord to tree decoration		X						NFPA 70 400-8
1	249	Emergency light not working		X						FBC 423.17.1
1	249	No cover over florescent light		X						NFPA 70 410.3
1	249	Storage in riser room		X						
1	215	Storage to close to sprinklers		X						NFPA 13 13.8.5.5.3
1	326	Evacuation sheet missing		X						FBC 423.14.2.4
1	335	No evacuation sheet		X						FBC 423 14.2.4
1	335	Ceiling tile missing		X						FBC 8050203

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY # 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: SEPTEMBER 20, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-20-05

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	335	Emergency light not working		X						FBC 423.17.1
1	312	Evacuation sheet missing		X						FBC 423.14.2.4
1	313	Storage to close to sprinklers		X						NFPA 13 13.8.5.5.3
1	291	Exit light missing		X						FBC 1016.3.1
1	270	Exit blocked - panel blocked storage		X						FBC 423.20.1
1	357	Evacuation sheet missing		X						FBC 423.14.2.4
1	361A	Evacuation sheet missing								FBC 423.14.4
9		LP gas bottle stored in building		X						NFPA 1.21-3.3.5
9		Emergency lights not working in both bathrooms		X						FBC 423.17.1
10		LP gas bottle stored in building		X						NFPA 1.21-3.3.5
10		Boys bathroom emergency light not working		X						FBC 423.17.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: x NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: SEPTEMBER 20, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.20.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	7	No evacuation sheet		X						FBC 423.14.2.4
92	7	Emergency light not working		X						FBC 423.17.1
92	47	Outlet cover plate broken	X							NFPA 70 314.1
92	47	No evacuation sheet		X						FBC 423.14.2.4
92	54A/B	Emergency light not working		X						FBC 423.17.1
92	60	Evacuation sheet missing		X						FBC 423.14.2.4
92	70	No evacuation sheet		X						FBC 423.14.2.4
92	71	No evacuation sheet		X						FBC 423.14.2.4
92	72	No evacuation sheet		X						FBC 423.14.2.4
92	75	No evacuation sheet		X						FBC 423.14.2.4
92	77	No evacuation sheet		X						FBC 423.14.2.4
92	77	Emergency light not working		X						FBC 423.17.1
92	78	No evacuation sheet		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION

ANNUAL RELOCATABLE BUILDING INSPECTION

FIRE DRILL LOG: X NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0019

FACILITY: MIDDLEBURG HIGH SCHOOL
3750 STATE ROAD 220
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: SEPTEMBER 20, 2005

9-20-05

INSPECTOR'S SIGNATURE DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	79	Emergency light not working		X						FBC 423.17.1
92	79	No evacuation sheet		X						FBC 423.14.2.4