


ORANGE PARK

SENIOR HIGH SCHOOL

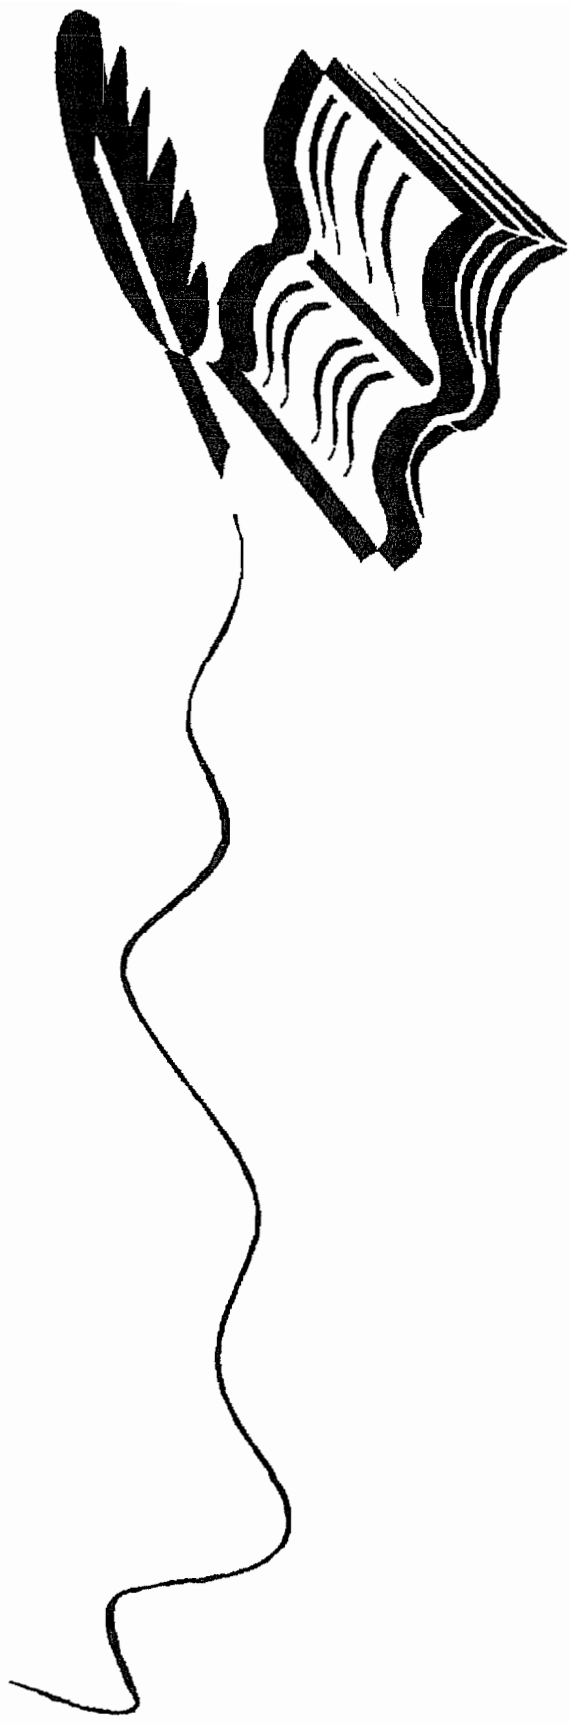

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *Carl Sweetman*
DATE: *Sept 23, 2005*

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	107	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	109	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	111	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	203	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	205	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	207	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	208	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	209	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	210	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	211	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	214	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	215	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	216	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	219	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

INSPECTOR'S SIGNATURE: *Tom Sweet* DATE: *Sept 23 2005*

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	220	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	222	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	236	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	223a	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	224a	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	226	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	227	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	231	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	233	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	204	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	232a	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	251	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	255	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	256	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005


 INSPECTOR'S SIGNATURE DATE Sept 23 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	228	EXTENSION CORD INTO CEILING FOR PROJECTOR		X						NFPA-70 527.2
2	2	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
2	3	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
2	4	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
2	6	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
2	5	LENSE COVER MISSING		X						NFPA-70 410.3
3	2	NO EMERGENCY LIGHTING	X							FBC 423.17.1
4	1	EMERGENCY LIGHT HANGING MISSING COVER	X							FBC 423.17.1
4		EMERGENCY LIGHT OUT OTHER END OF GYM		X						FBC 423.17.1
4		COVER PLATE MISSING PULL BOX	X							NFPA-70 312.5
4	3	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
4	4	BARE WIRES IN CORNER BY CEILING CLOSET	X							NFPA-70 312.5
4	5	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	5a	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: *Sept 23 2005*

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	6	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	8	NO EMERGENCY LIGHT	X							FBC 423.17.1
4	8a	NO EMERGENCY LIGHT	X							FBC 423.17.1
4	9	NO EMERGENCY LIGHT	X							FBC 423.17.1
4	19	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	125b	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	125b	LARGE HOLE IN CEILING	X							
1	126b	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	162	NO EMERGENCY LIGHT								FBC 423.17.1
1	118	EMERGENCY LIGHT OUT	X							FBC 423.17.1
1	119	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	120	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	122	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	123	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *Tom Sweatt* DATE: *Sept 23, 2005*

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	165	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	166	WIRING TROUGH AND KNOCK OUT MISSING	X							NFPA-70.312.5
1	129	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	110	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	116	EXIT LIGHTS NOT WORKING		X						FBC 1016.3.1
10	116	HEAT DETECTOR LOOSE	X							FBC
10	116	EXHAUST FAN THROUGH ROOF MISSING	X							FBC
10	114	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
10	100	EMERGENCY LIGHT OUT		X						FBC 423.17.1
10	131	WATER HEATER LOCK BROKEN	X							NFPA-70.312.5
1	107	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	109	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	111	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	112	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005


 INSPECTOR'S SIGNATURE DATE: Sept 23 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	113	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	101	COVER PLATE MISSING OLD CLOCK	X							NFPA-70:314-1
1	100	FIRE EXTINGUISHER MISSING		X						NFPA-10 7-6.15
1	154	NO EMERGENCY LIGHT (B1 UNDER STAIR)	X							FBC 423.17.1
1	183	NO EMERGENCY LIGHT	X							FBC 423.17.1
1	184	NO EMERGENCY LIGHT	X							FBC 423.17.1
1	105b	NO EMERGENCY LIGHT	X							FBC 423.17.1
1	106h	NO EMERGENCY LIGHT	X							FBC 423.17.1
1	107	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	109	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
1	111	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
21	2	NO EMERGENCY LIGHT		X						FBC 423.17.1
21	4	NO EMERGENCY LIGHT		X						FBC 423.17.1
21	9	EXIT LIGHT OUT		X						FBC 1016.3.1

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

INSPECTOR'S SIGNATURE: *[Signature]* DATE: Sept 23, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
20	5	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
20	10	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
20	18a	EXIT BLOCKED W/ DESK (required 72")		X						FBC 1004
20	14	FIRE PANEL MISSING COVER	X							NFPA-70 312.5
20	18	EXIT LIGHT OUT		X						FBC 1016.3.1
22	1	EXTENSION CORD TO STRIP		X						NFPA-70 527.2
22	2	EXTENSION CORD AROUND ROOM		X						NFPA-70 527.2
22	4	EXIT LIGHT OUT		X						FBC 423.17.1
22	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	9b	STORAGE IN ELECTRICAL CLOSET		X						NFPA-70 110.26
22	6	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	5	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	7	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	8	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005


 INSPECTOR'S SIGNATURE

DATE
 Sept 23, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
27	1	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
27		NO EMERGENCY LIGHTING IN WHOLE BUILDING	X							FBC 423.17.1
27	3	EXIT LIGHT OUT		X						FBC 1016.3.1
27	3	ELECTRIC PANEL BLOCKED		X						NFPA-70 160.26
27	10	EMERGENCY LIGHT OUT		X						FBC 423.17.1
18		NO EMERGENCY LIGHTING	X							FBC 423.17.1
18	2	TV STAND TO LOW NEEDS PADDING		X						FBC 423
18	7	EMERGENCY LIGHT IN HALL NOT WORKING		X						FBC 423.17.1
19		NO EMERGENCY LIGHTS IN CLASSROOMS	X							FBC 423.17.1
19	3	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	7	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: OK NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY # 0007

FACILITY: ORANGE PARK HIGH SCHOOL
2300 KINGSLEY AVENUE
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: SEPTEMBER 23, 2005


 INSPECTOR'S SIGNATURE DATE Sept 23 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
19	8	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
24	23	FOUR-WHEELER IN STORAGE AREA		X						NFPA-1 21:3.3.5
41	1	NO EMERGENCY LIGHT	X							FBC 423.17.1
41	2	NO EMERGENCY LIGHT	X							FBC 423.17.1
41	3	NO EMERGENCY LIGHT	X							FBC 423.17.1
41	4	NO EMERGENCY LIGHT	X							FBC 423.17.1
43		NO EMERGENCY LIGHT	X							FBC 423.17.1

RIDDGEVIEW

SENIOR HIGH SCHOOL

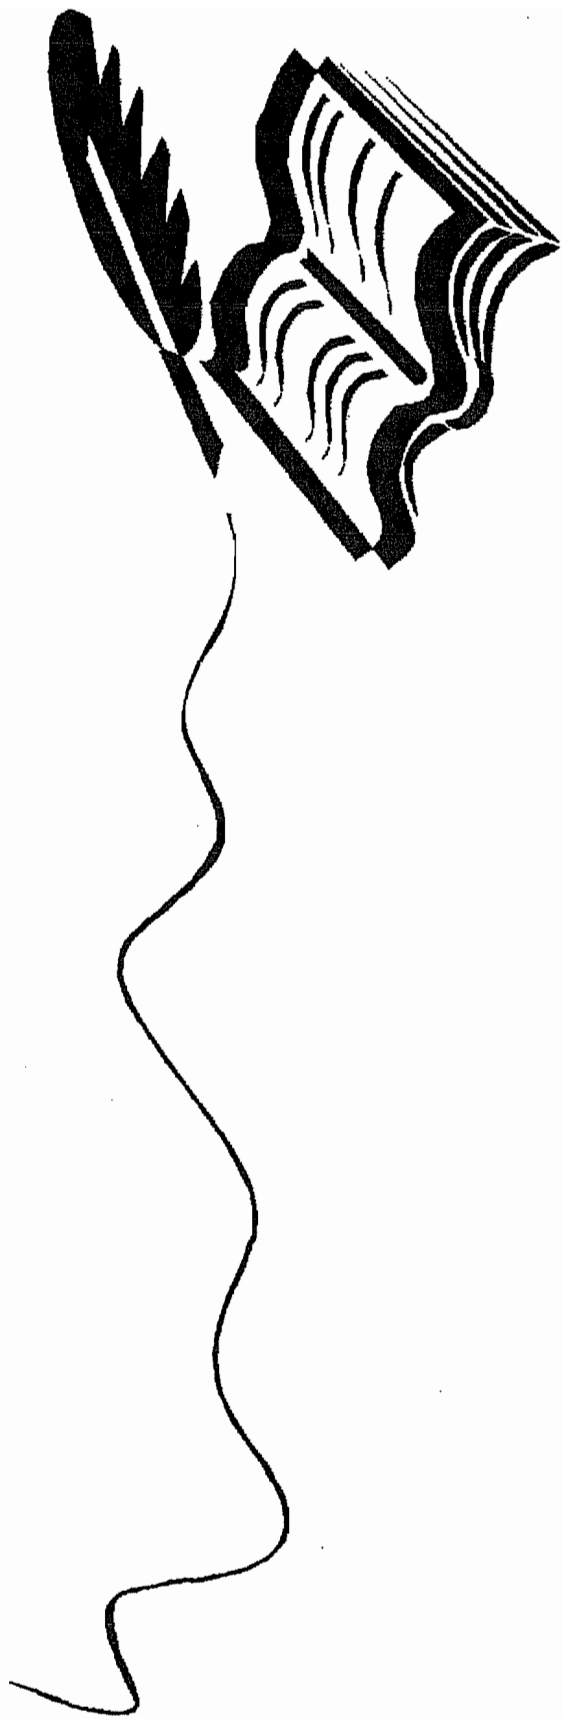

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

9-9-05

[Inspector Signature]
INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	108A	Cover plate on J-boxes	X							NFPA 70 314.1
1	107A	Exit light out		X						FBC 423.17.1
1	135 A	Exit sign direction arrow		X						FBC 423.17
1	135 A	Exit sign out		X						FBC 423.17
1	140	Exposed wires where clock was removed	X							NFPA 70 312.5
1	140	No emergency evacuation sheet		X						FBC 423 14.2.4
1	149	Occupant load sign missing		X						FBC 423.14.2
2	201	Occupant load sign missing		X						FBC 423 14.2
	207	Exposed wires by fire alarm horn	X							NFPA 70 312.5
2		Room numbers missing		X						FBC 423.14.2.3

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.9.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	223	Extension cord to appliances behind compartment sink		X						NFPA 1-11.1.5
2	224	Lens cover missing	X							NFPA 70 410.3
2	234	Lens cover missing	X							NFPA 410.3
2	233	Door missing	X							
2	233	Lens cover missing	X							NFPA 70 410.3
2	233	Switch plate missing	X							NFPA 70 314.1
2	221	Light missing; wires exposed	X							NFPA 70 312.5
2	216	Lens cover missing	X							NFPA 70 410.3
2	208	Extension cords draped from support rods		X						NFPA 1-11.1.5
2	201	Stair nosing on west side broken	X							FBC 1007.3.3
2	211	Exit sign missing		X						NFPA 7.10.6
2	211	Door knob missing	X							NFPA 14.5.2
8	826	Extension cord running to microwave		X						NFPA 1 11.1.5

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION
 ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

TYPE OF INSPECTION

DISTRICT: CLAY FACILITY # 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.9.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
8	801	Extinguisher cover broken		X						
8	808	Extinguisher cover broken		X						
8	829	Emergency light out		X						NFPA 101.7.9
8	829	Wire exposed	X							NFPA 70 314.1
9	901	Cover plate missing between air handlers	X							NFPA 70 314.1
9	901	Material stored in front of electrical panels		X						NFPA 70 160.26
9	902	Light out		X						FBC 423.17.1
9	911	Northeast emergency light out		X						FBC 423.17.1
9	911	Northwest emergency light out		X						FBC 423.17.1
9	911	North bleacher emergency light out		X						FBC 423.17.1
9	911	Fire extinguisher at NW corner missing		X						NFPA 10 7-6.15
9	911	Occupancy load sign missing		X						FBC 423.14.2
9	903	Room number missing		X						FBC 423.14.2.3
9	903	Cover plate on outlet missing	X							NFPA 10 314.1

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

9.9.05

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
9	904	Room number missing		X						FBC 423.14.2.3
9	904	Emergency light inoperable		X						FBC 423.17.1
9	911	SW wall cover plate missing	X							NFPA 70 314.1
9	924	Hall emergency lights "3" broken		X						FBC 423.17.1
9	919	Emergency light inoperable		X						FBC 423.17.1
9	940	Emergency light inoperable		X						FBC 423.17.1
9	941	Emergency light inoperable		X						FBC 423.17.1
9	924	Girls locker room exit light out		X						FBC 423.17
9	916	Emergency light broken		X						NFPA 101 7.9
9	914	Emergency light broken		X						NFPA 101 7.9
9	930	West wall exit light out		X						NFPA 101 7.9
9		GENERAL: Emergency evacuation signs missing		X						FBC 423 14.2.4

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



DISTRICT: CLAY FACILITY # 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

9.9.05

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	301	Fire extinguisher missing in hall		X						NFPA 10.7.6.15
3	320	Emergency evacuation sign missing		X						FBC 423.14.2.4
3	315	Emergency evacuation sign missing		X						FBC 423.14.2.4
3	302	Exit light missing in front of Rm 302		X						
6	632	Exposed wires - covers missing	X							NFPA 70 314.1
6	635	Exit light out - east end		X						FBC 423.17.1
6	635	Switch plate cover west end	X							NFPA 314.1
6	602	Fire extinguisher not within 15' of roof top		X						
6	638	North end exit light broken		X						FBC 423.17.1
6	689	Emergency evacuation sheet missing		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58**



DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

9-9-05

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
6	690	Emergency evacuation sheet missing		X						FBC 423 14.2.4
6	688	Emergency evacuation sheet missing		X						FBC 423 14.2.4
6	688	Exit light out		X						FBC 423.17.1
7		GENERAL: Number of room numbers missing		X						FBC 423.14.2.3
7	705	Exit light shorted out		X						FBC 423.17.1
7	705	Emergency evacuation sheets missing		X						FBC 423 14.2.4
10	1006	Fire extinguisher missing		X						NFPA 10 7.6.15
10	1012	Evacuation sheet missing		X						FBC 423.14.2.4
		Handrails on stadium			X					

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

9.9.05

INSPECTOR'S SIGNATURE _____ DATE _____

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	3	Emergency light		X						FBC 423.17.1
92	5	Emergency light		X						FBC 423.17.1
92	21	Non skid on ramp needs to be replaced		X						FBC 1013.9
92	21	Strobe lights on fire alarm	X							
92	22	Handrail on ramp	X							
92	23	Strobe on fire alarm	X							
92	24	Emergency light		X						NFPA 101.7.9
92	25	Handrail on ramp	X							
92	26	Emergency evacuation sheet		X						FBC 423.14.2.4
92	27	Emergency light		X						NFPA 101.7.9
92	27	Emergency evacuation sheet		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12 & RULE 69A-58



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION ANNUAL RELOCATABLE BUILDING INSPECTION
 FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 2

DISTRICT: CLAY FACILITY #: 0022

FACILITY: RIDGEVIEW HIGH SCHOOL
466 MADISON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: SEPTEMBER 9, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.9.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	29	Replace button switch on time out room	X							
92	63	Lense cover missing	X							
92	67	No emergency evacuation sheet		X						FBC 423.14.2.4
92	68	No emergency evacuation sheet		X						FBC 423.14.2.4
92	69	Door sticks in bathroom	X							
92	70	Spindles missing on ramp	X							
92	71	Exhaust fan loose	X							
92	71	Smoke detector hanging from ceiling	X							
92	74	No emergency evacuation sheet		X						FBC 423.14.2.4
92	82	No emergency evacuation sheet		X						FBC 423.14.2.4
92	90	No emergency evacuation sheet		X						FBC 423.14.2.4