


**ORANGE PARK**

**SENIOR HIGH SCHOOL**

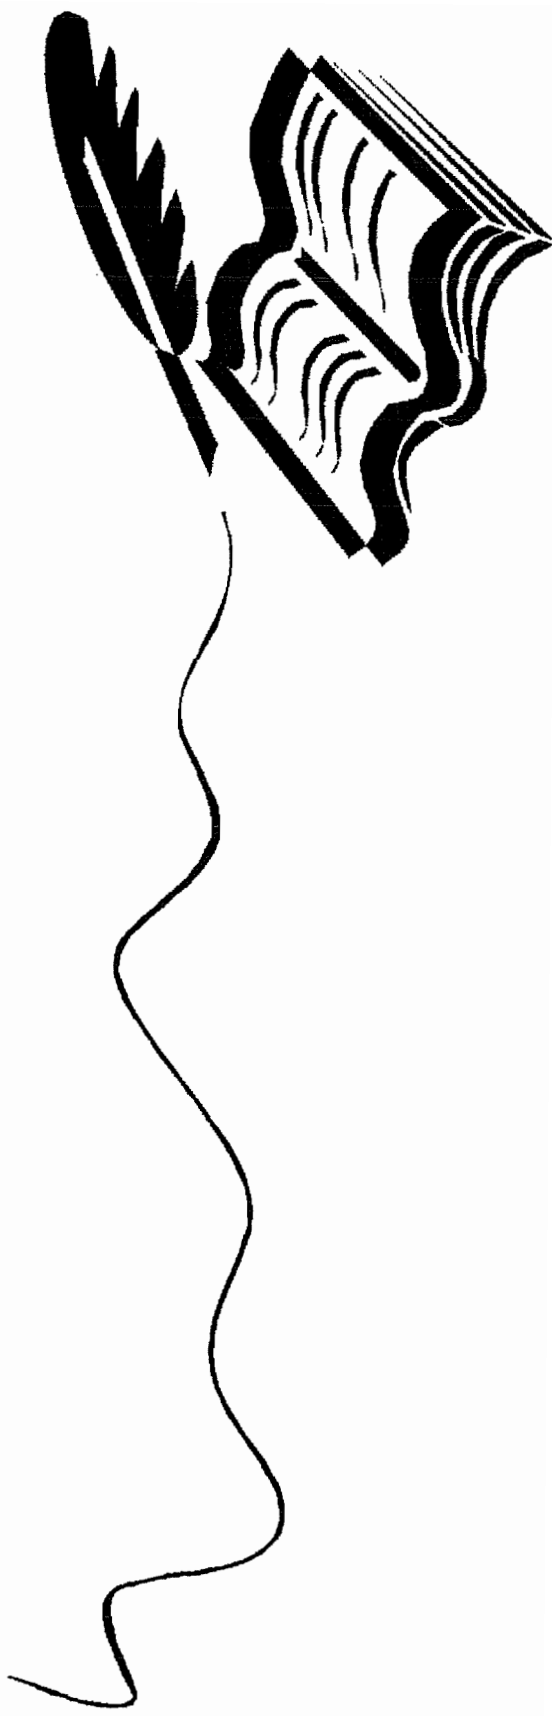

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9.23.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	107	No evacuation sheet		X						FBC 423.14.2.4
1	109	No evacuation sheet		X						FBC 423.14.2.4
1	203	No evacuation sheet		X						FBC 423.14.2.4
1	205	No evacuation sheet		X						FBC 423.14.2.4
1	207	No evacuation sheet		X						FBC 423.14.2.4
1	208	No evacuation sheet		X						FBC 423.14.2.4
1	209	No evacuation sheet		X						FBC 423.14.2.4
1	210	No evacuation sheet		X						FBC 423.14.2.4
1	211	No evacuation sheet		X						FBC 423.14.2.4
1	214	No evacuation sheet		X						FBC 423.14.2.4
1	215	No evacuation sheet		X						FBC 423.14.2.4
1	216	No evacuation sheet		X						FBC 423.14.2.4
1	219	No evacuation sheet		X						FBC 423.14.2.4
1	220	No evacuation sheet		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY: ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *James J. ...* DATE: 9.25.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	222	No evacuation sheet		X						FBC 423.14.2.4
1	236	No evacuation sheet		X						FBC 423.14.2.4
1	223A	No evacuation sheet		X						FBC 423.14.2.4
1	224A	No evacuation sheet		X						FBC 423.14.2.4
1	226	No evacuation sheet		X						FBC 423.14.2.4
1	227	No evacuation sheet		X						FBC 423.14.2.4
1	229	No evacuation sheet		X						FBC 423.14.2.4
1	231	No evacuation sheet		X						FBC 423.14.2.4
1	233	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	204	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	232A	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	255	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	251	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	256	Emergency evacuation sheet missing		X						FBC 423.14.2.4

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE  
*Doreen J. Moran*

DATE  
 9-23-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	219	Emergency evacuation sheet missing		X						FBC 423.14.2.4
1	254	Emergency light missing	X							FBC 423.17.1
1	250	Light not working		X						
1	231	Light not working		X						
1	210	Roof leak	X							
1	212	Roof leak; ceiling tile damaged	X							
1	212	Panel cover missing on electrical	X							NFPA 70-312.5
1	212	Hole in wall where clock was removed	X							NFPA 70 312.5
1	228	Extension cord into ceiling to AV projector		X						NFPA 70 527.2
1	2	Emergency light missing	X							FBC 423.17.1
1	3	Emergency light missing	X							FBC 423.17.1
1	4	Emergency light missing	X							FBC 423.17.1
1	6	Emergency light missing	X							FBC 423.17.1
1	5	Lens cover missing		X						NFPA 70 410.3

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *David F. Anderson* DATE: 9.23.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	5H	Exit light not working		X						FBC 1016.3.1
4	5C	Concrete column crumbling by exit door	X							
4	6	Emergency light out		X						FBC 423.17.1
4	6	Roof leak	X							
4	6A	Lenze cover missing		X						NFPA 70 410.3
4	8	No emergency light	X							FBC 423.17.1
4	8A	No emergency light	X							FBC 423.17.1
4	9	No emergency light	X							FBC 423.17.1
4	13	Lenze cover missing; hole in wall		X						NFPA 70 410.3
4	14	Roof leak	X							
4	18	Roof leak; mold	X							
4	19	Emergency light out		X						FBC 423.17.1
4	21	Bad roof leak	X							
4	21C	Lenze cover missing		X						FBC 410.3

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-23-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	125B	Emergency light out		X						FBC 423.17.1
1	125B	Large hole in ceiling/drywall	X							
1	126B	Emergency light not working		X						FBC 423.17.1
1	162	No emergency light	X							FBC 423.17.1
1	119	Evacuation sheet missing		X						FBC 423.14.2.4
1	120	Evacuation sheet missing		X						FBC 423.14.2.4
1	123	Evacuation sheet missing		X						FBC 423.14.2.4
1	122	Evacuation sheet missing		X						FBC 423.14.2.4
1	122	Lens cover missing								
1	118	Emergency light out		X						FBC 423.17.1
1	165	Emergency light out		X						FBC 423.17.1
1	166	Trough cover missing; knockout missing	X							NFPA 312.5
1	128	Lights not working	X							
1	129	Emergency light out		X						FBC 423.17.1

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *D. J. Johnson* DATE: 9.23.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	130	Conduit not secure to wall	X							FBC 423.17.1
10	102	Can light cover missing	X							NFPA 70 410.3
10	110	Emergency light not working		X						
10	116	Two exit light not working		X						FBC 1016.3.1
10	116	Leak at center of stage	X							
10	116	Heat detector loose								
10	116	Old exhaust duct through roof open to outside	X							
10	119	Elevator lift not working; certification not on hand	X							
10	114	Evacuation sheet missing		X						FBC 423.14.2.4
10	114	Light bulb & cover missing		X						NFPA 70 410.3
10	100	Emergency light not working, East end and South end		X						FBC 423.17.1
10	131	Water heater latch/lock broken	X							NFPA 70 312.5
10	122	Ceiling tile missing		X						FBC 804.2.3

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9-23-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	117b	Light not working, lens cover missing		X						NFPA 70 410.3
1	112	Evacuation sheet missing		X						FBC 423.14.2.4
1	113	Evacuation sheet missing		X						FBC 423.14.2.4
1	101	Cover plate missing - old clock	X							NFPA 70 314.1
1	183	No emergency light	X							FBC 423.17.1
1	184	No emergency light	X							FBC 423.17.1
1	100	Fire extinguisher missing		X						NFPA 10-7.6.15
1	154	No emergency light, lense cover missing		X						FBC 423.17.1
1	105B	No emergency light	X							FBC 423.17.1
1	106H	No emergency light	X							FBC 423.17.1
1	106G	Cover plate missing		X						FBC 423.14.2.4
1	107	No evacuation sheet		X						FBC 423.17.1
1	109	No evacuation sheet		X						FBC 423.17.1
1	111	No evacuation sheet		X						FBC 423.17.1



FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

*Deborah A. Ferguson*  
 INSPECTOR'S SIGNATURE

9-23-05

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	180A	Roof leak	X							
21	2	No emergency light	X							FBC 423.17.1
21	4	No emergency light	X							FBC 423.17.1
21		Ceiling tile missing, lens cover missing		X						FBC 804.2.3
21	9	Exit light out		X						FBC 1016.3.1
20	7	AC unit sweating badly causing moisture problem	X							
20	5	Evacuation sheet missing		X						FBC 423.14.2.4
20	10	Evacuation sheet missing		X						FBC 423.14.2.4
20	18A	Hall to exit blocked with desk		X						FBC 1004
20	14	Fire panel missing lever	X							NFPA 70 527.2
20	14	Ceiling tile missing		X						FBC 804.2.3
20	18	Exit light out		X						FBC 1016.3.1
22	2	Extension cord around room		X						NFPA 70 527.2
22	1	Extension cord to strip		X						NFPA 70 527.2
22	2	Hole in wall under AC unit (large)	X							NFPA 70 527.2

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY #: 0007



**COMPREHENSIVE SAFETY INSPECTION REPORT  
STATE BOARD OF EDUCATION  
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
"FIRE SAFETY, CASUALTY SAFETY & SANITATION  
INSPECTION" IN COMPLIANCE WITH  
F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY : ORANGE PARK HIGH SCHOOL  
2300 KINGSLEY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *David L. Swann* DATE: 9.25.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Schedule d for Correctio n	Rule
22	4	EXIT LIGHT OUT		X						FBC 1016.3.1
22	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	9b	STORAGE IN ELECTRICAL ROOM		X						NFPA-70110.26
22	6	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	6	DOOR CLOSURE BROKEN	X							FBC 423.16.10.1
22		FLOODING UNDER WALLS AND UNDER DOORS	X							
22	7	COMPUTER CONDUIT NOT SECURED TO WALL				X				
22	7	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	5	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	8	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
22	9	CEILING OUTSIDE DOOR EXPOSED TO ATTIC(east end)	X							
27	1	LIGHTS NOT WORKING COVERS MISSING		X						NFPA-70 410.3
27	1	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
27	2	NO EMERGENCY LIGHTS IN WHOLE BUILDING	X							FBC 423.17.1

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY # 0007

**COMPREHENSIVE SAFETY INSPECTION REPORT**  
**STATE BOARD OF EDUCATION**  
**ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5**  
**"FIRE SAFETY, CASUALTY SAFETY & SANITATION**  
**INSPECTION" IN COMPLIANCE WITH**  
**F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

*Dan R. Brown*  
 INSPECTOR'S SIGNATURE DATE 9.23.05



Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
27	6	CEILING TILE MISSING		X						FBC 804.2.3
27	3	EXIT LIGHT OUT		X						FBC 1016.3.1
27	3	ELECTRICAL PANEL BLOCKED WITH STORAGE		X						NFPA-70 160.26
27	10	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
16	1c	EXIT LIGHT MISSING	X							FBC 1016.3.1
16		NO EMERGENCY LIGHTS WHOLE BUILDING	X							FBC 423.17.1
16	5	EXTENSION CORD TO STRIP		X						NFPA-70 527.2
17		NO EMERGENCY LIGHTS WHOLE BUILDING	X							FBC 423.17.1
17	1	ROOF LEAK	X							
17	2	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
17	4	EXTENSION CORD PLUGGED INTO EACH OTHER		X						NFPA-70 527.2
17	8	EXTENSION CORD PLUGGED INTO EACH OTHER		X						NFPA-70 527.2
17	8	SECOND EXIT BLOCKED BY FILING CABINET		X						NFPA-1 4.4.3.1

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

9-23-05

INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
18		NO EMERGENCY LIGHTS WHOLE BUILDING (classrooms)	X							FBC 1016.3.1
18	2	TV STAND TO LOW NEEDS PADDING		X						NFPA-17.6.2
18	7	EMERGENCY LIGHT IN HALL NOT WORKING		X						FBC 1016.3.1
19		NO EMERGENCY LIGHTS IN CLASSROOMS	X							FBC 423.17.1
19	2	CEILING TILE MISSING		X						FBC 804.2.3
19	3	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	4	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	7	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	8	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
19	8	CEILING TILE MISSING		X						FBC 804.2.3
24	5	OUTLET COVER BROKEN		X						NFPA-70 314.1
24	14	CEILING TILE MISSING		X						FBC 804.2.3
24	14	CAN LIGHT MISSING	X							FBC 423.17.1
24	16	CAN LIGHT MISSING	X							FBC 423.17.1

FISCAL YEAR 2005-2006

DISTRICT: CLAY FACILITY #: 0007



**COMPREHENSIVE SAFETY INSPECTION REPORT  
STATE BOARD OF EDUCATION  
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
"FIRE SAFETY, CASUALTY SAFETY & SANITATION  
INSPECTION" IN COMPLIANCE WITH  
F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY : ORANGE PARK HIGH SCHOOL  
2300 KINGSLEY AVENUE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *Raymond J. Swann* DATE: 9.23.05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Schedule d for Correctio n	Rule
24	18	CEILING TILE MISSING		X						FBC 804.2.3
24	23	FOUR-WHEELER IN STORAGE AREA		X						NFPA-1 12-1.1
24	30	CEILING TILE MISSING		X						FBC 804.2.3
24	32	CEILING TILE MISSING		X						FBC 804.2.3
41	1	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
41	2	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
41	3	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
41	4	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
43		EMERGENCY LIGHT MISSING	X							FBC 423.17.1
43		GAS GRILL W/ PROPANE TANK		X						NFPA-1 21-3.3.5
47		EMERGENCY LIGHT MISSING	X							FBC 423.17.1
47		GAS GRILL W/ PROPANE TANK		X						NFPA-1 21-3.3.5
47	2	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

FISCAL YEAR 2005-2006



COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION  
 INSPECTION" IN COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101

DISTRICT: CLAY FACILITY # 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *David A. Jordan* DATE: 9-29-05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
46	1	LIGHT COVER MISSING		X						NFPA-70 410.3
46	4	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
46	4	LENSE COVER MISSING		X						NFPA-70 410.3
50		TRACTOR STORED UNDER SOUTH BLEACHERS		X						NFPA-1 12-1.1
51	2	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
51	2	FIRE ALARM NOT CERTIFIED	X							NFPA-11-10.1
51	4	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
51	5	EMERGENCY LIGHT MISSING	X							FBC 423.17.1
51	7	COVER PLATE MISSING	X							NFPA-70 314.1
51	7	LIGHT COVER PLATE MISSING	X							NFPA-70 314.1
51	18	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
 COMPLIANCE WITH  
 F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

INSPECTOR'S SIGNATURE: *[Signature]* DATE: 9/23/05

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	13	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	25	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	25	LOOSE BOARD ON RAMP/ NAIL STICKING UP		X						FBC 423.14.2.4
92	28	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	29	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	31	EMERGENCY EVACUATION SHEET MISSING								FBC 423.14.2.4
92	32	EMERGENCY EVACUATION SHEET MISSING								FBC 423.14.2.4
92	41	OUTLET COVER MISSING BY PANEL	X							NFPA-70 314.1
92	41	SMALL HOLE IN WALL BY RAMP DOOR	X							
92	42	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
92	43	FILING CABINET IN FRONT OF PANEL		X						NFPA-70 314.1
92	44	EMERGENCY EVACUATION SHEET MISSING								FBC 423.14.2.4
92	44	BOOKCASE IN FRONT OF PANEL								NFPA-70 314.1
92	46	EMERGENCY EVACUATION SHEET MISSING								FBC 423.14.2.4

FISCAL YEAR 2005-2006

COMPREHENSIVE SAFETY INSPECTION REPORT  
 STATE BOARD OF EDUCATION  
 ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
 "FIRE SAFETY, CASUALTY SAFETY & SANITATION INSPECTION" IN  
 COMPLIANCE WITH

F.S. 1013.12, 1013.20 & NFPA 101



DISTRICT: CLAY FACILITY #: 0007

FACILITY : ORANGE PARK HIGH SCHOOL  
 2300 KINGSLEY AVENUE  
 ORANGE PARK, FLORIDA 32073

INSPECTION DATE: SEPTEMBER 23, 2005

*[Signature]*  
 INSPECTOR'S SIGNATURE

DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	24	OK								
92	26	OK								
92	27	OK								
92	45	OK								
92	***	REPLACE WOOD RAMPS TO MEET ADA REQ.	X							FBC 4.8.4