


**TYNNE S**

**ELEMENTARY SCHOOL**

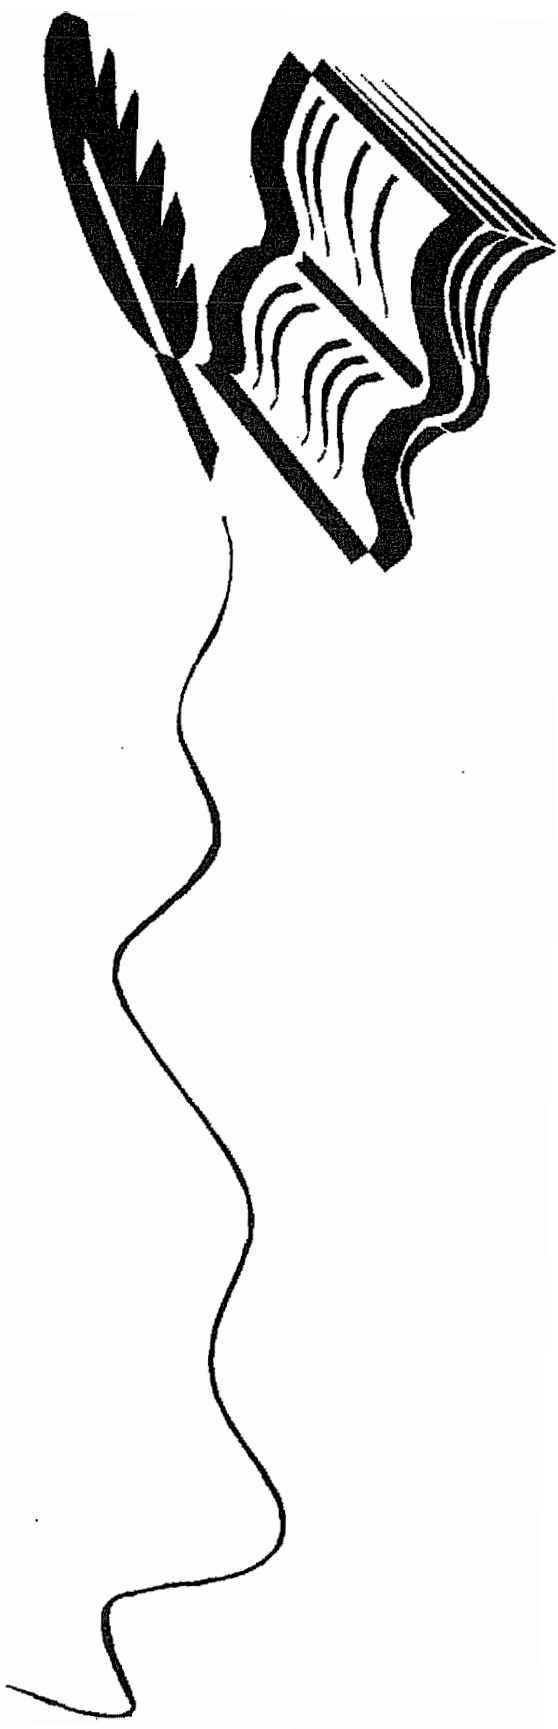

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



DISTRICT: CLAY FACILITY #: 0040

FACILITY: TYNES ELEMENTARY SCHOOL  
1550 TYNES BOULEVARD  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 14, 2005

*[Signature]*  
INSPECTOR'S SIGNATURE

*Dec 14, 2005*  
DATE


ANNUAL PERMANENT BUILDING INSPECTION  
 ANNUAL RELOCATABLE BUILDING INSPECTION  
FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

TYPE OF INSPECTION

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	144	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2
2	238	STORAGE AROUND WATER HEATER - MOVE		X						NFPA 70

**W. F. CHERRY**

**ELEMENTARY SCHOOL**

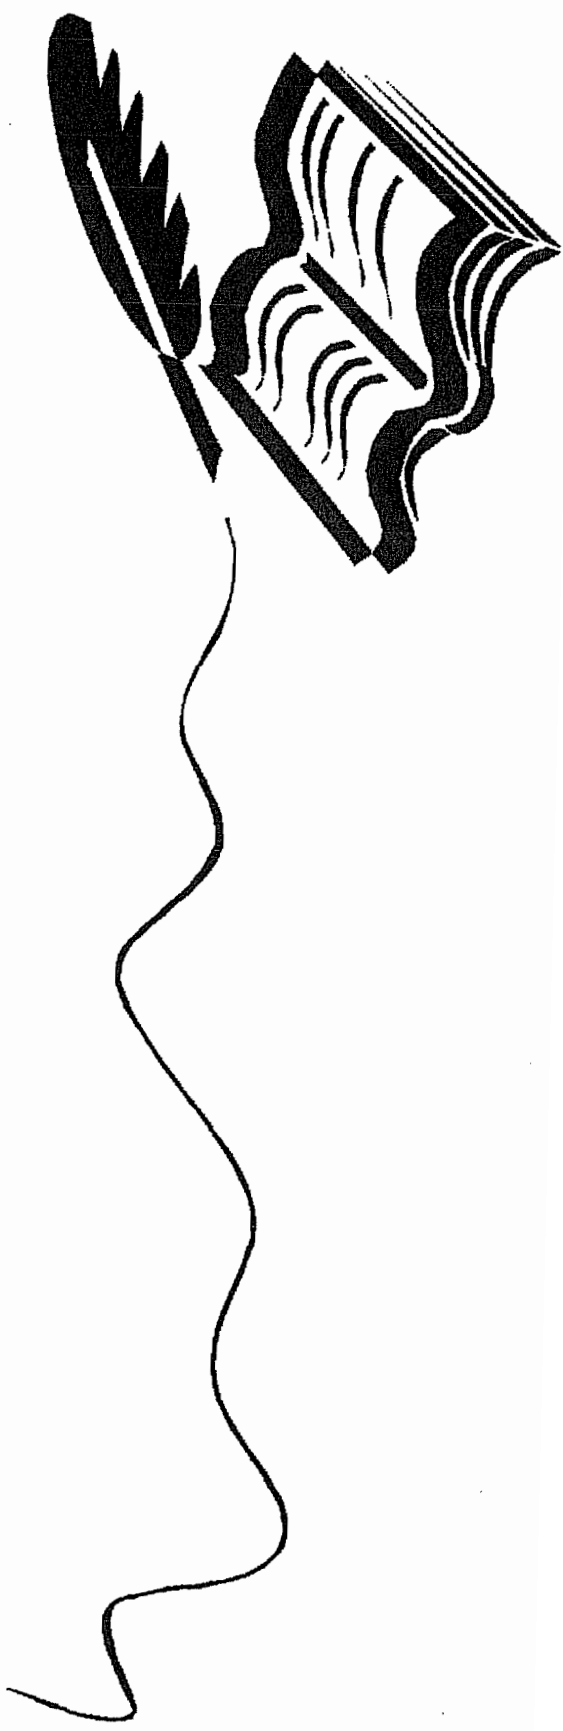

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION    
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY     FACILITY #: 0006

FACILITY: W. E. CHERRY ELEMENTARY SCHOOL  
420 EDISON DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: DECEMBER 12, 2005

INSPECTOR'S SIGNATURE: *Ted Sweetman*     DATE: Dec 12, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	47	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	53	WHEEL CHAIR LIFT NOT CERTIFIED								
2	75	EXIT LIGHT OUT		X						FBC 423.17.1
2	75	CEILING TILE OUT, WIRES EXPOSED								FBC 804.2.3
3	55	OCCUPANT LOAD SIGN MISSING		X						FBC 423.16.2
3	55B	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
3	64	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	15	FIRE EXTINGUISHER MISSING		X						69A-36
4	14	FIRE EXTINGUISHER MISSING		X						69A-36
4	71	LENS MISSING ON LIGHT FIXTURES		X						

FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58




TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION   
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY    FACILITY #: 0006

FACILITY: W. E. CHERRY ELEMENTARY SCHOOL  
420 EDISON DRIVE  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: DECEMBER 12, 2005

  
 INSPECTOR'S SIGNATURE    DATE: Dec 12, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	29	OK								
92	30	OK								
92	31	OK								
92	32	OK								
92	33	OK								
92	34	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	36	OK								
92	37	GRILL MISSING		X						
92	38	LIGHT FIXTURE LOOSE		X						
92	39	OK								
92	40	OK								
92	41	OK								

FISCAL YEAR 2005-2006

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



TYPE OF INSPECTION

ANNUAL PERMANENT BUILDING INSPECTION     ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0006

FACILITY: W. E. CHERRY ELEMENTARY SCHOOL  
420 EDISON DRIVE  
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: DECEMBER 12, 2005

INSPECTOR'S SIGNATURE: [Signature] DATE: Dec 12, 2005

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	42	OK								
92	43	GLOBE ON CLOSET LIGHT MISSING		X						
92	47	OK								
92	49	OK								
92	50	OK								
92	51	OK								
92	54	WIRE STICKING OUT OF HEAT DETECTOR	X							
92	54	GLOBE ON CLOSET LIGHT MISSING		X						
92	54	EMERGENCY LIGHT INOPERABLE	X							FBC 423.17.1

**WILLKINSON**

**ELEMENTARY SCHOOL**

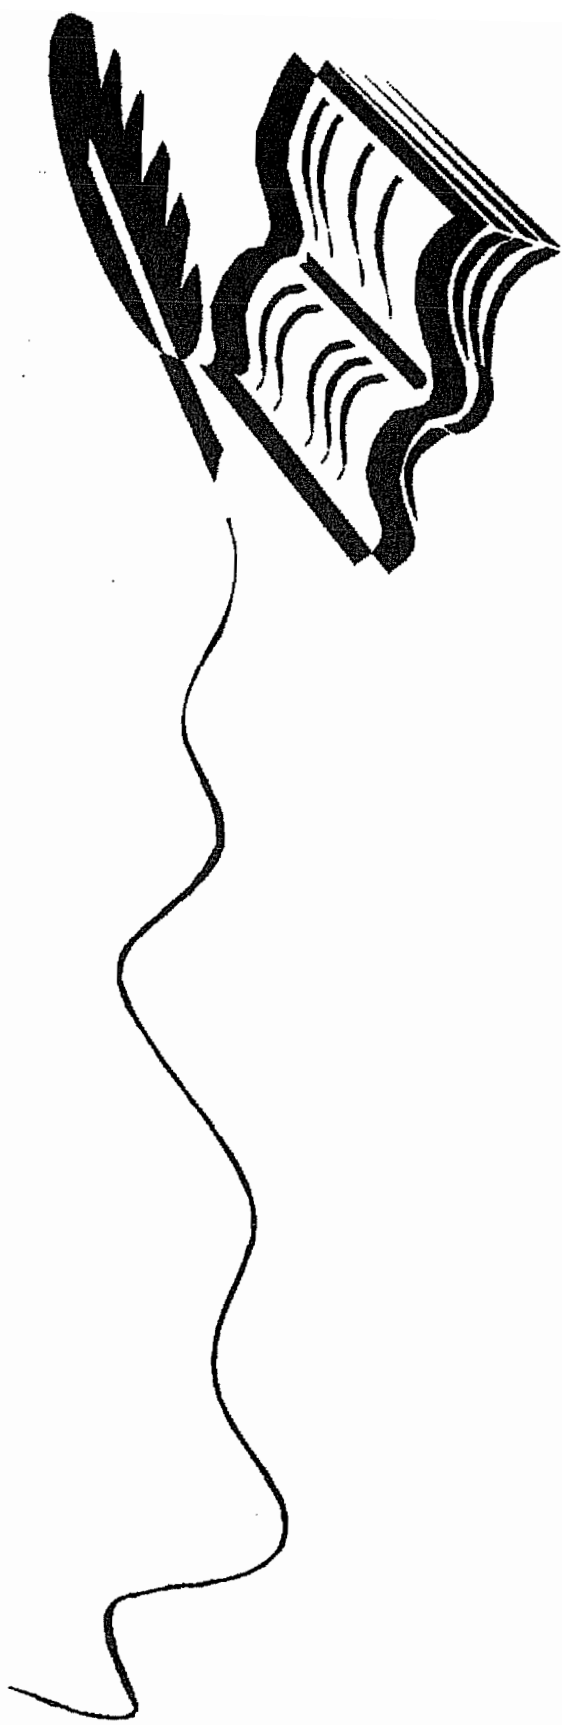

**FISCAL YEAR 2005-2006**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58**



DISTRICT: CLAY FACILITY #: 0026

FACILITY: J.L. WILKINSON ELEMENTARY SCHOOL  
4965 C.R. 218  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 10, 2006

**TYPE OF INSPECTION**

ANNUAL PERMANENT BUILDING INSPECTION    
  ANNUAL RELOCATABLE BUILDING INSPECTION  
 FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

INSPECTOR'S SIGNATURE: *[Signature]* DATE: Jan 10, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	126	PHONE PANEL - NO COVER, BIG MESS				X				NFPA 70 110-12
1	127	EXTENSION CORD NEEDS ELECTRICAL OUTLET		X						NFPA 70 400-8
2	226	EXIT LIGHT OUT		X						FBC 1016.3.1
20	R2	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	305	EXT. NOT WITHIN 15 FT RANGE		X						NFPA 70
5	511	EMERGENCY LIGHT OUT		X						FBC 423.17.1



FISCAL YEAR 2005-2006

FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12 & RULE 69A-58



ANNUAL PERMANENT BUILDING INSPECTION     ANNUAL RELOCATABLE BUILDING INSPECTION  
FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

TYPE OF INSPECTION

DISTRICT: CLAY    FACILITY # 0026

FACILITY: J.L. WILKINSON ELEMENTARY SCHOOL  
4965 C.R. 218  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 10, 2006

INSPECTOR'S SIGNATURE: *Tom Swearingen*    DATE: Jan 10, 2006

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	7	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	5	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	8	REPLACE NON SKID		X						FBC 11-4.8
92	9	EXIT FANS NOT WORKING	X							FBC 423.17.1
92	10	RAMP IN POOR CONDITION	X							FBC 11-4.8
92	11	RAMP IN POOR CONDITION	X							FBC 11-4.8
92	33	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	34	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	61	EMERGENCY LIGHT BUTTON NOT WORKING		X						FBC 423.17.1