



# ANCILLARIES

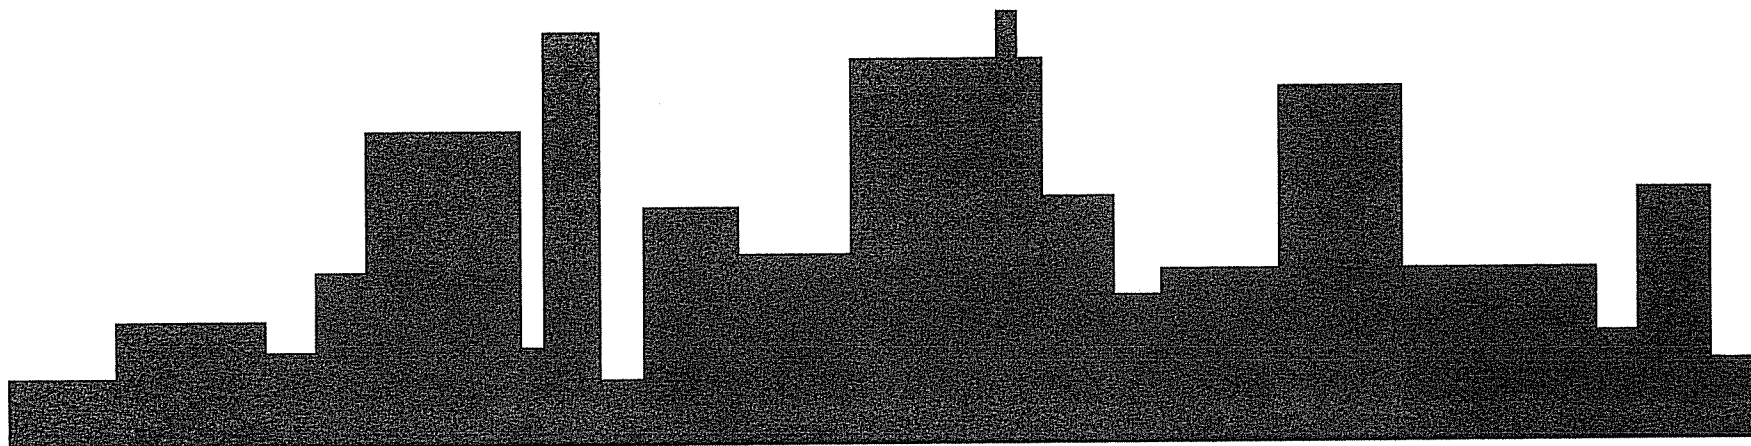

Administrative Office

Orange Park Annex

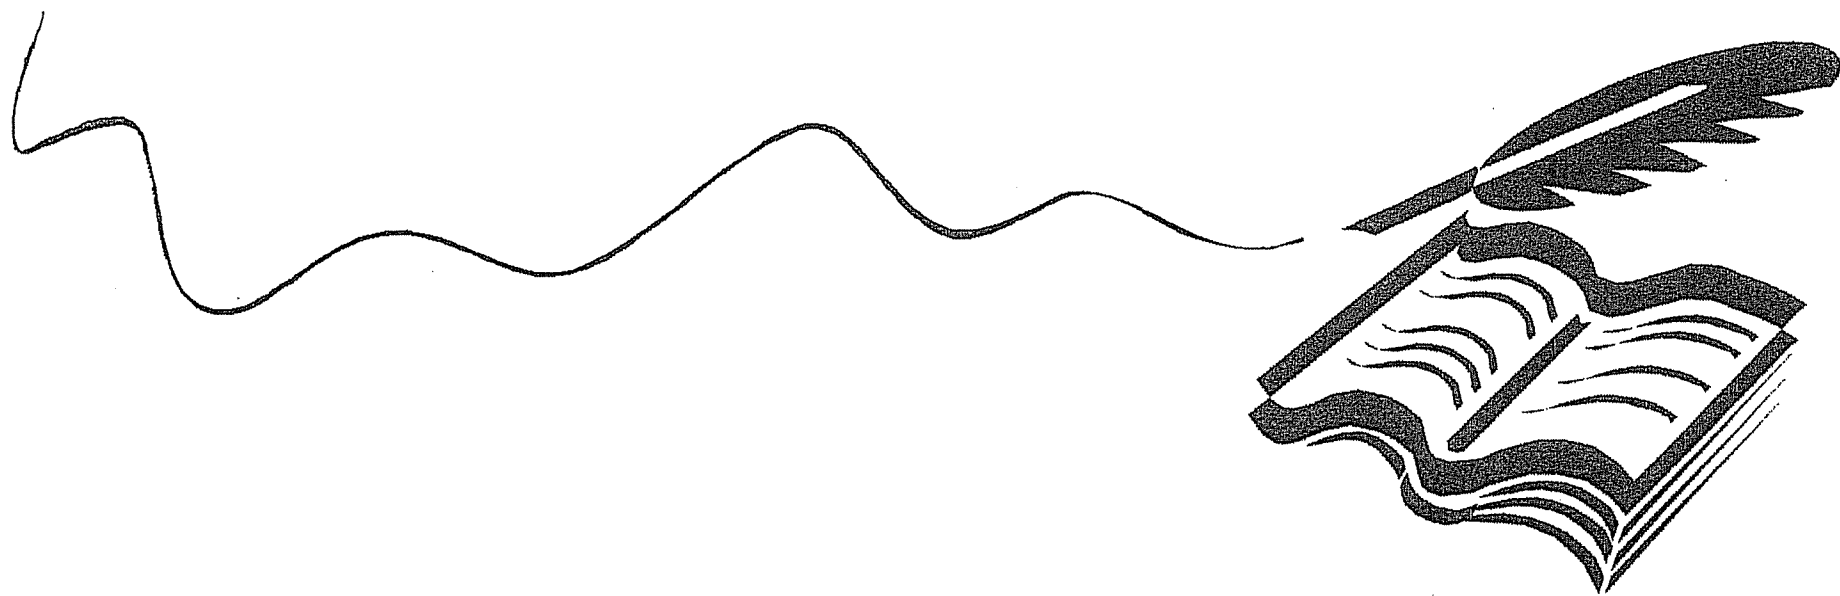

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0034

FACILITY: ADMINISTRATIVE OFFICE ORANGE PARK ANNEX  
2300 KINGSLEY AVENUE  
ORANGE PARK, FLORIDA 32073

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: OCTOBER 30, 2008


FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED:       

*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE

10-30-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16	11	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Clay  
Superintendents  
Office

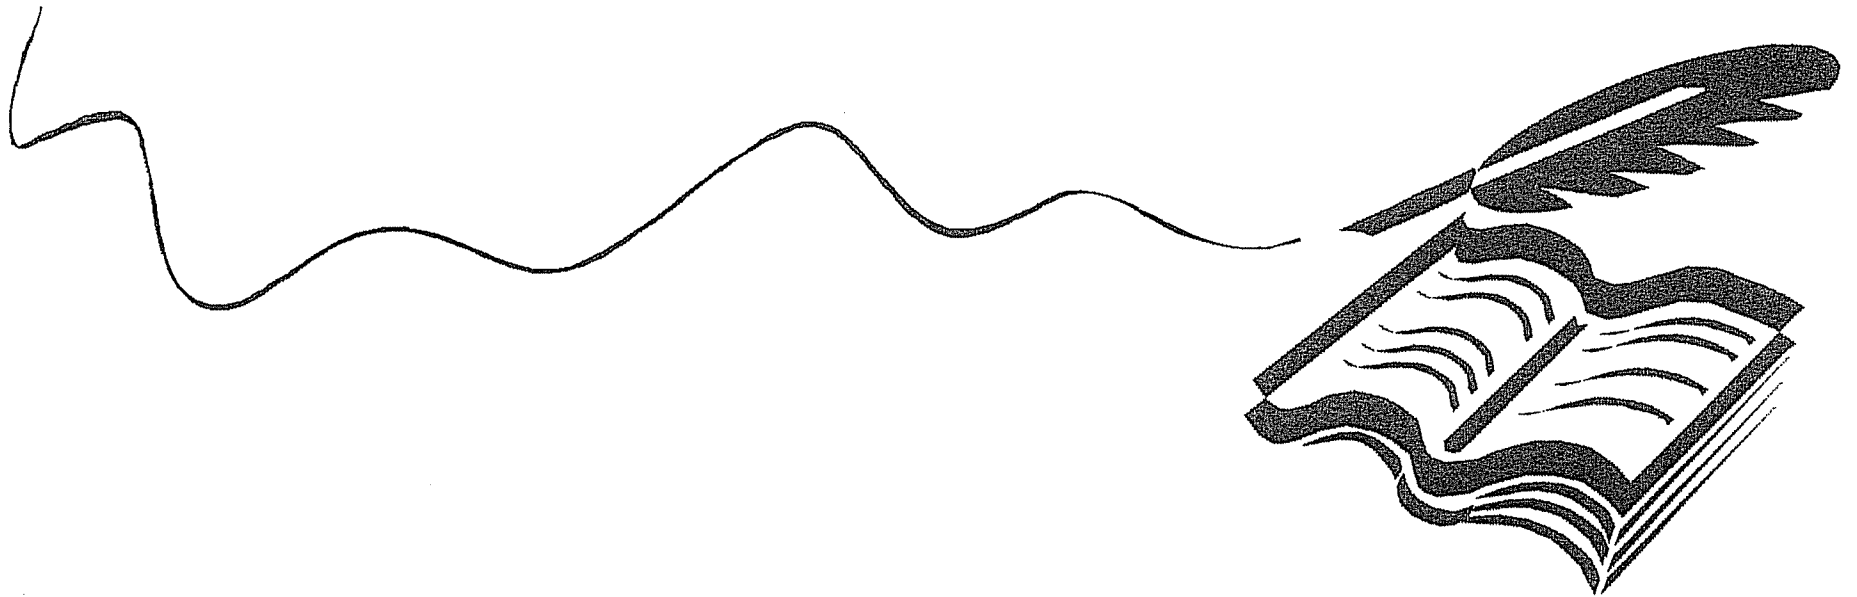

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0036

FACILITY: CLAY SUPERINTENDENT'S OFFICE  
900 WALNUT AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 2, 2009


  
INSPECTOR'S SIGNATURE

2-2-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	7	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	7A	CLEAR PATH TO EXIT		X						

Food Services

Storage

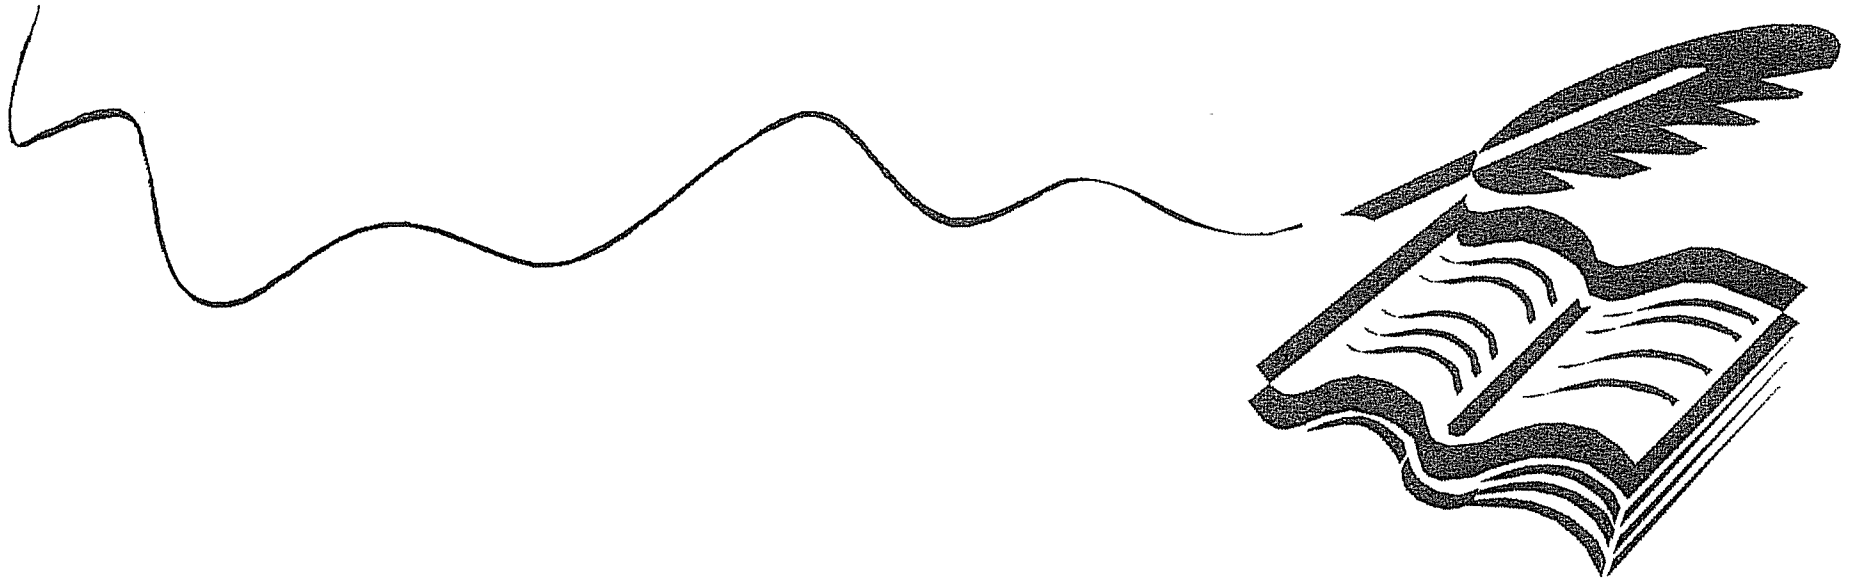

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES**

**FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0037

FACILITY: FOOD SERVICE STORAGE  
720 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 9, 2009


  
INSPECTOR'S SIGNATURE

2-9-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
95	1	OK								

Harris C. Long

Administration

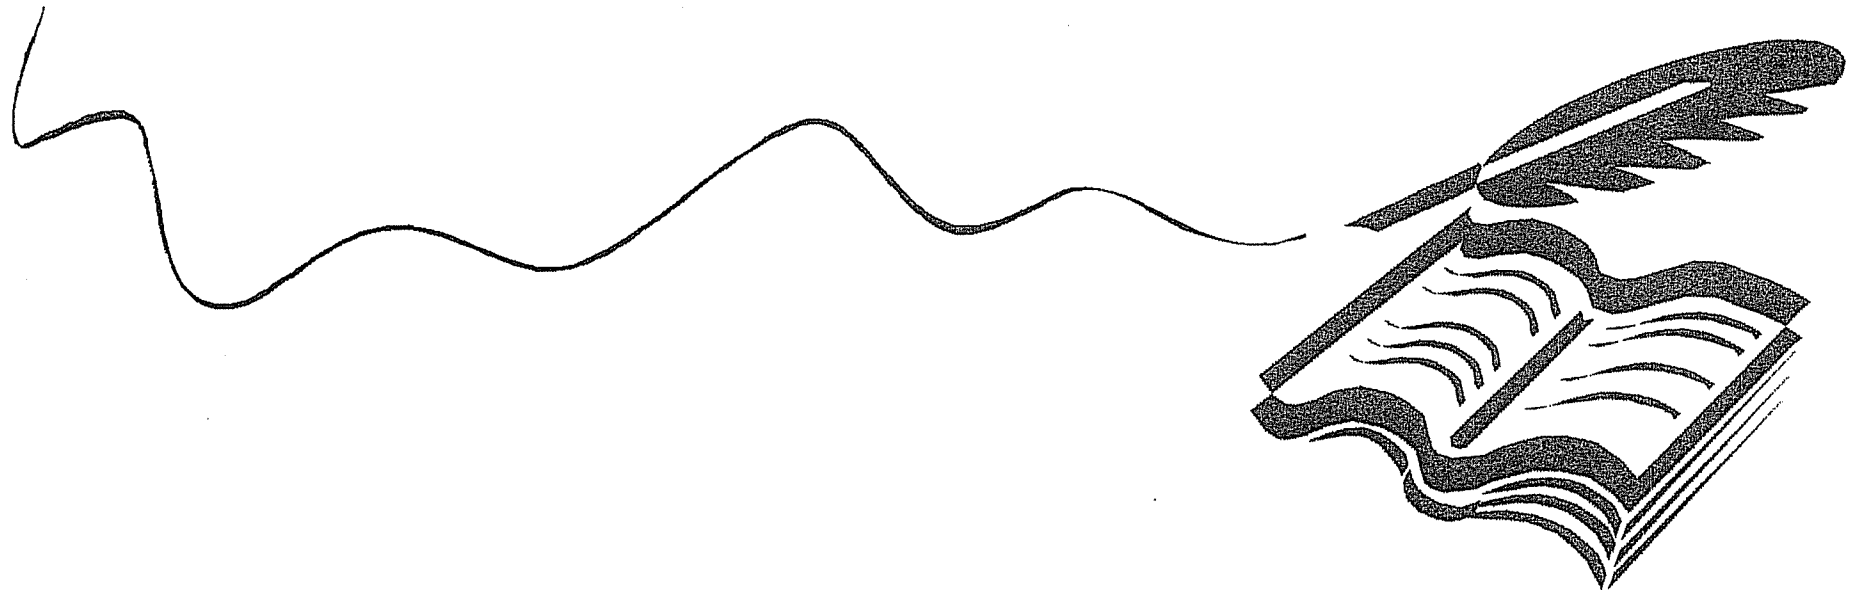



**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0027

FACILITY: HARRIS C. LONG ADMINISTRATION  
23 SOUTH GREEN STREET  
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: FEBRUARY 9, 2009

*[Signature]*  
INSPECTOR'S SIGNATURE DATE 2-9-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	100	BOTH EMERGENCY LIGHTS OUT		X						FBC 423.17.1
3	300	BOTH EMERGENCY LIGHTS OUT		X						FBC 423.17.1
3	309	OUTLET COVER MISSING		X						NFPA 70

Keystone Heights

Transportation

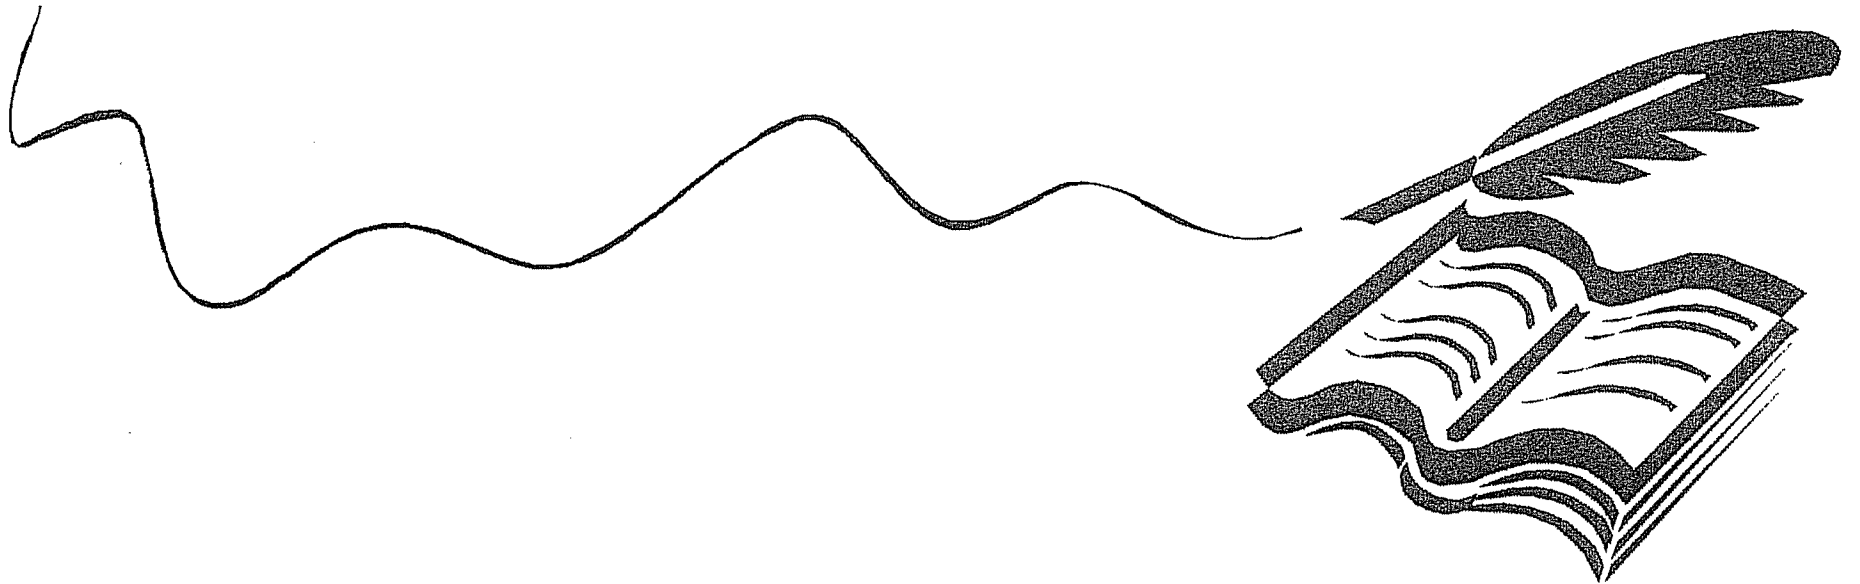

**FISCAL YEAR 2009-2010**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES**

**FLORIDA STATUTES 1013.12, 1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0037

FACILITY: KEYSTONE HEIGHTS TRANSPORTATION  
6800 COUNTY ROAD 315  
KEYSTONE HEIGHTS, FLORIDA 32656

INSPECTION DATE: FEBRUARY 13, 2009


*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE

2-13-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
802	1	OK								

Middelleburg

Transportation

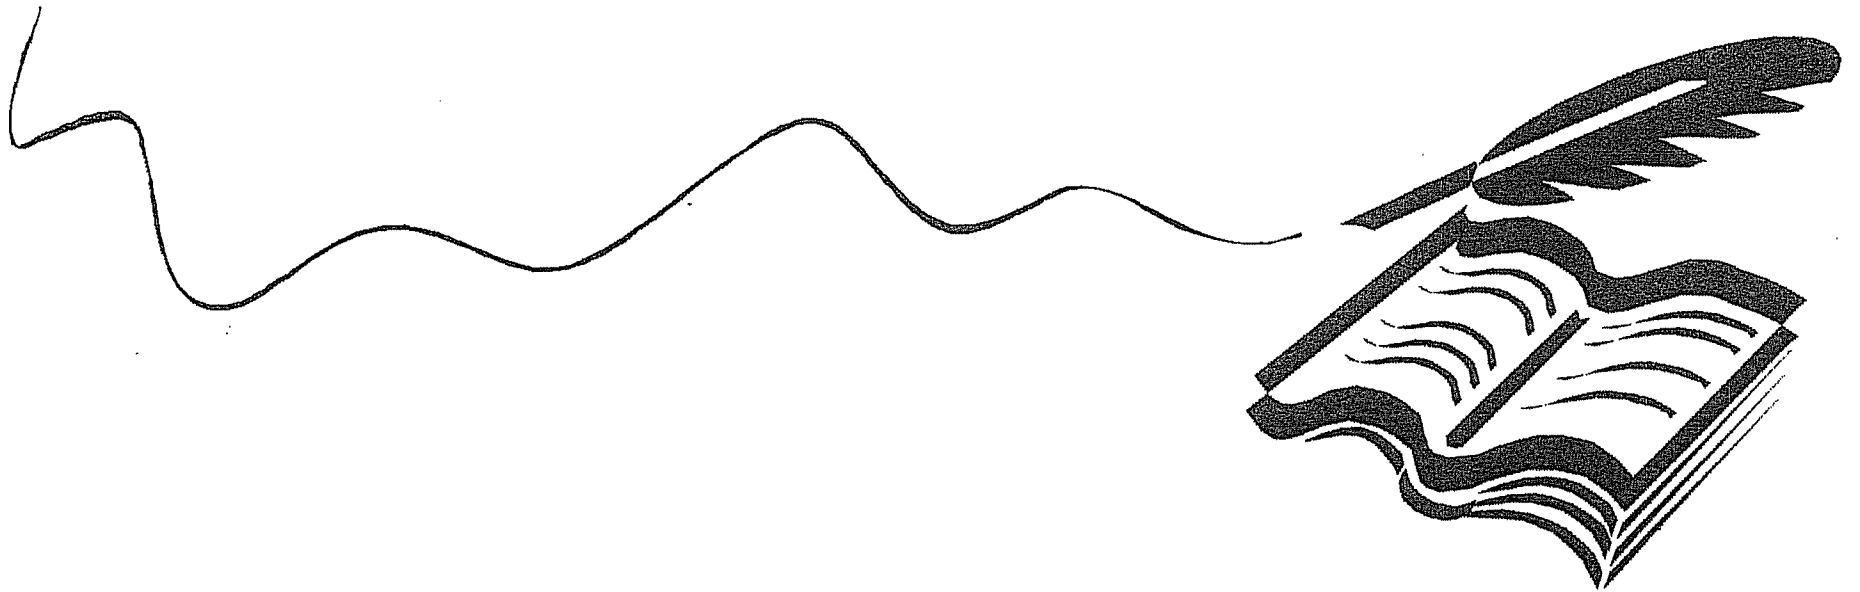

FISCAL YEAR 2008-2009


DISTRICT: CLAY FACILITY #: 0033



**COMPREHENSIVE SAFETY & SANITATION  
INSPECTION REPORT  
STATE BOARD OF EDUCATION  
ADMINISTRATIVE RULES S.R.E.F. - CHAPTER 5  
"CASUALTY SAFETY & SANITATION INSPECTION"  
IN COMPLIANCE WITH  
F.S. 1013.12, 1013.20 & NFPA 101**

FACILITY: MIDDLEBURG TRANSPORTATION  
3674 COUNTY ROAD 220  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 16, 2009


  
INSPECTOR'S SIGNATURE

2-16-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	1	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

School Buses

Garage

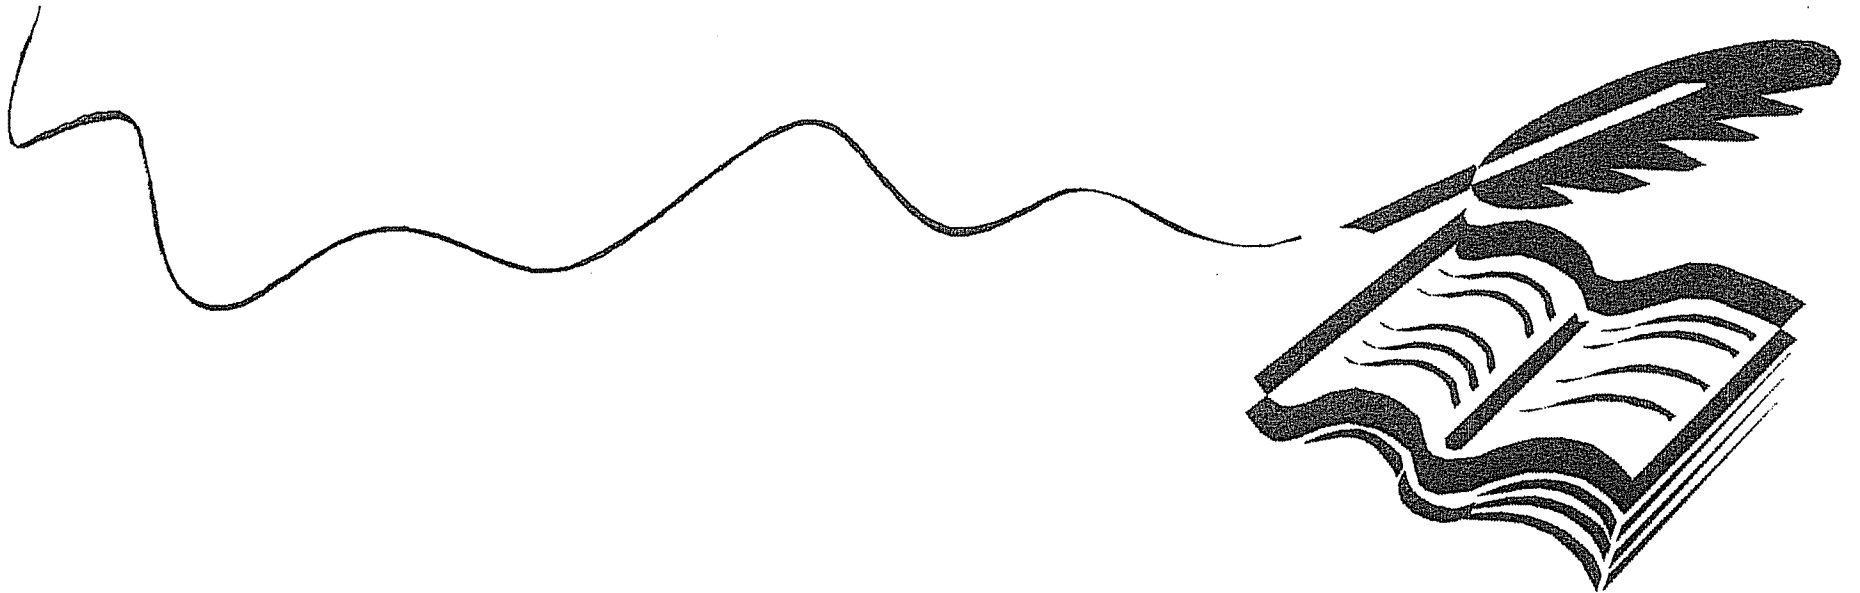

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0030

FACILITY: SCHOOL BUS GARAGE – TRANSPORTATION  
800 CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 9, 2009

  
INSPECTOR'S SIGNATURE


2-9-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	200	EMERGENCY LIGHT OUT		X						FBC 423.17.1



Support Services

AG Lat

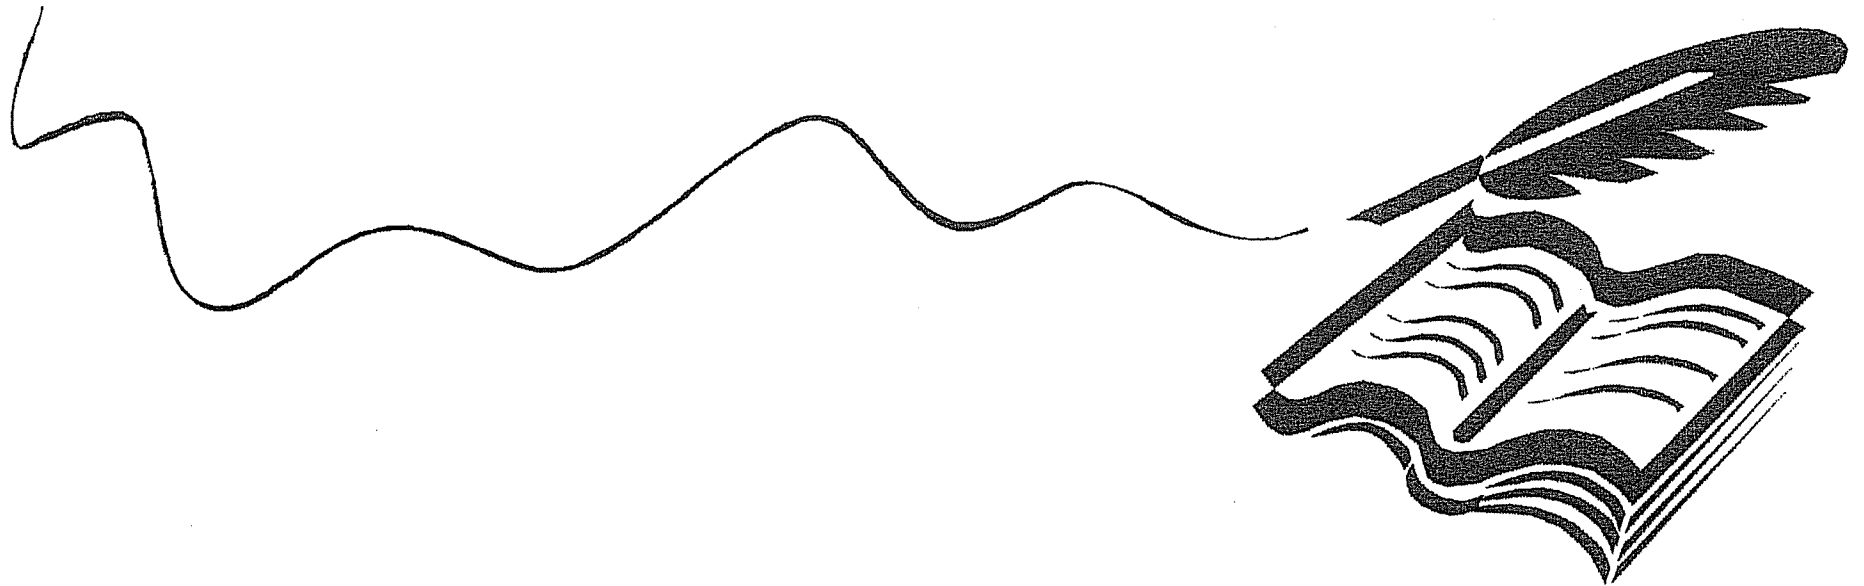



**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES**

**FLORIDA STATUTES 1013.12, 1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NA NUMBER OF DRILLS PERFORMED: NA

DISTRICT: CLAY FACILITY #: 0028

FACILITY: SUPPORT SERVICES AG LOT  
ROBERTS STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 6, 2009


*[Signature]*  
INSPECTOR'S SIGNATURE

2-6-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
90	1	OK								
95	2	NOT OCCUPIED								
95	3	NOT OCCUPIED								
95	4	NOT OCCUPIED								
95	5	NOT OCCUPIED								
95	6	NOT OCCUPIED								

Support Services

Center

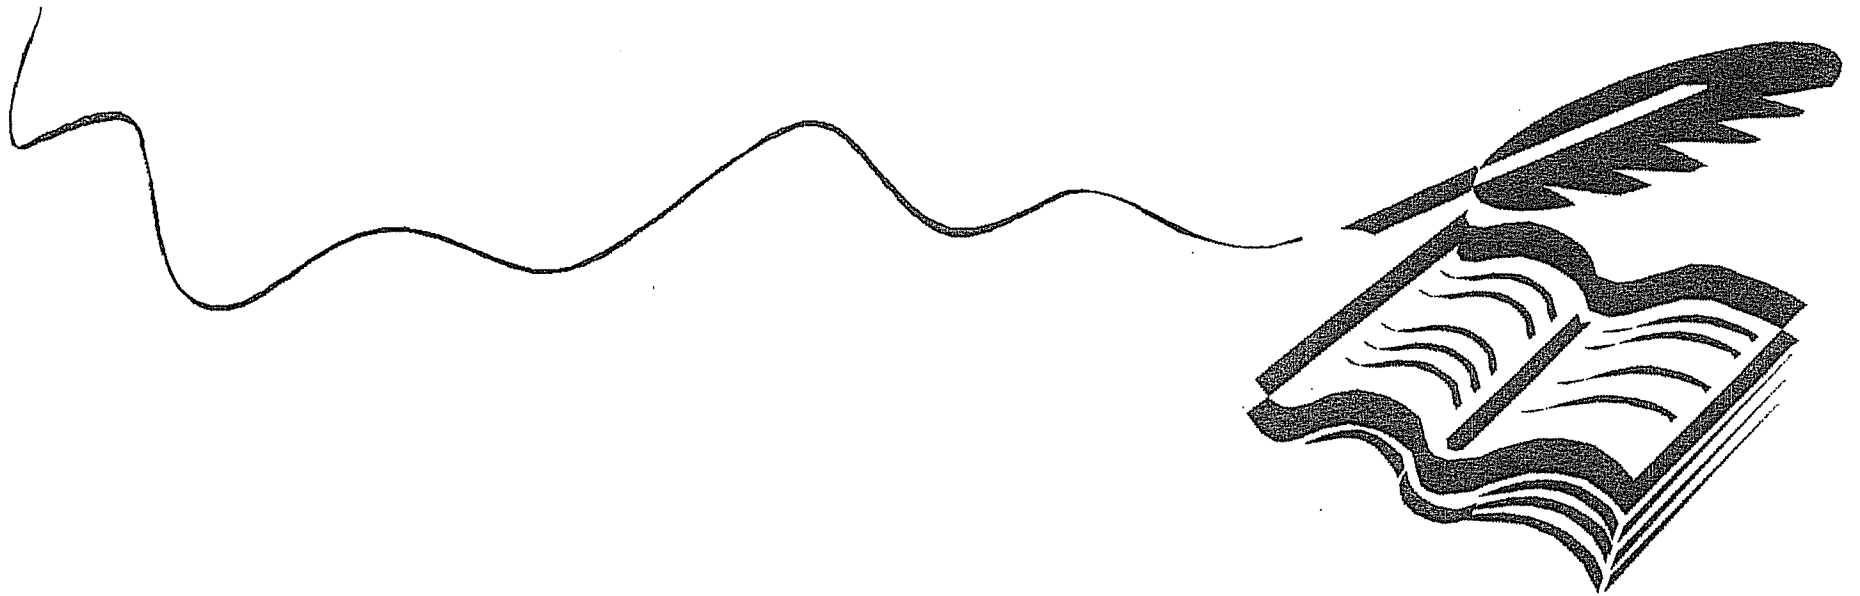

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: N/A NUMBER OF DRILLS PERFORMED: N/A

DISTRICT: CLAY FACILITY #: 0029

FACILITY: SUPPORT SERVICES CENTER  
925 WEST CENTER STREET  
GREEN COVE SPRINGS, FLORIDA 32043

INSPECTION DATE: FEBRUARY 6, 2009

*[Signature]*  
INSPECTOR'S SIGNATURE

2-6-09  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	32	EXIT STAIRS – REPLACE HANDRAILS/SOME STEPS	X							FBC 11.5
1	42	EXIT LIGHT / BULBS OUT		X						FBC 1006.3.1
1	11A	EMERGENCY LIGHT WEAK		X						FBC 423;17/1