


Oakleaf School

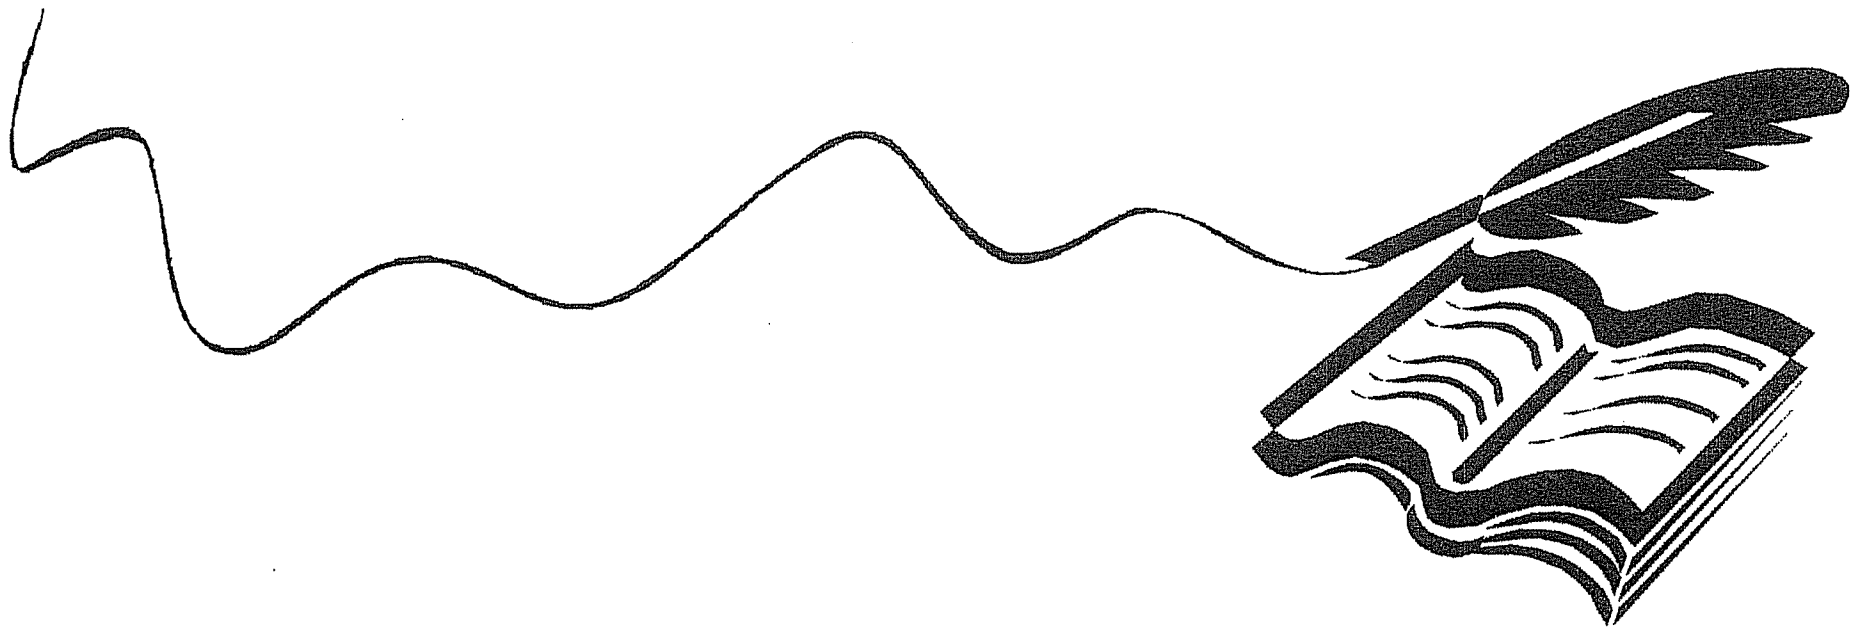

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0611

FACILITY: OAKLEAF SCHOOL
4085 PLANTATION OAKS BOULEVARD
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: DECEMBER 3, 2008

Garrett Brown
INSPECTOR'S SIGNATURE

12-3-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	213	MAGNETIC DOOR HOLDER BROKEN	X							FBC 705.1.3.2.3
1	226	SEAL AROUND SPRINKLER PIPE IN FLAMMABLE STORAGE ROOM	X							
1	111A	STORAGE TO HIGH IN CLOSET		X						NFPA 13.8.5.5.3
1	909	DOOR SWINGS IN WRONG DIRECTION	X							
1	419	STORAGE TO HIGH IN CLOSET		X						NFPA 13.8.5.5.3
5	505	OCCUPANCY LOAD SIGN MISSING		X						FBC 423.14.2.2

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0611

FACILITY: OAKLEAF SCHOOL
4085 PLANTATION OAKS BOULEVARD
ORANGE PARK, FLORIDA 32065


INSPECTION DATE: DECEMBER 3, 2008

Samuel J. ...
INSPECTOR'S SIGNATURE 12-3-08
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	816	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	818	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	821	EVACUATION SHEET MISSING		X						FBC 423.17.1
92	824	EVACUATION SHEET MISSING		X						FBC 423.17.1

Orange Park

Elementary School

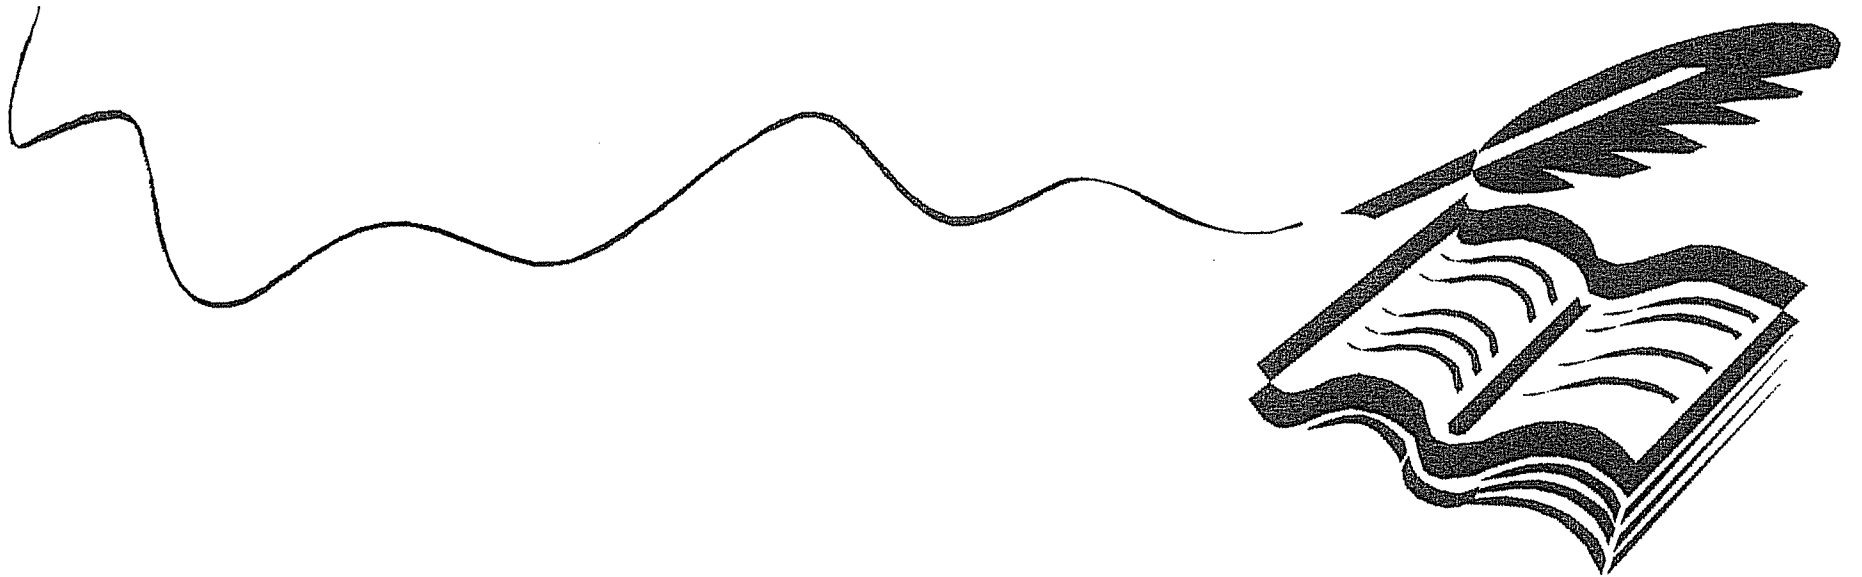

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0004

FACILITY: ORANGE PARK ELEMENTARY SCHOOL
1401 PLAINFIELD AVENUE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 14, 2009

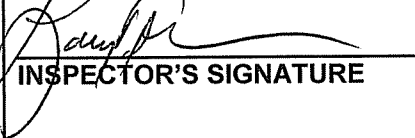

INSPECTOR'S SIGNATURE

1-14-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	50	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

R. M. Paterson

Elementary School

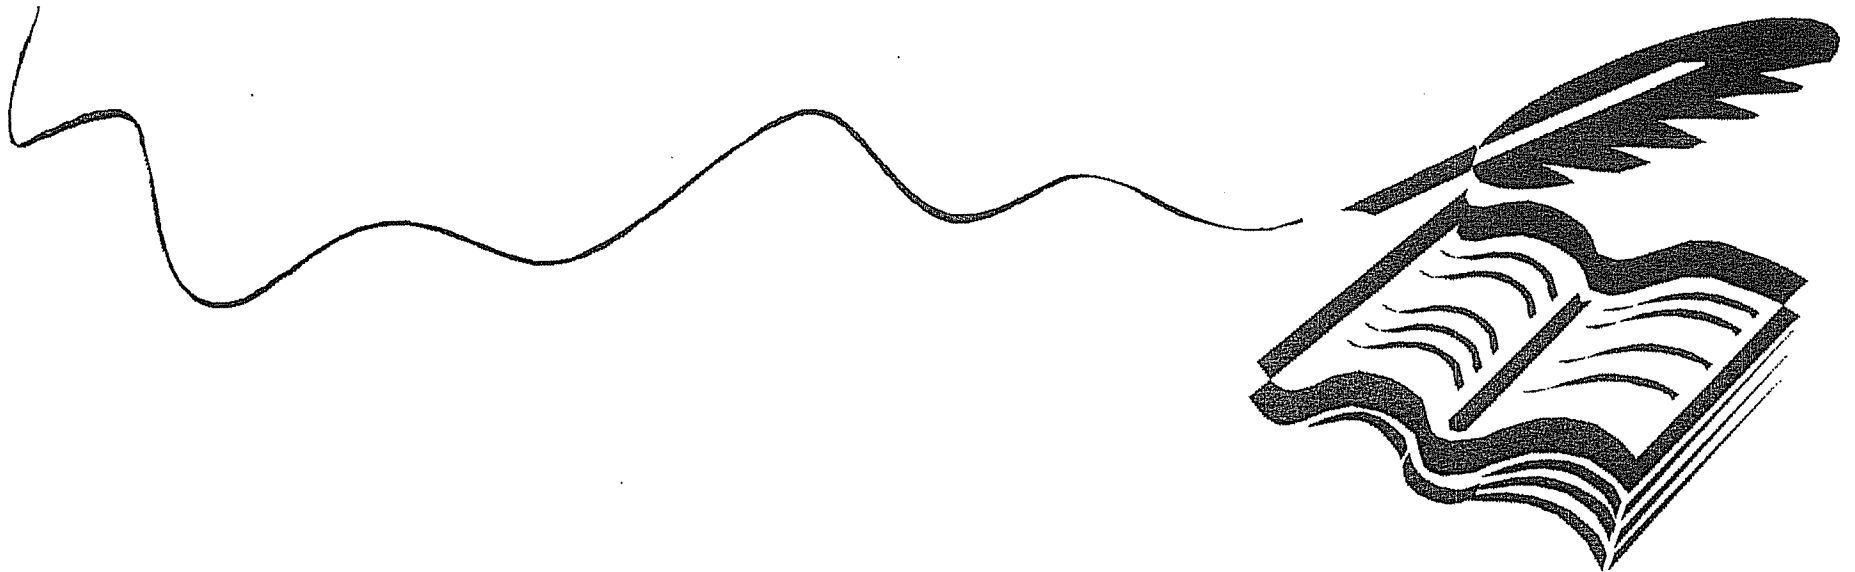

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 22, 2009

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 5

[Signature]
INSPECTOR'S SIGNATURE

1.22.09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	113	STORAGE IN ELECTRICAL CLOSET – REMOVE		X						NFPA 70
1	122	CLASSROOM NOT BY DESIGN – CHANGE DOOR SWING OR STOP USING AS CLASSROOM		X						FBC 423
1	133	STORAGE IN ELECTRICAL ROOM – REMOVE		X						NFPA 70
5	526	EMERGENCY EVACUATION SHEET MISSING								FBC 423.14.2.2
6	622	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.2
6	630	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0024

FACILITY: ROBERT M. PATERSON ELEMENTARY SCHOOL
5400 PINE AVENUE
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: JANUARY 22, 2009


[Signature]
INSPECTOR'S SIGNATURE

1/22/09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	50	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

Ride Out

Elementary School

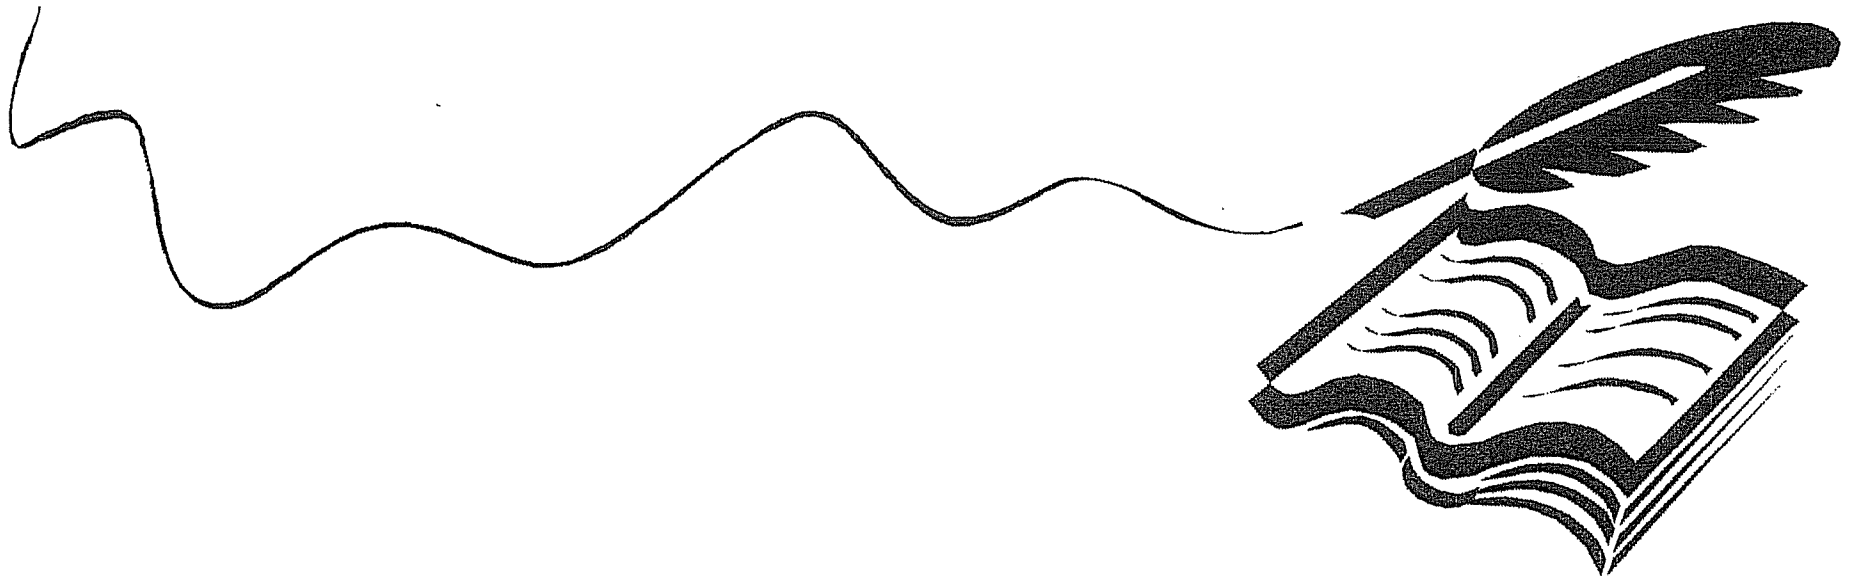

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 20, 2009

[Signature]
INSPECTOR'S SIGNATURE 1-20-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		NO VIOLATIONS								

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0043

FACILITY: RIDEOUT ELEMENTARY SCHOOL
3065 APALACHICOLA BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: JANUARY 20, 2009


[Signature]
INSPECTOR'S SIGNATURE

1-20-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	12	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	13	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	14	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	22	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	24	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Ridgewood

Elementary School

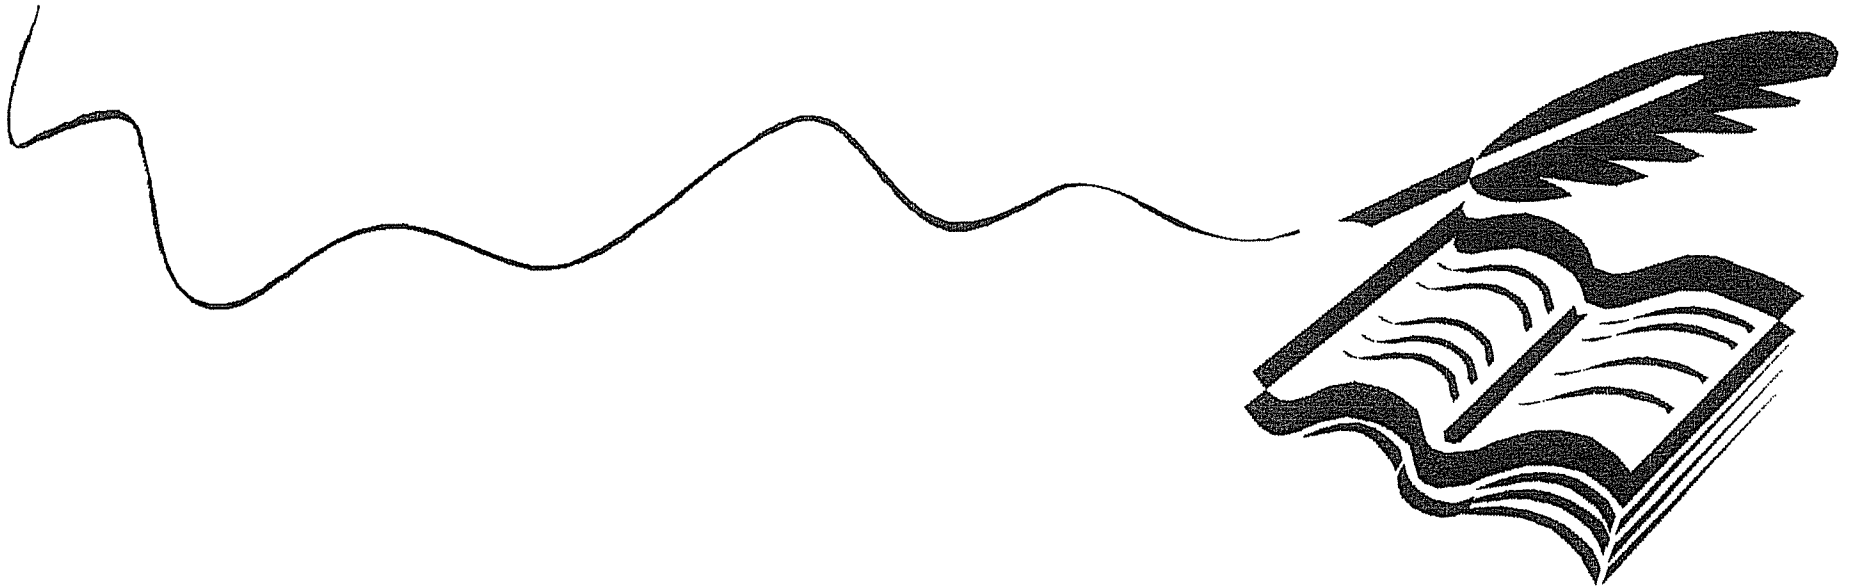

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: FEBRUARY 16, 2009

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 7

[Signature]
INSPECTOR'S SIGNATURE DATE 2-16-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	223	EXIT LIGHT NOT WORKING		X						FBC 1016.3
2	201	EXIT LIGHT NOT WORKING		X						FBC 1016.3
6	616	STORAGE IN MECHANICAL ROOM		X						FBC 423.20
6	621	STORAGE IN ELECTRICAL ROOM		X						NFPA 70
6	607	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	703	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	704	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	705	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	706	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	707	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	708	TV TO LOW – NEEDS PADDING		X						FBC 423.14.3
7	702	32" MINIMUM WIDTH CLEARANCE @BACK DOOR		X						FBC 423.20.1

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 7

DISTRICT: CLAY FACILITY #: 0020

FACILITY: RIDGEVIEW ELEMENTARY SCHOOL
421 JEFFERSON AVENUE
ORANGE PARK, FLORIDA 32065

INSPECTION DATE: FEBRUARY 16, 2009



INSPECTOR'S SIGNATURE

2-16-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	746	EMERGENCY LIGHT OUT		X						FBC 423.17.1

S. Bryan Jennings

Elementary School

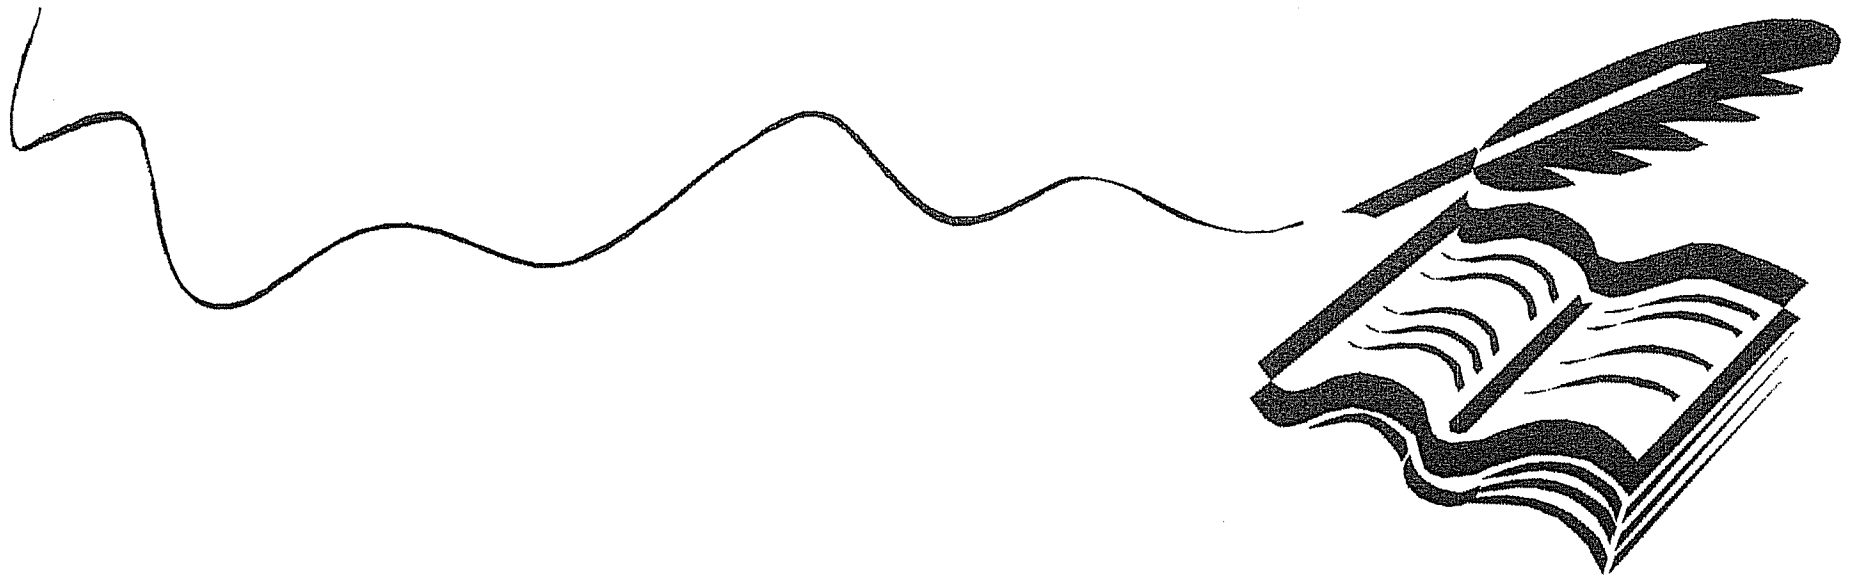

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 23, 2009

[Signature]
INSPECTOR'S SIGNATURE 1-23-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	42A	LIGHT GLOBE MISSING		X						NFPA 70 401.3
8	17E	FIRE ALARM BOX ON SHELF OPEN		X						NFPA 70 110.26

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**


DISTRICT: CLAY FACILITY #: 0012

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 23, 2009

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

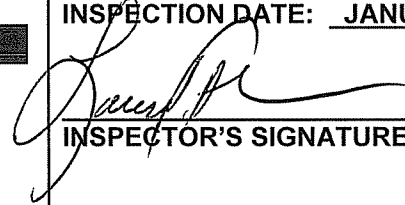
INSPECTOR'S SIGNATURE

1-23-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	26	OK								
92	27	OK								
92	28A&B	OK								
92	29	OK								
92	30	OK								
92	32	OK								
92	33	OK								
92	34	OK								
92	35	EMERGENCY LIGHT OUT		X						FBC 432.17.1
92	36	OK								
92	37	OK								
92	38	OK								
92	39	OK								

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 23, 2009

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

INSPECTOR'S SIGNATURE 

DATE 1/23/09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	43	OK								
92	44	OK								
92	45	OK								
92	75	OK								
92	76	OK								
92	77	OK								
92	78	OK								
92	79	OK								
92	80A&B	OK								
92	81	OK								

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: JANUARY 23, 2009

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

[Signature]
INSPECTOR'S SIGNATURE
DATE 1-23-09

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 4

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
3	42A	LIGHT GLOBE MISSING		X						NFPA 70 401.3
8	17E	FIRE ALARM BOX ON SHELF OPEN		X						NFPA 70 110.26

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0012

FACILITY: S.B. JENNINGS ELEMENTARY SCHOOL
215 CORONA DRIVE
ORANGE PARK, FLORIDA 32073


INSPECTION DATE: JANUARY 23, 2009

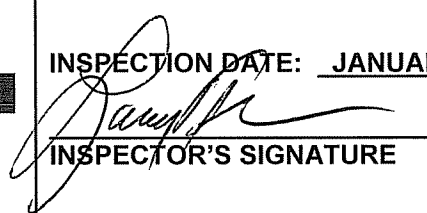
INSPECTOR'S SIGNATURE _____ DATE 1-23-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	35	EMERGENCY LIGHT OUT	X							FBC 423.17.1

Swimming Pen Creek

Elementary School

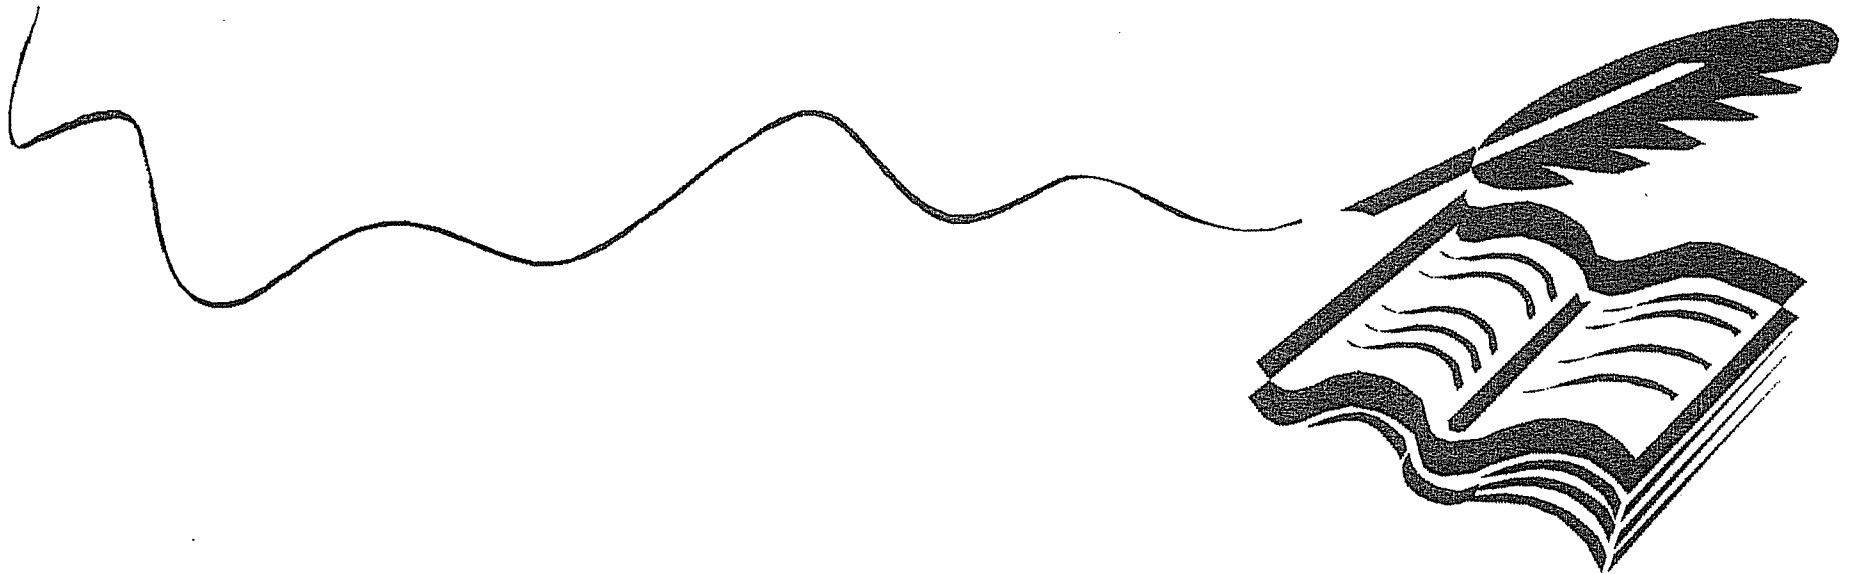

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
ORANGE PARK, FLORIDA 32068

INSPECTION DATE: JANUARY 27, 2009

[Signature]
INSPECTOR'S SIGNATURE

1-27-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2	200	BROKEN OUTLET COVER – EAST SIDE		X						NFPA 70
2	200	TWO ROOF LEAKS – NORTH CORNERS	X							
3	312	DESK IN CORIDOR – REMOVE		X						
4	410	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4
5		OK								
6	627	TEACHERS PLANNING ROOM USED AS CLASSROOM – NO SECONDARY EXIT		X						FBC 423.13.1

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0053

FACILITY: SWIMMING PEN CREEK ELEMENTARY SCHOOL
1630 WOODPECKER LANE
ORANGE PARK, FLORIDA 32068

INSPECTION DATE: JANUARY 27, 2009


[Signature]
INSPECTOR'S SIGNATURE

1-27-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	702	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	703	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	704	TV IN HAZARDOUS LOCATION – MOVE FROM ENTRY		X						
92	808	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1
92	809	EMERGENCY LIGHT NOT WORKING		X						FBC 423.17.1

Thunderbolt

Elementary School

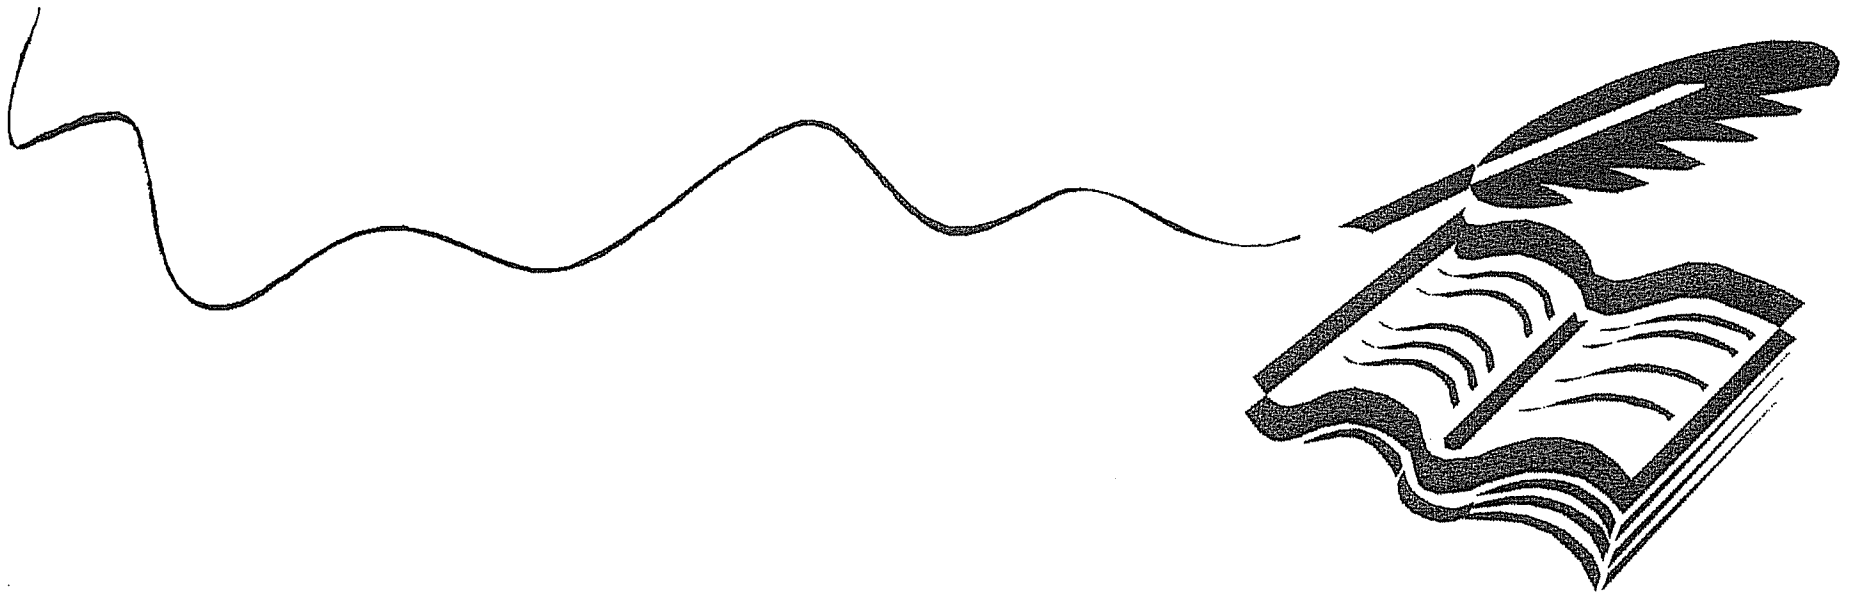

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL
2020 THUNDERBOLT ROAD
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: FEBRUARY 3, 2009

[Handwritten Signature]
INSPECTOR'S SIGNATURE

2-3-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	126	BREAKER KNOCKOUT MISSING	X							NFPA 70
1	247	ADD EXIT LIGHTS @ ROOM 270, ROOM 414 CORRIDORS	X							FBC 1006.3

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0042

FACILITY: THUNDERBOLT ELEMENTARY SCHOOL
2020 THUNDERBOLT ROAD
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: FEBRUARY 3, 2009

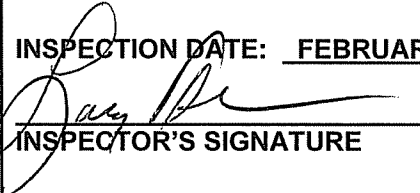
INSPECTOR'S SIGNATURE 

DATE 2-3-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	704	EMERGENCY LIGHT VERY DIM		X						FBC 423.17.1

Times

Elementary School

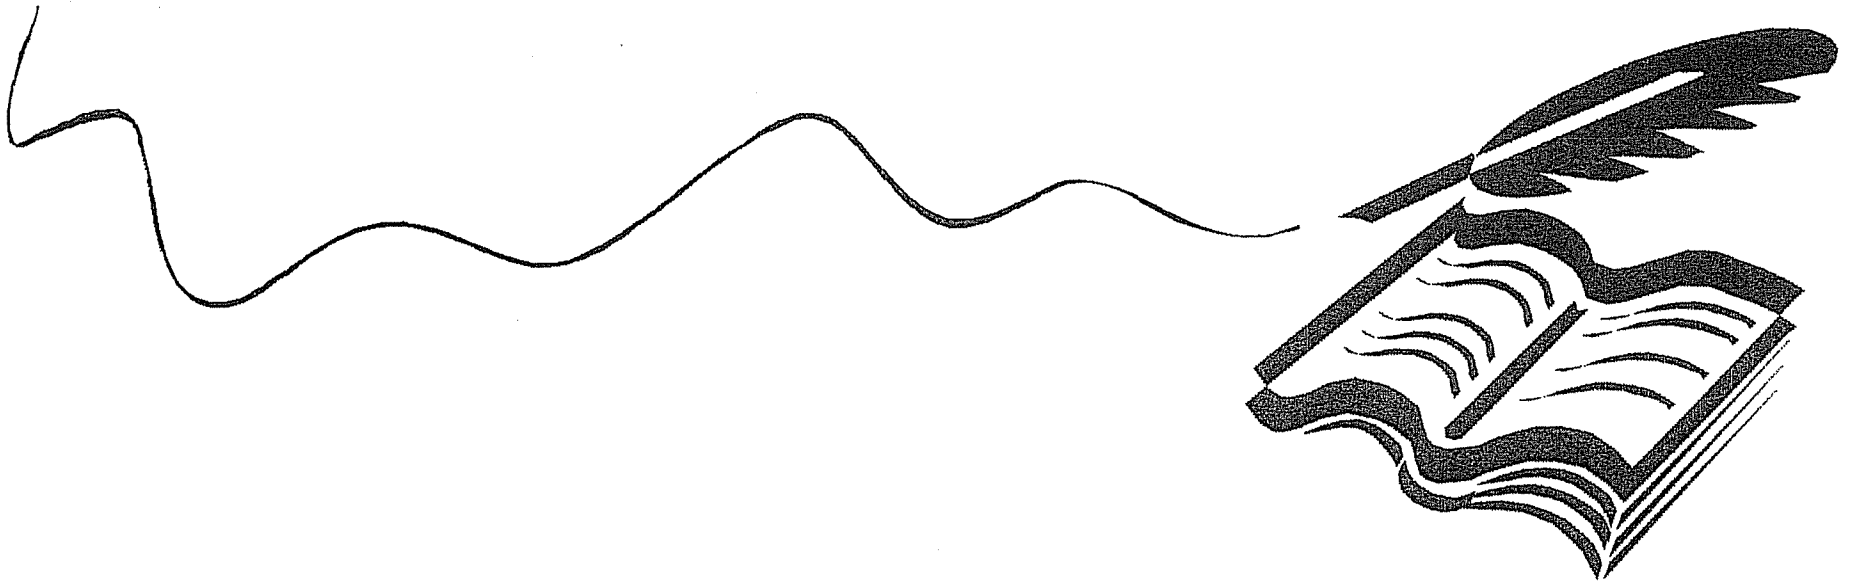

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 5

DISTRICT: CLAY FACILITY #: 0040

FACILITY: TYNES ELEMENTARY SCHOOL
1550 TYNES BOULEVARD
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 3, 2009


[Signature]
INSPECTOR'S SIGNATURE

2-3-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	157	EMERGENCY LIGHT OUT		X						FBC 423.17.1
3	302	NO EMERGENCY EVACUATION SHEET		X						FBC 423.14.2.4

W. E. Cherry

Elementary School

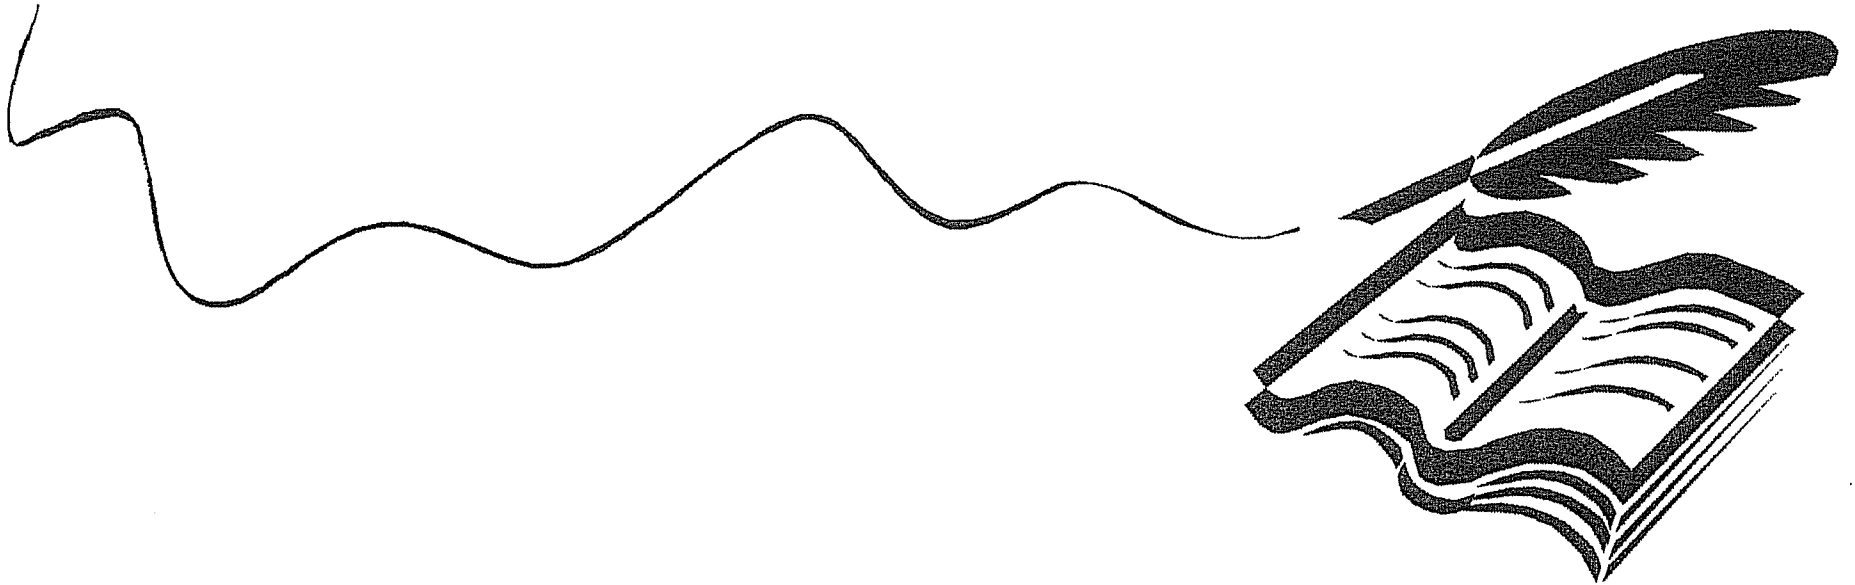

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL
420 EDSON DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 17, 2009

INSPECTOR'S SIGNATURE

DATE

Paul J.
2-17-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	8	EMERGENCY LIGHT OUT		X						FBC 423.17.1
1	54	EMERGENCY LIGHT OUT		X						FBC 423.17.1
2	53	FIRE EXTINGUISHER NOT SIGNED		X						69A-58.008
3	55	EMERGENCY LIGHT OUT		X						FBC 423.17.1
4	14A	NO COVER ON LIGHT	X							NFPA 70 401.3
4	58	FIRE EXTINGUISHER NOT SIGNED		X						69A-58.008
4	21	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.14.2.4
10	64	NO COVER ON LIGHT	X							NFPA 70 401.3
10	66	EMERGENCY LIGHT OUT		X						FBC 423.17.1

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 6


DISTRICT: CLAY FACILITY #: 0006

FACILITY: W.E. CHERRY ELEMENTARY SCHOOL
420 EDSON DRIVE
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: FEBRUARY 17, 2009

INSPECTOR'S SIGNATURE

DATE

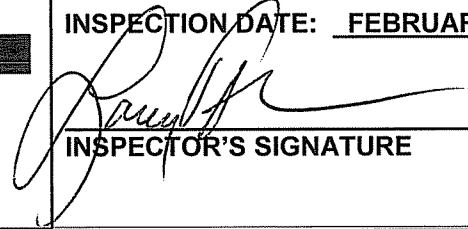


2-17-09

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	31	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	37	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	40	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	48	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	60	EMERGENCY LIGHT OUT		X						FBC 423.17.1

Wilkinson

Elementary School

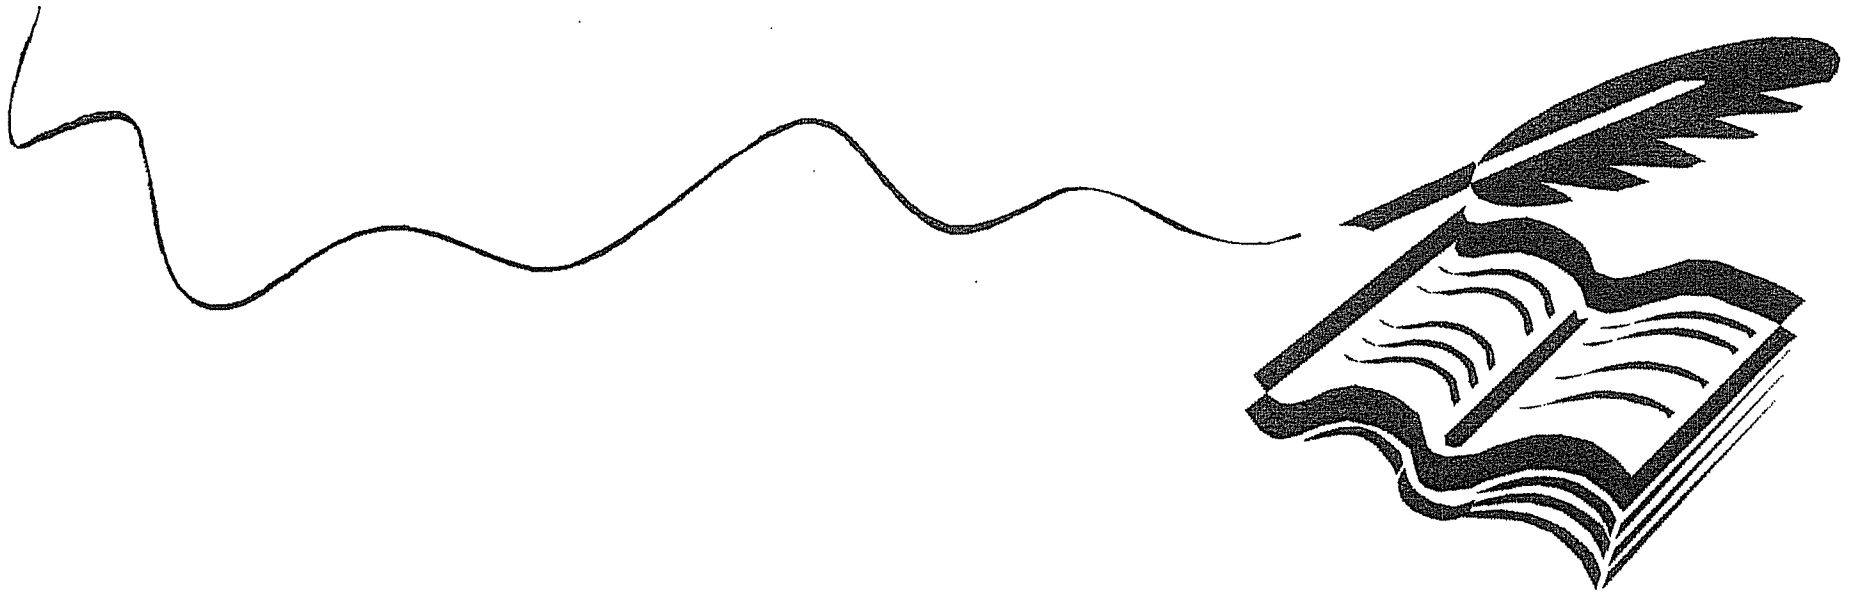

FISCAL YEAR 2008-2009

**FIRE SAFETY INSPECTION REPORT
FOR EDUCATIONAL FACILITIES
FLORIDA STATUTES 1013.12, 1013.20 & RULE 69A-58**


ANNUAL PERMANENT INSPECTION ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0026

FACILITY: J.L. WILKINSON ELEMENTARY SCHOOL
4965 C.R. 218
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: FEBRUARY 17, 2009

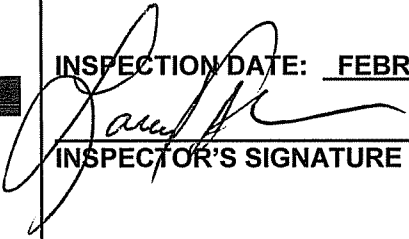INSPECTOR'S SIGNATURE 

2-18-09
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	35 A & B	EMERGENCY LIGHTS NOT WORKING		X						FBC 423.17.1
92	36	EMERGENCY LIGHTS NOT WORKING		X						FBC 423.17.1
92	37	EMERGENCY LIGHTS NOT WORKING		X						FBC 423.17.1