



# ELEMENTARY SCHOOLS

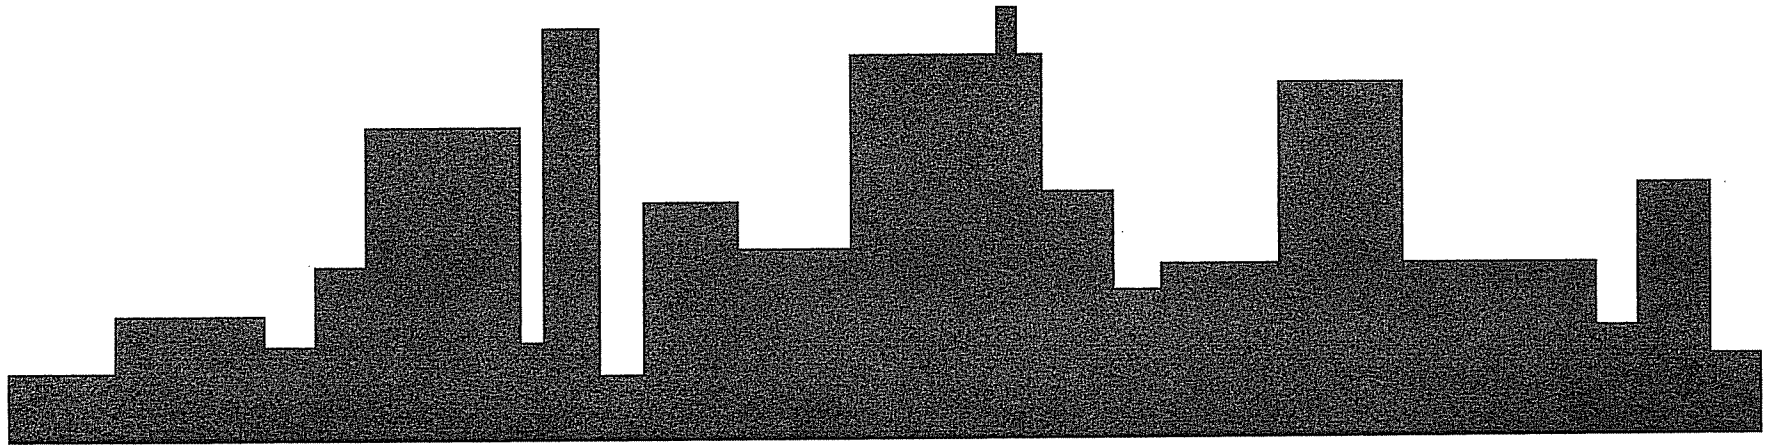

Argyle

Elementary School

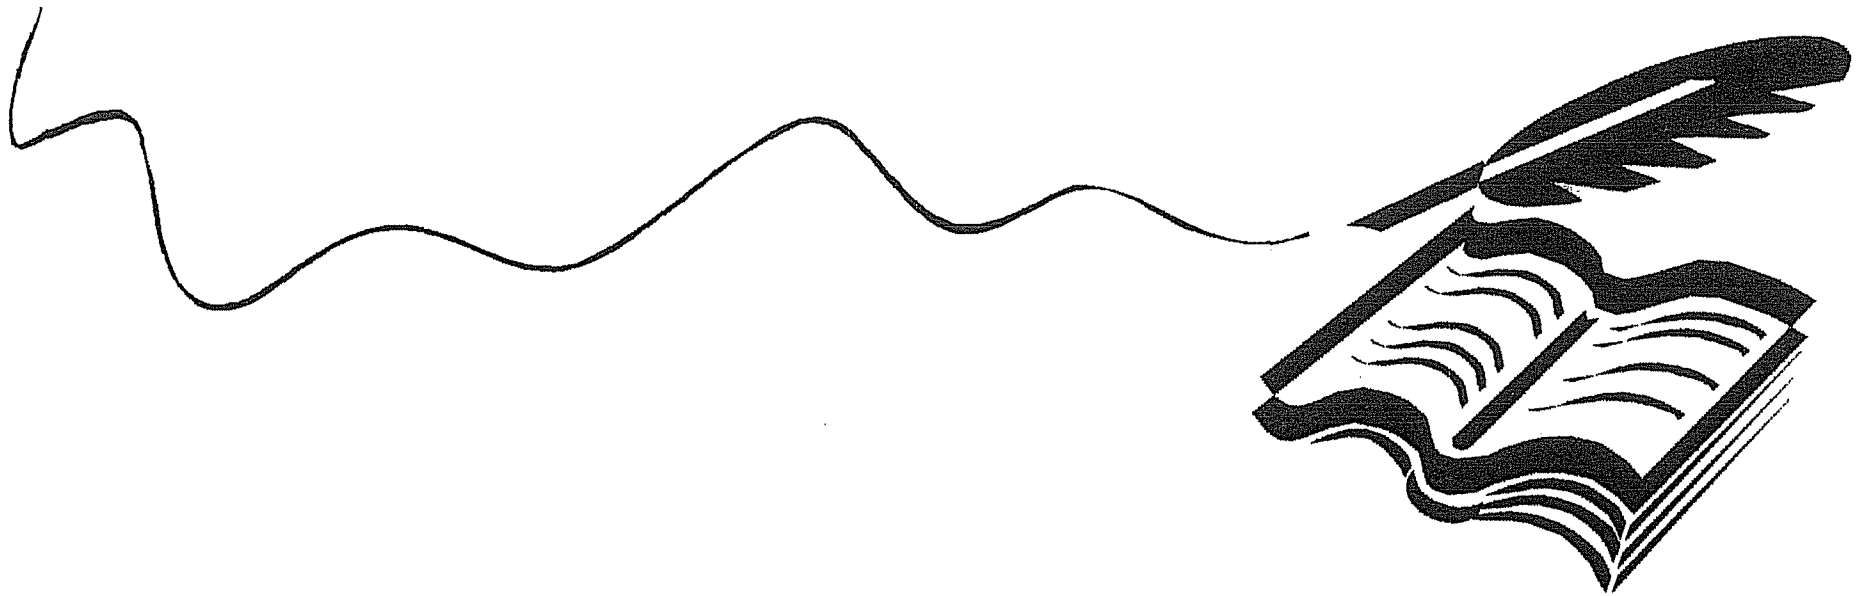

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0046

FACILITY: ARGYLE ELEMENTARY SCHOOL  
2625 SPENCER PLANTATION BOULEVARD  
ORANGE PARK, FLORIDA 32073

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 9, 2008

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 3

*[Signature]*  
INSPECTOR'S SIGNATURE 12.9.08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	416	NO EVACUATION SHEET		X						FBC 423.14.2.4
4	433	NO EVACUATION SHEET		X						FBC 423.14.2.4

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 3

DISTRICT: CLAY FACILITY #: 0046

FACILITY: ARGYLE ELEMENTARY SCHOOL  
2625 SPENCER PLANTATION BOULEVARD  
ORANGE PARK, FLORIDA 32073

INSPECTION DATE: DECEMBER 9, 2008


*[Handwritten Signature]*  
INSPECTOR'S SIGNATURE

12-9-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	707	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	711	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	712	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	714	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	806	EMERGENCY LIGHT OUT	X							FBC 423.17.1
92	909	EMERGENCY LIGHT OUT	X							FBC 423.17.1

Charles E. Bennett

Elementary School

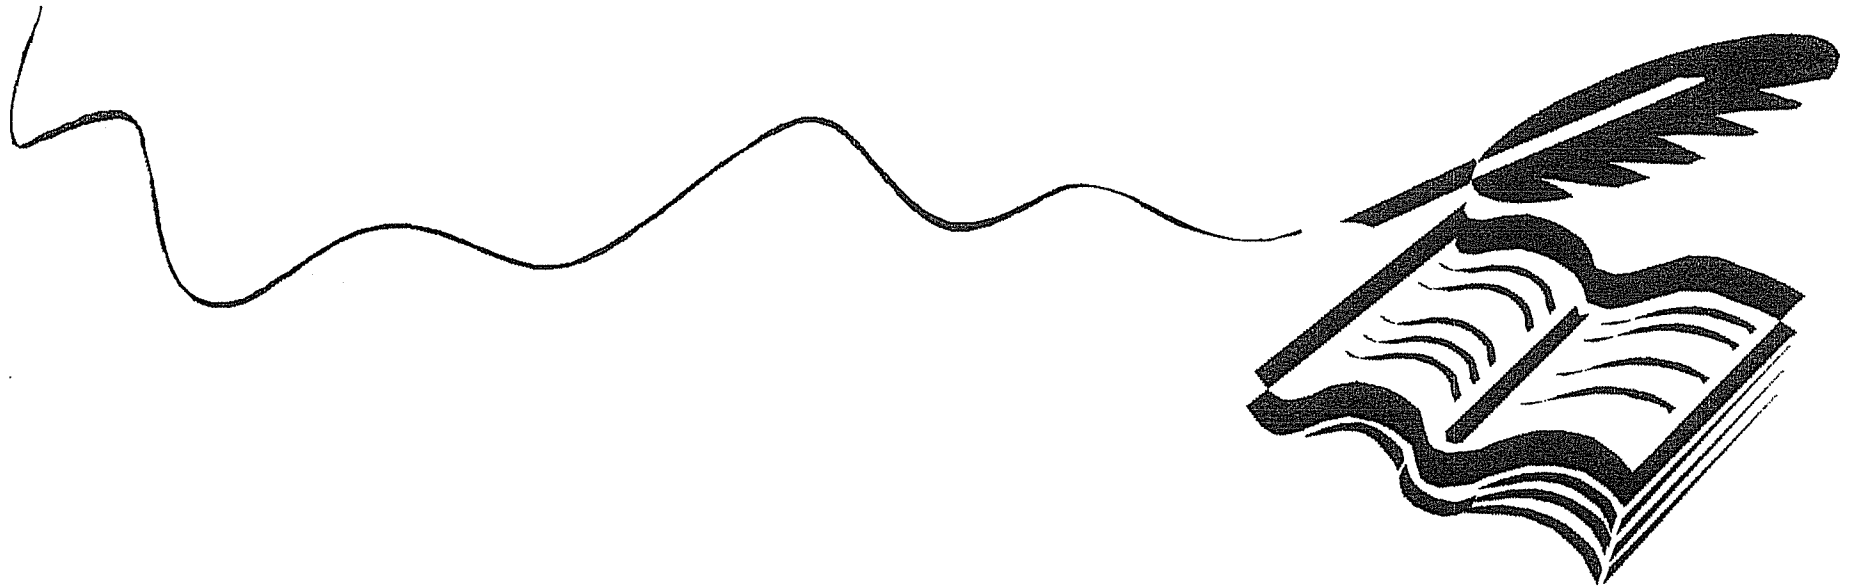

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL  
1 SOUTH OAKRIDGE AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

INSPECTION DATE: DECEMBER 12, 2008

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

  
INSPECTOR'S SIGNATURE

12-12-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
16	1609	STORAGE TO HIGH – CLOSE TO SPRINKLERS		X						NFPA 13
16	1634	STORAGE TO HIGH – CLOSE TO SPRINKLERS		X						NFPA 13
16	1640	STORAGE TO HIGH – CLOSE TO SPRINKLERS		X						NFPA 13
16	1662	STORAGE TO HIGH – CLOSE TO SPRINKLERS		X						NFPA 13
16	1664	STORAGE TO HIGH – CLOSE TO SPRINKLERS		X						NFPA 13



**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0002

FACILITY: CHARLES E. BENNETT ELEMENTARY SCHOOL  
1 SOUTH OAKRIDGE AVENUE  
GREEN COVE SPRINGS, FLORIDA 32043


INSPECTION DATE: DECEMBER 12, 2008

*[Signature]*  
INSPECTOR'S SIGNATURE 12-12-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	48	EMERGENCY LIGHT OUT		X						FBC 423.17.1
92	605	CABINET BLOCKING ELECTRICAL PANEL		X						NFPA 70
92	605	EXIT LIGHT OUT		X						FBC 1006.3.1

Clay Hill

Elementary School

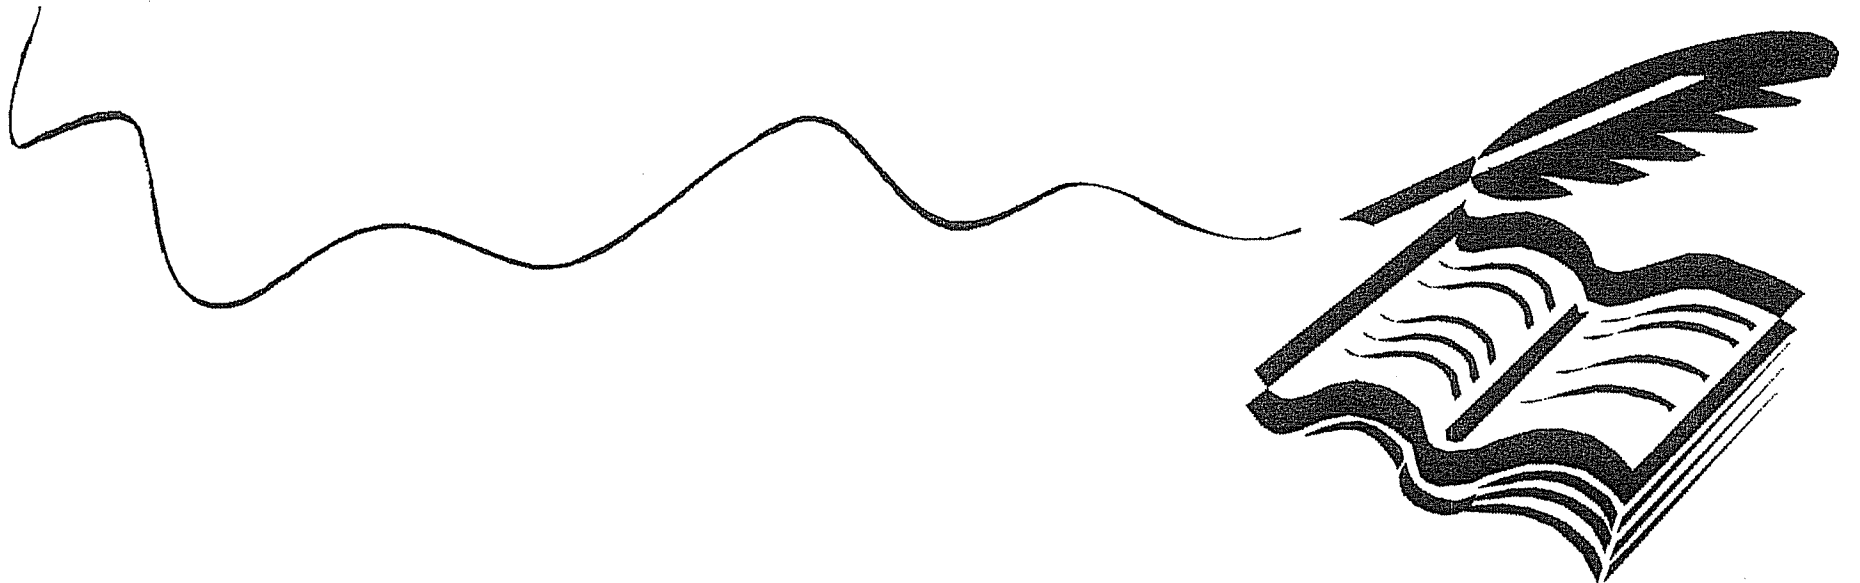



**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0021

FACILITY: CLAY HILL ELEMENTARY SCHOOL  
6345 STATE ROAD 218  
JACKSONVILLE, FLORIDA 32234

INSPECTION DATE: DECEMBER 15, 2008

*Larry H. Brown*  
INSPECTOR'S SIGNATURE

12-15-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1		OK								
2		OK								
3		OK								
4		OK								
5		OK								
6		OK								
7		OK								

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0021

FACILITY: CLAY HILL ELEMENTARY SCHOOL  
6345 STATE ROAD 218  
JACKSONVILLE, FLORIDA 32234

INSPECTION DATE: DECEMBER 15, 2008

*Larry H. ...*  
INSPECTOR'S SIGNATURE 12.15.08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	682	OK								
92	701	OK								
92	702	OK								
92	703	OK								
92	704	OK								
92	705	OK								
92	706	OK								
92	707	OK								
92	708	OK								
92	710	OK								
92	712	OK								
92	762	OK								
92	764	OK								

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0021

FACILITY: CLAY HILL ELEMENTARY SCHOOL  
6345 STATE ROAD 218  
JACKSONVILLE, FLORIDA 32234

INSPECTION DATE: DECEMBER 15, 2008


*[Signature]*  
INSPECTOR'S SIGNATURE

12.15.08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	766	OK								

*Coppergate*

*Elementary School*

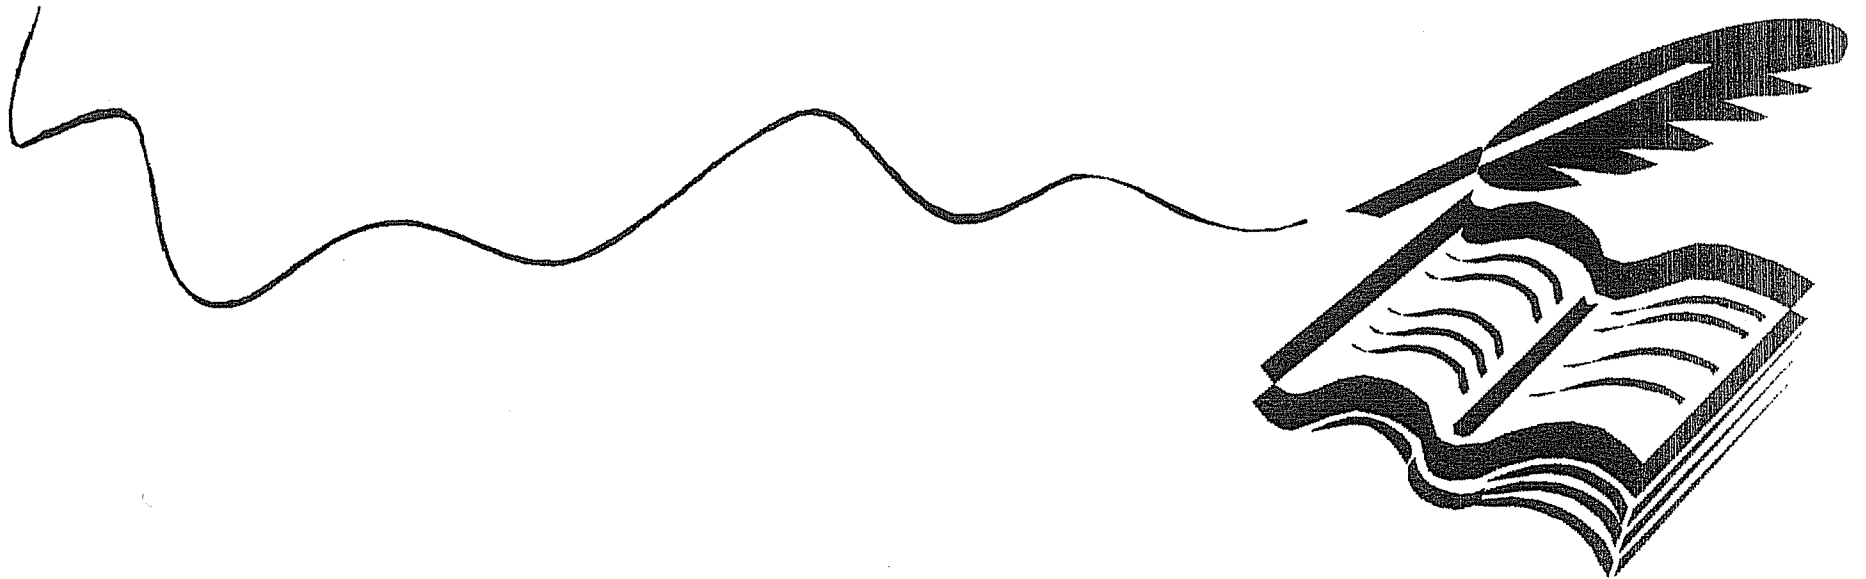

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0047

FACILITY: COPPERGATE ELEMENTARY SCHOOL  
2250 COUNTY ROAD NORTH  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 15, 2008

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG: √ NUMBER OF DRILLS PERFORMED: 5

  
INSPECTOR'S SIGNATURE

12-15-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
1	338	FIRE ALARM OUT OF DATE	X							

**FISCAL YEAR 2008-2009**


**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

DISTRICT: CLAY FACILITY #: 0047

FACILITY: COPPERGATE ELEMENTARY SCHOOL  
2250 COUNTY ROAD NORTH  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 15, 2008

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

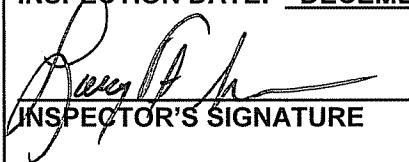  
INSPECTOR'S SIGNATURE


12.15.08  
DATE

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 5

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	ALL	OK								

Doctors Inlet

Elementary School

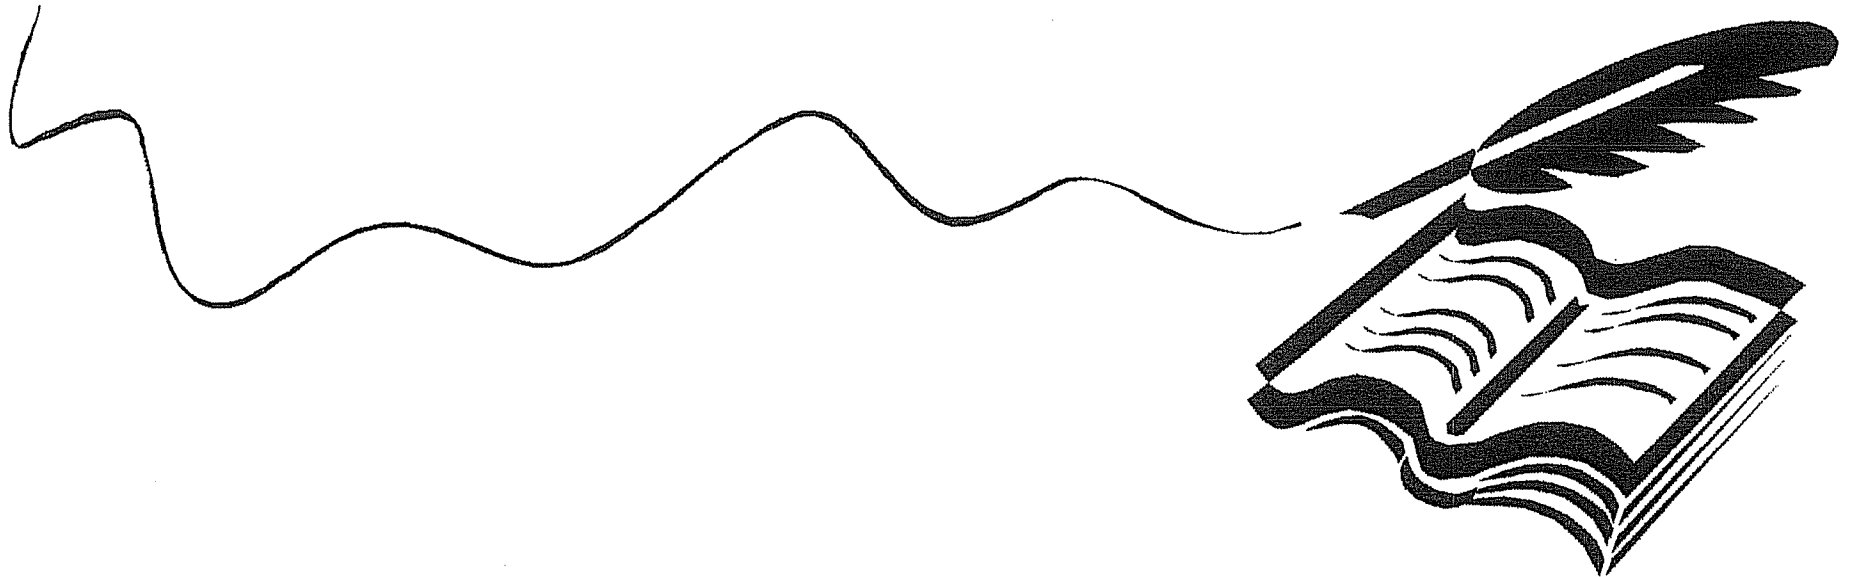



**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12, 1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL  
2634 STATE ROAD 220  
MIDDLEBURG, FLORIDA 32068

INSPECTION DATE: DECEMBER 16, 2008

*Ted Sweetland*  
INSPECTOR'S SIGNATURE 12-16-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
4	110	EMERGENCY LIGHT OUT		X						FBC 423.17.1
POST OFFICE		EMERGENCY LIGHT OUT		X						FBC 423.17.1

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 6

DISTRICT: CLAY FACILITY #: 0008

FACILITY: DOCTORS INLET ELEMENTARY SCHOOL  
2634 STATE ROAD 220  
MIDDLEBURG, FLORIDA 32068


INSPECTION DATE: DECEMBER 16, 2008

*Ted Swearingen*  
INSPECTOR'S SIGNATURE 12-16-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
92	923	EMERGENCY EVACUATION SHEET MISSING		X						FBC 423.2.4

Fleming Island

Elementary School

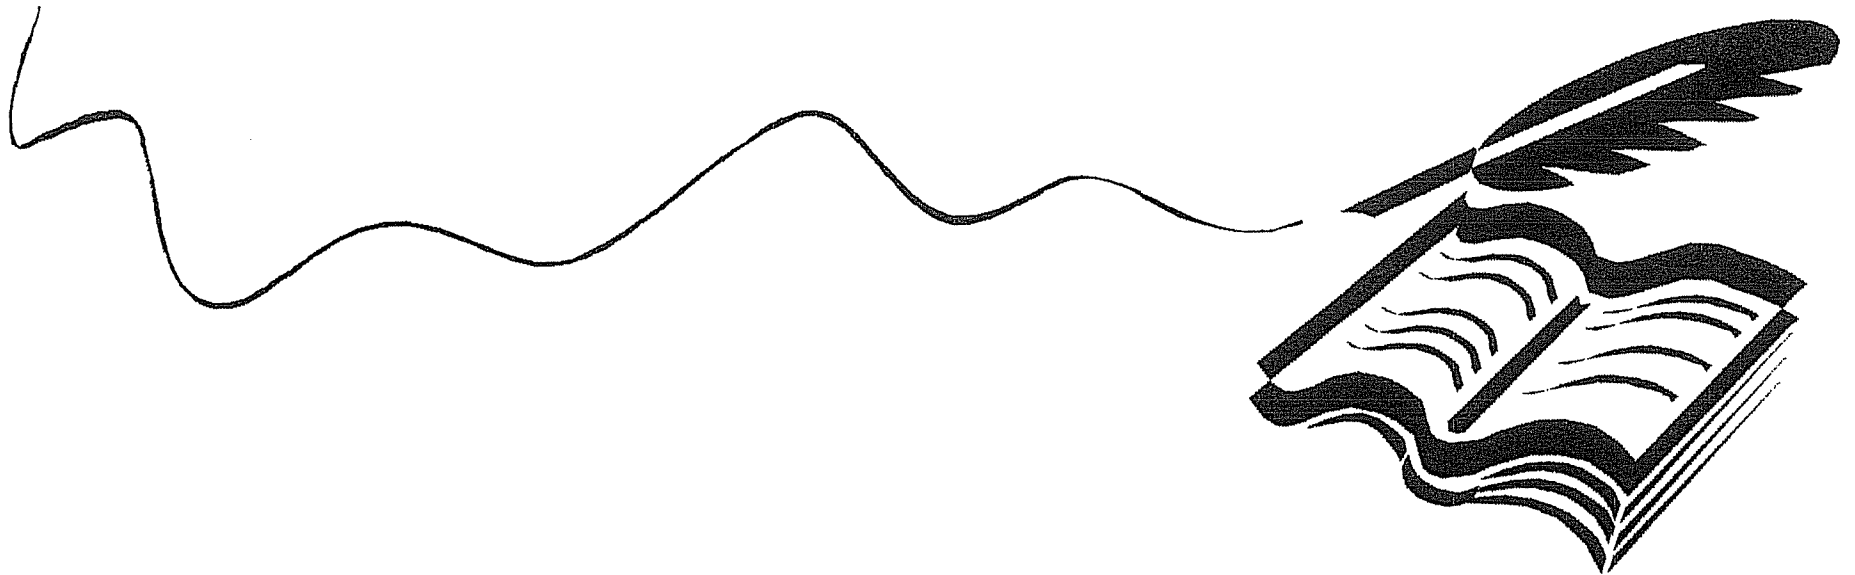

**FISCAL YEAR 2008-2009**

**FIRE SAFETY INSPECTION REPORT  
FOR EDUCATIONAL FACILITIES  
FLORIDA STATUTES 1013.12,1013.20 & RULE 69A-58**

ANNUAL PERMANENT INSPECTION  ANNUAL RELOCATABLE INSPECTION

FIRE DRILL LOG:  NUMBER OF DRILLS PERFORMED: 4

DISTRICT: CLAY FACILITY #: 0038

FACILITY: FLEMING ISLAND ELEMENTARY SCHOOL  
4425 LAKE SHORE DRIVE  
ORANGE PARK, FLORIDA 32003

INSPECTION DATE: DECEMBER 19, 2008

*[Signature]*  
INSPECTOR'S SIGNATURE

12-19-08  
DATE

Building	Room	Deficiency Description and Corrective Action Required:	Maint. "M"	Oper. "O"	Fac. "C"	Info. Serv. "I.S."	Cost	No. of times Def. Cited	Scheduled for Correction	Rule
2	229	GOLF CARTS STORED IN MECHANICAL ROOM – MUST MOVE		X						
3	304	EXIT LIGHT OUT		X						FBC 1006.3.1
3	323	EXIT LIGHT OUT		X						FBC 1006.3.1

